


DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS IN ALL CASES. VERIFY DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE DESIGNERS IMMEDIATELY.  
 THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE DESIGNERS SPECIFICATION.  
 © THIS DRAWING IS COPYRIGHT AND MAY ONLY BE REPRODUCED WITH THE DESIGNERS PERMISSION.

- NOTES:
1. ALL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH ALL RELEVANT SPECIFICATIONS, BILLS OF QUANTITIES, ARCHITECTURAL, SERVICES AND ENGINEERING DRAWINGS.
  2. ALL LEVELS ARE IN METRES RELATED TO ORDNANCE DATUM MALIN HEAD.
  3. ANY DISCREPANCIES BETWEEN THESE DOCUMENTS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
  4. DRAWINGS ARE NOT TO BE SCALED.
  5. ALL DIMENSIONS ARE IN MILLIMETRES, UNLESS NOTED OTHERWISE.
  6. PLINTH DIMENSIONS & UNDERGROUND SERVICES LOCATIONS INDICATIVE ONLY & SUBJECT TO CHANGE BASED ON DETAILED DESIGN & GROUND CONDITIONS (NOTE, SOME UNDERGROUND SERVICES WITHIN COMPOUNDS NOT SHOWN ON DRAWING).

- LEGEND:
- Palisade Fence
  - Wooden Post & Rail Fence
  - Foul Water Pipe
  - Storm Water Pipe
  - Water Supply from Harvesting Tank
  - A.J. (Access Junction)
  - Manhole
  - Light Pole
  - Lightning Column

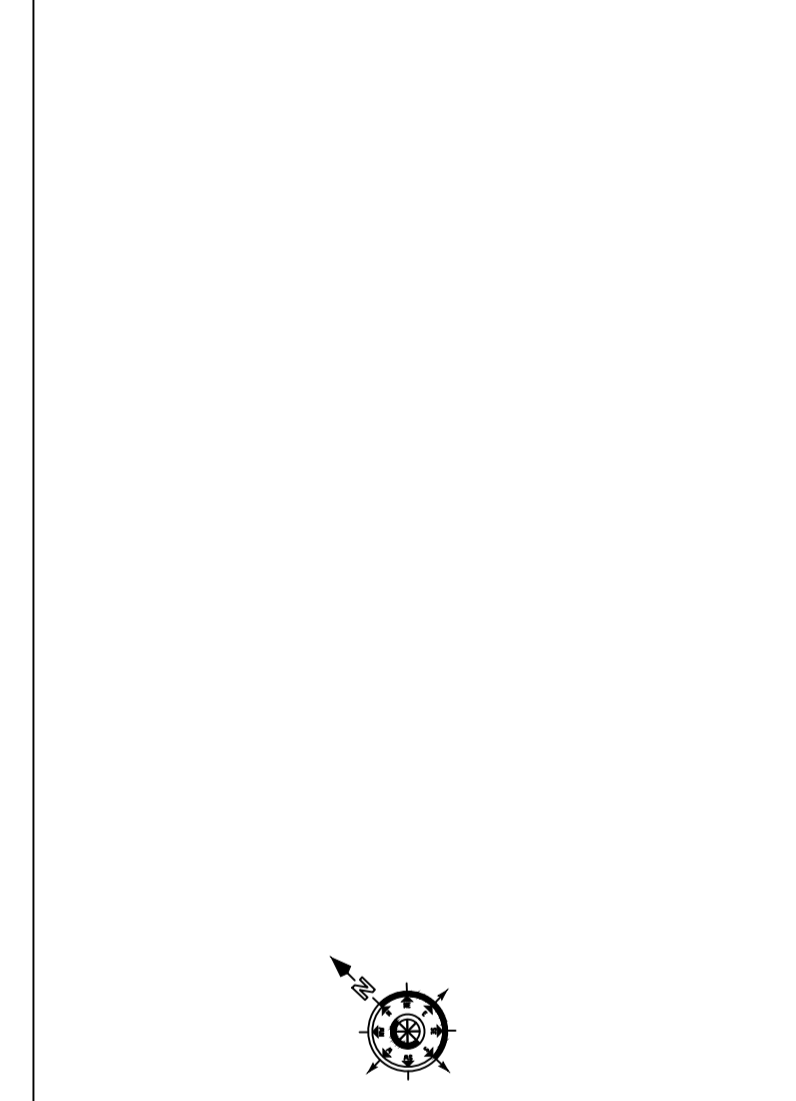

PI	26/02/2021	ISSUED FOR PLANNING	JK	GT
REV	DATE	DESCRIPTION	BY	APP
PROJECT: Proposed Kilmuckridge 110kV Substation				
TITLE: Proposed Substation Compound Layout				
CLIENT:  Cloncant Renewable Energy Limited				
<b>Malachy Walsh and Partners</b> Engineering and Environmental Consultants Cork   Tralee   London   Limerick				
Reen Point, Blennerville, Tralee, Co. Kerry, V92 X2TK Tel: +353 (0) 66 7123404 Fax: +353 (0) 66 7125586 E-mail: tralee@mwp.ie Web: www.mwp.ie				
DRAWN: JK	CHECKED: GT	APPROVED: GT		
DATE: January 2021	SCALE @ A1: 1:200			
PROJECT NUMBER: 21280	DRAWING STATUS: S2			
DRAWING NUMBER: 21280-MWP-00-00-DR-C-5401				REV: P01

