

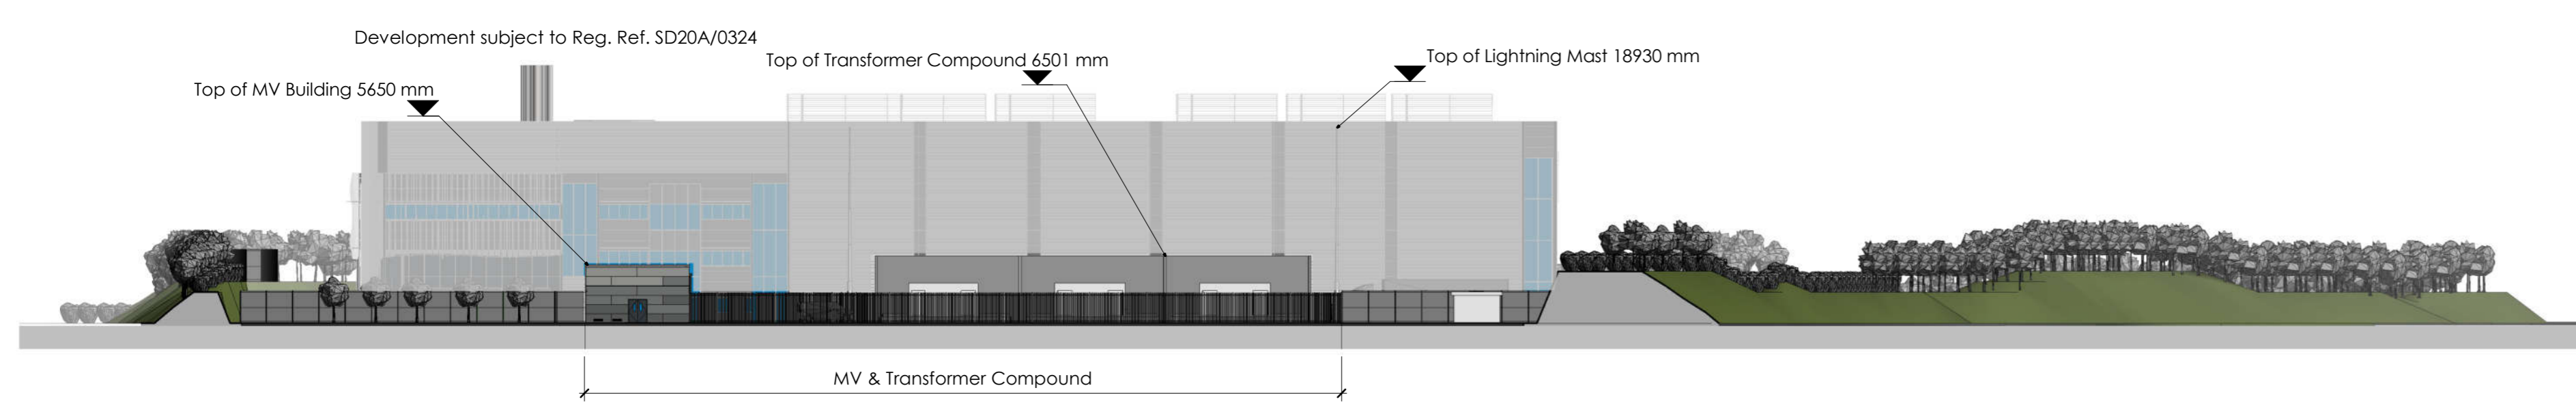



- NOTES:
1. All rights reserved. All drawing and written material appearing herein constitute original and copyright works of ARC:MC. Content may not be duplicated, used or disclosed without written consent.
 2. All dimensions shown are in millimetres.
 3. This drawing shall be read in conjunction with all specifications and schedules.
 4. All dimensions shall be checked by Contractor prior to any works commencing on site.
 5. The Contractor shall comply with all relevant health, safety, regulatory, standard codes of practice, methods of working, and good practice.
 6. Generators shall not be used from the drawing and the contractor shall be responsible for obtaining all dimensions and levels on site for the actual setting out of the works.

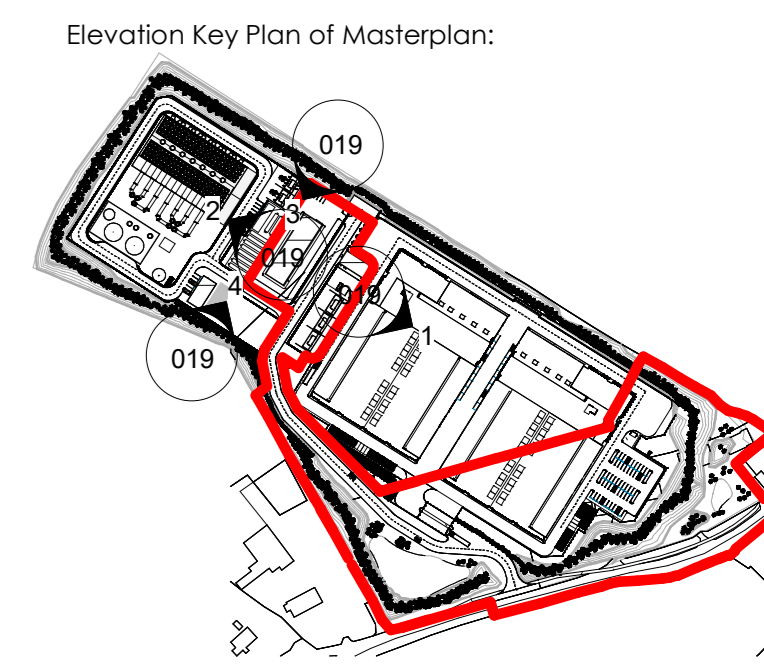

1 Substation Contiguous Elevation 1
1 : 500

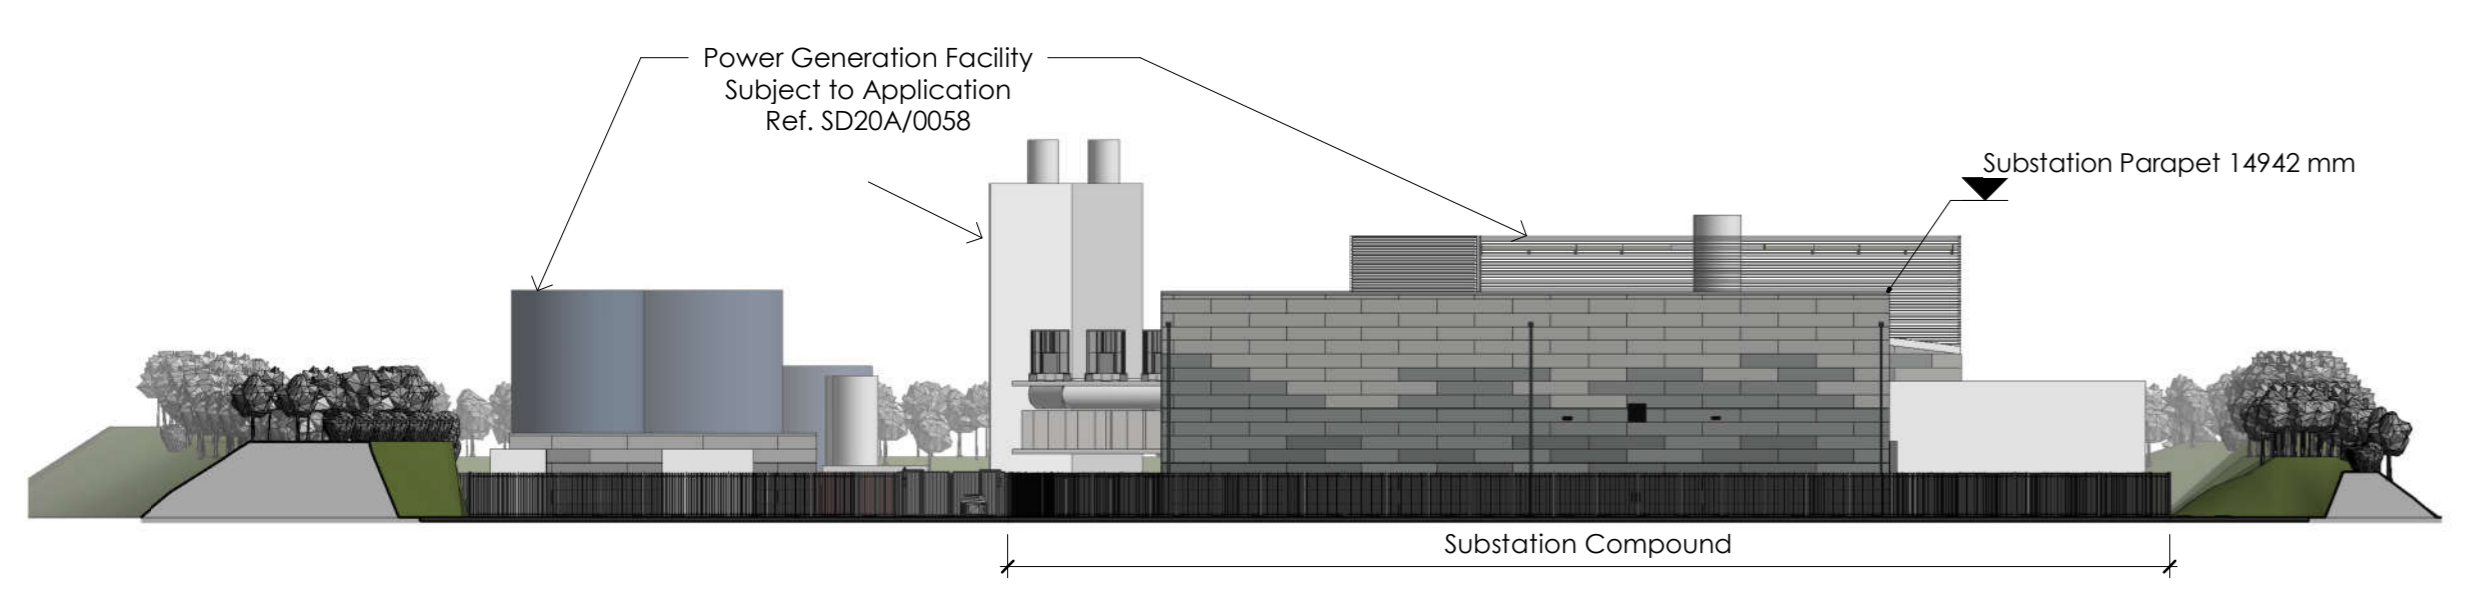

2 Substation Contiguous Elevation 2
1 : 500

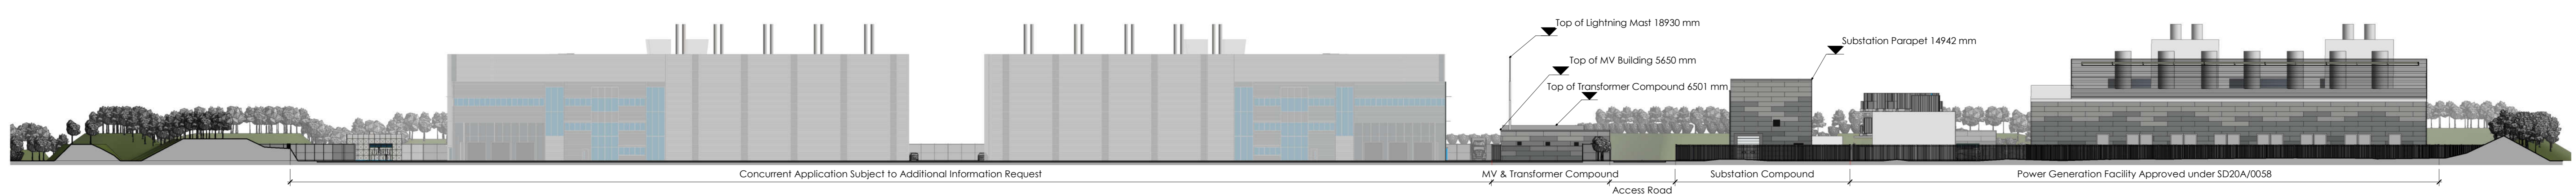

3 Substation North East Contiguous Elevation
1 : 500



4 Substation South West Contiguous Elevation
1 : 500

REV	DATE	ISSUED FOR PLANNING	DATE	ISSUED FOR
S2		ISSUED FOR INFORMATION		

ARC:MC
MISSION CRITICAL
140-142 St John Street, London EC1V 4UB
T 020 34112571
REGISTERED IN ENGLAND / COMPANY REG. NO. 7883299

DATA AND POWER HUB SERVICES

PROJECT: ICT Facility Peamount Road
PROJECT NO: 3183.00
DESCRIPTION: DUB 40 - Sub-station Contiguous Elevations
SCALE: As Indicated @ A0
DRAWING NO: D40-ARC-SS-ZZ-DR-A-019
REVISION: #

