


NOTES:

- DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT ALL WORKS ARE CONSTRUCTED IN ACCORDANCE WITH THE IRISH WATER CODE OF PRACTICE AND STANDARD DETAILS. THE CODE OF PRACTICE AND STANDARD DETAILS ARE AVAILABLE TO DOWNLOAD FROM THE IRISH WATER WEBSITE AT WWW.WATER.IE/CONNECTIONS/DEVELOPER-SERVICES/ WHERE THE DETAILS CONTAINED ON THIS DRAWING DIFFER FROM THE IRISH WATER CODE OF PRACTICE OR STANDARD DETAILS THIS MUST BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY. IRISH WATER STANDARDS WILL TAKE PRECEDENCE.

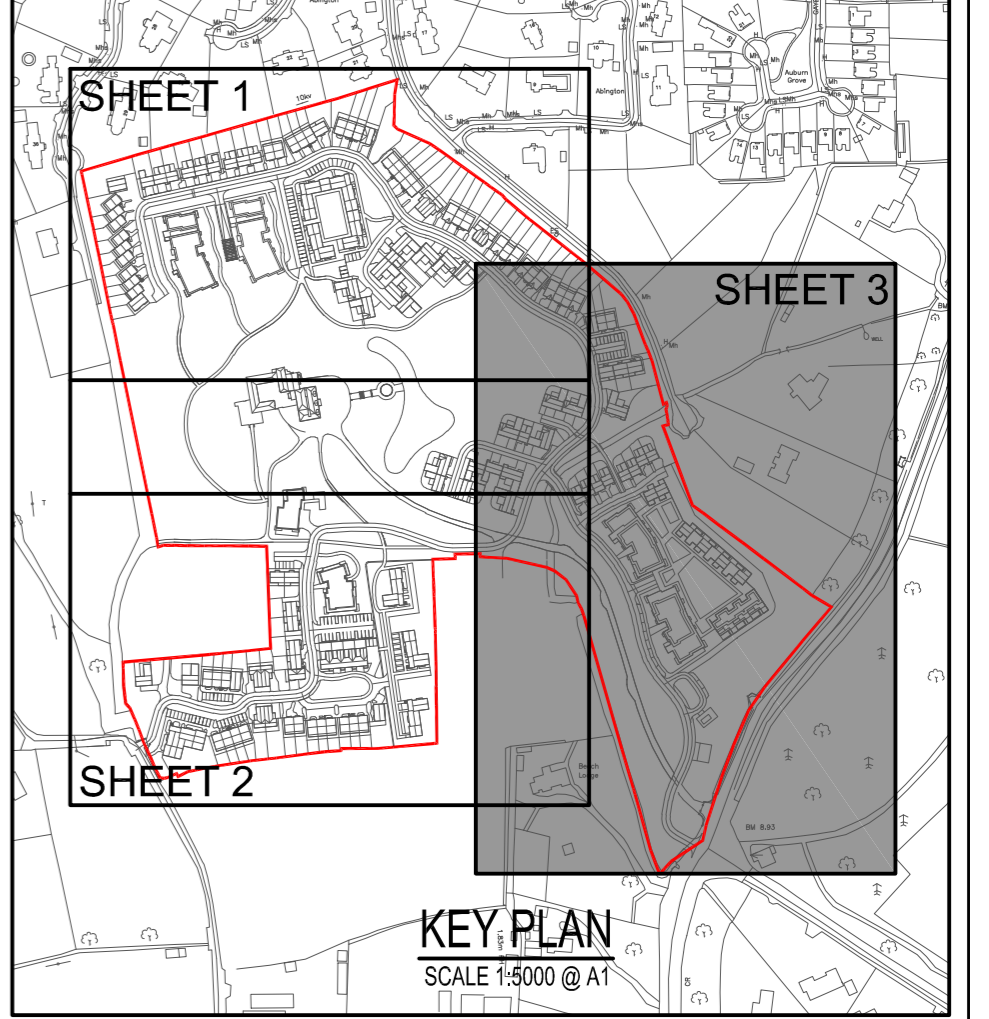

NOTES:

ALL PROPOSED PUBLIC STORM WATER DRAINAGE WORKS TO BE IN ACCORDANCE WITH FINGAL COUNTY COUNCIL'S REQUIREMENTS FOR TAKING IN CHARGE AND IN ACCORDANCE WITH THE GREATER DUBLIN REGIONAL CODE OF PRACTICE FOR DRAINAGE WORKS.

ALL PROPOSED PUBLIC FOUL WATER DRAINAGE WORKS TO BE IN ACCORDANCE WITH IRISH WATER REQUIREMENTS.

ALL PRIVATE DRAINAGE WORKS SHALL BE IN ACCORDANCE WITH THE BUILDING REGULATIONS PART H. ALL COVER LEVELS ARE INDICATIVE ONLY AND SHOULD BE SET TO SUIT THE FINISHED ROAD OR PAVED LEVEL. LEVELS IN REAR GARDENS HAVE BEEN ASSUMED AS STRAIGHT GRADE TO ADJACENT BOUNDARY FROM FFL - 150mm. EXTERNAL LEVELS TO BE CONFIRMED BY ARCHITECT

GRAVITY SEWER PIPE MATERIAL TYPES
 WASTEWATER PIPE MATERIALS SHALL BE IN ACCORDANCE WITH SECTION 3.1.3 OF THE IRISH WATER CODE OF PRACTICE FOR WASTEWATER INFRASTRUCTURE.

THE TYPES AND FITTINGS OUTLINED HEREIN SHALL BE USED IN THE CONSTRUCTION OF THE GRAVITY SEWERS. PIPE MATERIAL SHOULD NOT CHANGE BETWEEN MANHOLES. THE LIST BELOW DOES NOT APPLY TO PIPES INSTALLED BY PIPE JACKING OR MICRO TUNNELLING.

CONCRETE: CONCRETE SEWER PIPES WITH SPIGOT AND SOCKET JOINTS AND RUBBER RING FITTINGS SHALL COMPLY WITH IS EN 1916 (2002), BS 5911, PART 1 (2002 - 2010) AND IS 6 (2004) OR EQUIVALENT STANDARD, STRENGTH CLASS 120 WITH MINIMUM CRUSHING LOADS IN ACCORDANCE WITH TABLE 8 OF BS 5911-1 (2002/2010).

ALL PIPES AND FITTINGS SHALL HAVE GASKET TYPE JOINTS OF SPIGOT AND SOCKET OR REBATED FORM (PIPE DIAMETERS 225MM AND ABOVE).

THERMOPLASTIC STRUCTURED WALL PIPES: THERMOPLASTIC STRUCTURED WALL PIPES SHALL COMPLY WITH THE PROVISIONS OF IS EN 13476 (2007/2009). PIPES TO BE OF STIFFNESS CLASS BKN/M2 AND TO BE CAPABLE OF DEMONSTRATING A JETTING RESISTANCE OF 2,600 PSI (180 BAR) WITHOUT DAMAGE WHEN TESTED IN ACCORDANCE WITH SECTION 3.3 OF WIS 4-35-01 (2008). (SEWER DIAMETERS 150MM UP TO 450MM, SERVICE CONNECTIONS OF 100MM DIAMETER).

UNPLASTICISED PVC: UNPLASTICISED PVC PIPES AND FITTINGS SHALL COMPLY WITH THE PROVISIONS OF IS EN 1401 2009/2012. PIPES TO BE APPLICATION AREA CODE 'UD', STIFFNESS CLASS BKN/M2. PROVISION FOR JETTING SHALL BE BASED ON THE WRC SEWER JETTING CODE OF PRACTICE, JUNE 1997. PIPES TO BE CAPABLE OF RESISTING A MAXIMUM JETTING PUMP PRESSURE OF 2,600PSI (180 BAR) WITHOUT DAMAGE. (SEWER DIAMETERS 150MM UP TO 450MM, SERVICE CONNECTIONS OF 100MM DIAMETER).

OTHER: THE USE OF ALTERNATIVE PIPE TYPES AND MATERIALS WILL REQUIRE THE PRIOR WRITTEN AGREEMENT OF IRISH WATER.

WHERE 1.2m COVER TO FOUL WATER PIPE SOFFIT IS NOT ACHIEVABLE IN ROADWAYS, CONCRETE SURROUND SHALL BE PROVIDED IN ACCORDANCE WITH STD-WW-08 OF WASTEWATER INFRASTRUCTURE STANDARD DETAILS.


SERVICE LAYOUT DISTANCES:
 HORIZONTAL AND VERTICAL SERVICE LAYOUT DISTANCES SHALL BE AS PER IRISH WATER STANDARD DETAIL STD-WW-05.

THE EXTERNAL FACE OF MANHOLES SHALL BE AT LEAST 0.5m FROM KERB LINE.

RESTRICTIONS ON PLANTING:
 PLANTING ADJACENT TO WASTEWATER INFRASTRUCTURE SHALL BE IN COMPLIANCE WITH IRISH WATER STANDARD DETAILS STD-WW-06 AND STD-WW-06A.

LEGEND:

FS	EXF	EXISTING FOUL WATER SEWER WITH PIPE SIZE, GRADE, MANHOLE REF. AND INVERT LEVEL
SW	EXS	EXISTING SURFACE WATER SEWER WITH PIPE SIZE, GRADE, MANHOLE REF. AND INVERT LEVEL
XXXmm @ 1/XXX	FX	PROPOSED FOUL WATER SEWER WITH PIPE SIZE, GRADE, MANHOLE REF. AND INVERT LEVEL
uPVC SN8	SX	PROPOSED SURFACE WATER SEWER WITH PIPE SIZE, GRADE, MANHOLE REF. AND INVERT LEVEL
XXXmm @ 1/XXX	SX	PROPOSED SURFACE WATER SEWER WITH PIPE SIZE, GRADE, MANHOLE REF. AND INVERT LEVEL
- - -		PROPOSED FOUL INSPECTION CHAMBER AND CONNECTION
- - -		PROPOSED SURFACE WATER INSPECTION CHAMBER AND CONNECTION
→		PROPOSED 150# FOUL RISING MAIN
→		PROPOSED PERFORATED PIPE
→		PROPOSED 225# FILTER DRAIN
G		PROPOSED GULLY AND CONNECTION
→		PROPOSED 0.5m WIDE KERB OPENING FOR SURFACE WATER RUN-OFF, MAX CENTER'S 25m
□		PROPOSED PERMEABLE PAVING
□		PROPOSED ABOVE GROUND ATTENUATION STORAGE WITH UNDERLYING STONE 400m DEEP
□		PROPOSED RAIN GARDEN
□		EXISTING DITCH NETWORK
□		PROPOSED STORMTECH ATTENUATION STORAGE
□		PROPOSED GREEN ROOF

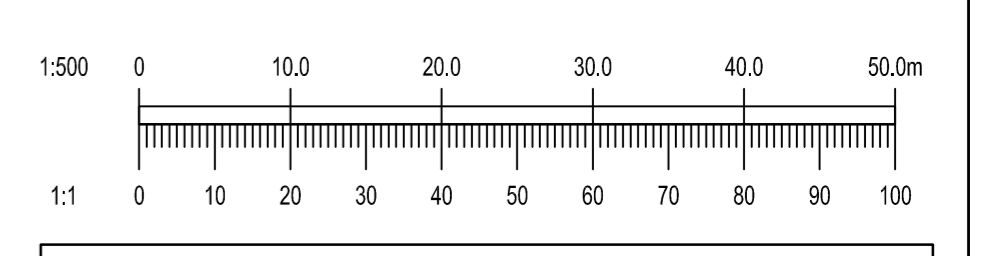

Ordnance Survey Ireland Licence No. EN 0006021
 © Ordnance Survey Ireland/Government of Ireland.

A	01/04/21	REVISED FOR FINAL SUBMISSION	PJD	MD
REV. DATE		AMENDMENT	DRN	APPD
CAD REF.				

STATUS **PLANNING**

Waterman Moylan
 Engineering Consultants

BLOCK 5, EASTPOINT BUSINESS PARK, ALFIE BYRNE ROAD, DUBLIN D03 K7W7 IRELAND.
 Tel: (01) 664 8900 Fax: (01) 661 3618
 Email: info@waterman-moylan.ie www.waterman-moylan.ie

CLIENT	KINWEST LTD.		
ARCHITECT	CONROY CROWE KELLY ARCHITECTS		
PROJECT	AUBURN, MALAHIDE, CO. DUBLIN		
TITLE	DRAINAGE LAYOUT SHEET 3 OF 3		
DRAWN	DESIGNED	APPROVED	DATE
PJD	MD	MD	APR '20
SCALE	JOB NO.	DRG. NO.	REVISION
1:500 @ A1	19-020	P203	A