


DRAWING IS PRODUCED USING THE IRISH TRANSVERSE MERCATOR (ITM) GEOGRAPHIC COORDINATE SYSTEM

A1

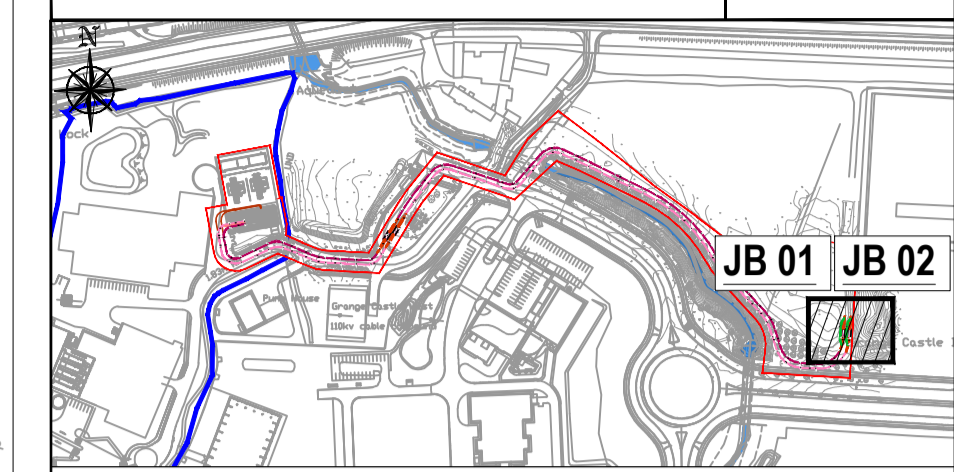


KEYPLAN

- LEGEND:**
- PLANNING BOUNDARY
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.1 CIRCUIT
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.2 CIRCUIT
 - 110KV DUCT SDR 21 HDPE
 - COMMS DUCT SDR 17.6 HDPE
 - EXISTING MV/LV UNDERGROUND CIRCUITS
 - EXISTING 110KV UNDERGROUND CIRCUITS
 - EXISTING WAYLEAVE

NOTE:

- THE CABLE DUCTING DEPICTED IN THIS DRAWING IS TO OUR BEST KNOWLEDGE THE INTENDED ALIGNMENT ROUTE. ON INSTALLATION SOME MINOR ADJUSTMENTS MAY ARISE AS PREVIOUSLY UNIDENTIFIED UNDERGROUND SERVICES OR SIMILARLY UNFORESEEN OBSTRUCTIONS MAY ARISE. THE CURRENT ALIGNMENTS WILL BE ADJUSTED TO SUIT ACCORDINGLY.

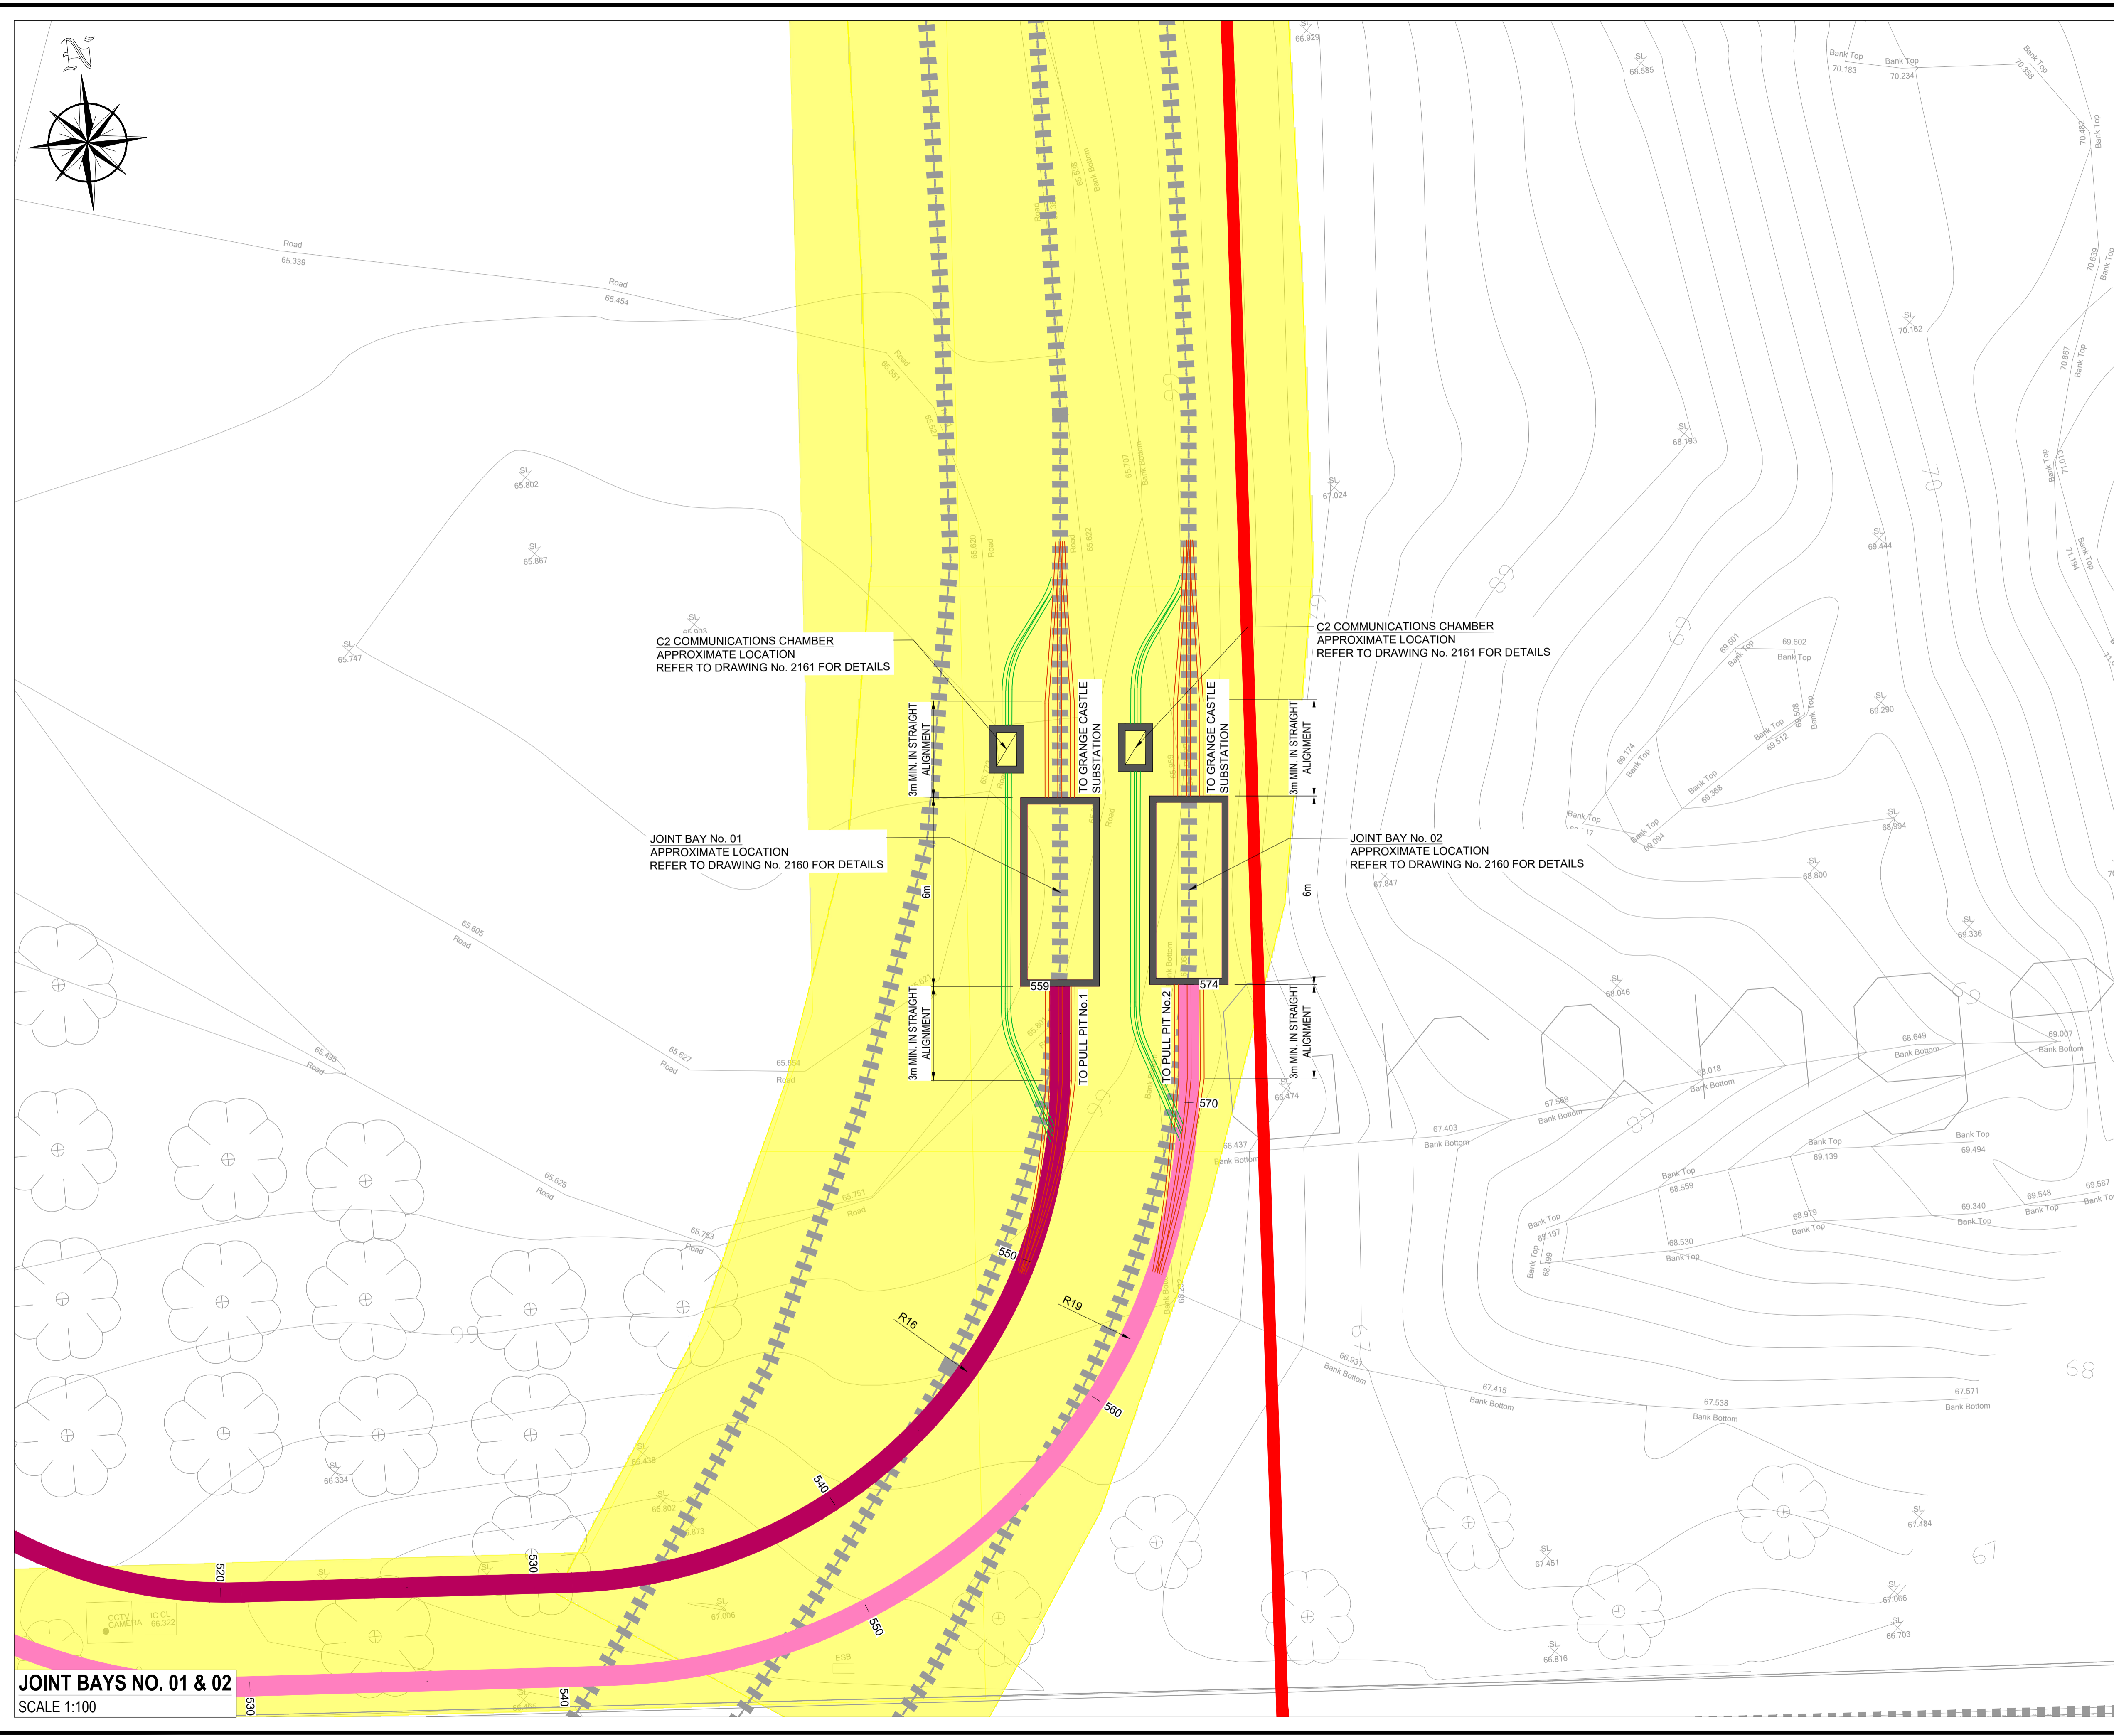

JOINT BAYS NO. 01 & 02
SCALE 1:100

P05	ISSUE FOR PLANNING	DW	BV	09.04.21
P04	FOR DISCUSSION	DW	BV	01.04.21
P03	FOR DISCUSSION	DW	RG	22.03.21
P02	FOR DISCUSSION	DW	-	-
P01	FOR DISCUSSION	-	-	-
Rev	Description	Drawn	Checked	Date

Clifton Scannell Emerson Associates
Clifton Scannell Emerson Associates Limited
Consulting Engineers,
Seaforth Lodge,
Castledawson Avenue,
Blackrock, Co. Dublin,
Ireland, A94 P768
T: +353 1 288 5006
F: +353 1 283 3466
E: info@csea.ie
W: www.csea.ie

Client		BCEI	
Project		EDGECONNEX SUBSTATION 110KV CABLE ROUTE PROPOSED JOINT BAY JB01 & JB02	
Dwg. Title	20_167		
Drawn By DW	Date DEC 2020	20_167	
Checked By RG	Scale 1:100 @ A1	CSEA Job No.	
Project Code	Originator	Zone/Phase	Level Type Role
20_167 - CSE - GEN - ZZ - DR - C - 2126			
S2	FOR INFORMATION		
Status Code	Suitability Description		
P05	PLANNING		
Revision	Project Status		