


TYPICAL STOCKPROOF FENCE

SCALE NTS

NOTES

- FENCING TO COMPLY WITH BS 1722-2:1999.
- WOVEN WIRE TO BE B.8.80.15.W (SEE BS1722-2:1999 TABLE 1) AND GALVANISED IN ACCORDANCE WITH BS EN ISO 1461:1999.
- HORIZONTAL WIRES TO BE TENSIONED AND THEN SECURED TO POSTS WITH STAPLES GALVANISED IN ACCORDANCE WITH BS EN ISO 1461:1999.
- STRAINING POSTS PLACED AT INTERVALS NOT EXCEEDING 60M. ALSO AT THE START AND FINISH OF EACH FENCE RUN AND MAJOR CHANGE OF DIRECTION.

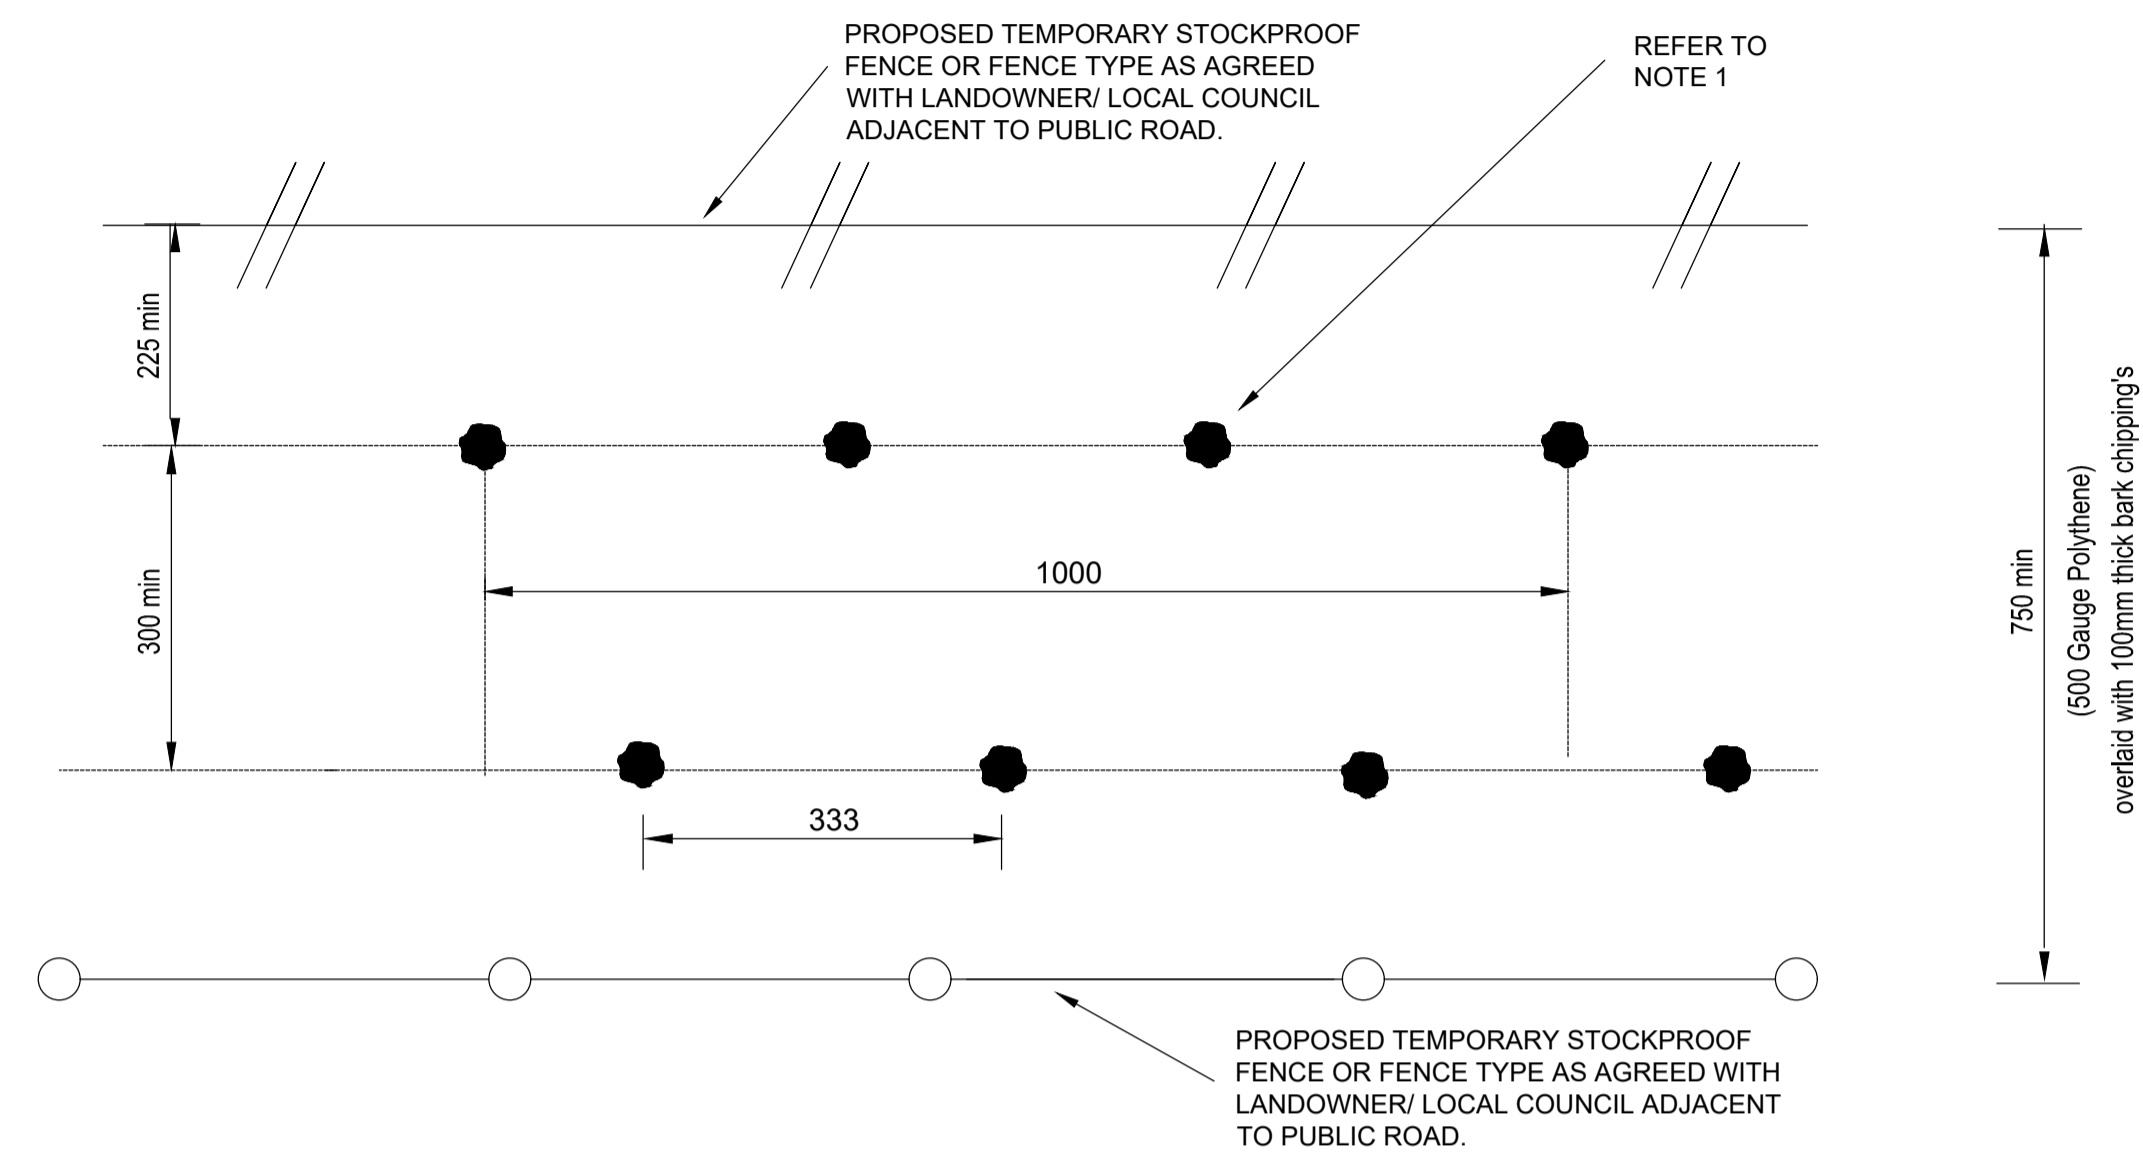


TYPICAL REINSTATEMENT HEDGE AND TEMPORARY PROTECTION FENCING

SCALE NTS

NOTES

- SHALLOW ROOTED NATIVE SPECIES PLANTING TO BE INCORPORATED

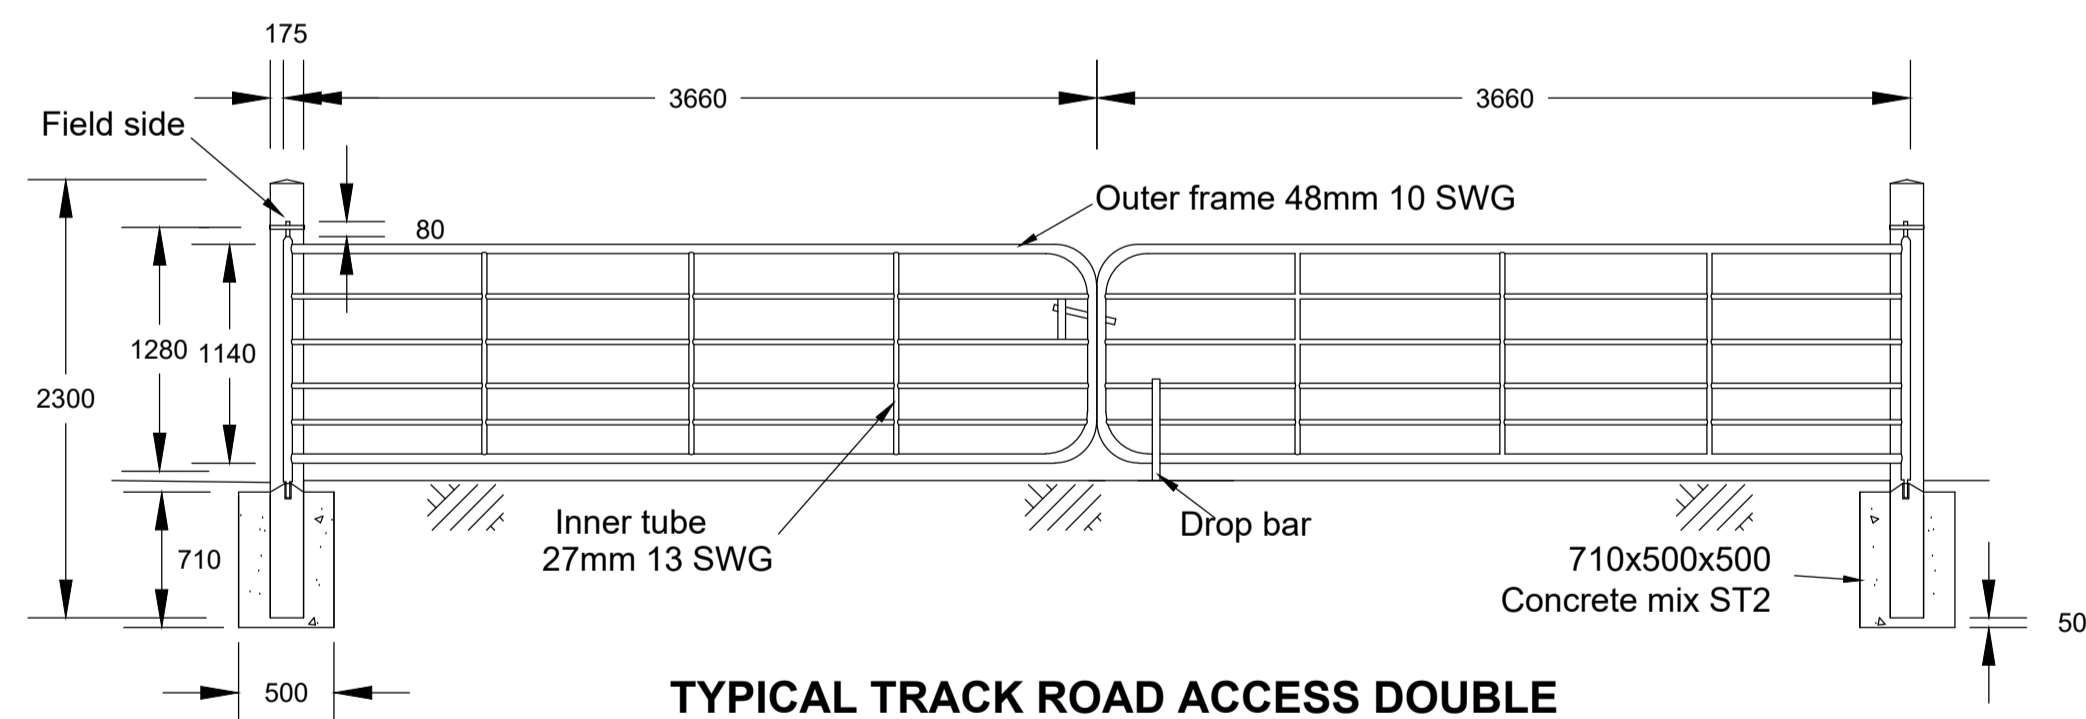


TYPICAL TRACK ROAD ACCESS DOUBLE FIELD GATES

SCALE NTS

NOTES

- ALL TUBES TO BE IN COMPLIANCE WITH BS 6323-1:1982.
- GATE AND FITTINGS TO BE HOT DIPPED GALVANISED TO BS EN ISO 1461:1999.
- CONCRETE GATE POSTS 175X175X2300MM LONG
- REINFORCED WITH 4 NO. 10MM Ø BARS. IF TIMBER POST REQ'D SIZE TO BE 200X200X2300MM LONG.
- IF STEEL POST REQ'D SIZE TO BE 150X150X2300MM LONG.
- GATES SHALL BE HUNG TO FIELD SIDE.
- GATE TO BE AGREED WITH LANDOWNER.

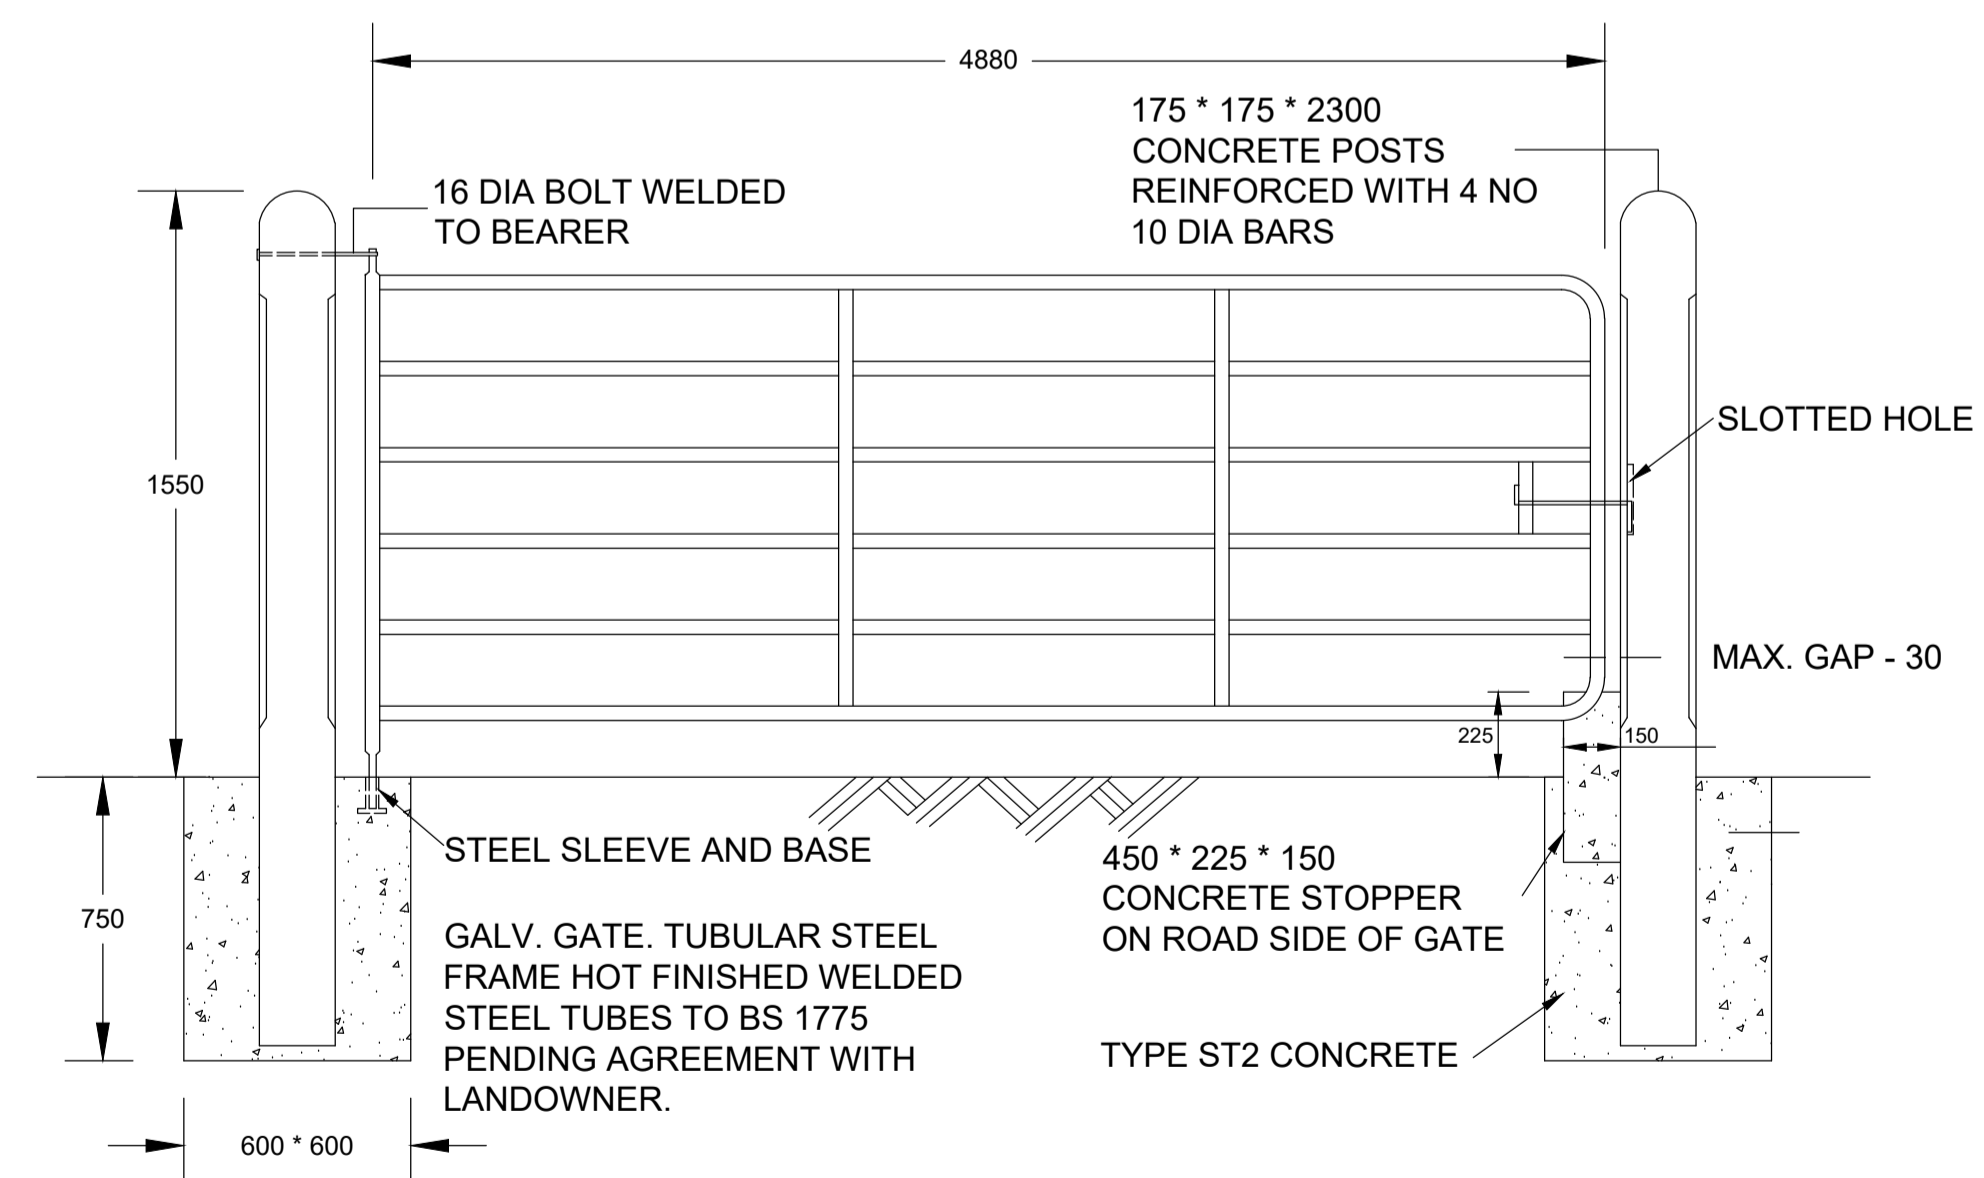

TYPICAL TRACK ROAD ACCESS FIELD GATES

SCALE NTS

Rev	Date	By	Chkd	Appd
PL1	22.03.21	SB	SO'S	MW

ARUP

One Albert Quay
Cork, Ireland
Tel +353 (0)21 422 3200
www.arup.com

Client
Sure Partners Limited

Design Consultant
AECOM

Project Title
**Arklow Bank Wind Park
Phase 2
Onshore Grid Infrastructure**

Drawing Title
Typical Fencing and Gate Details

Scale at A1
As Shown
Role
Civil
Suitability
Planning

Arup Job No 271715-00	Rev PL1
Name ONS-GEN-008	