

ISO A1 594mm x 841mm
 Approved: BM
 Checked: CH
 Drawn by: DM
 Project Management Initials:
 Last saved by: KAREL MULLIGAN (2021.03.15) Last Plotter: 2021.04.14
 Filename: \\EU.AECOM\NET.COM\EMIA\UK\IED\BL2\LUOSS\PR-461030_AVID_SANDYFORD_MARLET\900_CAD_GIS\904_CE01_WIP\02_SHEETS\PR461030-ACM-XX-00-DR-CE-10-2701.DWG

LEGEND

EXISTING PUBLIC WATERMAIN.....

EXISTING WATERMAIN CONNECTION TO BE DECOMMISSIONED.....

PROPOSED 150mm Ø NOMINAL BORE HDPE WATERMAIN.....

EXISTING 101.60mm Ø ASBESTOS WATERMAIN TO BE UPGRADED TO 150mm Ø NOMINAL BORE HDPE WATERMAIN.....

EXISTING FIRE HYDRANT.....


PROPOSED FIRE HYDRANT.....

PROPOSED SLUICE VALVE.....

PROPOSED NON-RETURN VALVE.....

PROPOSED BULK WATER METER.....

PROPOSED CONNECTION WITH BOUNDARY BOX.....

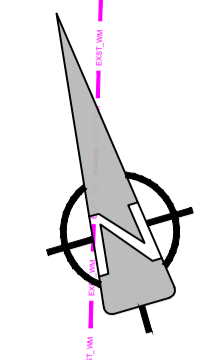

PROJECT

PROPOSED STRATEGIC HOUSING DEVELOPMENT AT CARMANHALL ROAD, SANDYFORD INDUSTRIAL ESTATE, DUBLIN 18

CLIENT

ATLAS GP LTD

CONSULTANT

AECOM
 4th Floor Adelphi Plaza,
 George's Street Upper,
 Dun Laoghaire,
 Co Dublin
 Tel: +353 (0)1 2383100
 Fax: +353(0)1 2383199
 www.aecom.com

- NOTES**
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS. ANY DISCREPANCIES, ERRORS OR OMISSIONS TO BE BROUGHT TO THE ATTENTION OF THE DESIGNER.
 - ALL DIMENSIONS TO BE CHECKED BY THE CONTRACTOR ON SITE PRIOR TO COMMENCEMENT OF WORKS.
 - AECOM LIMITED TO BE INFORMED BY THE CONTRACTOR OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF WORKS ON SITE.
 - DIMENSIONS OF ALL BOUNDARIES AND ADJOINING ROADS TO BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF WORKS.
 - DO NOT SCALE. ALL MEASUREMENTS AND COORDINATES TO BE CHECKED ON SITE.
 - THE DEVELOPMENT SHALL HAVE A BULK WATER METER (EXACT LOCATION TO BE AGREED WITH IRISH WATER) IN ACCORDANCE WITH IRISH WATER CODE OF PRACTICE SECTION 3.15.4.
 - EACH HOUSE UNIT SHALL HAVE AN APPROVAL BOUNDARY BOX (REFER TO APPENDIX A OF THE IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE) WITH INTEGRAL STOPCOCK AND SUITABLE FOR THE RECEPTION OF A WATER METER (REFER TO IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.14).
 - ALL PROPERTIES SHALL HAVE METERS INSTALLED INTERNALLY WITHIN THE PREMISES IN ACCORDANCE WITH THE BUILDING CONTROL AUTHORITY'S REQUIREMENTS AND SUBJECT TO REVIEW BY IRISH WATER AS PER IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.15.2.
 - ALL PROPOSED WATERMAIN PIPEWORK TO BE HDPE WITH MINIMUM PE80 RATING IN ACCORDANCE WITH IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.15.5.
 - THE MINIMUM PIPE DIAMETER PROPOSED IS 100mm.
 - ALL WATERMANS WILL HAVE A MINIMUM COVER OF 900mm. ALL SERVICE PIPES CONNECTING PROPERTIES WILL HAVE MINIMUM COVER OF 750mm.
 - HYDRANTS SHALL BE DOUBLE FLANGED DRILLED TO PN16 AND SHALL COMPLY WITH BS EN 14339, IS EN 1074 PART 6 AND 135 750. REFER TO IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.16.5.
 - SLUICE VALVES HAVE BEEN PROVIDED SO THAT INDIVIDUAL SECTIONS CAN BE ISOLATED & WILL COMPLY TO BS 5163. THE DEPTH OF THE SLUICE VALVE SPINDLE CAP BELOW FINISHED GROUND WILL NOT EXCEED 300mm.
 - ALL WATERMAIN DETAILS TO BE IN ACCORDANCE WITH THE IRISH WATER INFRASTRUCTURE STANDARD DETAILS AND CODE OF PRACTICE FOR WATER INFRASTRUCTURE.
 - THERE IS A MINIMUM OF 300mm CLEARANCE BETWEEN THE EXISTING AND PROPOSED WATERMANS WHERE THEY CROSS AS PER SECTION 3.6 OF IRISH WATER CODE OF PRACTICE.



ISSUE/REVISION		
NO	DATE	DESCRIPTION
1	18.03.2021	STAGE 3 PLANNING ISSUE
0	17.08.2020	STAGE 2 PRE - APP ISSUE

PROJECT NUMBER

60626107

SHEET TITLE

PROPOSED WATERMAIN LAYOUT

SHEET NUMBER

PR461030-ACM-XX-00-DR-CE-10-2701

ORDNANCE SURVEY IRELAND LICENCE No. AR 0064220
 © ORNANCE SURVEY IRELAND / GOVERNMENT OF IRELAND

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.