


THE INFORMATION ON THIS DRAWING IS TO THE ORDNANCE SURVEY IRELAND ITM COORDINATE SYSTEM

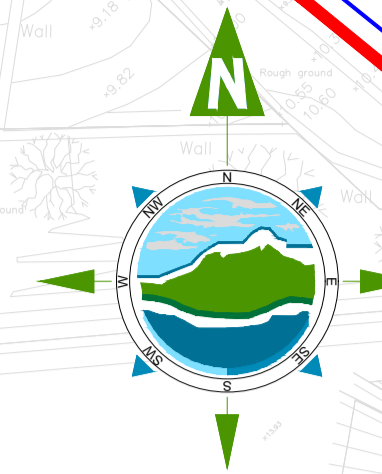

LEGEND:

- Site Boundary
- + 15.00 Proposed Level
- Proposed Ø 200mm PE100 SDR 17 Water Supply Pipe
- Proposed Ø 150mm PE100 SDR 17 Water Supply Pipe
- ▶ Proposed Thrust Block
- Proposed Watermain House Connection
- + Proposed 3-Way Sluice Valve Arrangement (Ductile Iron Pipework Between Valves) as per IW-CDS-5020-01
- + Proposed Water Hydrant
- + Scour Valve and Wash-out Chamber
- Possible Future Phase of Lands - Not Subject to this Planning Application
- Lands in Control of Applicant

NOTES:

1. FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
2. ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
3. ENGINEER/EMPLOYERS REPRESENTATIVE, AS APPROPRIATE, TO BE INFORMED BY THE CONTRACTOR OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
4. THE CONTRACTOR SHALL UNDERTAKE A THOROUGH CHECK FOR THE ACTUAL LOCATION OF ALL SERVICES/UTILITIES, ABOVE AND BELOW GROUND, BEFORE ANY WORK COMMENCES.
5. ALL LEVELS SHOWN RELATE TO ORDNANCE SURVEY DATUM AT MALIN HEAD.

Rev	Date	Description	By	Chkd.
P05	28.06.2021	Revised Layout - Issued for Planning	MN	RD
P04	16.06.2021	Issue for Planning Revision to Drainage	EC	RD
P03	19.05.2021	Draft Issue For Planning	EC	SH
P02	14.05.2021	Issued For Comment	MN	SH
P01	12.05.2021	First Issue	MN	RD

Client: **ALBER**
DEVELOPMENTS

Project: **Rosshill Residential Development**

Title: **Watermain Layout (Sheet 1 of 2)**

Scale @ A1: 1:500 / @A3 1:1000

Prepared by: MN Checked: RD Date: June 2021

Project Director: Michael McDonnell

Drawing Status: Planning

TOBIN
CONSULTING ENGINEERS

Galway Office
Fairgreen House, Fairgreen Road,
Galway,
H91 AXK8,
Ireland.

Tel: +353 (0)91 565 211
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and provided. Except where specified otherwise, all rights are reserved. TOBIN Consulting Engineers, its copyright holders, its part of the document may be reproduced or transmitted in any form and this document shall not be relied upon by any third party for any purpose.

Drawing No.: **10690-2101P05** Revision:

Possible future phase shaded - not subject to this application

Scour Valve and wash-out chamber in accordance with IW-STD-W-30A connected to Storm Sewer

Temporary 'Dead End' arrangement as per Irish Water standard detail STD-W-05 for possible future connection.

Temporary 'Dead End' arrangement as per Irish Water standard detail STD-W-05 for possible future connection.

Possible future phase shaded - not subject to this application

Ø100mm watermain to Pump Station