
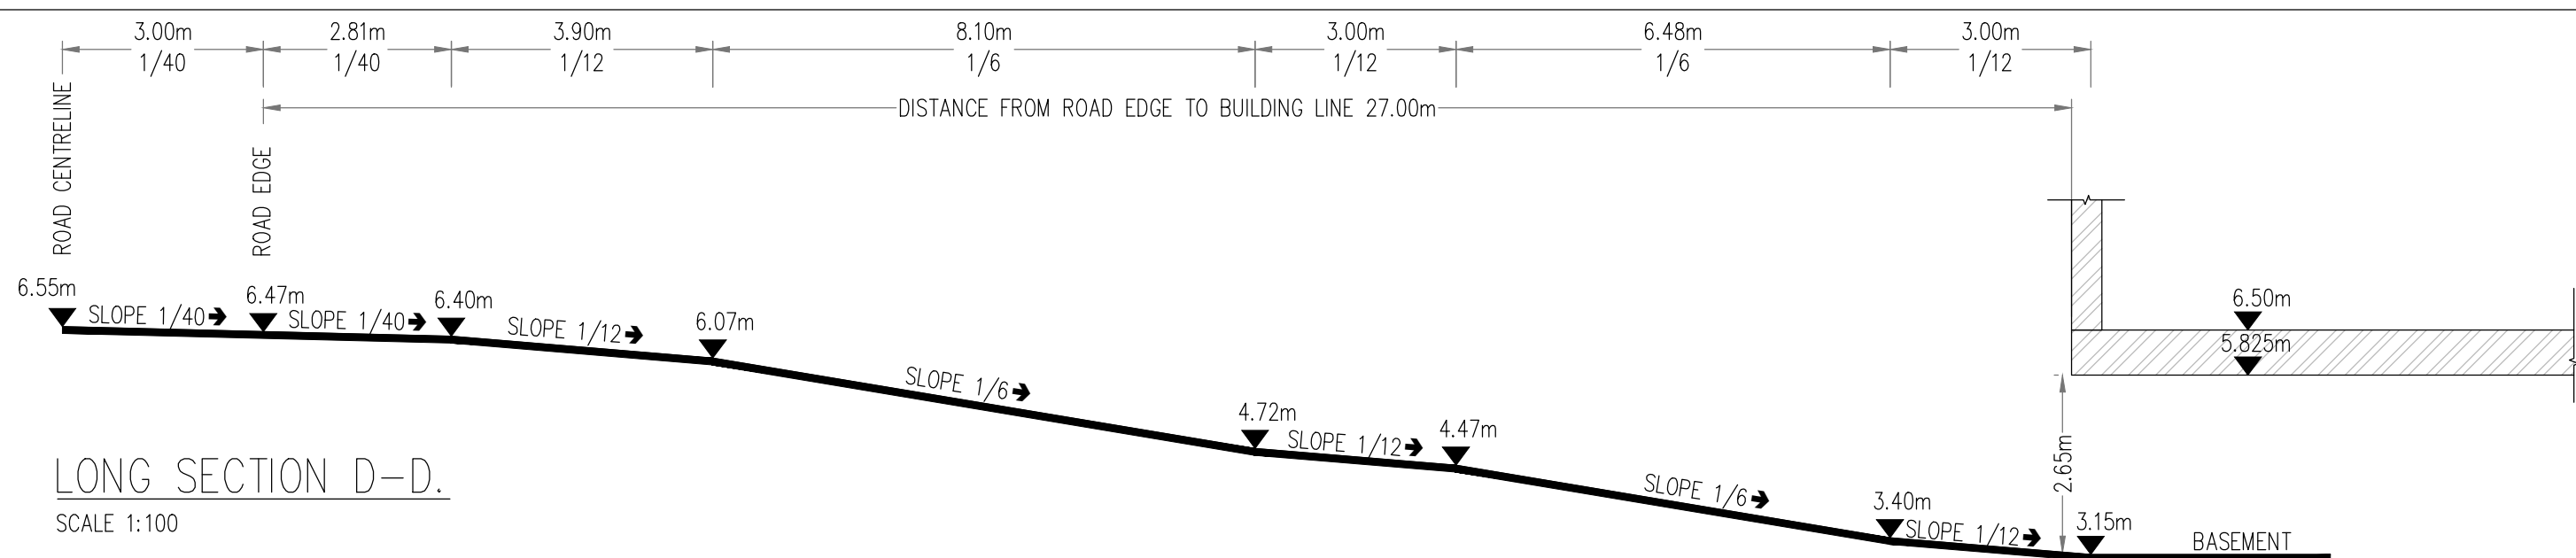


**NOTE:**  
SPECIFICATION FOR SUB-BASE AND LAYING COURSE - THE CRUSHED STONE MUST POSSESS WELL DEFINED EDGES AND HAVE A MINIMUM 10% FINES VALUE OF 150µm WHEN TESTED IN ACCORDANCE WITH BS812 PART III.

SIEVE SIZE	% PASSING
100mm	100
6.3mm	90-100
37.5mm	60-80
20mm	15-30
10mm	0-5

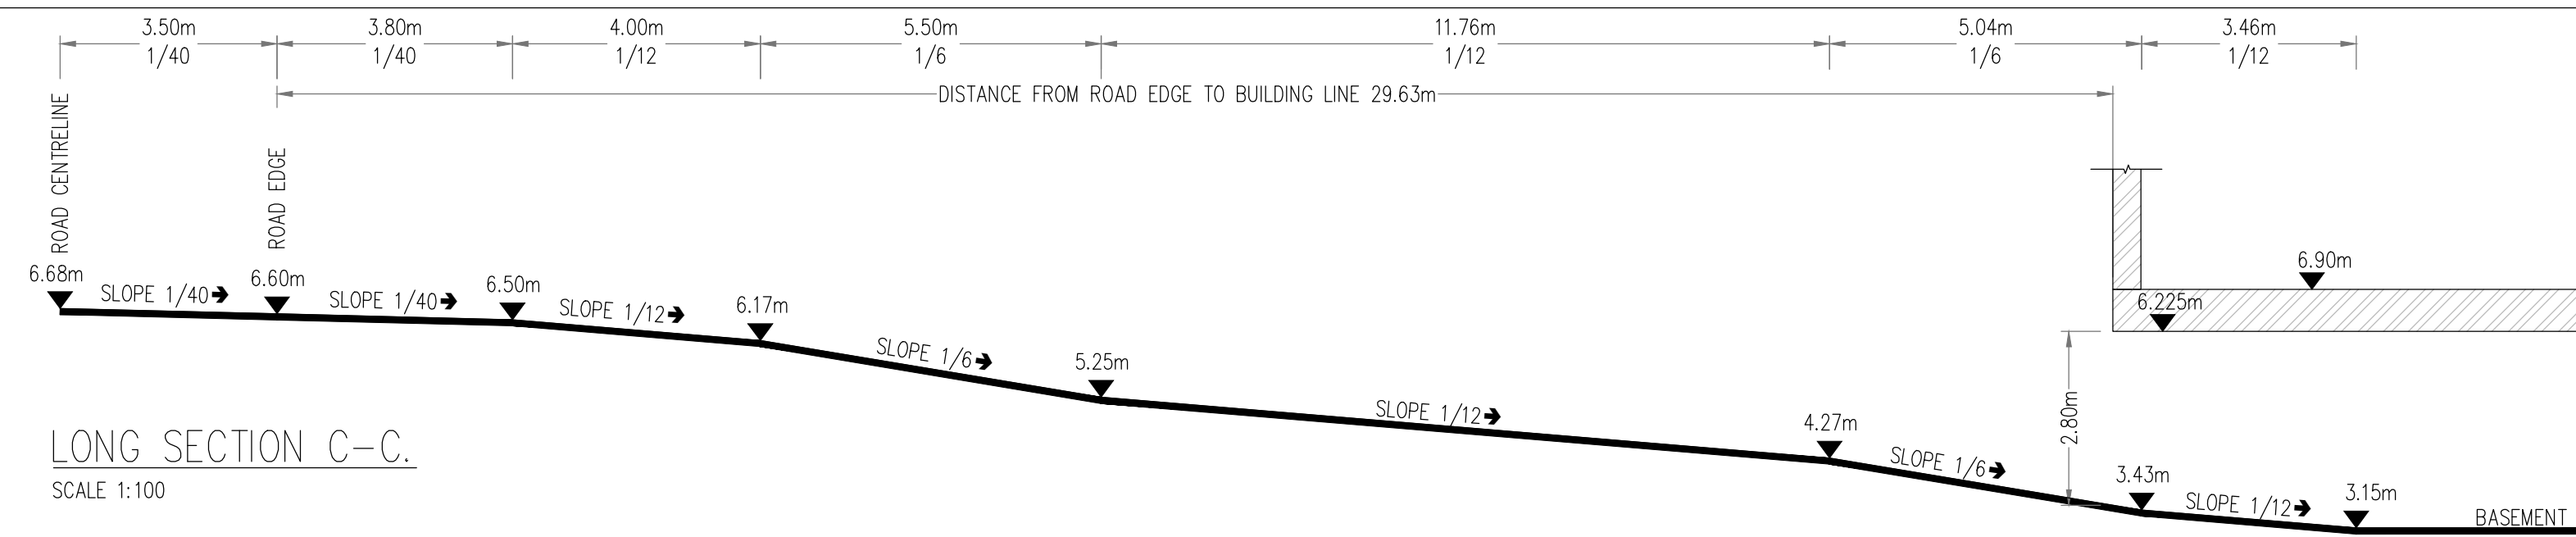

**PLANNING DRAWING.**  
**NOT FOR CONSTRUCTION.**  
ALL LEVELS GIVEN ARE  
RELATIVE TO ORDNANCE DATUM.  
THIS DRAWING HAS BEEN ISSUED FOR INFORMATION  
PURPOSES ONLY AND MUST NOT BE USED  
FOR CONSTRUCTION UNDER ANY CIRCUMSTANCES

- NOTES**
- For setting out refer to Architect's drawings.
  - This drawing to be read in conjunction with all other Architectural and Engineering drawings and all other relevant drawings and Specifications.
  - DO NOT SCALE THIS DRAWING. Use figured dimensions only.
  - No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission as copyright holder except as agreed.
  - Ordnance Survey Ireland Licence Number EN 0074021

Rev. No.	Date	REVISION NOTE
P1	01.03.2021	Site Layout Revised

Dim. By	Chkd. By	Architect	Project
JS	OS	Henry J. Lyons	GA03 Project Shoreline, Baldoyle.

Title	Dwg. No.	Date	Dim. by	Chkd. by	Aprvd. by	Scale	Revision
PROPOSED ROAD CROSS SECTIONS & BASEMENT RAMPS LONG SECTIONS	BD-CSC-ZZ-G3-DR-C-0123	13.10.2020	JS	NB	OS	AS SHOWN @A1	P1

**CS Consulting Group**  
DUBLIN | LONDON | LIMERICK

Head Office  
19-22 Dame Street, Dublin 2.  
T: +353 (0)1 5480863  
e: info@csconsulting.ie  
w: www.csconsulting.ie

Quality  
NSAI Certified  
I.S. EN ISO 9001:2008  
I.S. EN ISO 14001:2004  
I.S. EN ISO 50001:2011  
OHSAS 18001:2007