


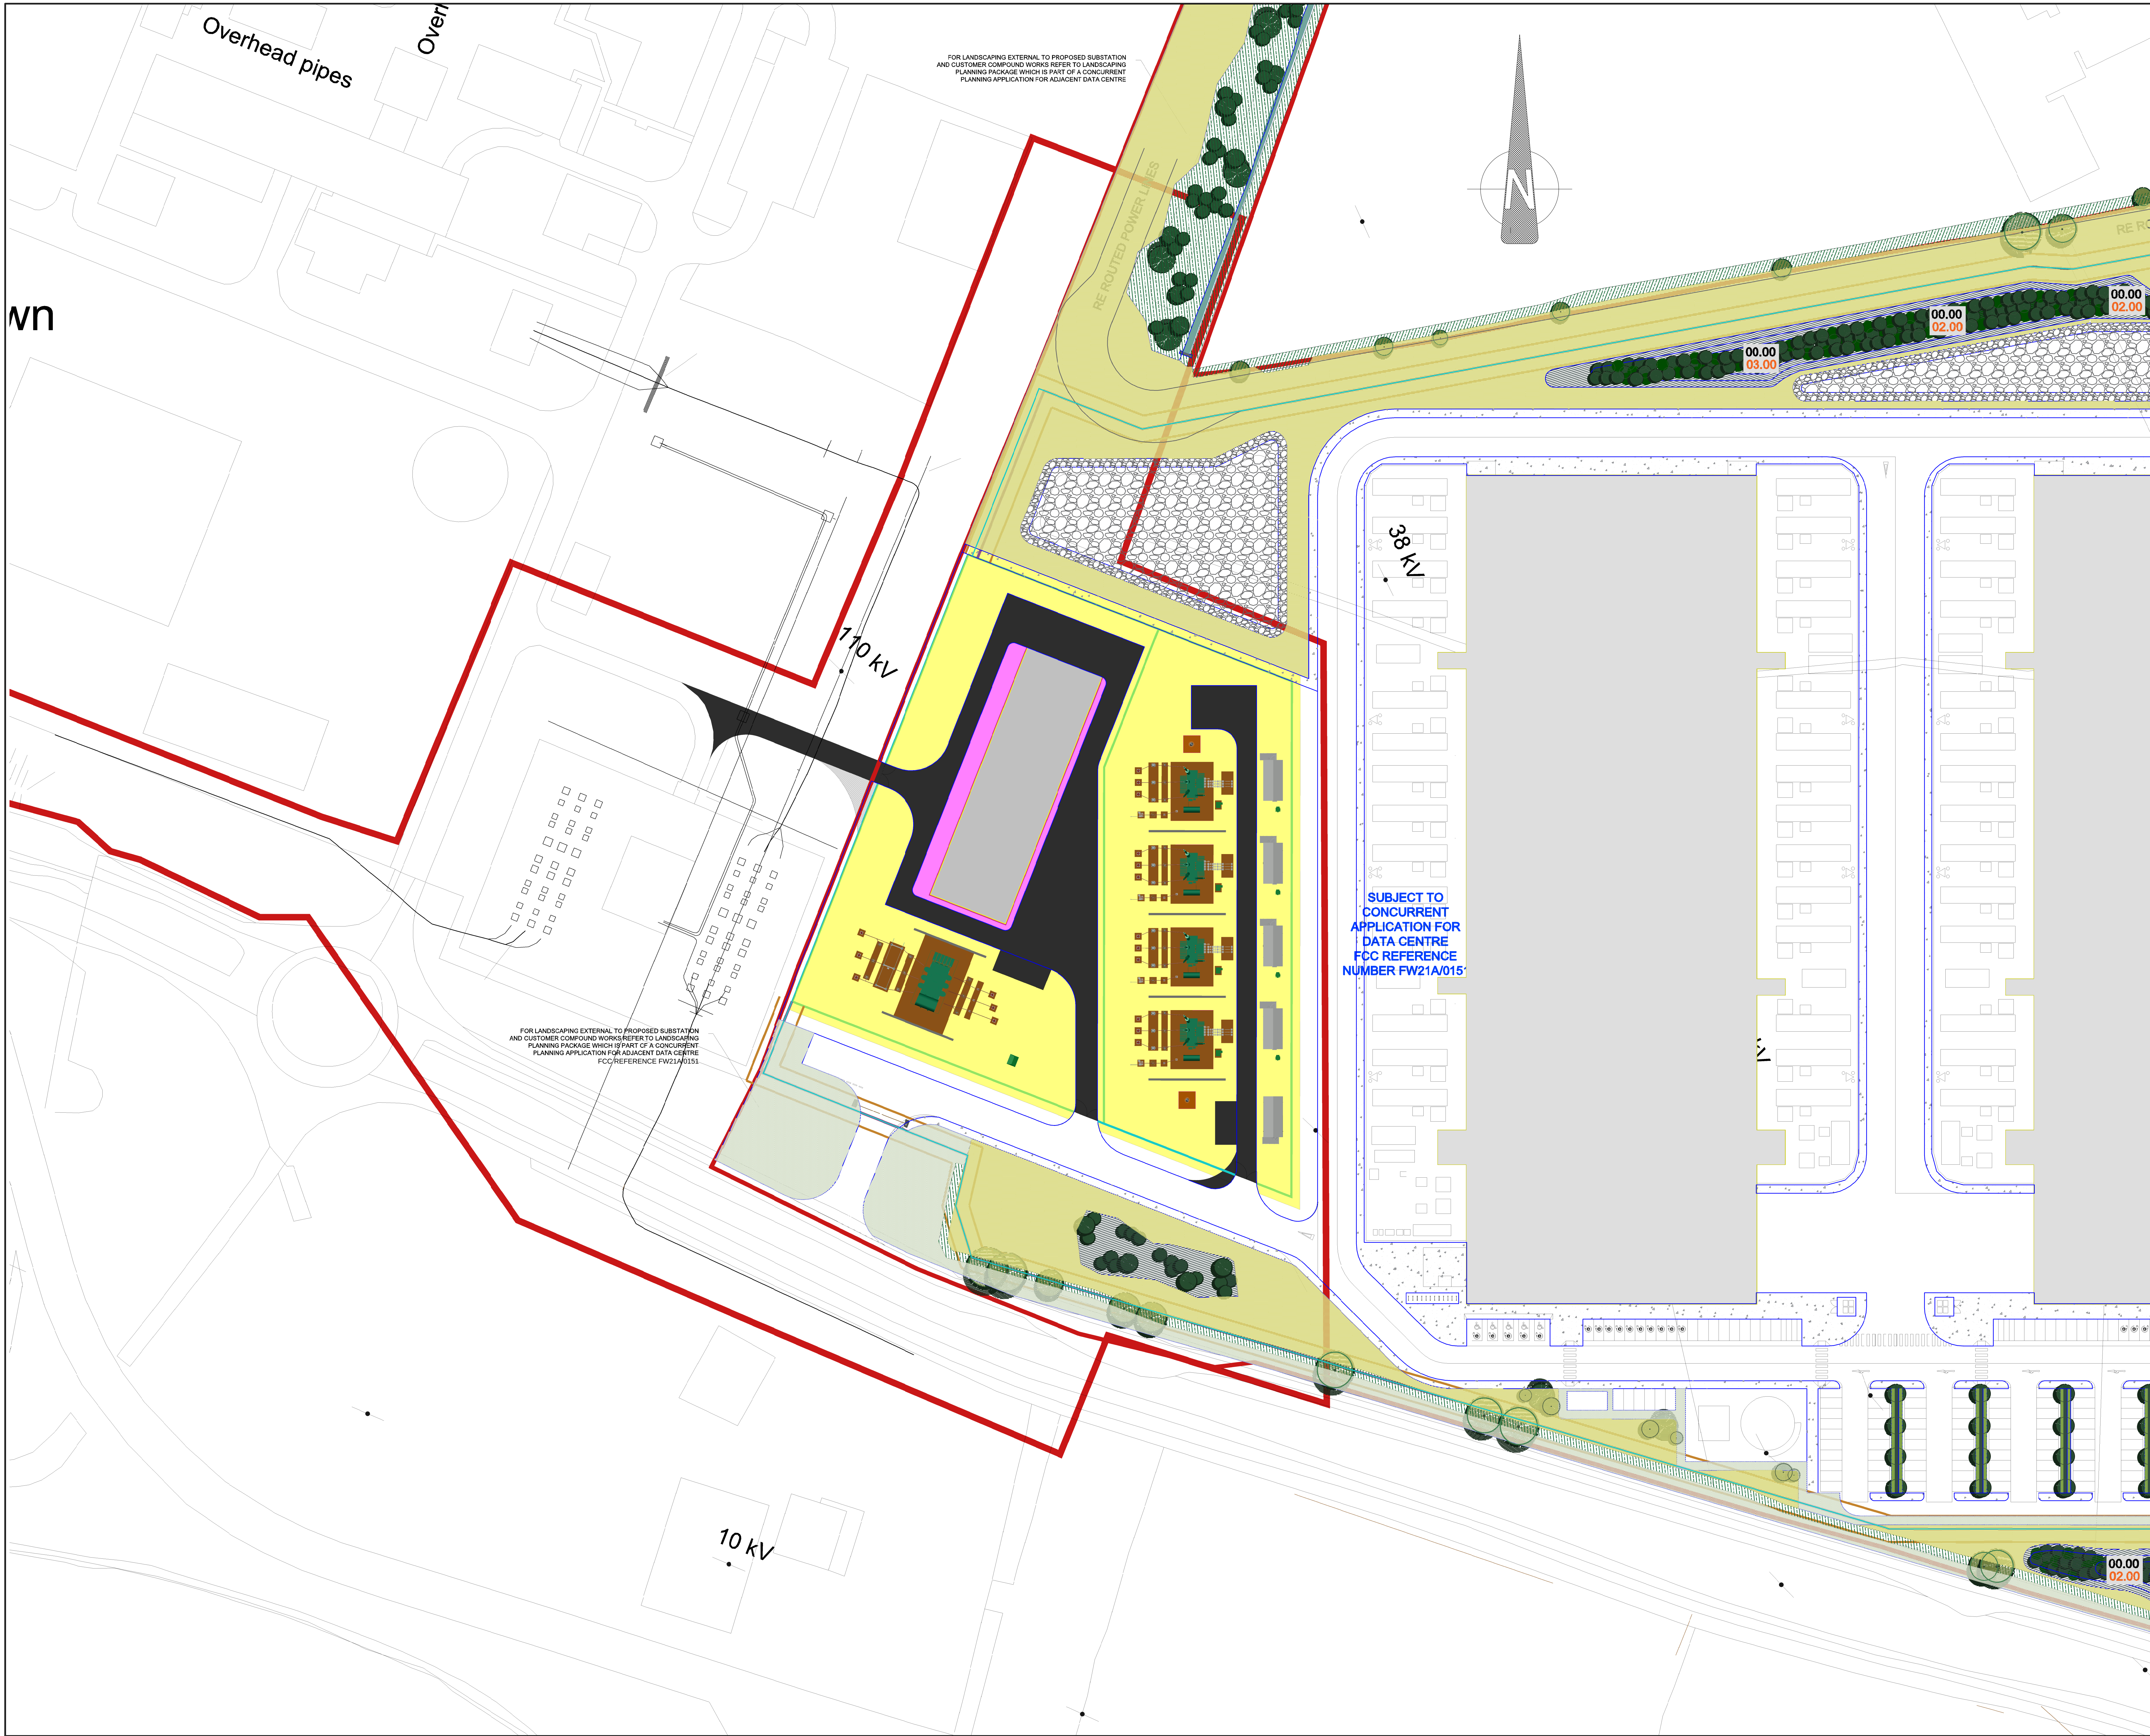

PROJECT

PROJECT CIRRUS

CLIENT

HUNTSTOWN POWER
COMPANY LTD.



CONSULTANT

AECOM
Adelphi Plaza
Georges Street Upper
Dun Laoghaire
County Dublin
Ireland
T +353 (0)1 2383100
www.aecom.com

LEGEND

- 220 kV SUBSTATION PLANNING BOUNDARY
- PROPOSED SECURITY FENCE
TYPE 1 TO ARCHITECTS DETAIL
- SUBSTATION ROAD
- SURFACE FINISH (CRUSHED ROCK)
- CONCRETE FOOTPATH
- CONCRETE PLINTHS

NOTES

- DRAWINGS ARE INDICATIVE ONLY AND SHOULD NOT BE USED FOR DETAILED DESIGN;
- THE EIRGRID SUBSTATION IS BASED ON THE LATEST EIRGRID STANDARD (01-09-2020) AND IS SUBJECT TO CHANGE BY EIRGRID. EIRGRID DRAWING REFERENCE XDN-LAY-ELV-STND-F004;

ISSUE/REVISION

ISSUE/REVISION	DATE	DESCRIPTION
P2	03/09/2021	FOR PLANNING
P1	30/07/2021	REVISED COMMENTS
P0	28/06/2021	FIRST ISSUE FOR PLANNING
I/R	DATE	DESCRIPTION

STATUS

FOR PLANNING

PROJECT NUMBER SCALE

60641561 1:500 @ A0

SHEET TITLE

MOORETOWN 220 kV SUBSTATION
LAYOUT
PROPOSED HARDSTANDING FINISHES

SHEET NUMBER REV

60641561-DWG-714 P2