



Project Management Initials : Designer : OB Checked: PB Approved: BW

Last saved by: MARIA.BORRELLAGARRID(2021.09.03) Last Picked: 2021.09.03
Filename: \\IEDSLJPF001\1\EU\AECOM\NET\COMDATA\DCS\PROJECTS\BP60641561_PROJECT_CIRRUS\900_CAD_GIS\910_CAD\PLANNING\FOLDER\360641561-DWG-722.DWG

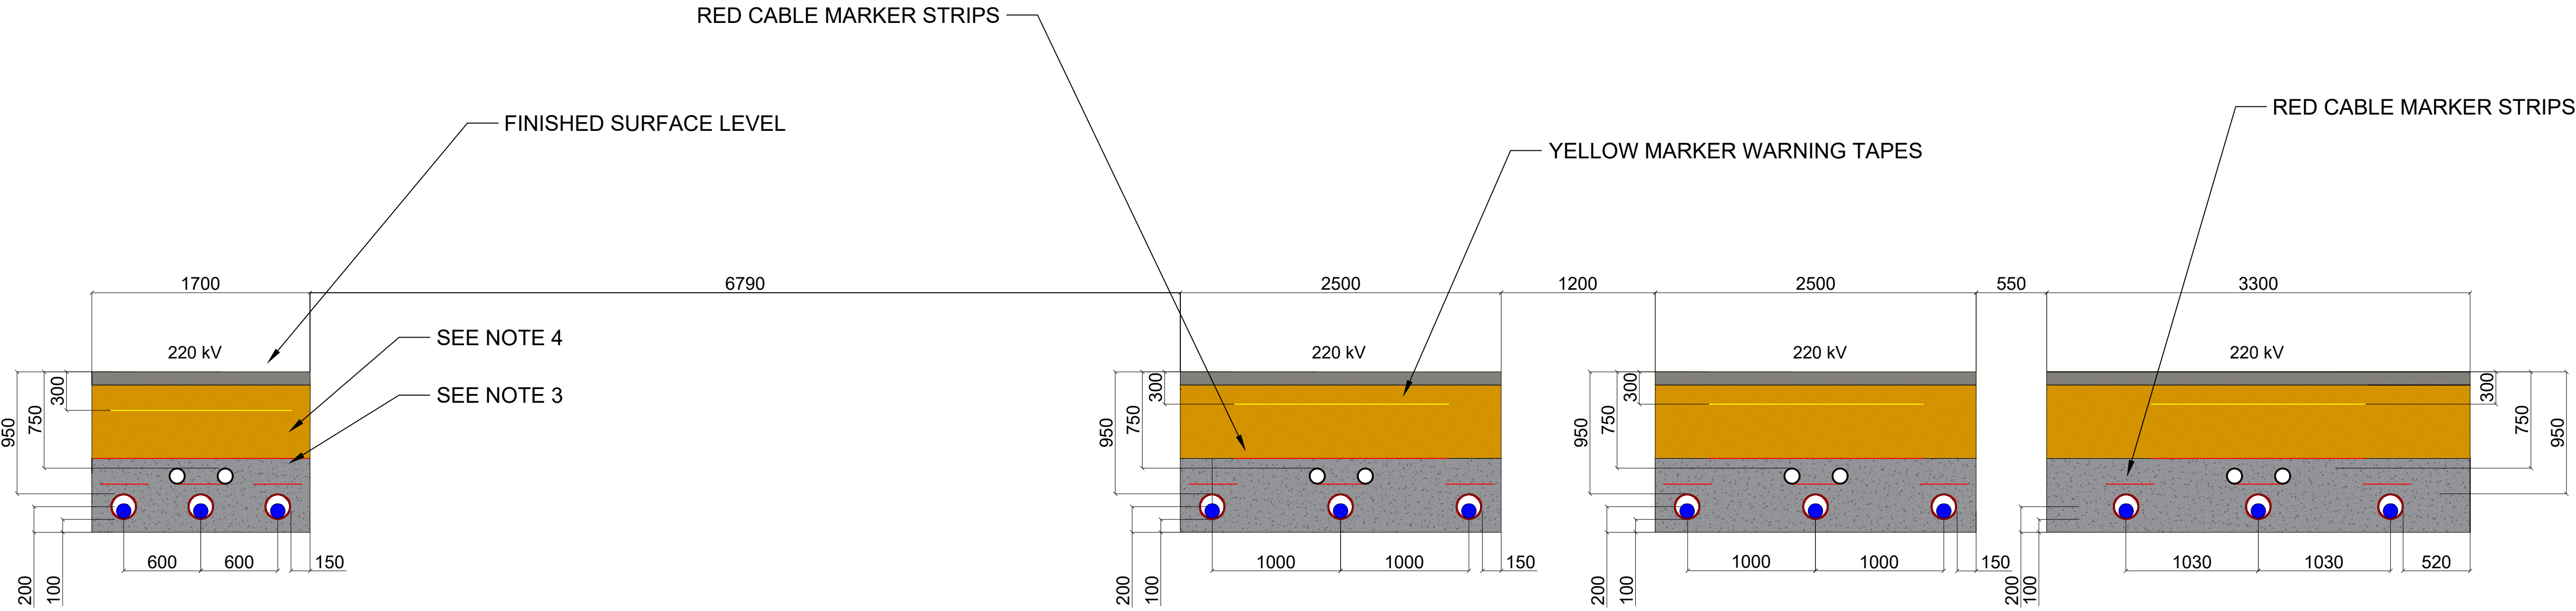

CROSS SECTION 1 - SEE SHEET 60641561 - DWG-721 - LAYOUT
SCALE 1:30 @ A1

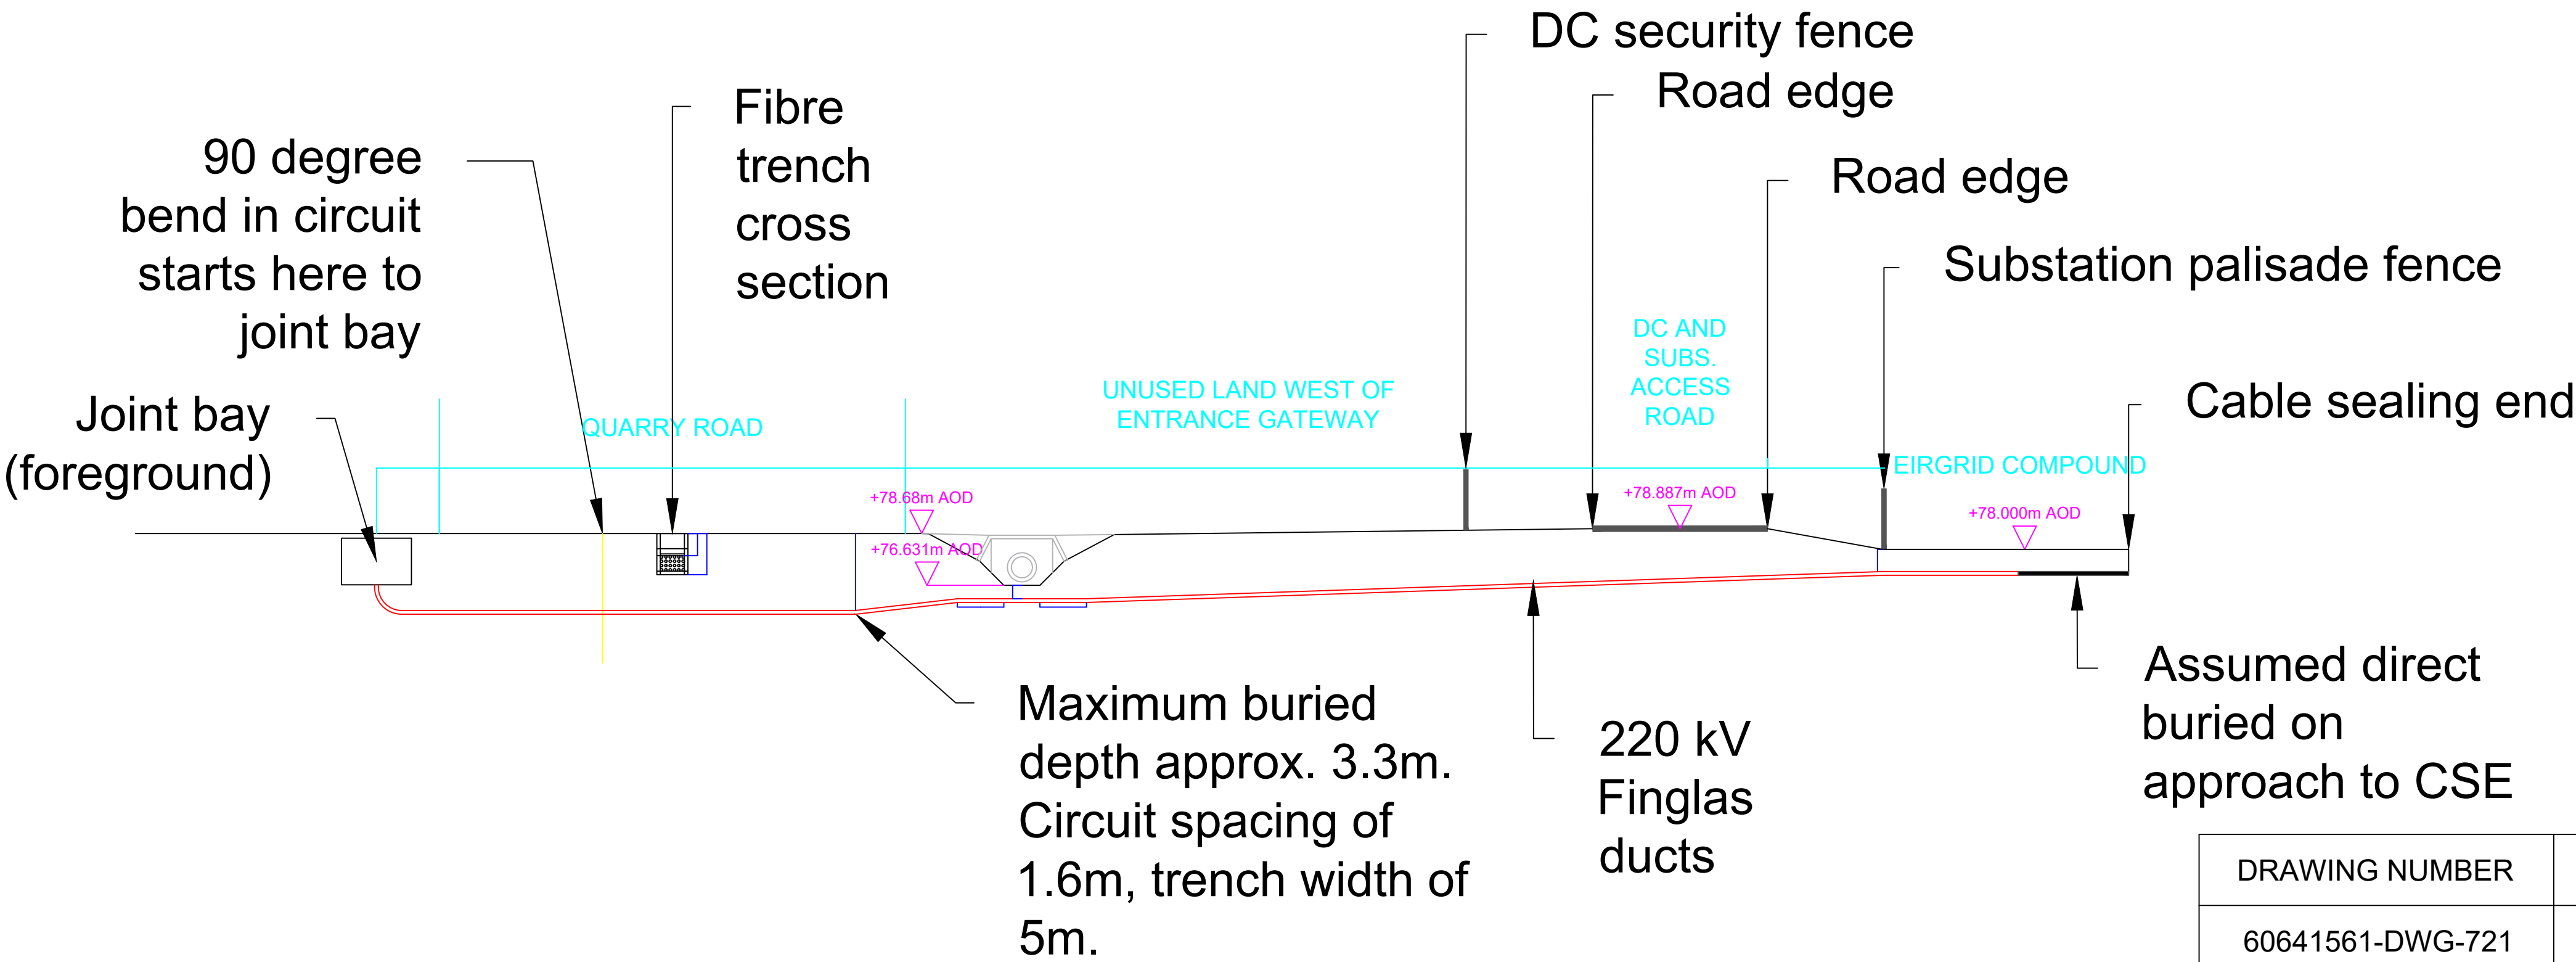

CROSS SECTION 2 - SEE SHEET 60641561 - DWG-721 - LAYOUT
SCALE 1:200 @ A1

AECOM

PROJECT

PROJECT CIRRUS

CLIENT

HUNSTOWN POWER
COMPANY LTD.

energia

CONSULTANT

AECOM
Adelphi Plaza
Georges Street Upper
Dun Laoghaire
County Dublin
Ireland
T +353 (0)1 2383100
www.aecom.com

LEGEND

- 220 kV CABLES
- NATIVE SOIL
- BACKFILL MATERIAL
- CL.804 COMPACTED IN LAYER

NOTES

- PRELIMINARY DRAWING FOR DISCUSSION ONLY;
- MEASUREMENTS PRESENTED ARE IN MILLIMETERS;
- BACKFILL MATERIAL TO BE CBGM WITH T.R ACCORDING TO HV CALCULATIONS
- NATIVE SOIL WITH T.R ACCORDING TO HV CALCULATIONS

ISSUE/REVISION

P3	03/09/2021	FOR PLANNING
P2	30/07/2021	REVISED SECTION FOR PL.
P1	28/06/2021	FOR PLANNING
P0	04/06/2021	FIRST ISSUE FOR PLANNING
I/R	DATE	DESCRIPTION

STATUS

FOR PLANNING

SCALE
VARIES @ A1

SHEET TITLE

MOORETOWN 220 kV SUBSTATION
HV CABLE CROSS SECTIONS 1 & 2
SHEET 2 OF 4

SHEET NUMBER

60641561-DWG-722

REV

P3

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.