

HUNTSTOWN
POWER COMPANY
LTD.

AECOM
Adelphi Plaza
Georges Street Upper
Dun Laoghaire
County Dublin
Ireland
T +353 (0)1 2383100
www.aecom.com

LEGEND

1. DRAWINGS ARE INDICATIVE ONLY AND SHOULD NOT BE USED FOR DETAILED DESIGN;
2. THE EIRGRID SUBSTATION IS BASED ON THE LATEST EIRGRID STANDARD (01-09-2020) AND IS SUBJECT TO CHANGE BY EIRGRID. DRAWING REFERENCE XDNL-LAY-ELV-STND-F004;
3. THE EQUIPMENT LAYOUTS ARE INDICATIVE AND DIMENSIONS MAY CHANGE ONCE THE EXACT SPECIFICATIONS ARE DETERMINED;
4. CABLE ROUTES ARE INDICATIVE AND MAY CHANGE ONCE THE EXACT LAYOUT IS DETERMINED.


P2	14/09/2021	FOR PLANNING
P1	03/09/2021	FOR PLANNING
P0	28/06/21	FIRST ISSUE FOR PLANNING
I/R	DATE	DESCRIPTION

FOR PLANNING


60641561 1:500 @ A1

MOORETOWN 220 kV SUBSTATION
220 kV GIS SUBSTATION
TRANSFORMER DELIVERY - OPTION

60641561-DWG-727 P2

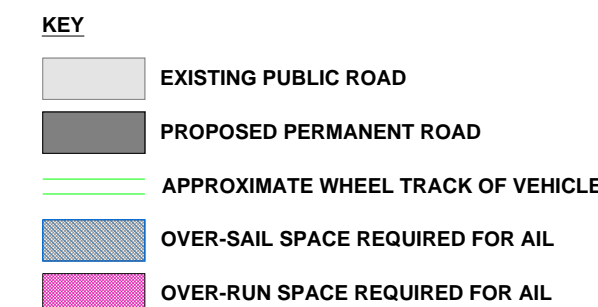

NOTE:
VEHICLE TRACKING SHOWN IS INDICATIVE ONLY.
BESPOKE VEHICLE TRACKING BY ABNORMAL LOAD
HAULIER IS REQUIRED TO ESTABLISH SPECIFIC
EXTENTS OF WHEEL-TRACK, OVER-SAIL SPACE, etc.

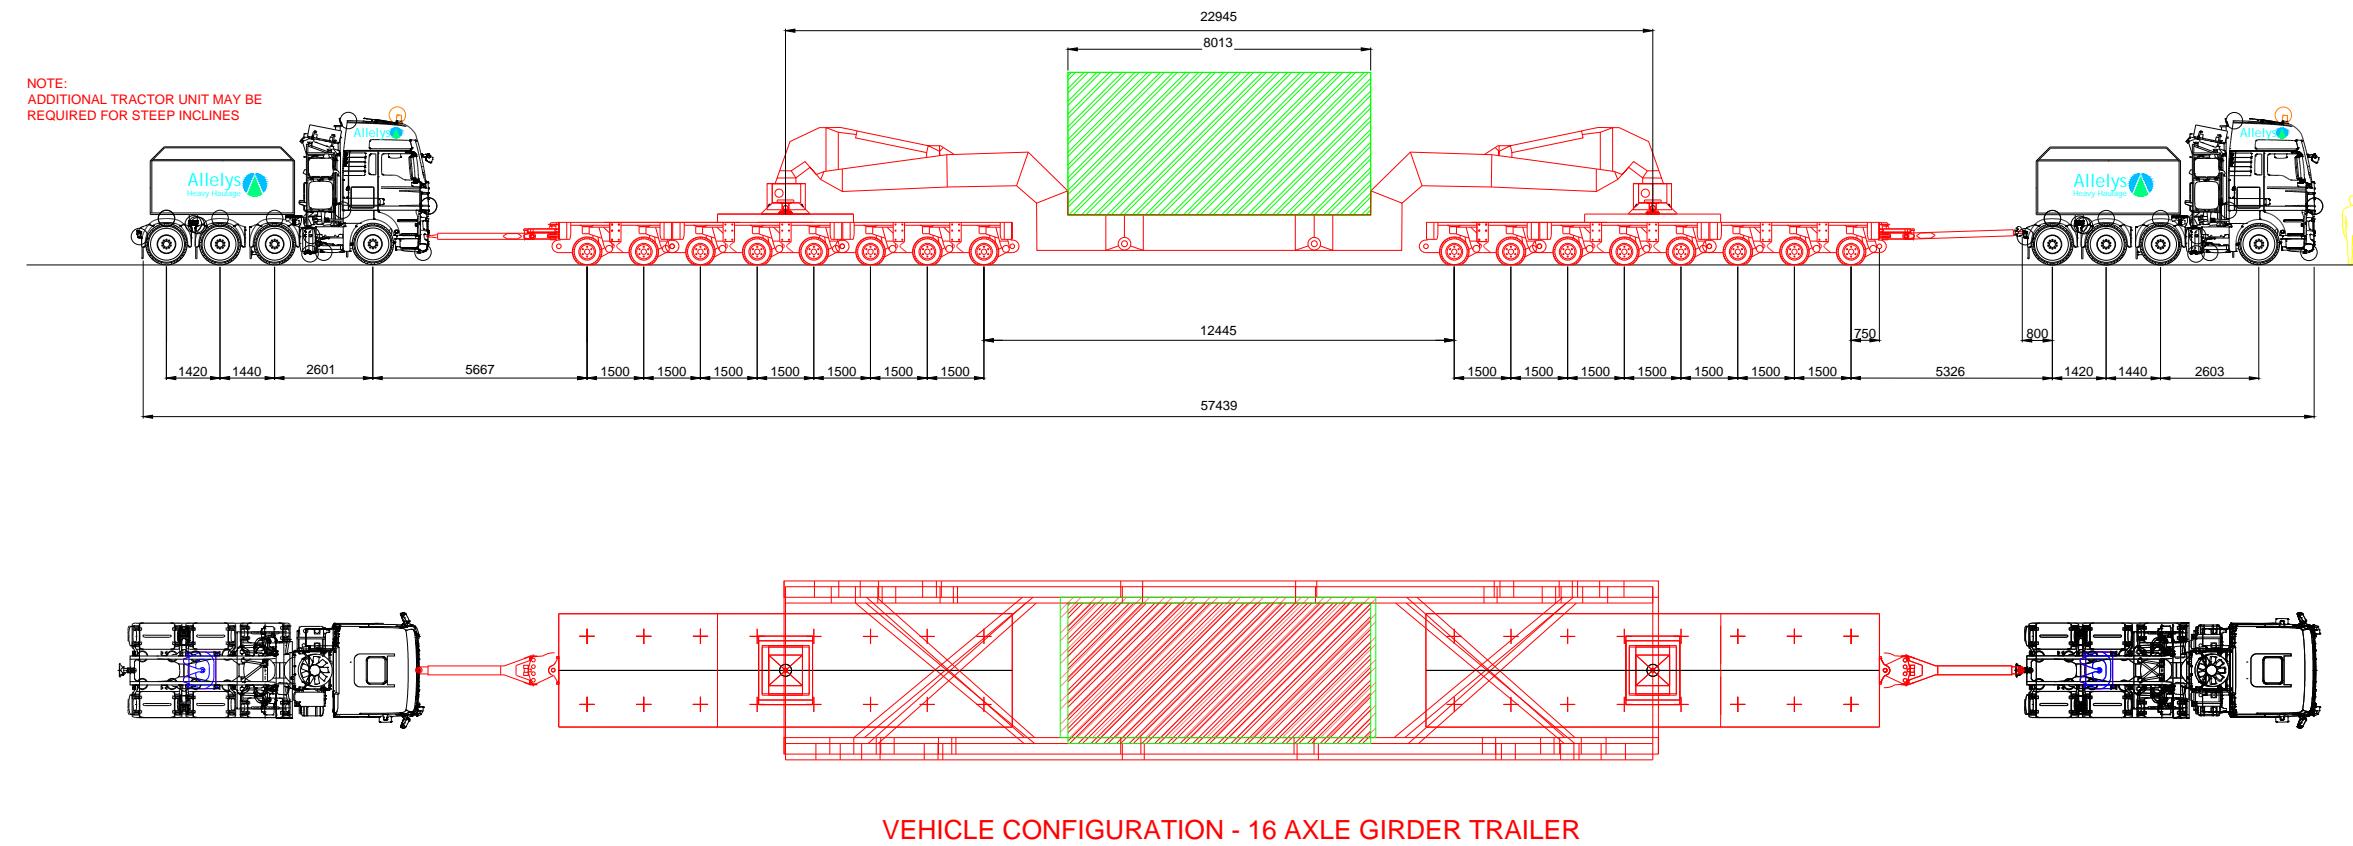

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM, or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.