




CROSS SECTION 4 - SEE SHEET 60641561 - DWG-721 - LAYOUT
SCALE 1:16 @ A1

DRAWING NUMBER	TITLE
60641561-DWG-721	HV CABLE CROSS SECTIONS-LAYOUT
60641561-DWG-722	CROSS SECTIONS 1 &
60641561-DWG-723	CROSS SECTION 3
60641561-DWG-731	CROSS SECTION 4

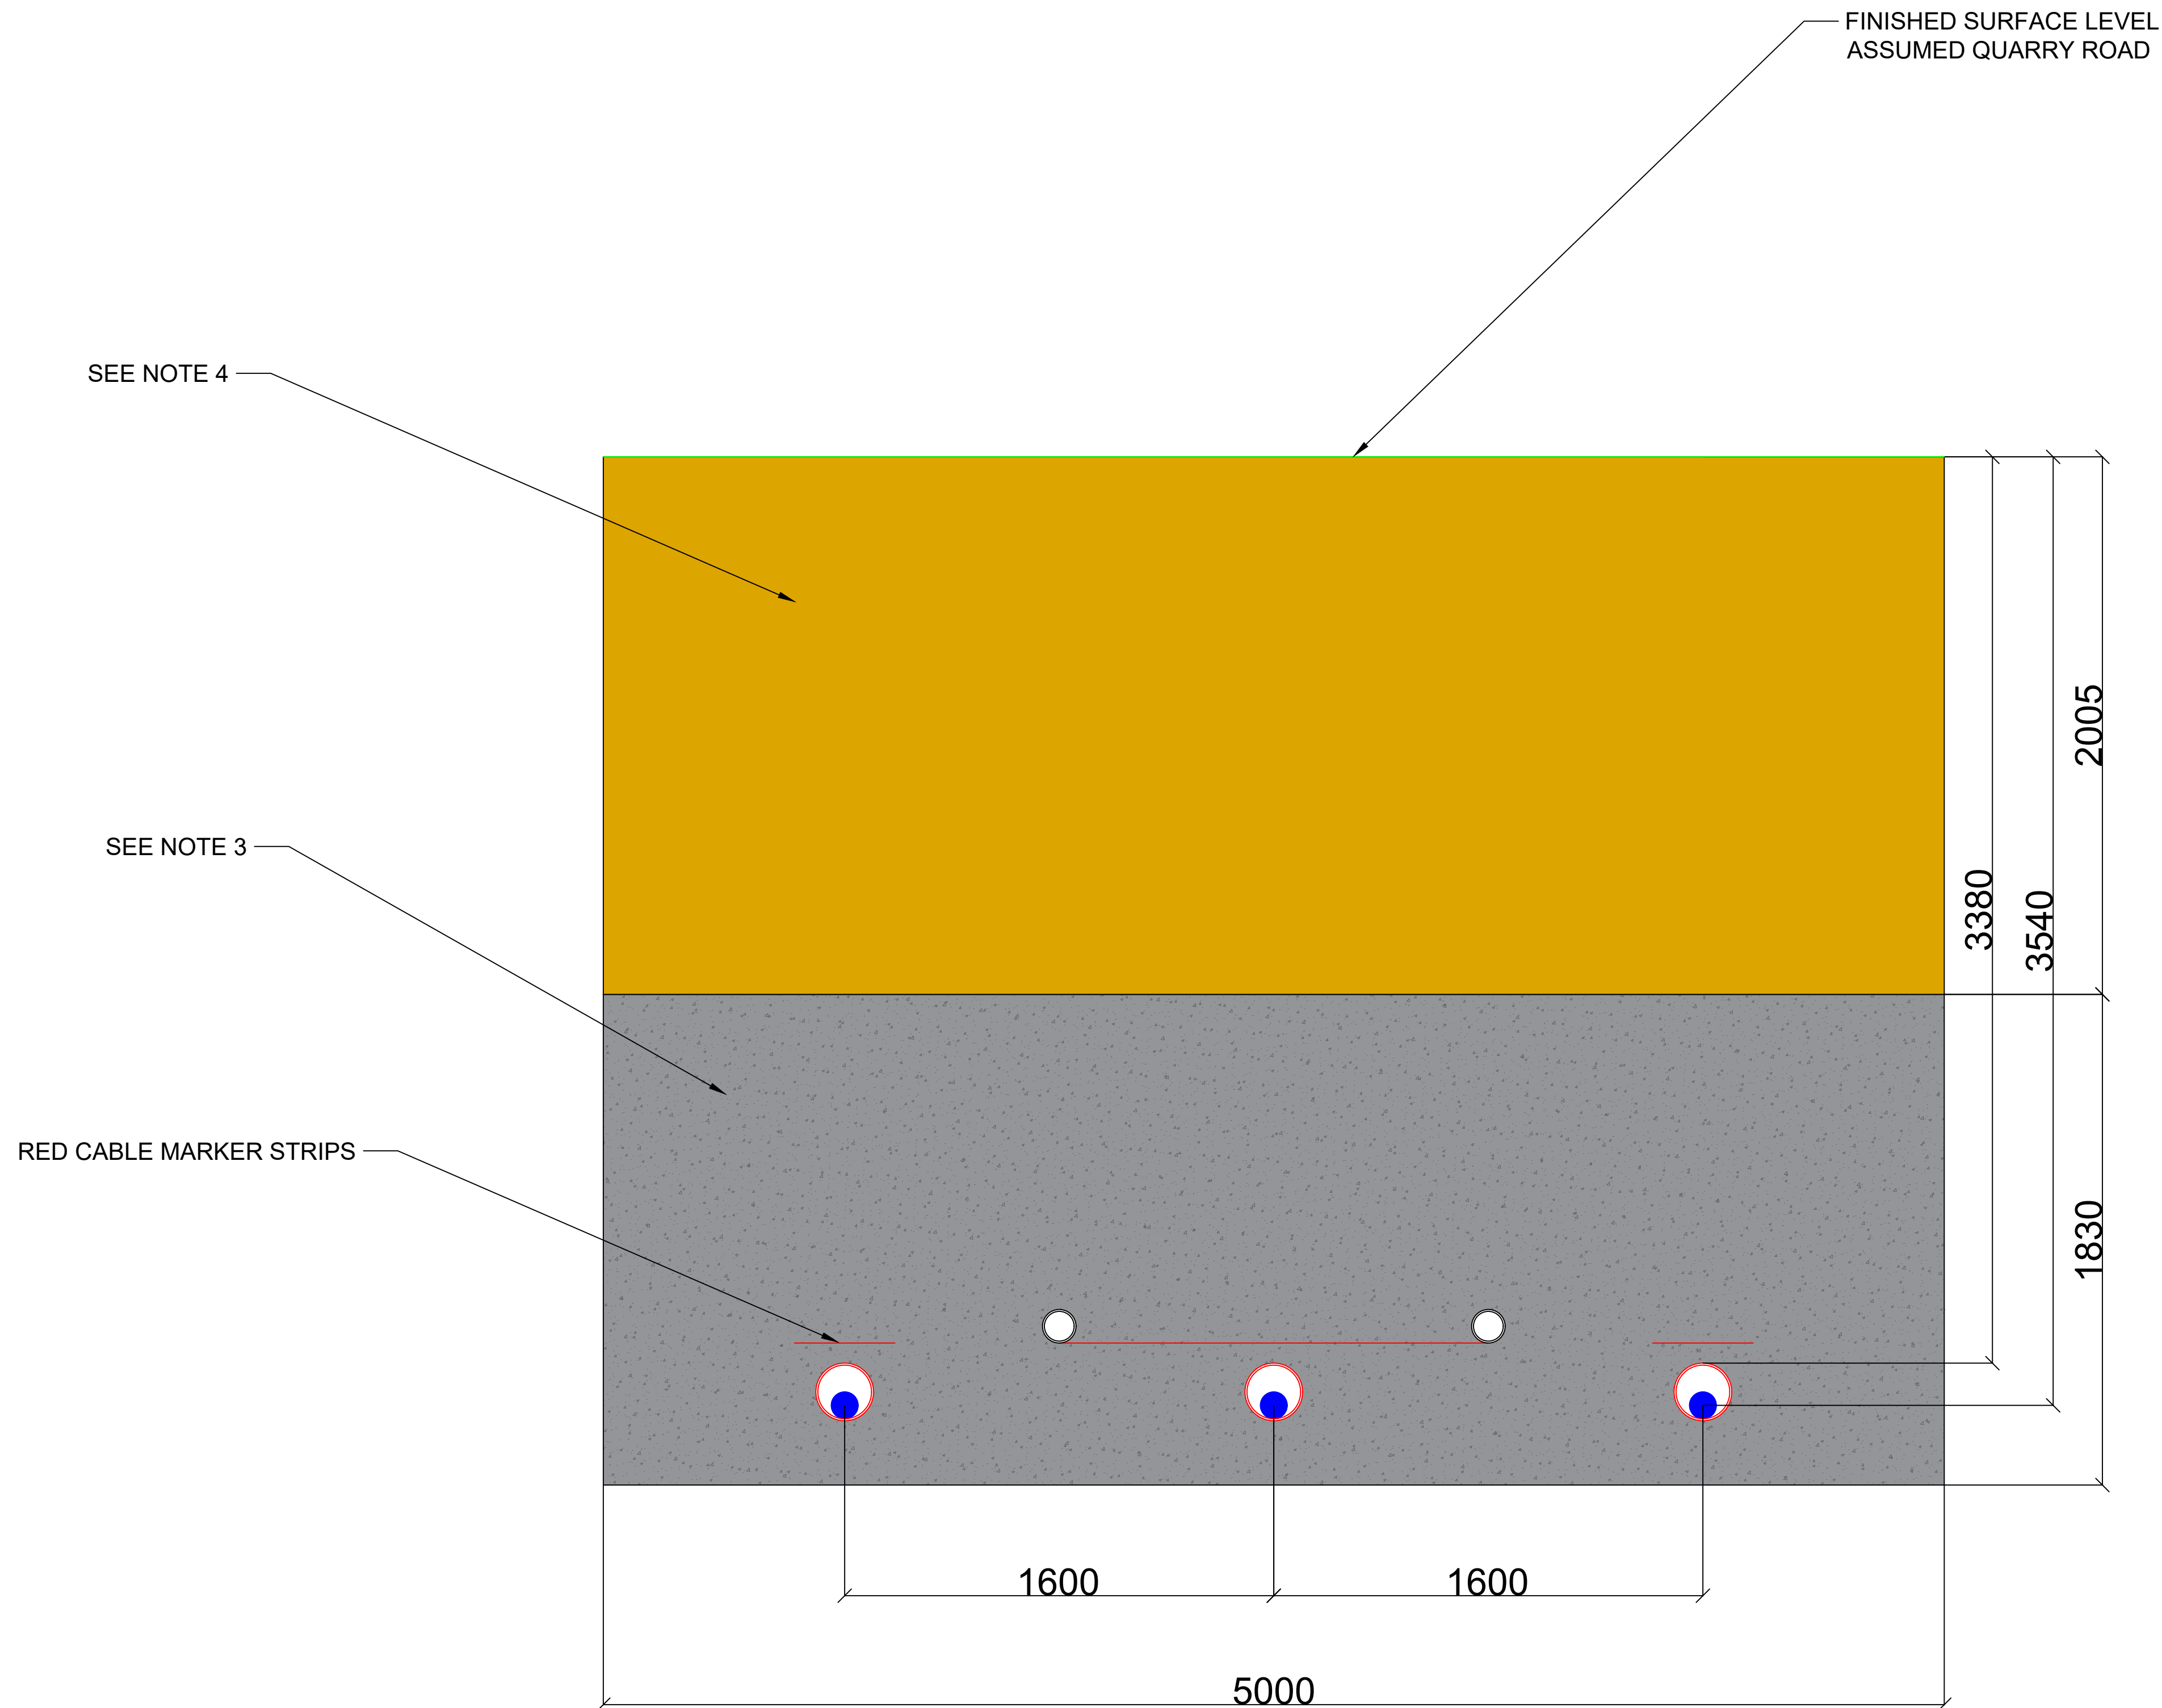

PROJECT

PROJECT CIRRUS

CLIENT

HUNSTOWN POWER
COMPANY LTD.



CONSULTANT

AECOM
Adelphi Plaza
Georges Street Upper
Dun Laoghaire
County Dublin
Ireland
T +353 (0)1 2383100
www.aecom.com

LEGEND

-  220 kV CABLES
-  NATIVE SOIL
-  BACKFILL MATERIAL
-  CL.804 COMPACTED IN LAYER

NOTES

1. PRELIMINARY DRAWING FOR DISCUSSION ONLY;
2. MEASUREMENTS PRESENTED ARE IN MILLIMETERS;
3. BACKFILL MATERIAL TO BE CBGM WITH T.R ACCORDING TO HV CALCULATIONS
4. NATIVE SOIL WITH T.R ACCORDING TO HV CALCULATIONS

ISSUE/REVISION

P2	03/09/2021	FOR PLANNING
P1	30/07/2021	REVISED COMMENTS
P0	28/06/2021	FIRST ISSUE FOR PLANNING
I/R	DATE	DESCRIPTION

STATUS

FOR PLANNING

SCALE

1:16 @ A1

SHEET TITLE

MOORETOWN 220 kV SUBSTATION
HV CABLE CROSS SECTION 4
SHEET 4 OF 4

SHEET NUMBER

60641561-DWG-731

REV

P2