

TYPICAL 110KV CABLE TRENCH DETAIL THROUGH ACCESS TRACKS SECTION
SCALE 1:10

- Notes:
- 1) All dimensions must be checked on site and not scaled from this drawing.
 - 2) All dimensions in millimetres unless otherwise stated.
 - 3) Dimensions may vary depending on site conditions.

Date:	Rev:	Description:	Drawn By:

Prepared By:




Galetech Energy Services
Clondorgan, Stradone
Co. Cavan, H12 NV06
info@galetechenergy.com
www.galetechenergy.com

Client: Bracklyn Wind Farm Limited

Job Title: Bracklyn Wind Farm

Drawing Title: Typical 110kV Cable Trench Detail Through Access Tracks

Drawing No.: BRK001PAS_EIAR_GA-0.07	Revision No.: Rev00
Scale: (A3) 1:10	Date: 27/07/2021
Drawn By: J.B.	Checked By: S.C.
	Confirmed By: D.O.

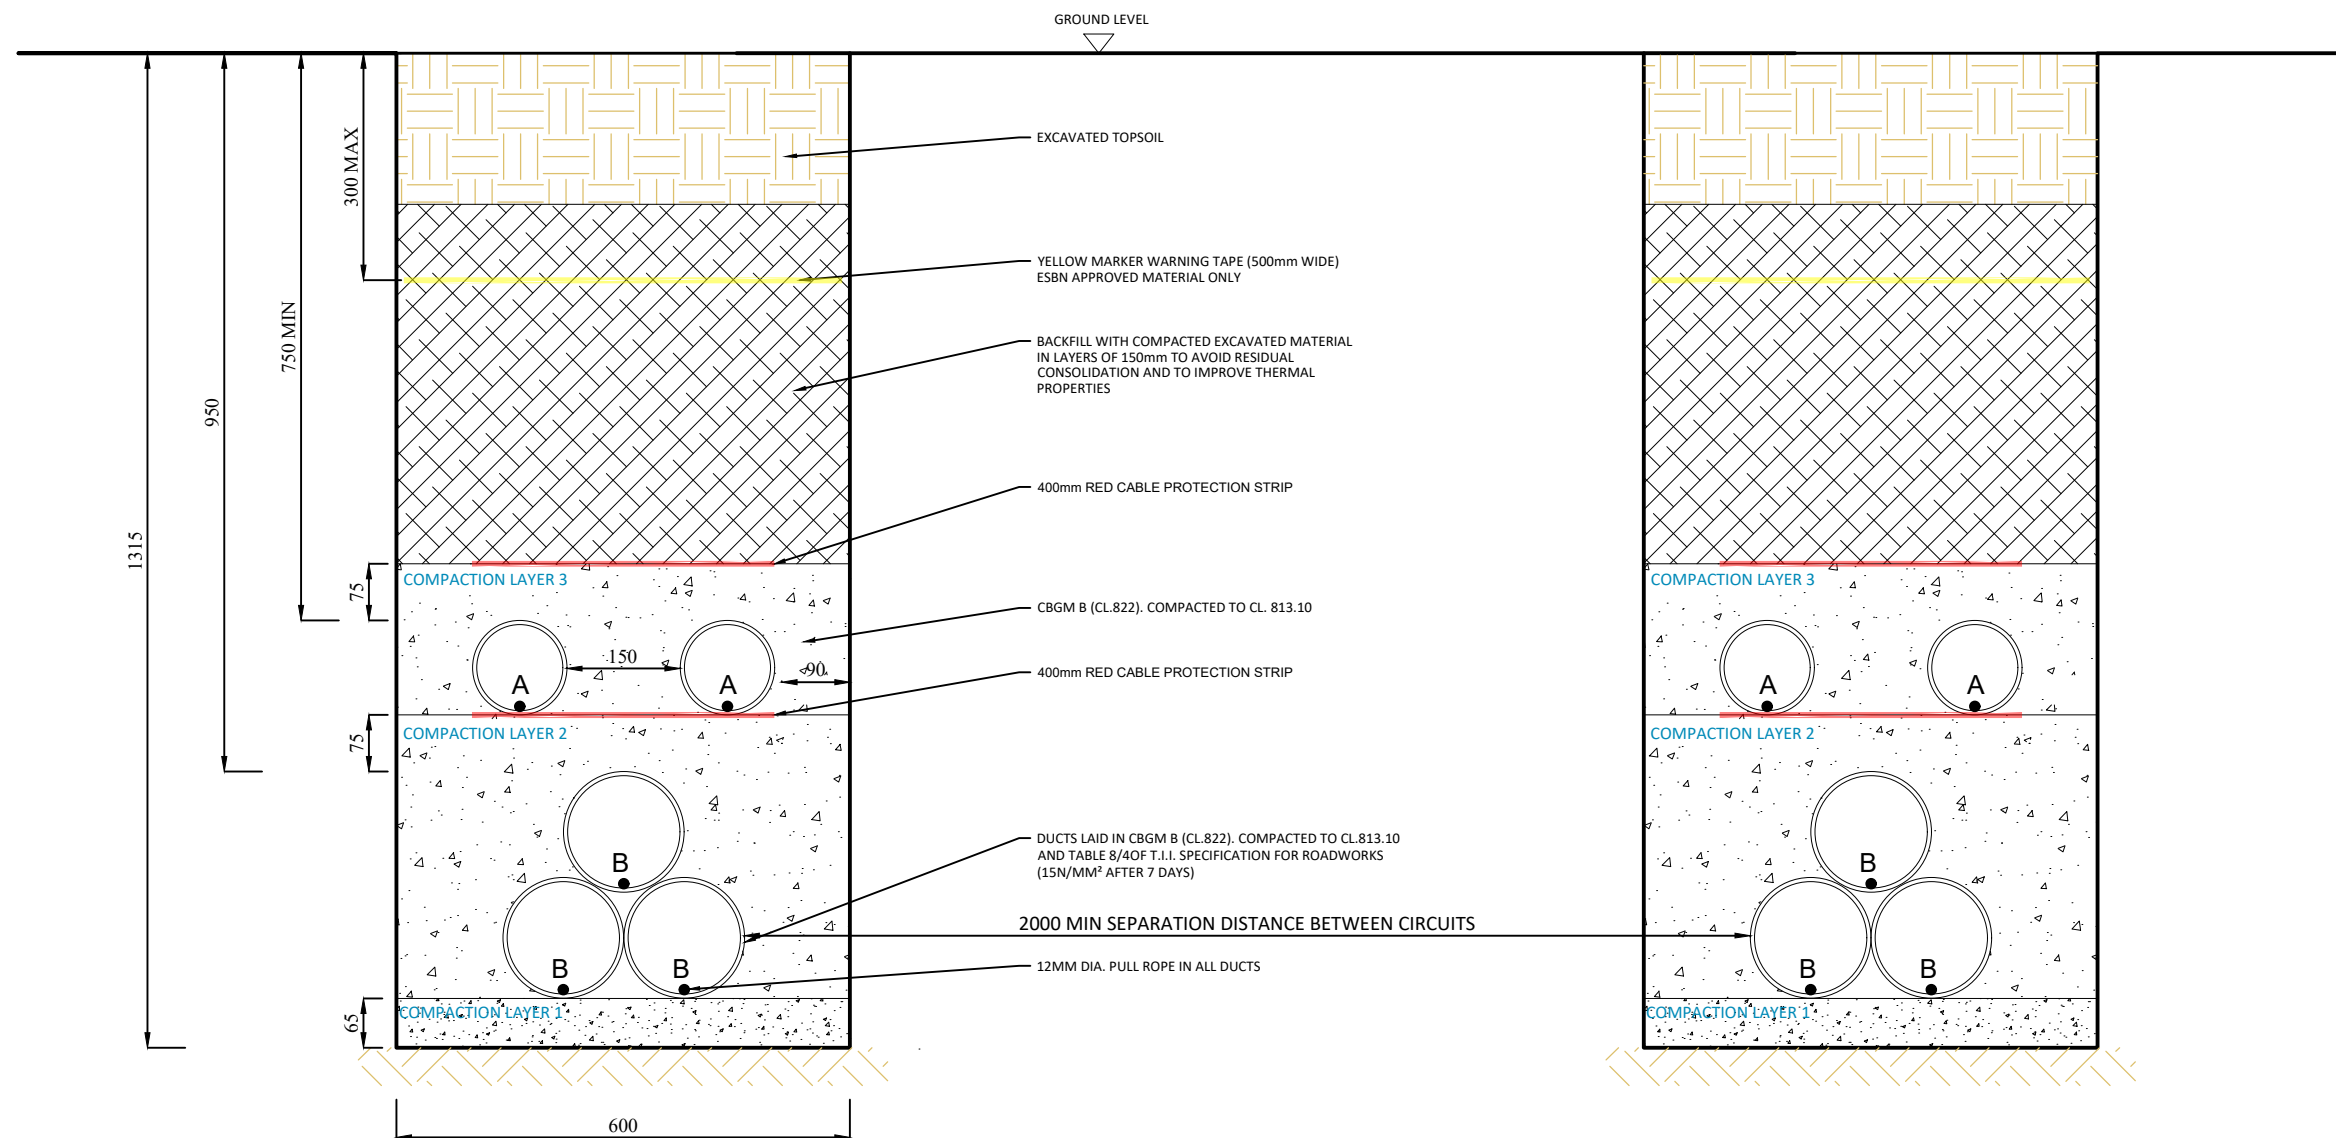

A = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6
 B = 160mm : Outer Diameter HDPE ESB Approved Duct, SDR= 21

TYPICAL 110KV CABLE TRENCH DETAIL THROUGH OFF ROAD SECTION
 SCALE 1:10

Notes:

- 1) All dimensions must be checked on site and not scaled from this drawing.
- 2) All dimensions in millimetres unless otherwise stated.
- 3) Dimensions may vary depending on site conditions.

Date:	Rev:	Description:	Drawn By:

Prepared By:




Galetech Energy Services
 Clondorgan, Stradone
 Co. Cavan, H12 NV06
 info@galetechenergy.com
 www.galetechenergy.com

Client: Bracklyn Wind Farm Limited

Job Title: Bracklyn Wind Farm

Drawing Title: Typical 110kV Cable Trench Detail Through Off Road

Drawing No.: BRK001PAS_EIAR_GA-0.08	Revision No.: Rev00
Scale: (A3) 1:10	Date: 27/07/2021
Drawn By: J.B.	Checked By: S.C.
	Confirmed By: D.O.

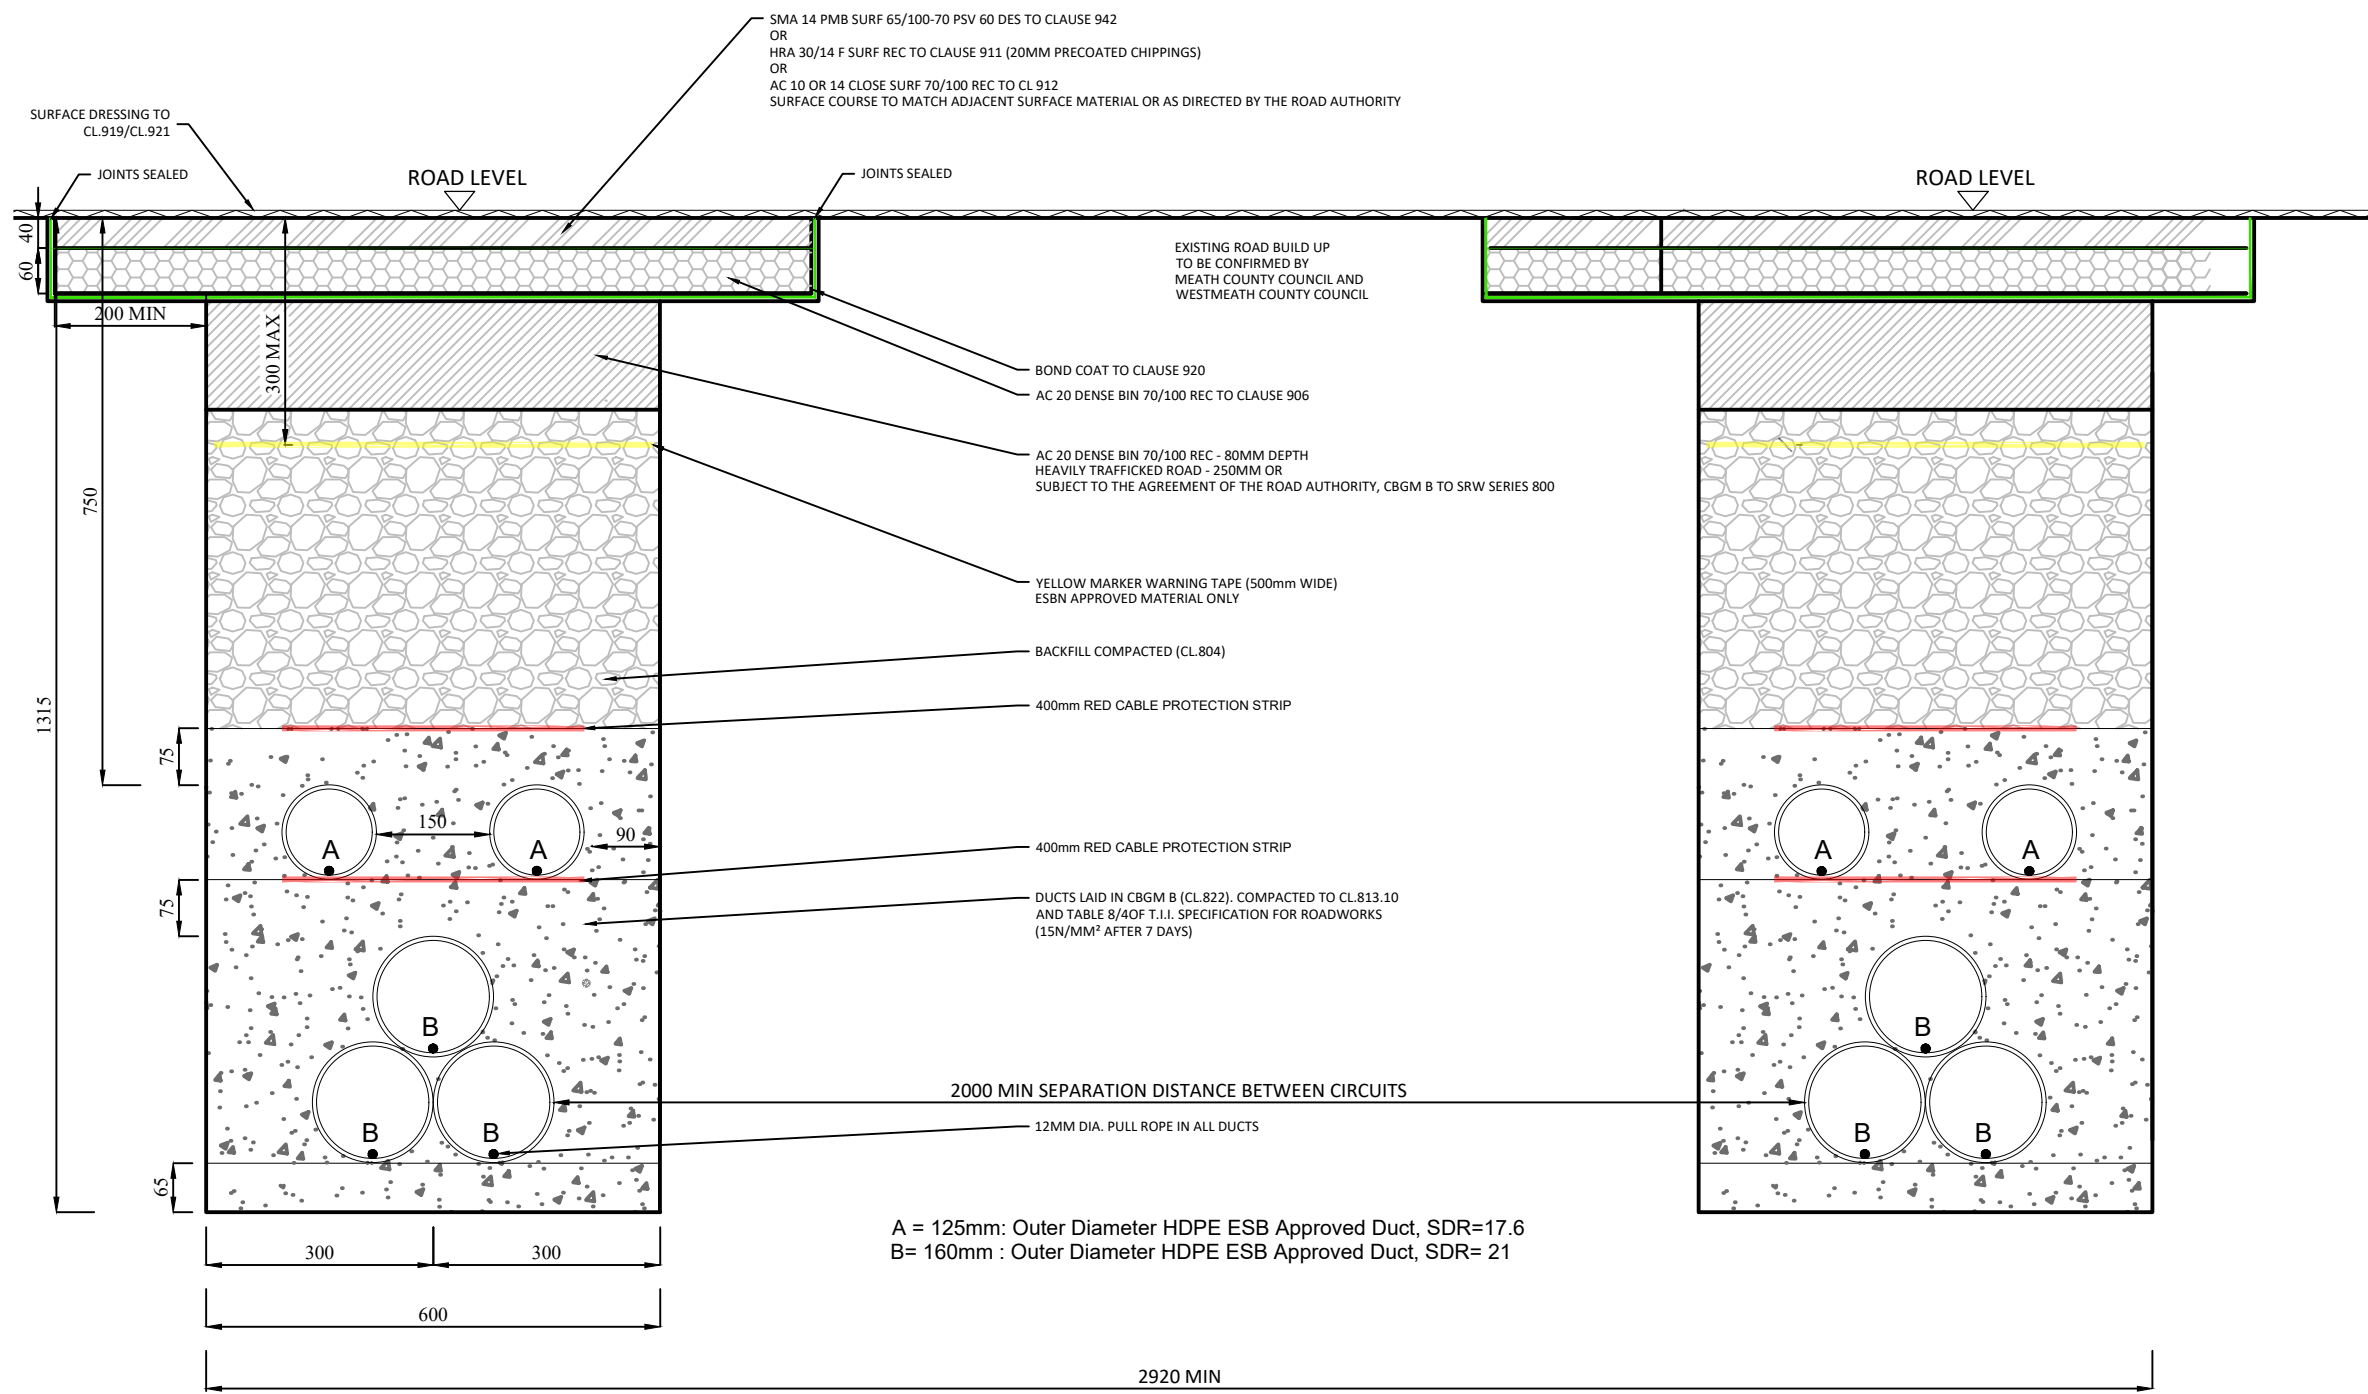

A = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6
 B = 160mm : Outer Diameter HDPE ESB Approved Duct, SDR= 21

TYPICAL 110KV CABLE TRENCH DETAIL THROUGH PUBLIC ROADWAY SECTION
 SCALE 1:10

- Notes:
- 1) All dimensions must be checked on site and not scaled from this drawing.
 - 2) All dimensions in millimetres unless otherwise stated.
 - 3) Dimensions may vary depending on site conditions.

Date:	Rev:	Description:	Drawn By:

Prepared By:



Galetech Energy Services
 Clondorgan, Stradone
 Co. Cavan, H12 NV06
 info@galetechenergy.com
 www.galetechenergy.com

Client: Bracklyn Wind Farm Limited

Job Title: Bracklyn Wind Farm

Drawing Title: Typical 110kV Cable Trench Detail Through Public Roadway

Drawing No.: BRK001PAS_EIAR_GA-0.09	Revision No.: Rev00
Scale: (A3) 1:10	Date: 27/07/2021
Drawn By: J.B.	Checked By: S.C.
	Confirmed By: D.O.