



TRENCH CROSS SECTION - PILOT CABLES

Scale 1:10

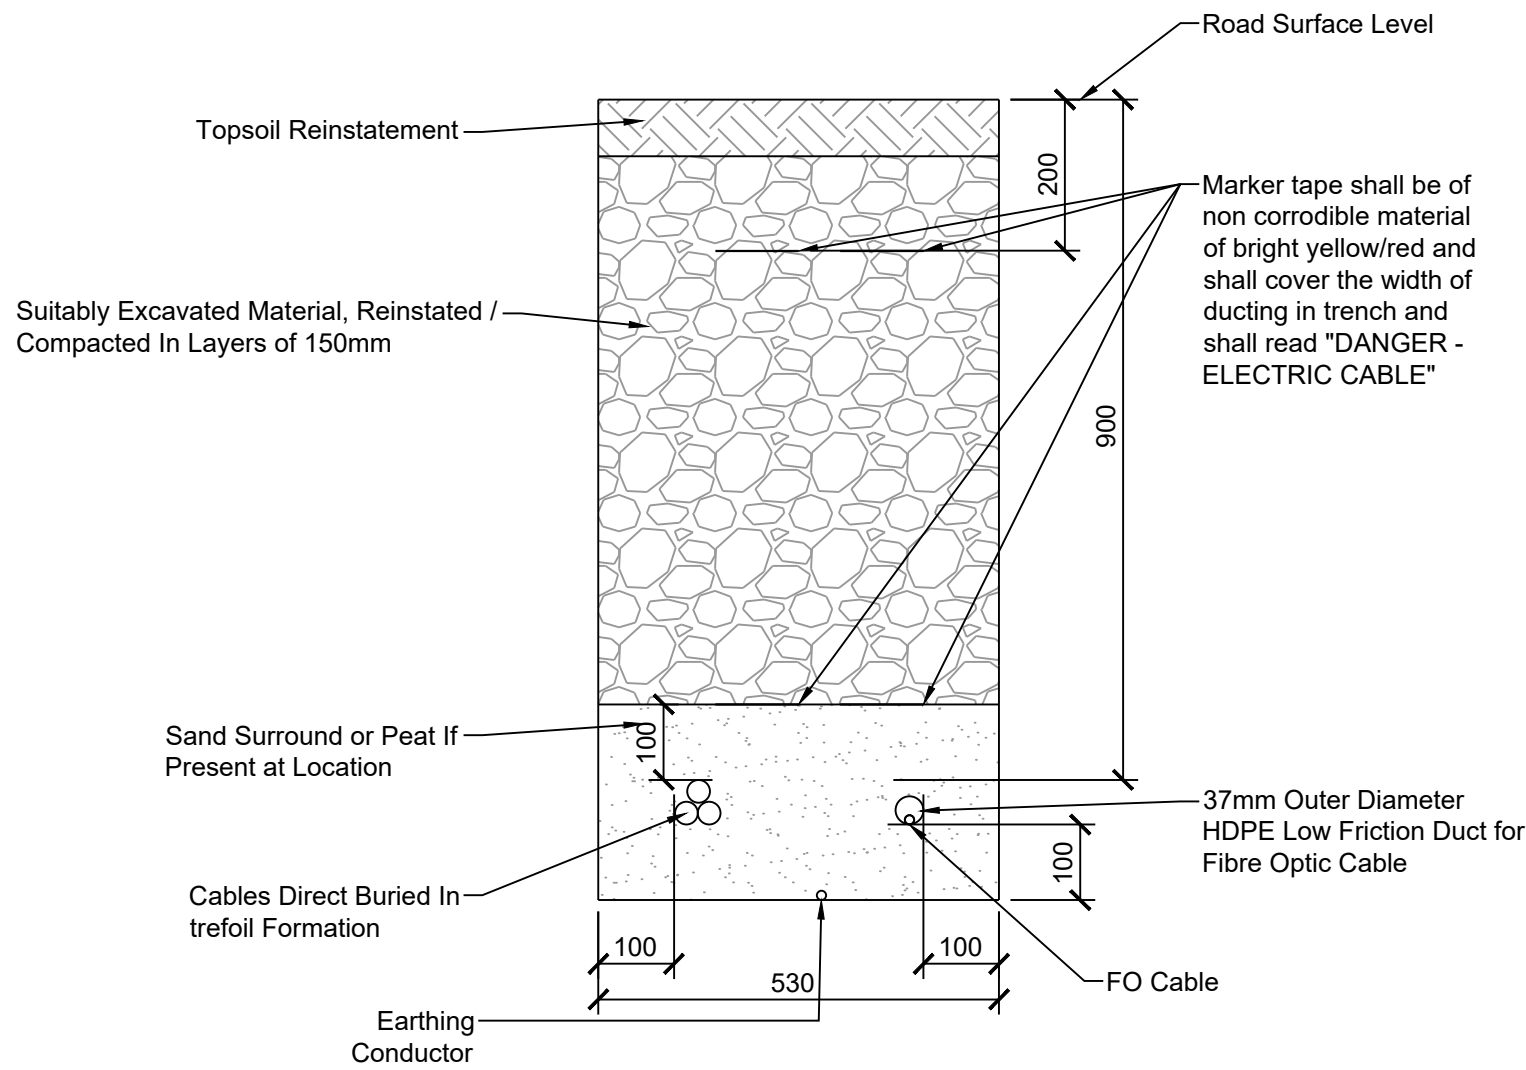

COLLECTOR CIRCUIT VERGE (DIRECT BURY)


Scale 1:10

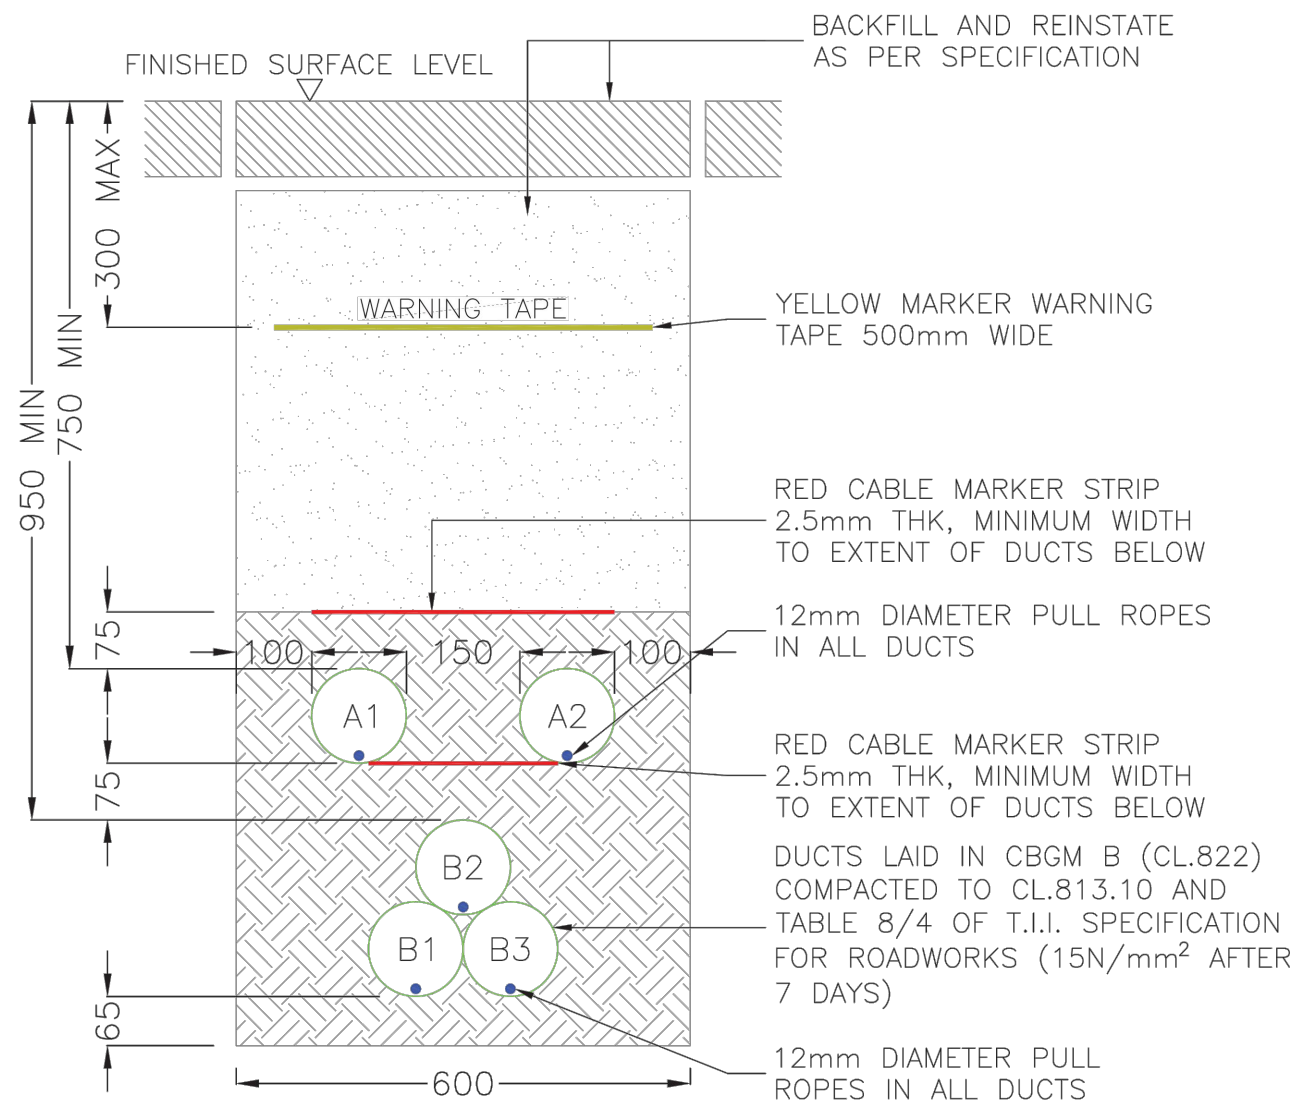

A=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6  
B=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6  
ALL DIMENSIONS IN MILLIMETERS

110kV SINGLE CIRCUIT TRENCH CROSS SECTION  
FOR POWER DUCTS IN TREFOIL FORMATION


Scale 1:10

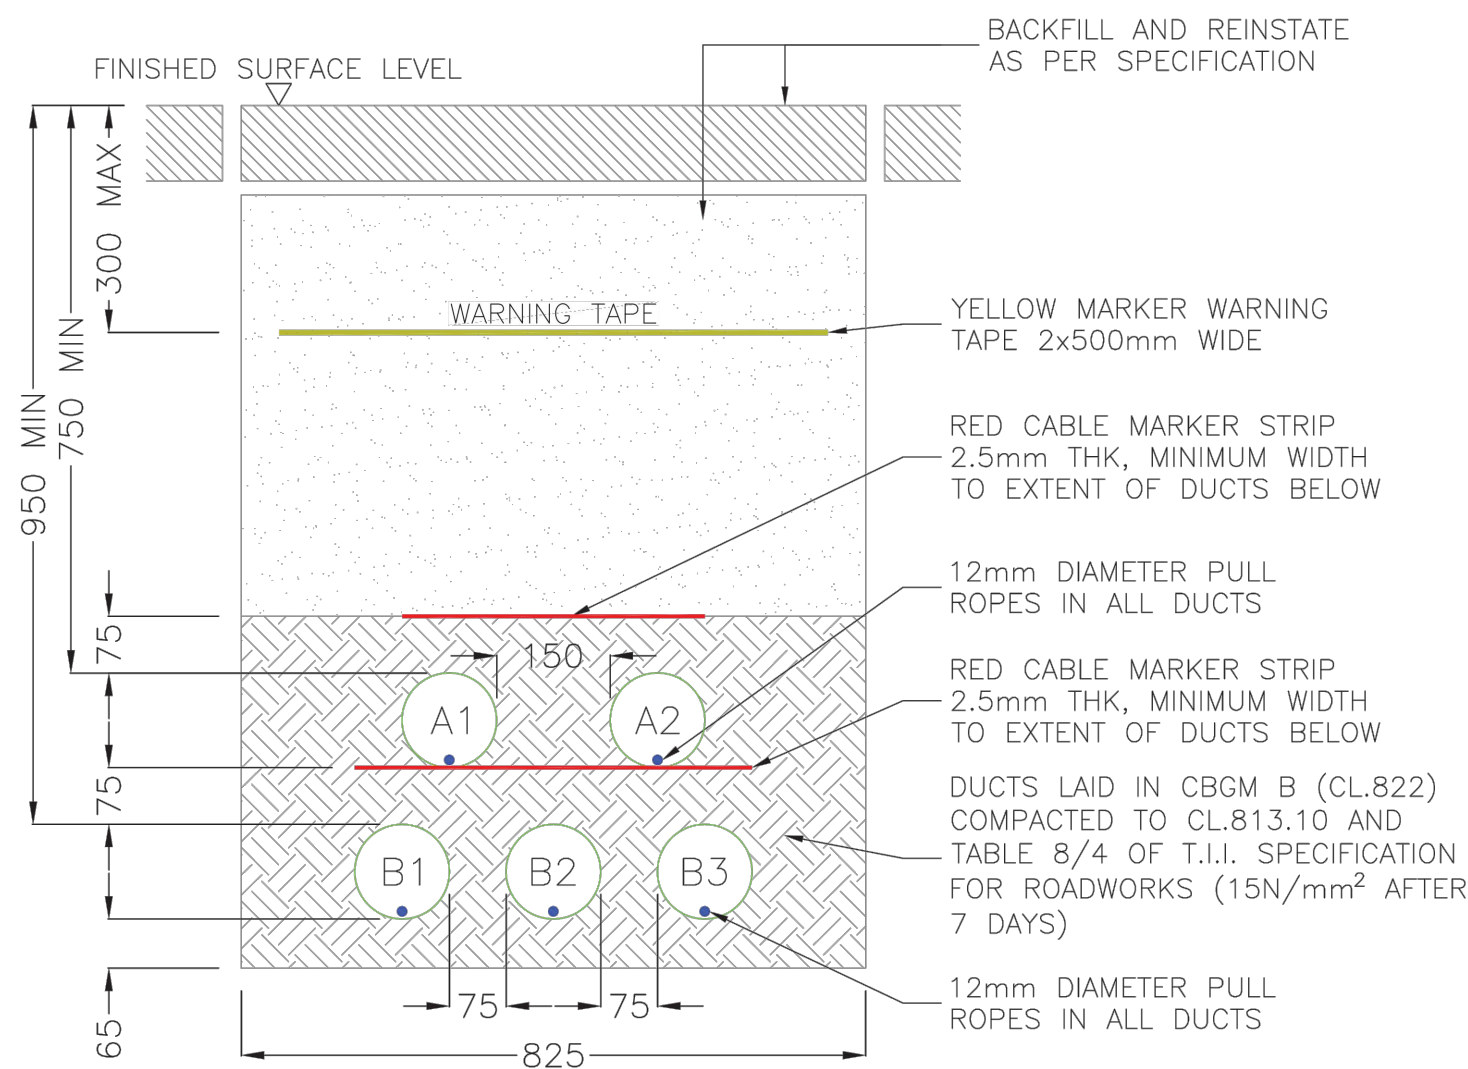

A=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6  
B=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6  
ALL DIMENSIONS IN MILLIMETERS


110Kv SINGLE CIRCUIT TRENCH CROSS SECTION  
FOR POWER DUCTS IN FLAT FORMATION

Scale 1:10

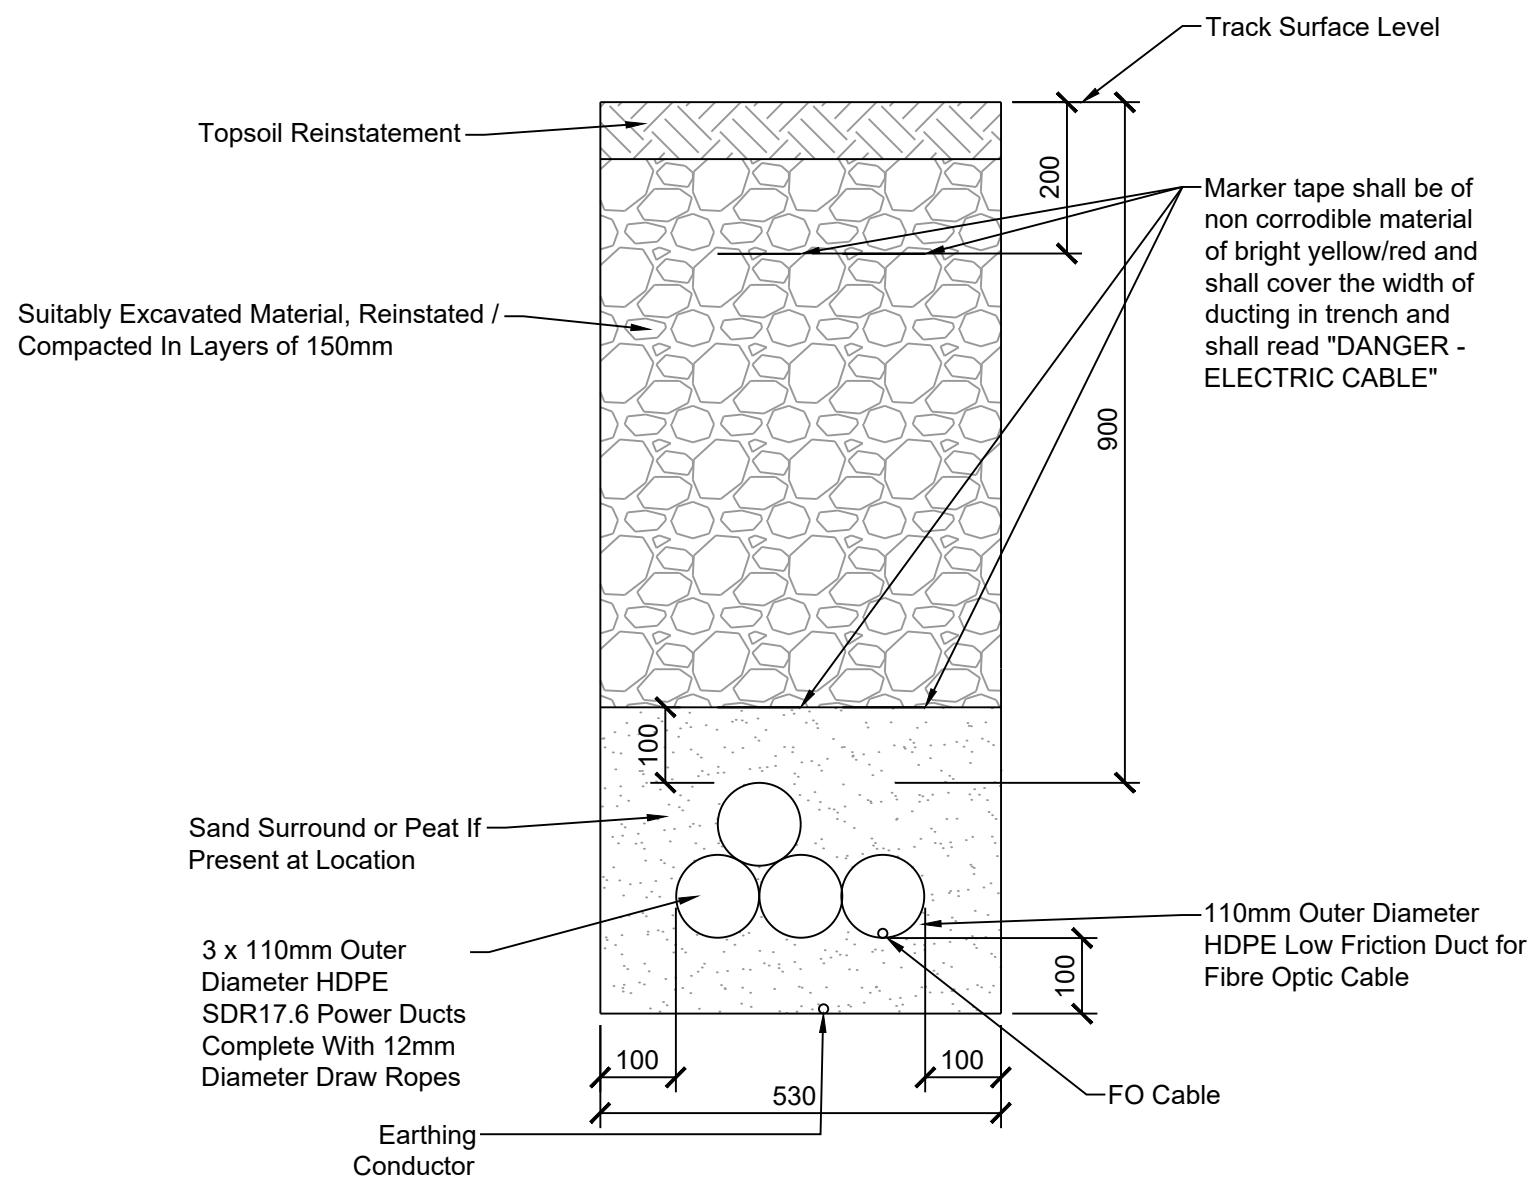


COLLECTOR CIRCUIT VERGE

Scale 1:10

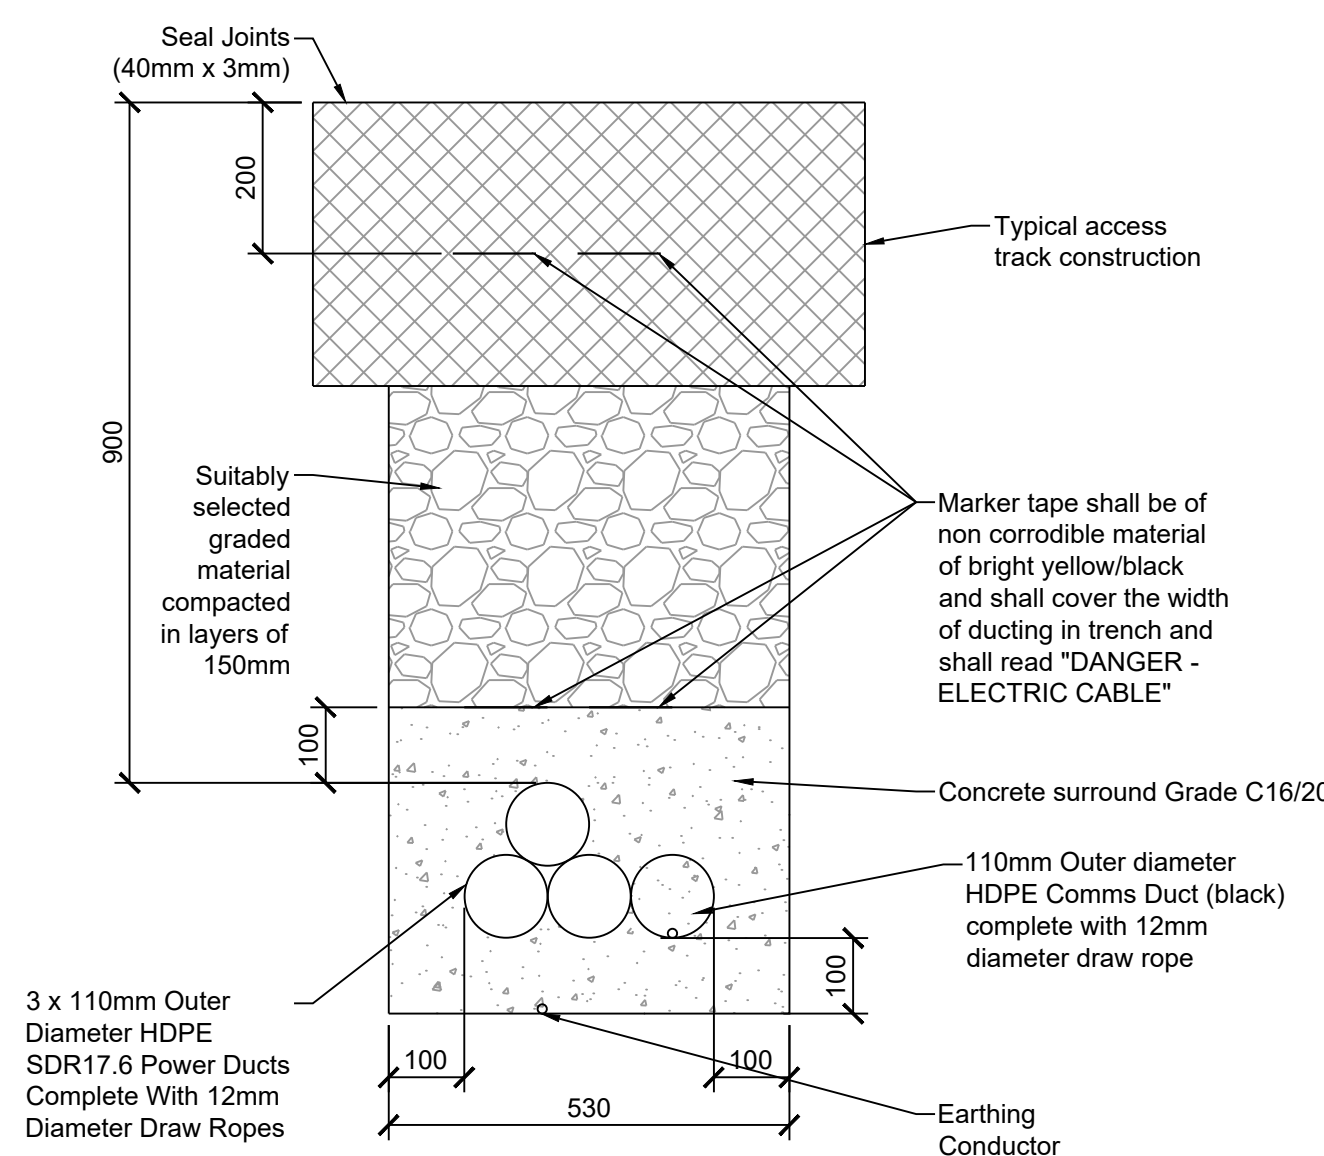

COLLECTOR CIRCUIT CENTRE

Scale 1:10

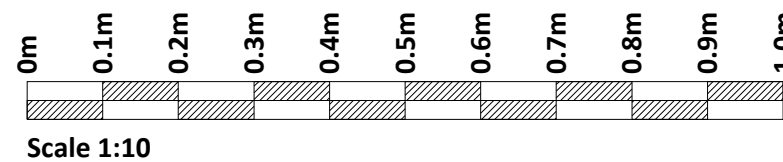

If Applicable : Ordnance Survey Ireland Licence No. EN 0001220 © Ordnance Survey Ireland and Government of Ireland  
OSI-6186,6140, Cork-40-48-49-59-60

Rev.	Description	App By	Date
A	ISSUE FOR APPROVAL	JH	15.12.21
B	ISSUE FOR PLANNING	JH	27.01.22

PROJECT	CLIENT		
BALLINAGREE WIND FARM	BALLINAGREE WIND DAC		
SHEET	Date	15.12.21	Project number
	Drawn by	NS	Drawing Number
	Checked by	TB	P2114-0300-0010
CABLE TRENCH DETAILS		Scale (@ A1-)	Rev
		1:10	B