


LEGEND

- LANDS OWNERSHIP BOUNDARY
- SID APPLICATION SITE BOUNDARY
- PROPOSED UNDER GROUND GRID ROUTE
- PROPOSED JOINT BOX
- GROUND LEVEL
- EX. 220KV CABLE ROUTE
- EX. CATV
- EX. CCTV_CABLE
- EX. EIR
- EX. ELECTRIC
- EX. FIBER OPTIC
- EX. FOUL
- EX. STORM
- EX. WATER
- EX. CATV2
- EX. EIRCOM
- EX. ELECTRIC
- EX. MAGNET
- EX. STREET_LIGHTING
- EX. WATER
- EX. 110KV CABLE ROUTE FROM INCHICORE

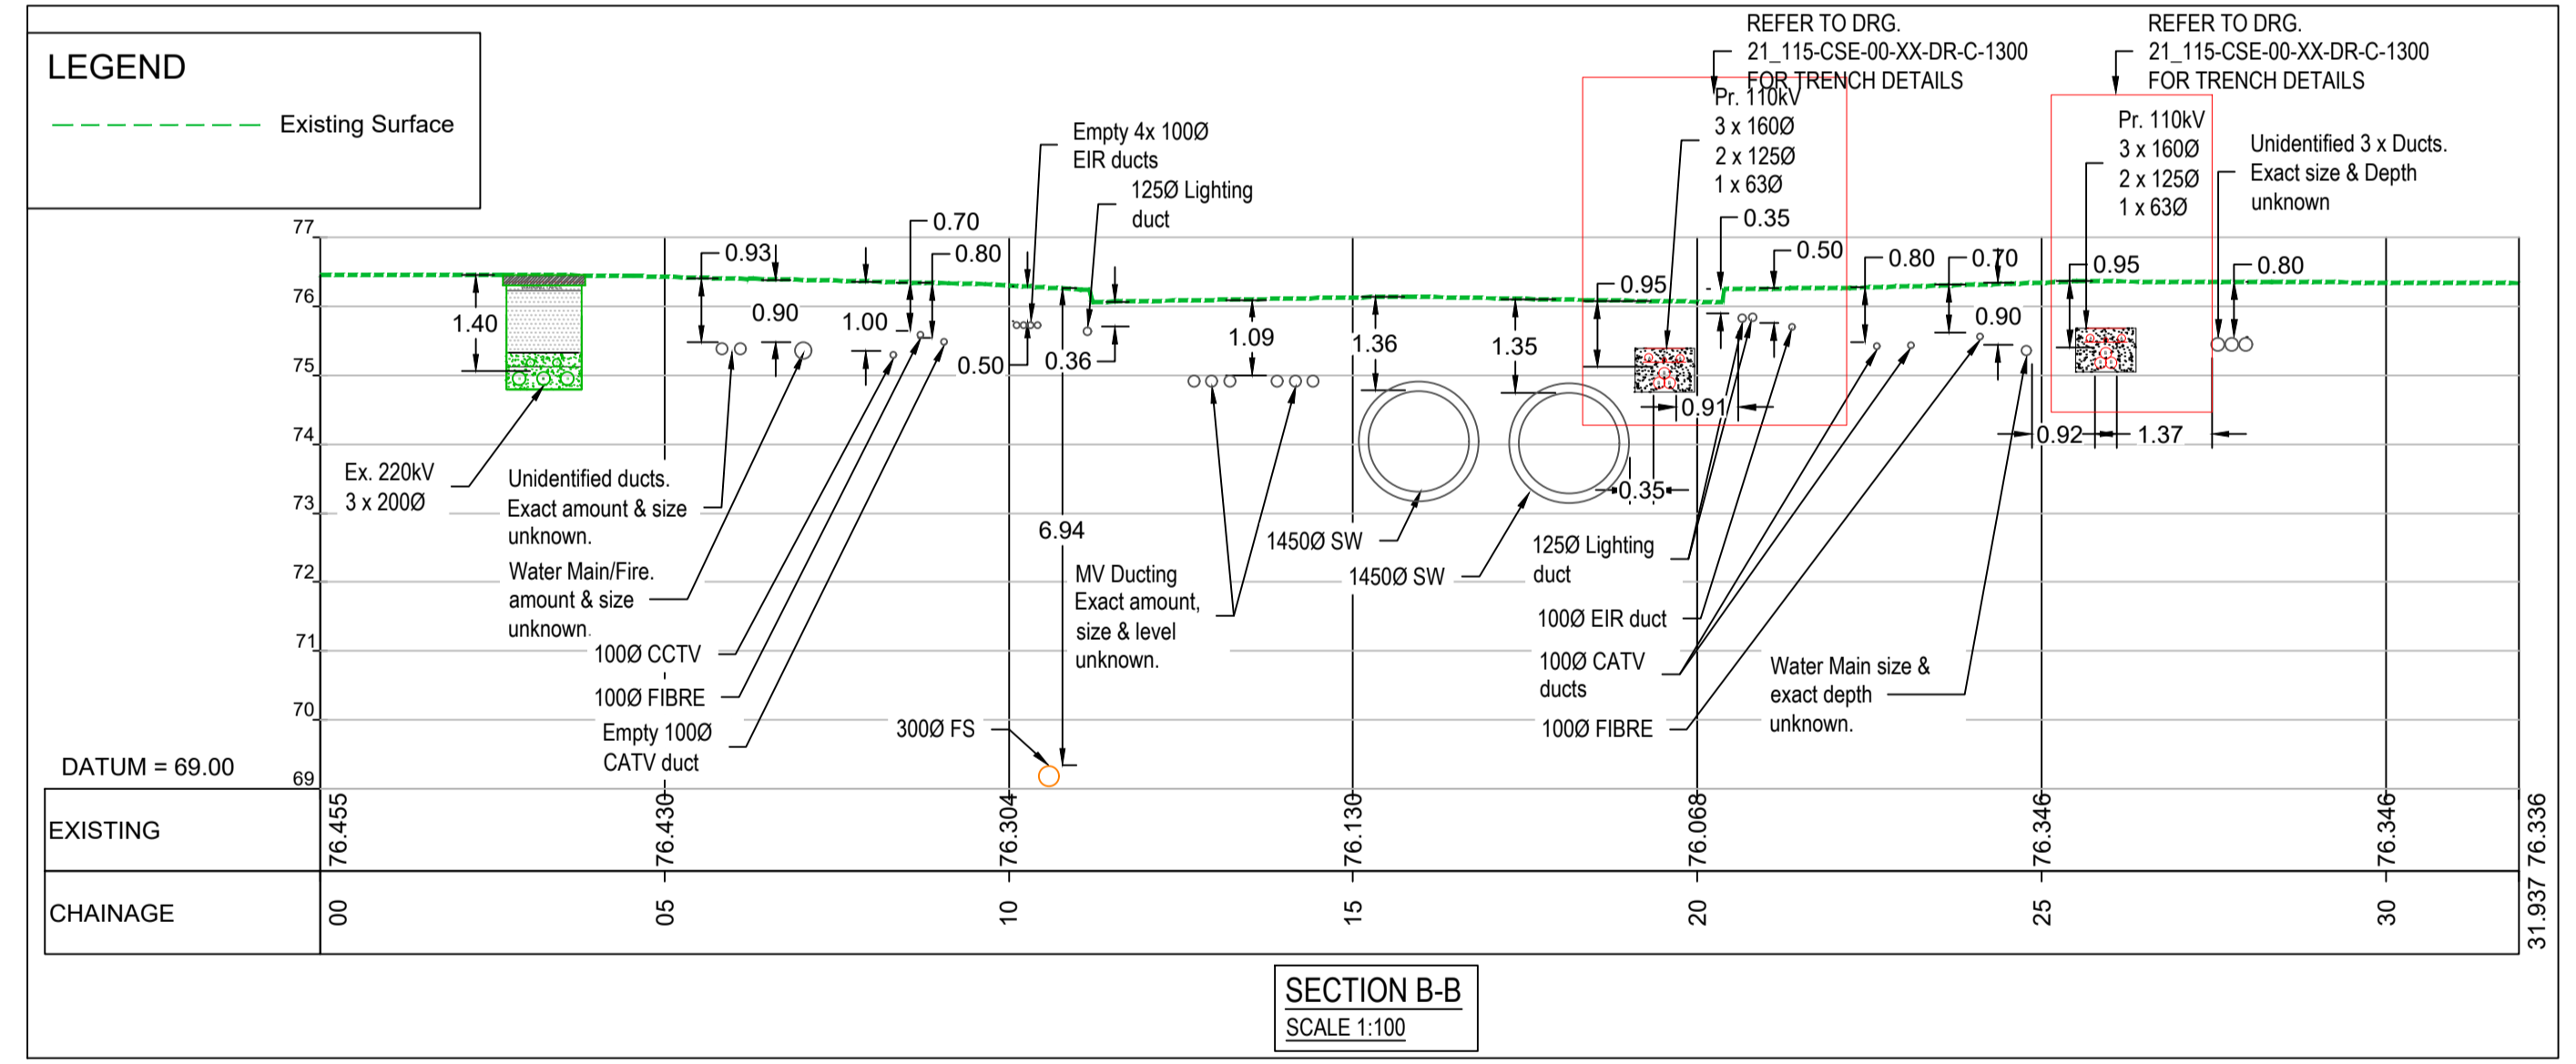

NOTE:
DEPTH & EXACT POSITION
OF EXISTING SERVICES TO
BE VERIFIED.

Rev	Description	Drawn	Checked	Date
P04	SID ISSUE	DM	PM	04.02.2022
P03	DRAFT SID ISSUE	DM	PM	10.12.2021
P02	SID SCHEME ISSUE	DM	PM	26.11.2021
P01	WIP	DM	PM	22.10.2021

Clifton Scannell Emerson Associates Limited
Consulting Engineers,
3rd Floor The Highline,
Bakers Point, Pottery Road,
Dun Laoghaire, Co. Dublin,
Ireland, A96 KW29

T. +353 1 288 5006
F. +353 1 283 3466
E. info@csea.ie
W. www.csea.ie

VANTAGE DATA CENTERS

Client: **KILCAREBRY 110KV SUBSTATION & MV CLIENT COMPOUND**

Project: **PROPOSED 110KV ROUTE LAYOUT PLAN & SECTIONS - SHEET 2**

Dwg. Title: **21_115**

Drawn By: **DM** Date: **OCT 2021**

Checked By: **PM** Scale: **1:250 @ A1**

Project Code: **21_115** Originator: **CSEA** Zone/Phase: **C** Level: **DR** Type: **C** Role: **DR** Dwg. No.:

21_115 - CSE - 00 - XX - DR - C - 1221

Status Code: **S2** Suitability Description: **PRELIMINARY**

Revision: **P04** Project Status: **PRELIMINARY**