
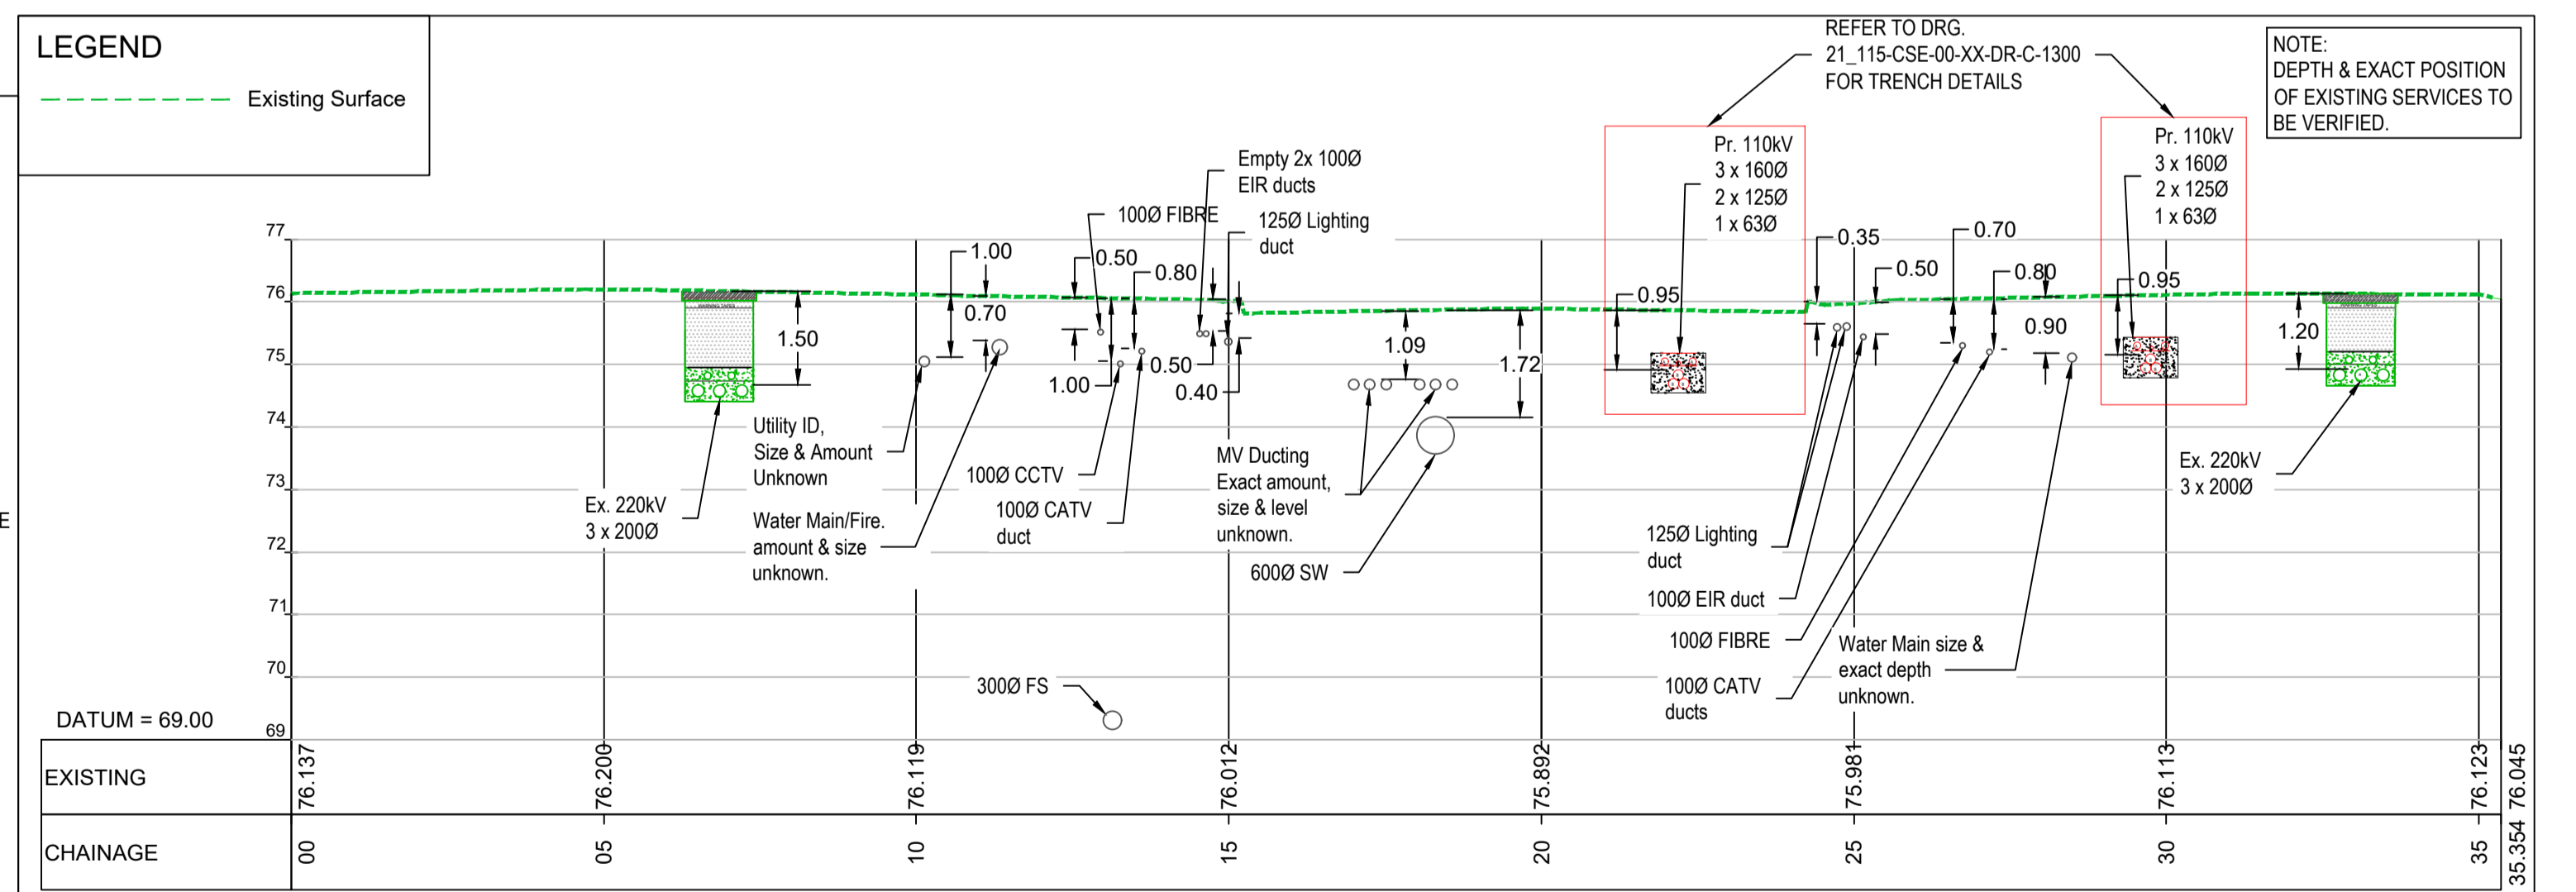


DRAWING IS PRODUCED USING THE IRISH TRANSVERSE MERCATOR (ITM) GEOGRAPHIC COORDINATE SYSTEM **A1**

KEYPLAN
SCALE: 1:3000

LEGEND

- PROPOSED DEVELOPMENT
- LANDS OWNERSHIP BOUNDARY
- SID APPLICATION SITE BOUNDARY
- PROPOSED UNDER GROUND GRID ROUTE
- PROPOSED JOINT BOX
- GROUND LEVEL
- EX. 220kV CABLE ROUTE
- EX. CATV
- EX. CCTV_CABLE
- EX. EIR
- EX. ELECTRIC
- EX. FIBER OPTIC
- EX. FOUL
- EX. STORM
- EX. WATER
- EX. CATV2
- EX. EIRCOM
- EX. ELECTRIC
- EX. MAGNET
- EX. STREET_LIGHTING
- EX. WATER
- PROPOSED SW NETWORK
- PROPOSED FS NETWORK
- PROPOSED 38mmØ (PE 80 SDR 11) WM
- PROPOSED 100mmØ (PE100 SDR 17) WM
- PROPOSED RURAL SUPPLY

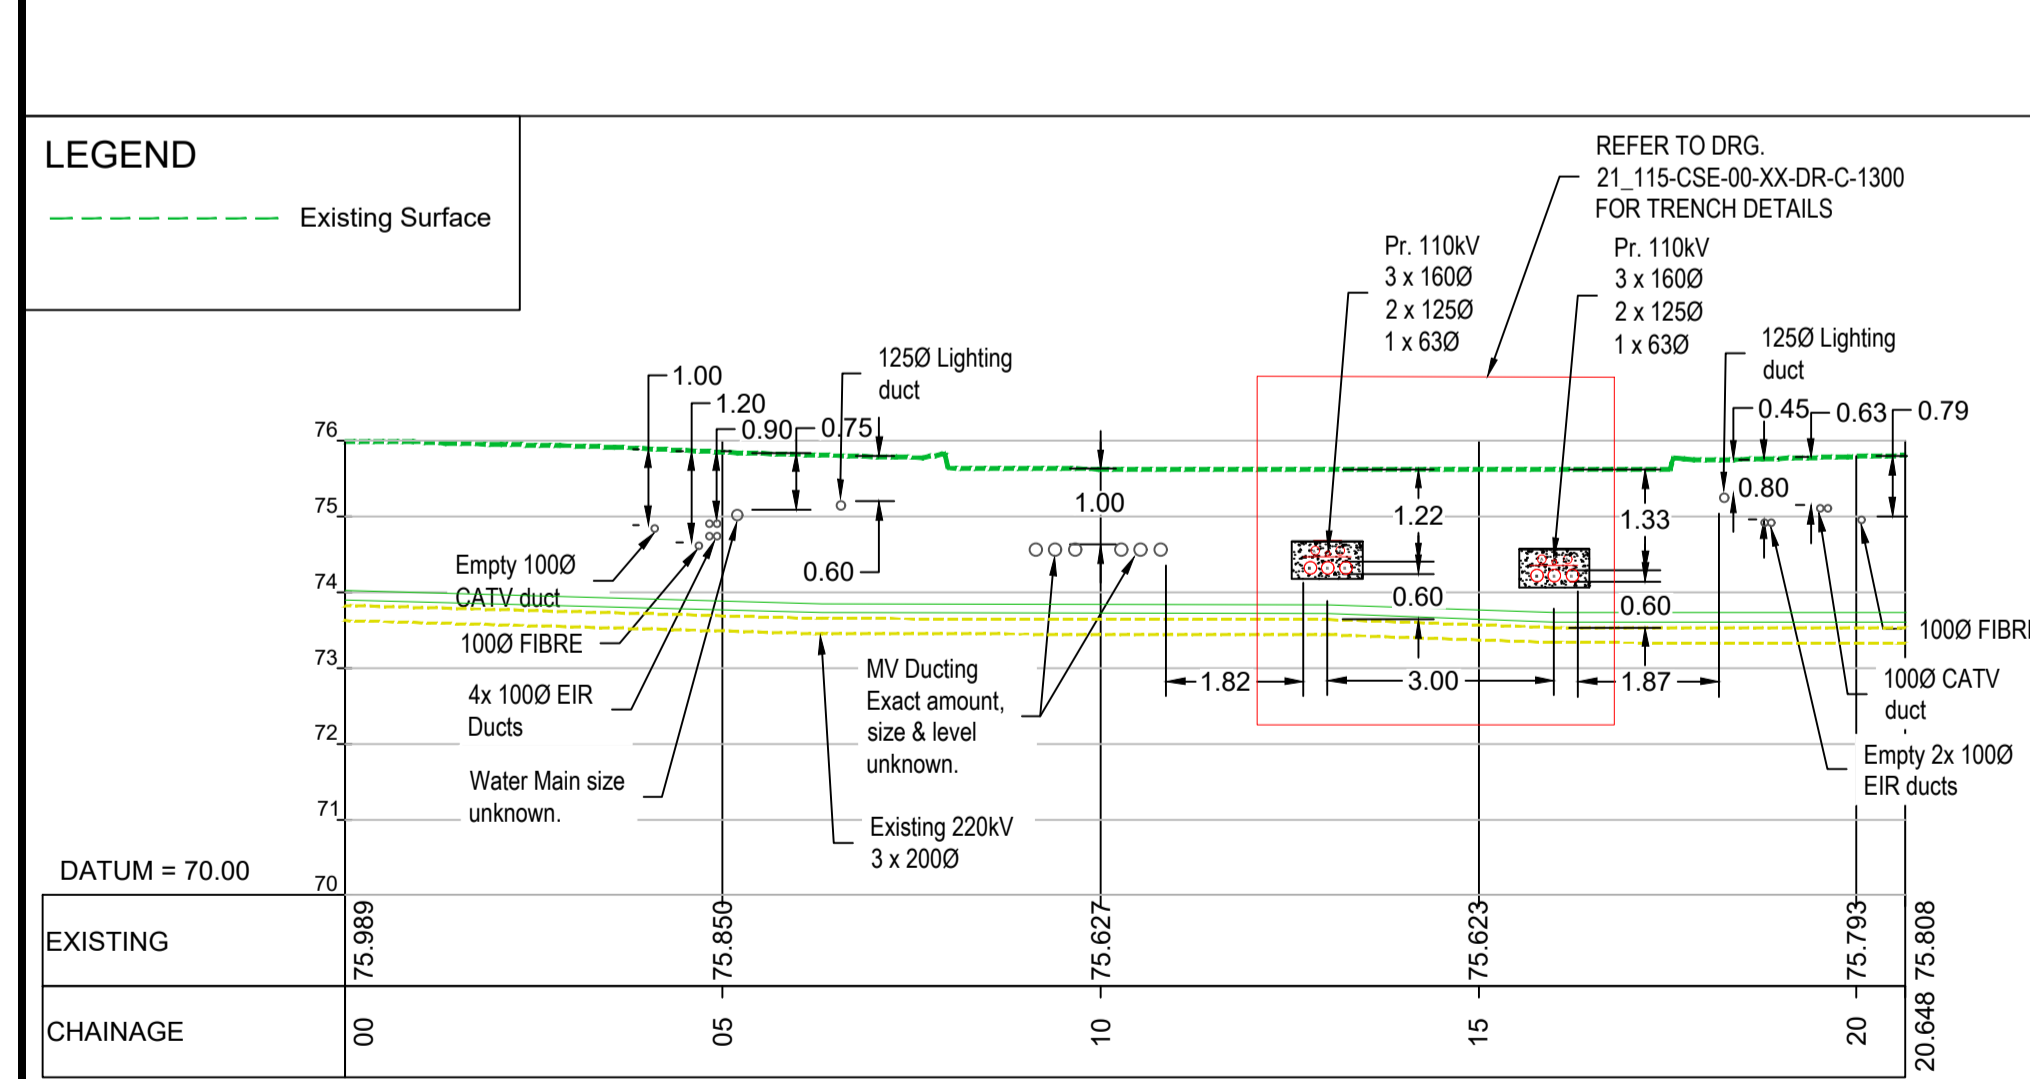

SECTION D-D
SCALE 1:100

SECTION C-C
SCALE 1:100

Rev	Description	Drawn	Checked	Date
P04	SID ISSUE	DM	PM	04.02.2022
P03	DRAFT SID ISSUE	DM	PM	10.12.2021
P02	SID SCHEME ISSUE	DM	PM	26.11.2021
P01	WIP	DM	PM	22.10.2021

Clifton Scannell Emerson Associates
Clifton Scannell Emerson Associates Limited
Consulting Engineers,
3rd Floor The Highline,
Bakers Point, Pottery Road,
Dun Laoghaire, Co. Dublin,
Ireland, A96 KW29
T: +353 1 288 5006
F: +353 1 283 3466
E: info@csea.ie
W: www.csea.ie

VANTAGE DATA CENTERS

Client: **KILCARBERY 110KV SUBSTATION & MV CLIENT COMPOUND**

Project: **PROPOSED 110KV ROUTE LAYOUT PLAN & SECTIONS - SHEET 3**

Dwg. Title: **21_115**

Drawn By: **LT** Date: **02_11_2021**

Checked By: **PM** Scale: **1:250 @ A1**

Project Code: **21_115 - CSE - 00 - XX - DR - C - 1222**

Status Code: **S2** Suitability Description: **PRELIMINARY**

Revision: **P04** Project Status: **PRELIMINARY**