

# Daylight Reception Report

## DAYLIGHT RECEPTION IN HABITABLE ROOMS WITHIN THE PROPOSED DEVELOPMENT

Phase 1 - The Meadows - Bessborough

Proposed Residential Development

Bessborough, Ballinure, Blackrock, Co. Cork

Estuary View Enterprises 2020 Ltd

DKP-M88-5020-2P 2022-02-23

## 5020

### Document control

DKP project no: M88 DKP document no: 5020 Project file no: DKP-M88-5020

Circular	Issue >	· 1P#	1P	2P
Clients Architects Planning consultants	Estuary View Enterprises 2020 Ltd Shipseybarry Architects HW Planning	V V	<b>V</b>	5

Issue	1P#	2021-08-31	Draft issue
Issue	1P	2021-09-06	SHD issue
Issue	2P	2022-02-23	SHD updated issue

#### Document issue status ID

- # Sketch/draft
- P Planning
- C Concept
- D Design
- G General information
- T Tender
- W Works/construction
- Z As-build/constructed

Issue	Prepared	Checked	Approved
1P#	201	208	208
1P	208	208	201
2P	208	208	201

ING Gerard (Craig) van Deventer CEng., BE(mech)., HDip CIOB, MCIBSE

M : [00] 353 (0)87 260 8080 E : gerard@dkpartnership.com

DKPartnership 70 Main Street, Applewood , Swords, Co. Dublin, Ireland Reen Kenmare Co. Kerry

post@dkpartnership.com www.dkpartnership.com

T : [00] 353 (0) 1813 1930 T : [00] 353 (0)64664 1686

## Contents

Section		Page
1	Introduction	4
2	Executive summary	5
3	Geographical project overview	7
4	Approach and methodology	8
5	Basis of receptor (room) selection and calculation results	11

## 1 Introduction

#### 1.1 Report purpose

This report gives information on the level of achieved daylight reception in habitable rooms within the proposed new development.

#### 1.2 Instruction

DKPartnership (DKP) have been commissioned by Estuary View Enterprises 2020 Ltd, to carry out the analysis and report for the proposed development at Bessborough, Co. Cork.

#### 1.3 Development description

Estuary View Enterprises 2020 Limited are seeking planning permission for a mixed use strategic housing development of 420 no. build to sell residential units with two creches, a café, tenant amenities, landscaping, pedestrian/cycleway infrastructure and associated site development works at Bessborough, Ballinure, Blackrock, Cork. The proposed development comprises two planning applications to An Bord Pleanála and includes two distinct phases, namely 'The Meadows' (Phase 1) and 'The Farm' (Phase 2).

#### 1.4 Policy and building regulation requirements

There are no particular building regulations in relation day light/shadow effect standards other than recommendations outlined or referred to in the CIBSE lighting guide 10, BS EN17037/EN17037 and the BRE document" Site layout planning for daylight and sun light".

## 2 Executive summary

#### 2.1 Analysis conducted

This report details the achieved calculated daylight reception in habitable rooms within the new development and compares these for compliance with the recommendations of the relevant guidelines and standards.

#### 2.2 Daylight reception and building orientation

Day light reception in habitable rooms within the proposed development under the BRE, CIBSE and BS EN17037/EN17037 is calculated using the area of the glazed element, the room depth/height ratio, the room light reflection capability and the amount of direct or blocked/partially blocked daylight it receives. i.e. building orientation is not relevant to day light reception or daylight reception calculations. In other words day light factor analysis is equal to all orientations. This note is for clarity as day light is often confused with sunlight or sunlight energy which is effected by orientation.

#### 2.3 Guidelines and standards applied

For this report we applied the recommendations and guideline of the following;

- The Building Research Establishment (BRE) report, site layout planning for daylight and sunlight a guide to good practice (referred to as the BRE Report).
- British European Standard BS EN17037/EN17037 Day lighting standards and contains guidance on the minimum recommended levels of interior day lighting.
- CIBSE guide 10 Day light and lighting for buildings.

#### 2.4 Technical analysis

The amount of daylight received in a room is calculated and expressed as a daylight factor. This calculated daylight factor is then compared with the BRE recommended room daylight factor to ensure sufficient daylight reception. Calculations were conducted in accordance with the BRE guidelines to determine the average day light factor in a number of selected rooms within the new development. These selected rooms are generally in (daylight) challenging locations typically based at the lowest (ground floor) levels given that these would receive the least amount of day light. Once the ground floor rooms achieve compliance all other rooms at higher levels with similar room/window configurations and parameters will also achieve compliance as the vertical daylight impact angle will improve increasing the daylight reception typically 0.3%-0.5% per floor level (3m).

#### 2.5 Daylight reception in rooms within the new development conclusion

The BRE report recommends as a methodology for assessing sufficient daylight reception in a habitable room, that the calculated average daylight factor (ADF) of a habitable room to be in excess of the BRE bench marks of a kitchen at 2%, a living room at 1.5%, a bedroom at 1% and a living room/bedroom at 1.5%. Calculation findings are as follows (see image 5.1–5.7 for receptor/room locations):

#### Ground floor (level 00)

- Block A: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block B: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block C: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines.
- Block D: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.

#### First floor (level 01)

- Block A: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block B: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines.
- Block C: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block D: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.

#### Second floor (level 02)

- All floors above the first floor apartments are further deemed compliant as they naturally would have an improved vertical daylight impact angle thus increasing the daylight reception factor typically 0.3%-0.5% per floor level.

Given the results and conclusions above we, DKP, deem the proposed project to be in compliance with the recommendations in the BRE design guidelines 'site layout and planning for daylight and sunlight - a guide to good practice'.

#### 2.6 Mitigation measures/actions

No mitigation measures anticipated.

## **3** Geographical overview

#### 3.1 Project overview

Image 3.1 the (google) site map below indicates the location of the site area approximately outlined.



Image 3.1 proposed development site outline



## 4 Approach and methodology

#### 4.1 General approach

This report covers the day light reception of habitable rooms within the new proposed development. The day light reception is expressed as the average day light factor (ADF) in the following rooms:

- Bed rooms within dwellings
- Living rooms/dining rooms
- Kitchens
- Any combination of the above

#### 4.2 The nature and effects of day light and sun light

When assessing the effects of proposed building projects on the potential to cause issues relating to light, it is important to recognise the distinction between daylight and sunlight. Daylight is the combination of all direct and indirect sunlight during the daytime, whereas sunlight (for the purposes of this report) comprises only the direct elements of sunlight. For example, on a cloudy or overcast day diffused daylight still comes in through windows, even when sunlight is absent. Any development within a built-up area has the potential to alter the amount of daylight received by nearby residential properties.

Care should be taken when designing new buildings in built-up areas, especially when the proposed development is relatively tall or situated to the south of existing buildings, because in the northern hemisphere the majority of the sunlight comes from the south. In Ireland (and other northern hemisphere countries) south-facing facades will in general, receive the most sunlight, while the north facing facades will receive sunlight on only a handful of occasions, specifically early mornings and late evenings during the summer months. It is therefore important to ensure that new buildings to the south of any development do not cause over shadowing to existing dwellings and therefore reduce their capacity to receive sunlight.

#### 4.3 Assessment criteria

#### National Policy/building regulations:

The government does not have an adopted policy on daylight, sunlight and the effects of overshadowing, and does not have targets, criteria or relevant planning guidance in the way it has for other environmental impacts such as noise, landscape or air quality. However, there are a number of guidance documents which are relevant when considering daylight, sunlight and overshadowing in dwellings:

- The Building Research Establishment (BRE) report, "Site layout planning for daylight and sunlight a guide to good practice (referred to as the BRE Report).
- Although not Government guidance, this report is commonly referenced as the main guide in Ireland/UK in determining the minimum standards of daylight and sunlight and for determining the impact of a development.
  British European Standard BS EN17037 / EN17037 Day Lighting for buildings.
- BS EN17037/EN17037 contains guidance on the minimum recommended levels of interior day lighting and introduces some of the calculation procedures used in the BRE Report.
- CIBSE guide 10 Day light and lighting for buildings.
   CIBSE lighting guide 10, BS EN17037/EN17037 contains guidance on the minimum recommended levels of interior day lighting and introduces recommended day light levels for general buildings.

#### 4.4 The BRE Report – "Site Layout and Planning for Daylight and Sunlight – A Guide to Good Practice"

The BRE report contains guidance on how to design developments whilst minimising the impacts on existing buildings from overshadowing and reduced levels of daylight and sunlight. The advice provided within the guide is not mandatory and should not be seen as an instrument of planning policy, its aim is to help rather than constrain the designer. Although it gives numerical guidance values these should be interpreted flexibly since natural lighting is one of many factors in site layout design. The guidance should be applied appropriately to developments to assist in gaining the best development possible without adverse impacts.

As well as advice the report contains a methodology to assess levels of daylight, sunlight and over shadowing and contains criteria to determine the potential impacts of a new development on surrounding buildings. Table 4.1 below details the BRE assessment criteria for daylight reception within the proposed development.

Analysis	Description	Acceptable parameters
Daylight reception criterion	Average daylight factor (ADF)	Habitable rooms to have ADF factors between 1% and 2% pending room type
Table 4.1		

There are also recommendations with regards to minimum proposed glazed area in facades in relation to the available sky view component angle. BS EN17037/EN17037 gives guidance on the minimum glazed area with different virtual sky component angles to maintain sufficient daylight reception. Table 4.2 presents the minimum glazed areas fractions relative to the available sky view angle.

Room depth	VSC <=25°	VSC >=25° <=45°	VSC >=45° <=65°	VSC >=65°	Comments
1 to 8	20%	20% - 31%	31% - 35%	35% - 40%	
8 – 11	25%	25% - 40%	40% - 44%	44% - 50%	
11 – 14	30%	30% - 47%	47% - 53%	53% - 60%	
14 - 20	35%	35% - 54%	54% - 61%	61% - 70%	

Table 4.2

#### 4.5 ADF or Average day light factor

The average day light assessment is the amount of day light received by the habitable rooms in the proposed development only. Whereas there are no standards applied for day light factors there are recommendations published in the CIBSE guides and BRE documents in relation to the percentage and minimum area of the room/area to conform to same. Table 4.4 below represents recommended minimum day light factors.

Habitable room types		Minimum day light factor	Minimum floor area cover
Multi-residential buildings	Kitchen	2%	75%
Multi-residential buildings	Living rooms, dining rooms,	1.50%	70%
Multi-residential buildings	Bedrooms	1%	50%
Table 4.3			

Table 4.3

#### 4.6 ADF or Average Daylight Factor calculation method

The average daylight factor provides a useful technique for assessing the daylight potential of interior spaces under standard overcast conditions. The average daylight factor *df* is defined as;

 $df = TAw q / [A (1-R^2)] \%$ 

where.

T is the diffuse visible transmittance of the glazing, including corrections for dirt on glass

Aw is the net glazed area of the window (m<sup>2</sup>)

A is the total area of the room surfaces: ceiling, floor, walls and windows (m<sup>2</sup>)

R is their average reflectance of the ceiling, walls and floor surfaces

q is the angle of visible sky in degrees (VSC)

#### 4.7 Project ADF calculation parameters


The following calculation parameters have been applied. For T (Em), the overall maintained light transmittance into the room we applied a conservative 0.66. Current triple glazed elements can now be supplied with light emittance in excess of 0.72 effecting/improving the final resultant ADF by a further 0.3% to 0.5%.

Glass light emittance	0.72
Glazing maintenance factor	8%
Maintained light emittance Em	0.66

For R (Rf), the average reflectance of the walls, ceiling and floor we have used an overall average figure 0.61 representing a dark floor, medium dark walls and a light ceiling. R can also be significantly improved by implementing lighter colours on the walls and floor effecting/improving the ADF by 0.5% to 0.7%.

Ceiling	0.8	95%	Light
Walls	0.6	80%	Medium dark
Floor	0.4	70%	Dark
Combined Rf	0.61		

For g, the vertical sky component angle we use the combined calculated vertical sky component over the full visual horizontal plane from the relevant window/room point. i.e. at each obstacle in the general 180° horizontal view plane the vertical sky component is measured and combined to form the overall resultant VSC. The illustration 4.1 below shows the room analysed to be effected by 3 different vertical sky component angles A, B and C on its horizontal plane. The resultant VSC is a calculated combination of all three VSC angles.

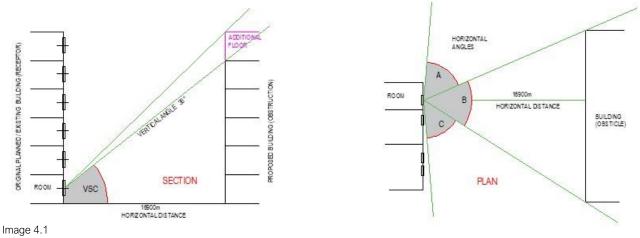



### 5 Basis of receptor selection of habitable rooms within the development and Calculation results

#### 5.1 Basis of receptor (room) selection

The daylight reception assessment has been targeted to rooms which are perceived to receive less day light i.e. ground floor rooms / rooms facing close-by large obstacles. Once a (lowest level) room is compliant, rooms at higher levels with similar configuration / parameters are deemed compliant on the basis that the room daylight factor would have improved due to the better vertical sky view angle of higher located rooms. A combined total of 85 room locations have been selected on the basis that these locations are more daylight challenging.

Image 5.1 and 5.2 indicate the locations of the rooms chosen from the residential apartment blocks A, B, C and D.

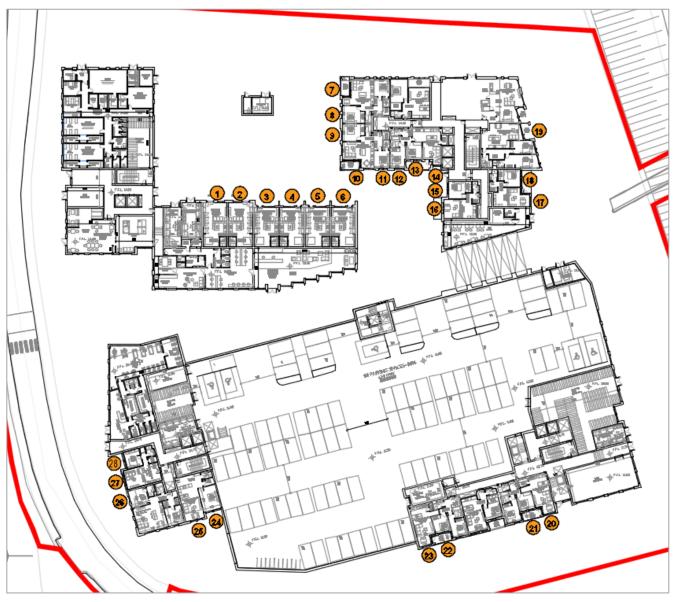


Image 5.1: Level 00 with selected rooms



Image 5.2: Level 01 with selected rooms

#### 5.2 Assessment approach and colour indicators

The tables below provide the full calculation results of the selected rooms including the overall calculated vertical sky component together with the 'to-be-achieved' BRE minimum daylight factor standards. Note: The ADF calculation results have been given the following colour code guide depending on its level of resulting compliance.

#### Compliance guide

$\checkmark$	0% Over /equal to
V	5% Within
11	10% Within
x	10% In excess of

#### 5.3 ADF calculation results

L		Receptor		eptor	Hor S	ec a	Hor S	Sec b	Hor S	Sec c	Hor S	Sec d	.		glass		Room		Room	BRE
Receptor	×	₽	-		Hor	Vert	Hor	Vert	Hor	Vert	Hor	Vert	Hor L	VSC	area	width	depth	height	ADF	ADF
Rec	Block	Unit ID	Level	Room / type	∟°	∟°	∟°	∟°	∟°	∟°	∟°	∟°	Σн	Σ	m2	m	m	m	%	%
1	А	A.0.1	00	Living - Bedroom	65	50	70	5	37	50	8	22	180	25%	3.40	5.00	7.50	2.70	1.52	1.50
2	A	A.0.2	00	Living - Bedroom	57	45	72	5	45	54	6	24	180		3.40	5.00	7.50	2.70	1.54	1.50
	А	A.0.3	00	Living - Bedroom	50	41	72	5	51	62	7	26	180	25%	4.00	5.00	6.80	2.70	1.91	1.50
	A	A.0.4	00	Living - Bedroom	44	35	68	5	59	70	9	34	180		4.00	5.00	6.80	2.70	1.80	1.50
	A	A.0.5	00	Living - Bedroom	40	31	61	5	71	74	8	37	180	22%	4.00	5.00	6.80	2.70	1.66	1.50
	A	A.0.6	00	Living - Bedroom	35	28	48	5	84	74	13	41	180	20%	4.00	5.00	6.80	2.70	1.51	1.50
7		B.0.3	00	Living - Kitchen	42	85	9	23	45	28	84	5	180	25%	4.80	4.85	6.50	2.70	2.48	2.00
8	В	B.0.3	00	Bed room	63	36	41	29	76	5			180	29%	2.70	3.55	3.70	2.70	3.06	1.00
9		B.0.2	00	Bed room	67	38	41	29	72	5			180	28%	3.06	3.55	3.70	2.70	3.39	1.00
10	В		00	Living - Kitchen	94	80	48	60	38	26			180	12%	6.30	3.55	3.70	2.70	2.78	2.00
11		B.0.2	00	Bed room	75	59	51	26	54	55			180	18%	2.52	3.10	4.00	2.70	1.79	1.00
12	В	B.0.1	00	Bed room	67	55	51	26	62	60			180	18%	2.88	2.85	4.00	2.70	2.16	1.00
13	В	B.0.1	00	Bed room	85	80	51	26	44	62			180	13%	2.52	3.25	3.55	2.70	1.35	1.00
14	В	B.0.1	00	Living - Kitchen	7	20	45	29	42	20	86	48	180	23%	3.30	3.85	5.80	2.70	2.00	2.00
15	В	B.0.8	00	Bed room	57	70	38	69	45	20	40	38	180	17%	2.70	3.60	3.40	2.70	1.86	1.00
16	В	B.0.8	00	Living - Kitchen	70	68	15	20	41	38	54	20	180	20%	4.20	4.00	6.30	2.70	2.04	2.00
17	В	B.0.7	00	Living - Kitchen	20	72	123	5	37	43			180	29%	3.80	4.00	7.00	2.70	2.48	2.00
18	В	B.0.7	00	Bed room	103	75	77	5					180	19%	2.88	3.60	3.33	2.70	2.28	1.00
19	В	B.0.6	00	Living - Kitchen	93	75	87	5					180	21%	4.40	3.70	6.30	2.70	2.30	2.00
20	С	C.0.1	00	Living - Kitchen	67	5	35	28	55	31	23	7	180	30%	4.60	3.85	7.60	2.70	2.98	2.00
21	С	C.0.1	00	Bed room	81	75	99	29					180	17%	2.70	3.25	3.50	2.70	1.98	1.00
22	С	C.0.3	00	Bed room	76	75	60	38	44	22			180	17%	2.70	3.25	3.50	2.70	1.98	1.00
23	С	C.0.3	00	Living - Kitchen	43	6	33	22	70	38	34	9	180	29%	3.80	3.85	7.60	2.70	2.32	2.00
24	D	D.0.3	00	Bed room	32	70	72	42	53	23	23	21	180	22%	3.24	3.60	3.40	2.70	2.88	1.00
25	D	D.0.3	00	Living - Kitchen	49	23	64	45	47	21	20	20	180	25%	3.60	4.00	7.00	2.70	2.02	2.00
26	D	D.0.2	00	Bed room	9	65	55	14	52	9	64	22	180	30%	2.25	3.70	3.72	2.70	2.59	1.00
27	D	D.0.1	00	Living - Kitchen	17	68	51	14	50	9	62	21	180	29%	3.60	4.00	7.00	2.70	2.35	2.00
28	D	D.0.1	00	Bed room	85	84	48	14	47	9			180	19%	3.24	3.50	3.30	2.70	2.58	1.00
29	А	A.1.15	01	Bed room	29	4	44	52	26	28	81	29	180	25%	2.52	3.55	3.70	2.70	2 47	1.00
30		A.1.15		Living - Kitchen	58	45	72	4	50	52	•			25%	4.80	6.00	4.65	2.70	2.72	2.00
31		A.1.15		Bed room	67	54	70	4	43	44				24%	3.60	4.20	3.15	2.70	3.39	1.00
32		A.1.14		Living - Kitchen	74	63	66	4	40	41				23%	3.68	4.00	5.70	2.70	2.17	2.00
33		A.1.14		Bed room	84	76	60	4	36	37			180		3.24	3.60	3.40	2.70	2.57	1.00
34		A.1.7		Living - Kitchen	66	4	27	34	16	19	71	57		25%	3.70	3.85	7.30	2.70	2.03	2.00
35			01	Bed room	85	84	16	4	27	34	52	40	180	14%	2.88	3.25	3.55	2.70	1.73	1.00
36	A	A.1.7	01	Bed room	76	4	28	34	25	18	51	46	180	28%	1.62	3.10	4.30	2.70	1.77	1.00
37	А	A.1.8	01	Bed room	81	4	28	34	25	17	46	45	180	29%	2.16	3.10	3.65	2.70	2.72	1.00
38	А	A.1.8	01	Living - Kitchen	84	4	27	34	25	19	44	34	180	30%	5.00	5.40	5.20	2.70	3.42	2.00
39	A	A.1.9	01	Living - Kitchen	65	5	76	10	39	9			180	34%	5.00	5.40	5.20	2.70	3.90	2.00
40	Α	A.1.9	01	Bed room	65	5	78	10	37	9			180	34%	1.62	3.10	3.65	2.70	2.42	1.00
41	Α	A.1.12	01	Living - Kitchen	97	6	56	45	27	49			180	28%	5.00	6.20	4.90	2.70	2.92	2.00
42	Α	A.1.12	01	Bed room	91	6	53	46	36	59			180	26%	1.44	3.40	3.75	2.70	1.49	1.00
43	А	A.1.13	01	Living - Kitchen	77	5	47	46	56	72			180	23%	3.68	3.90	6.50	2.70	2.00	2.00
44	А	A.1.13	01	Bed room	33	5	33	46	114	85			180	12%	4.32	3.60	4.83	2.70	1.56	1.00
45	А	A.1.17	01	Bed room	44	5	63	62	43	31	30	17	180	24%	2.52	3.10	4.20	2.70	2.36	1.00
46	А	A.1.17	01	Bed room	78	80	46	62	56	32				13%	2.88	3.25	3.55	2.70	1.54	1.00
47	A	A.1.17		Living - Kitchen	31	5	62	62	53	34	34	18		23%	4.20	3.85	7.60	2.70	2.05	2.00
48	A	A.1.16	01	Bed room	27	5	66	62	48	35	39	19		23%	3.24	3.10	4.20	2.70	2.83	1.00
49	A	A.1.16	01	Living - Kitchen	32	75	52	40	44	34	52	20	180	22%	4.40	5.40	5.20	2.70	2.14	2.00

50	В	B.1.9	01	Bed room	85	80	51	23	44	59			180	14%	2.52	3.25	3.55	2.70	1.42	1.00
51	В	B.1.9	01	Living - Kitchen	7	18	45	28	42	19	86	46	180	24%	3.30	3.85	5.80	2.70	2.06	2.00
52	В	B.1.18	01	Bed room	57	60	38	67	45	19	40	37	180	19%	2.70	3.60	3.40	2.70	2.05	1.00
53	В	B.1.18	01	Living - Kitchen	70	56	15	19	41	36	54	19	180	22%	4.20	4.00	6.30	2.70	2.25	2.00
54	В	B.1.17	01	Living - Kitchen	59	54	56	23	65	25			180	24%	4.80	4.59	5.79	2.70	2.66	2.00
55	С	C.1.5	01	Living - Kitchen	88	5	52	44	30	17	10	77	180	29%	4.40	8.20	4.90	2.70	2.13	2.00
56	С	C.1.5	01	Bed room	72	82	42	25	66	30			180	17%	2.52	4.50	3.20	2.70	1.56	1.00
57	С	C.1.5	01	Bed room	46	37	57	18	29	25	48	43	180	25%	2.52	3.70	3.60	2.70	2.44	1.00
58	С	C.1.4	01	Living - Kitchen	41	35	48	18	35	27	56	56	180	23%	4.40	5.70	4.25	2.70	2.53	2.00
59	С	C.1.4	01	Bed room	39	27	51	20	27	27	63	62	180	22%	2.34	2.93	3.59	2.70	2.37	1.00
60	С	C.1.4	01	Bed room	37	27	48	20	27	29	68	74	180	20%	3.24	3.68	4.90	2.70	1.99	1.00
61	С	C.1.15	01	Bed room	91	74	28	26	61	18			180	18%	1.62	3.50	3.30	2.70	1.24	1.00
62	С	C.1.15	01	Living - Kitchen	59	64	46	26	43	16	32	32	180	22%	3.68	3.90	6.40	2.70	2.01	2.00
63	С	C.1.14	01	Living - Kitchen	50	54	51	26	44	19	35	38	180	24%	3.68	3.90	6.40	2.70	2.09	2.00
64	С	C.1.13	01	Bed room	44	48	51	26	41	20	44	49	180	23%	1.80	3.45	3.60	2.70	1.68	1.00
65	С	C.1.13	01	Living - Kitchen	37	38	53	25	28	23	62	62	180	21%	4.66	6.80	4.50	2.70	2.05	2.00
66	С	C.1.13	01	Bed room	82	62	41	5	57	26			180	22%	2.34	3.60	4.30	2.70	1.80	1.00
67	С	C.1.9	01	Bed room	70	80	63	12	47	24			180	21%	4.32	3.60	5.03	2.70	2.72	1.00
68	С	C.1.9	01	Living - Kitchen	45	8	68	12	67	24			180	31%	3.00	4.00	7.30	2.70	2.03	2.00
69	D	D.1.9	01	Living - Kitchen	21	4	51	27	65	12	43	22	180	30%	3.68	4.00	7.30	2.70	2.40	2.00
70	D	D.1.9	01	Bed room	70	80	53	27	57	12			180	20%	4.32	3.60	5.03	2.70	2.65	1.00
71	D	D.1.11	01	Living - Kitchen	28	4	56	24	58	12	38	36	180	30%	4.20	4.00	7.30	2.70	2.67	2.00
72	D	D.1.12	01	Bed room	28	4	52	24	56	12	44	40	180	29%	1.62	3.10	3.70	2.70	2.02	1.00
73	D	D.1.12	01	Bed room	81	76	80	16	19	43			180	19%	2.52	3.25	3.50	2.70	2.03	1.00
74	D	D.1.12	01	Living - Kitchen	22	4	51	19	48	15	59	58	180	26%	4.20	3.85	7.60	2.70	2.30	2.00
75	D	D.1.13	01	Bed room	15	8	61	54	33	29	71	23	180	24%	2.16	3.60	4.30	2.70	1.79	1.00
76	D	D.1.13	01	Living - Kitchen	13	7	57	52	32	29	78	26	180	24%	4.40	4.50	6.80	2.70	2.20	2.00
77		D.1.14	01	Bed room	53	52	52	33	54	23	21	20	180	24%	2.16	3.60	3.43	2.70	2.08	1.00
78		D.1.14	01	Living - Kitchen	58	53	47	33	55	21	20	18	180	24%	3.68	3.90	6.45	2.70	2.09	2.00
79	D	D.1.15	01	Living - Kitchen	67	61	41	33	53	18	19	14	180	22%	3.68	3.90	6.45	2.70	2.00	2.00
80	D	D.1.15	01	Bed room	80	72	37	33	45	17	18	14	180	19%	2.16	3.50	3.30	2.70	1.78	1.00
81	D	D.1.4	01	Living - Kitchen	36	29	38	17	21	14	85	72	180	19%	4.37	3.80	6.45	2.70	2.03	2.00
82		D.1.4	01	Bed room	80	76	49	62	51	19			180	15%	3.24	3.25	3.50	2.70	2.00	1.00
83	D	D.1.4	01	Bed room	72	61	16	37	44	18	48	18	180	23%	1.62	3.10	4.20	2.70	1.42	1.00
84	D	D.1.5	01	Bed room	67	52	31	18	28	18	54	50	180	21%	2.16	3.25	4.30	2.70	1.69	1.00
85	D	D.1.5	01	Living - Kitchen	62	55	24	18	34	18	60	44	180	22%	4.88	4.90	6.80	2.70	2.05	2.00

#### 5.4 Daylight reception within the new development (The Meadows) conclusion

The BRE report recommends as a methodology for assessing sufficient daylight reception in a habitable room, that the calculated average daylight factor (ADF) of a habitable room to be in excess of the BRE bench marks of a kitchen at 2%, a living room at 1.5%, a bedroom at 1% and a living room/bedroom at 1.5%. Calculation findings are as follows (see image 5.1–5.2 for receptor/room locations):

Ground floor (level 00)

- Block A: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block B: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block C: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines.
- Block D: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.

First floor (level 01)

- Block A: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block B: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines.
- Block C: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.
- Block D: All selected habitable rooms have achieved an ADF in excess of the recommended guidelines or are equal to minimum recommendations.

Second floor (level 02)

- All floors above the first floor apartments are further deemed compliant as they naturally would have an improved vertical daylight impact angle thus increasing the daylight reception factor typically 0.3%-0.5% per floor level.

Given the results and conclusions above we, DKP, deem the proposed project to be in compliance with the recommendations in the BRE design guidelines 'site layout and planning for daylight and sunlight - a guide to good practice'.