

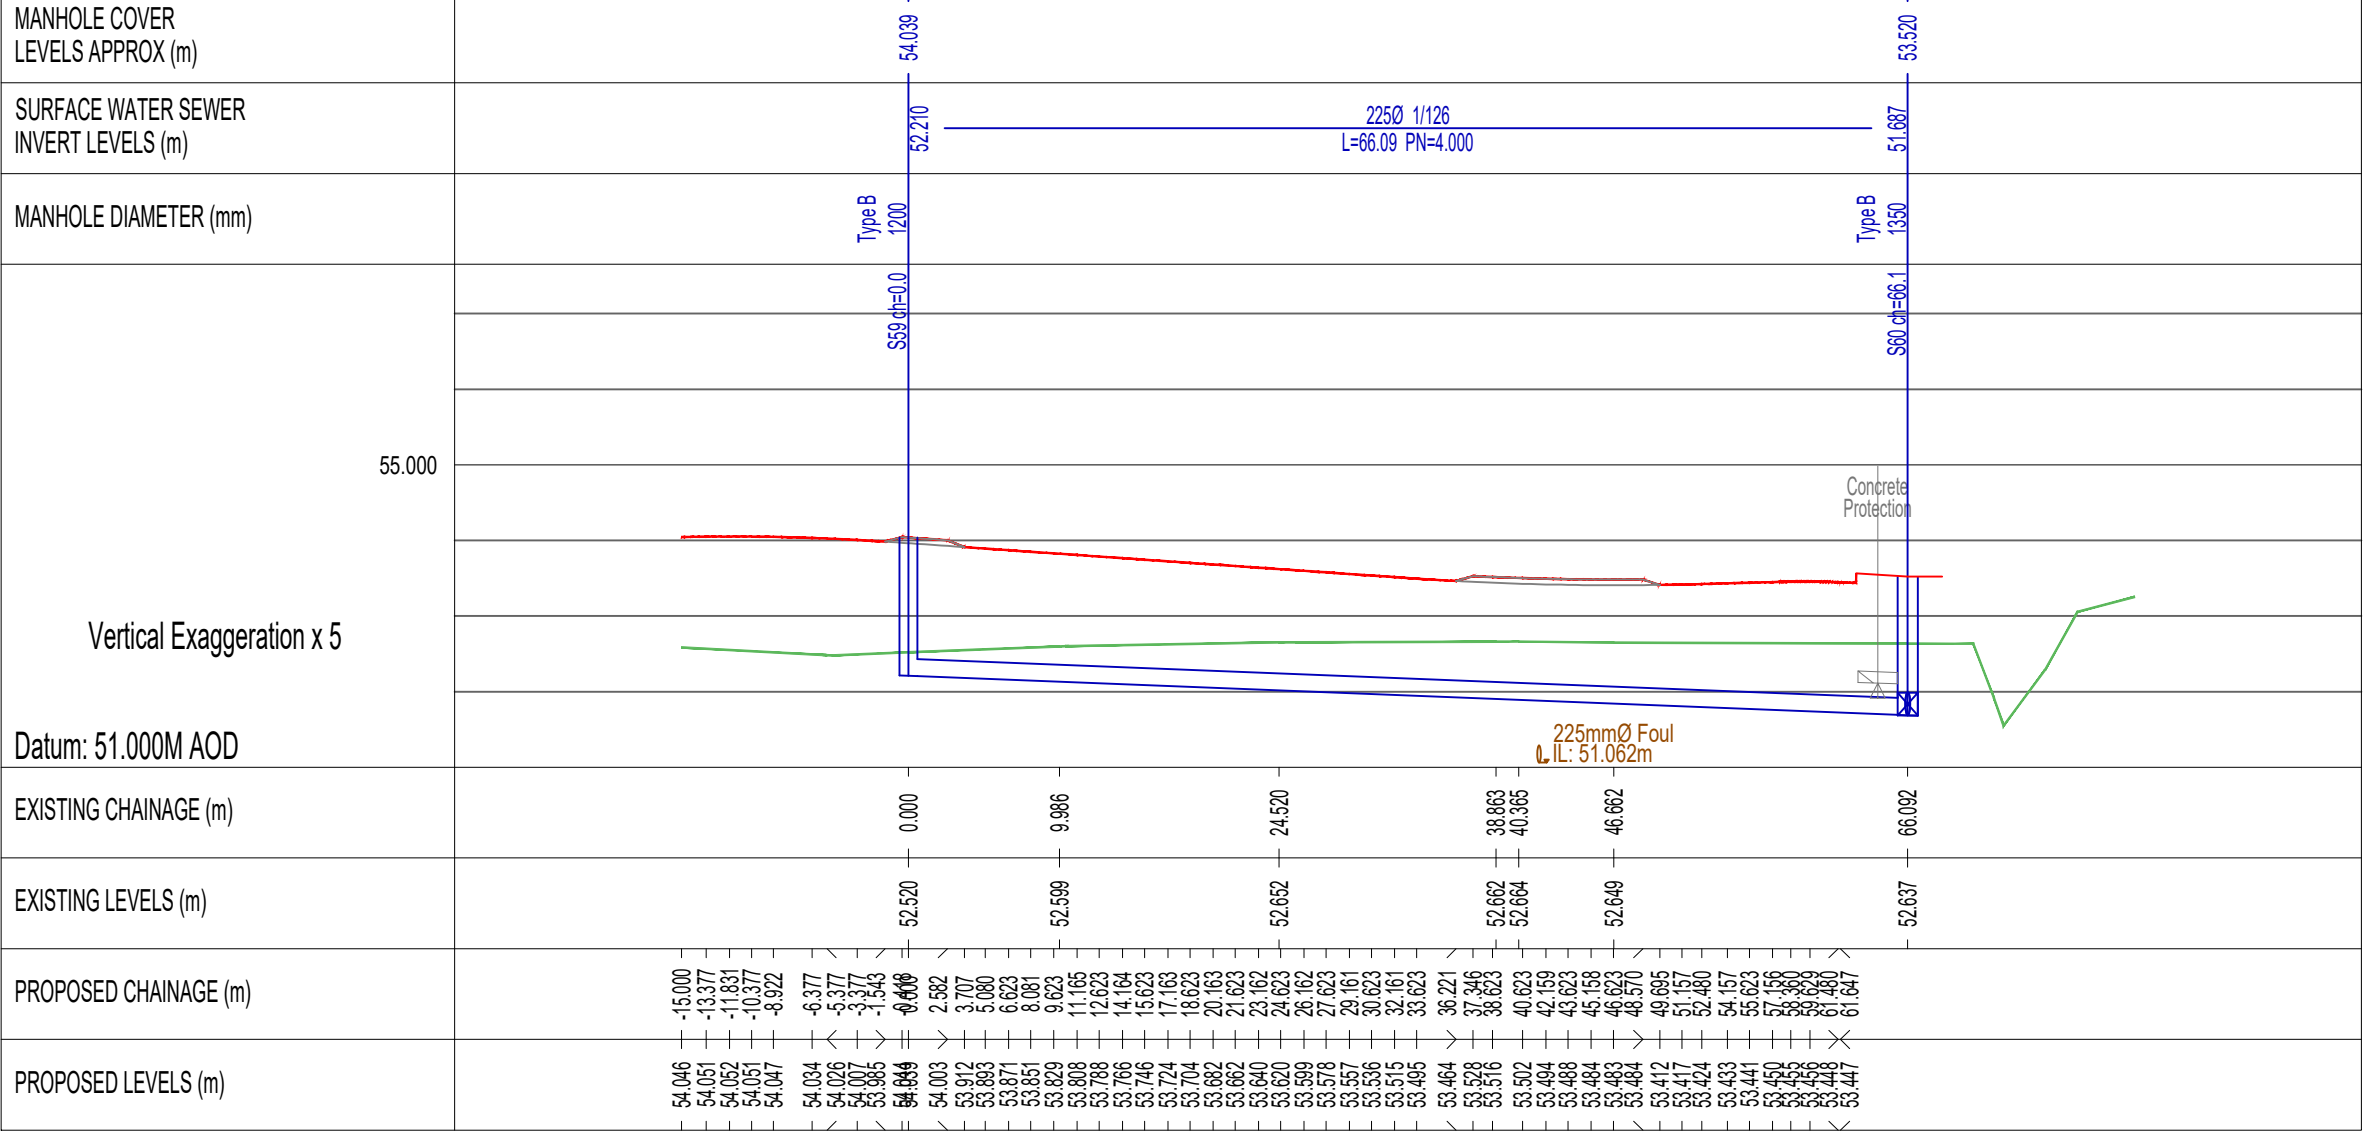
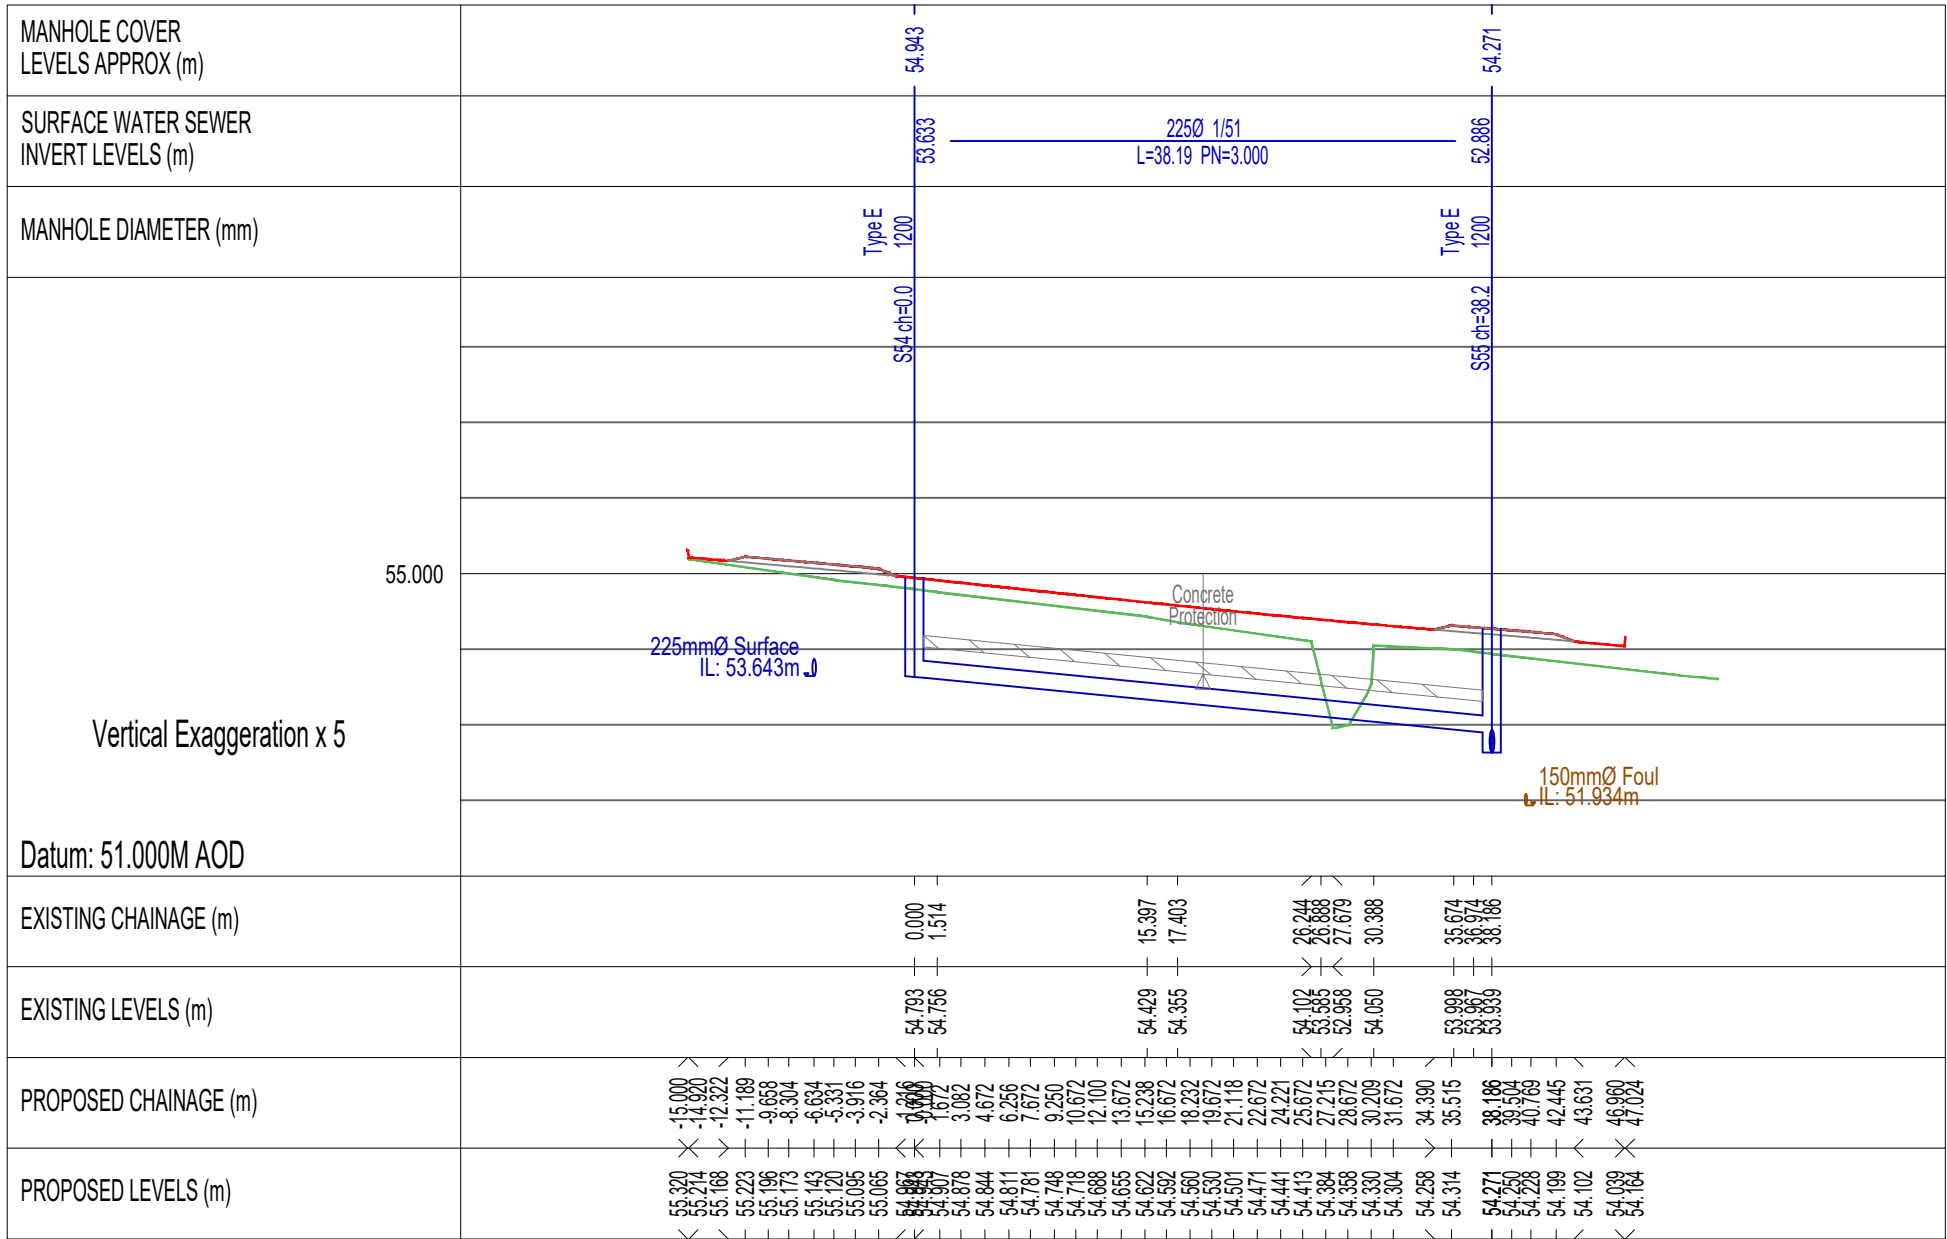
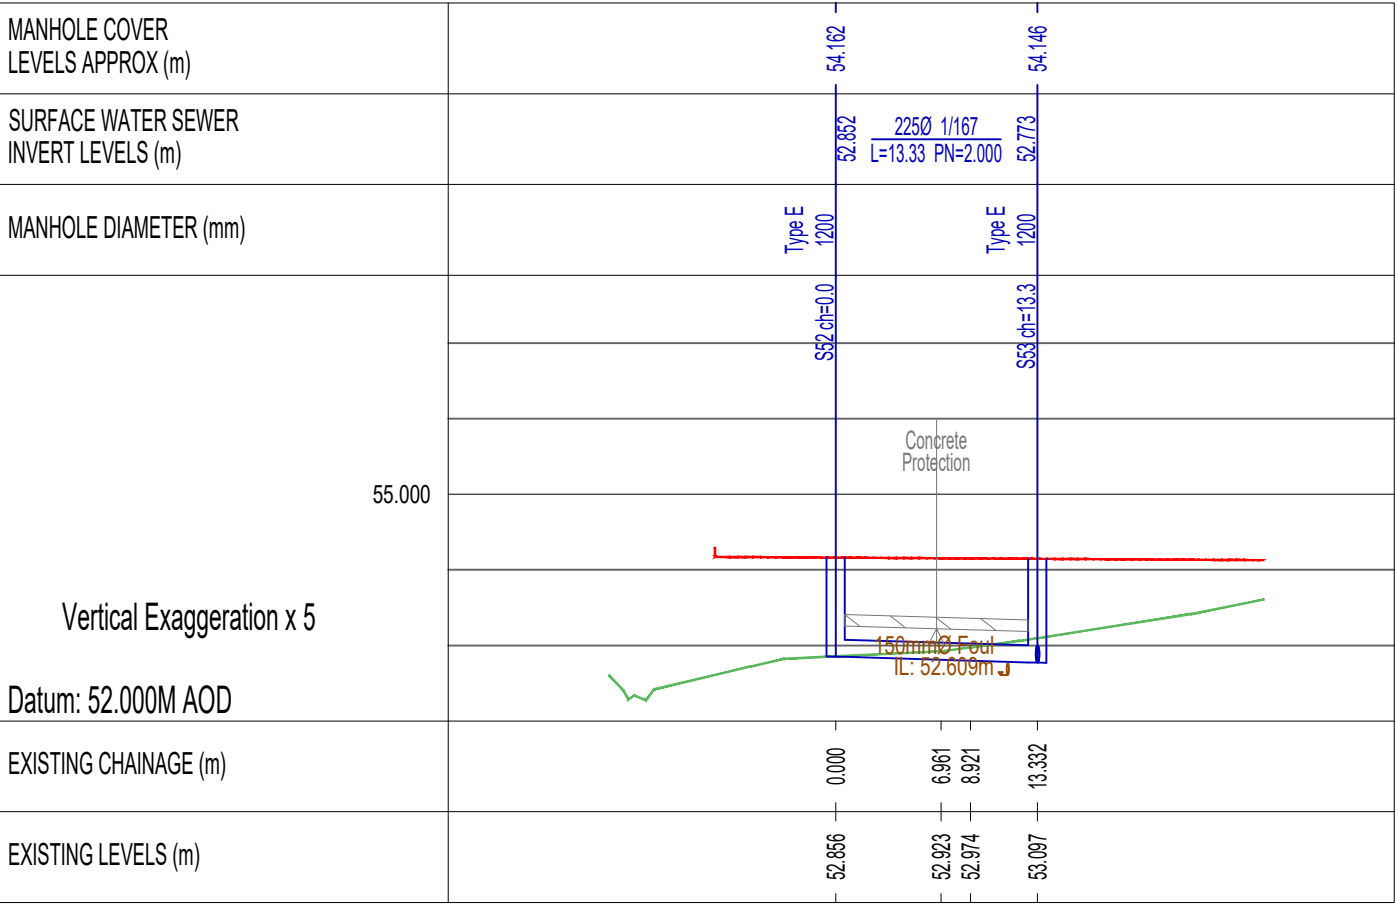
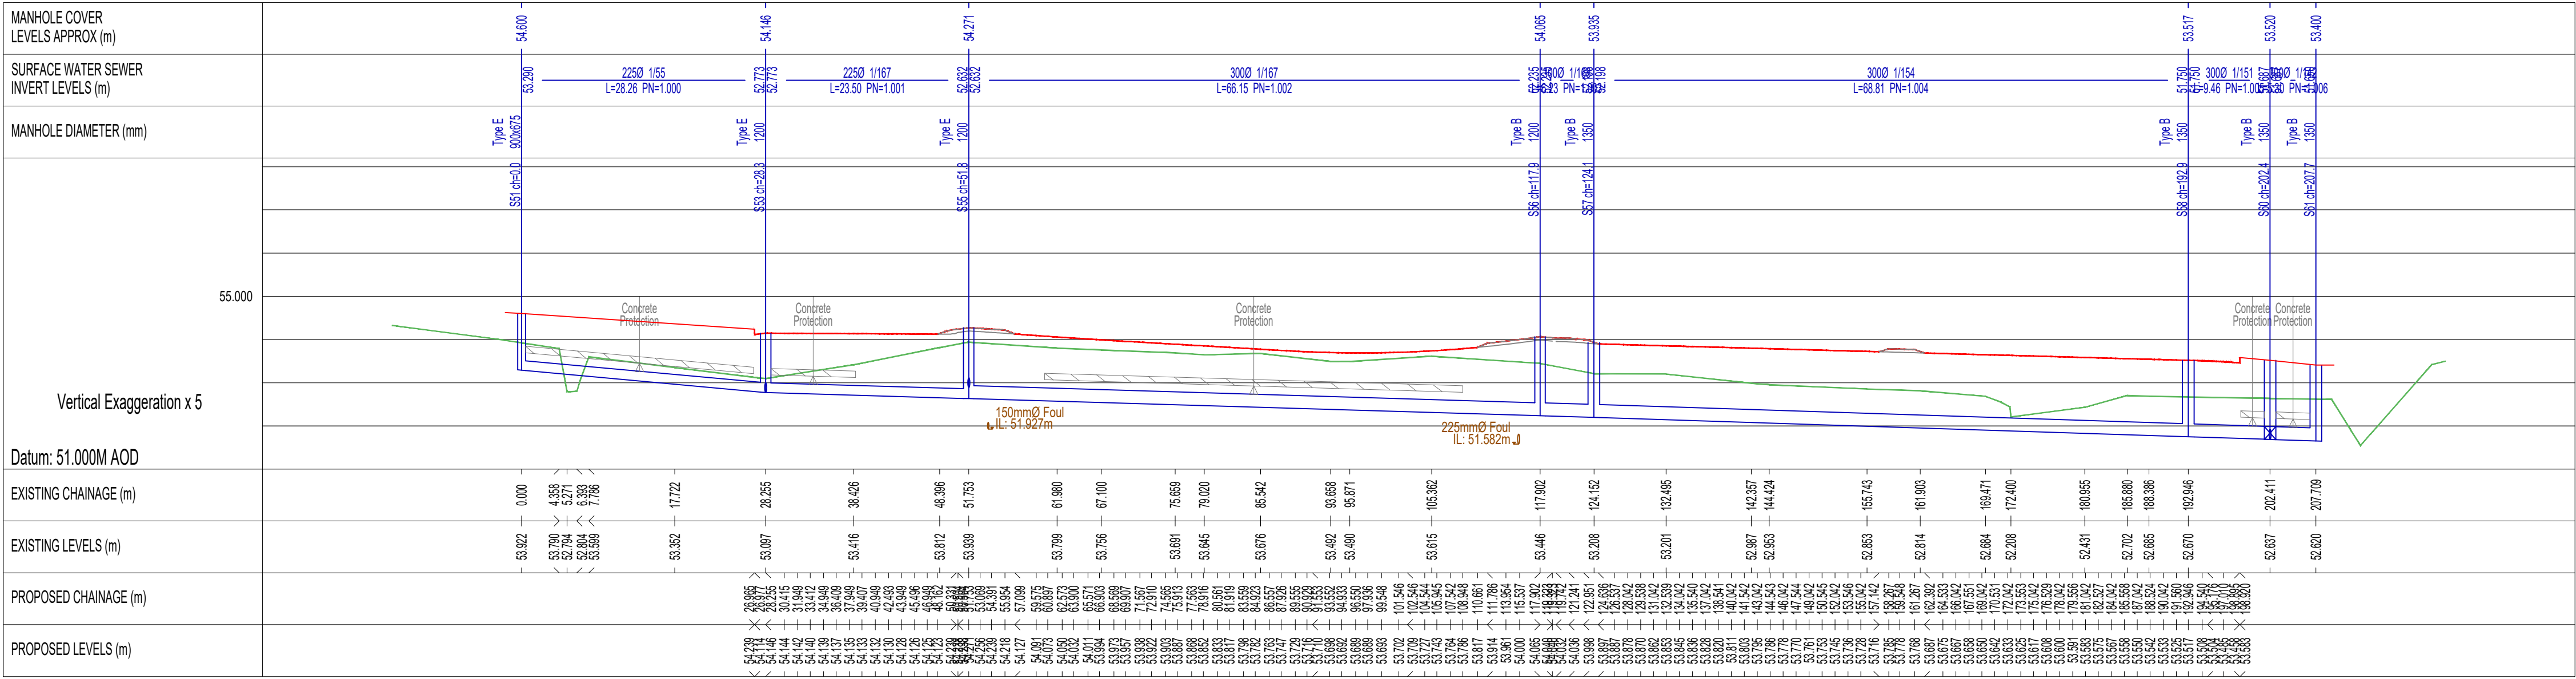
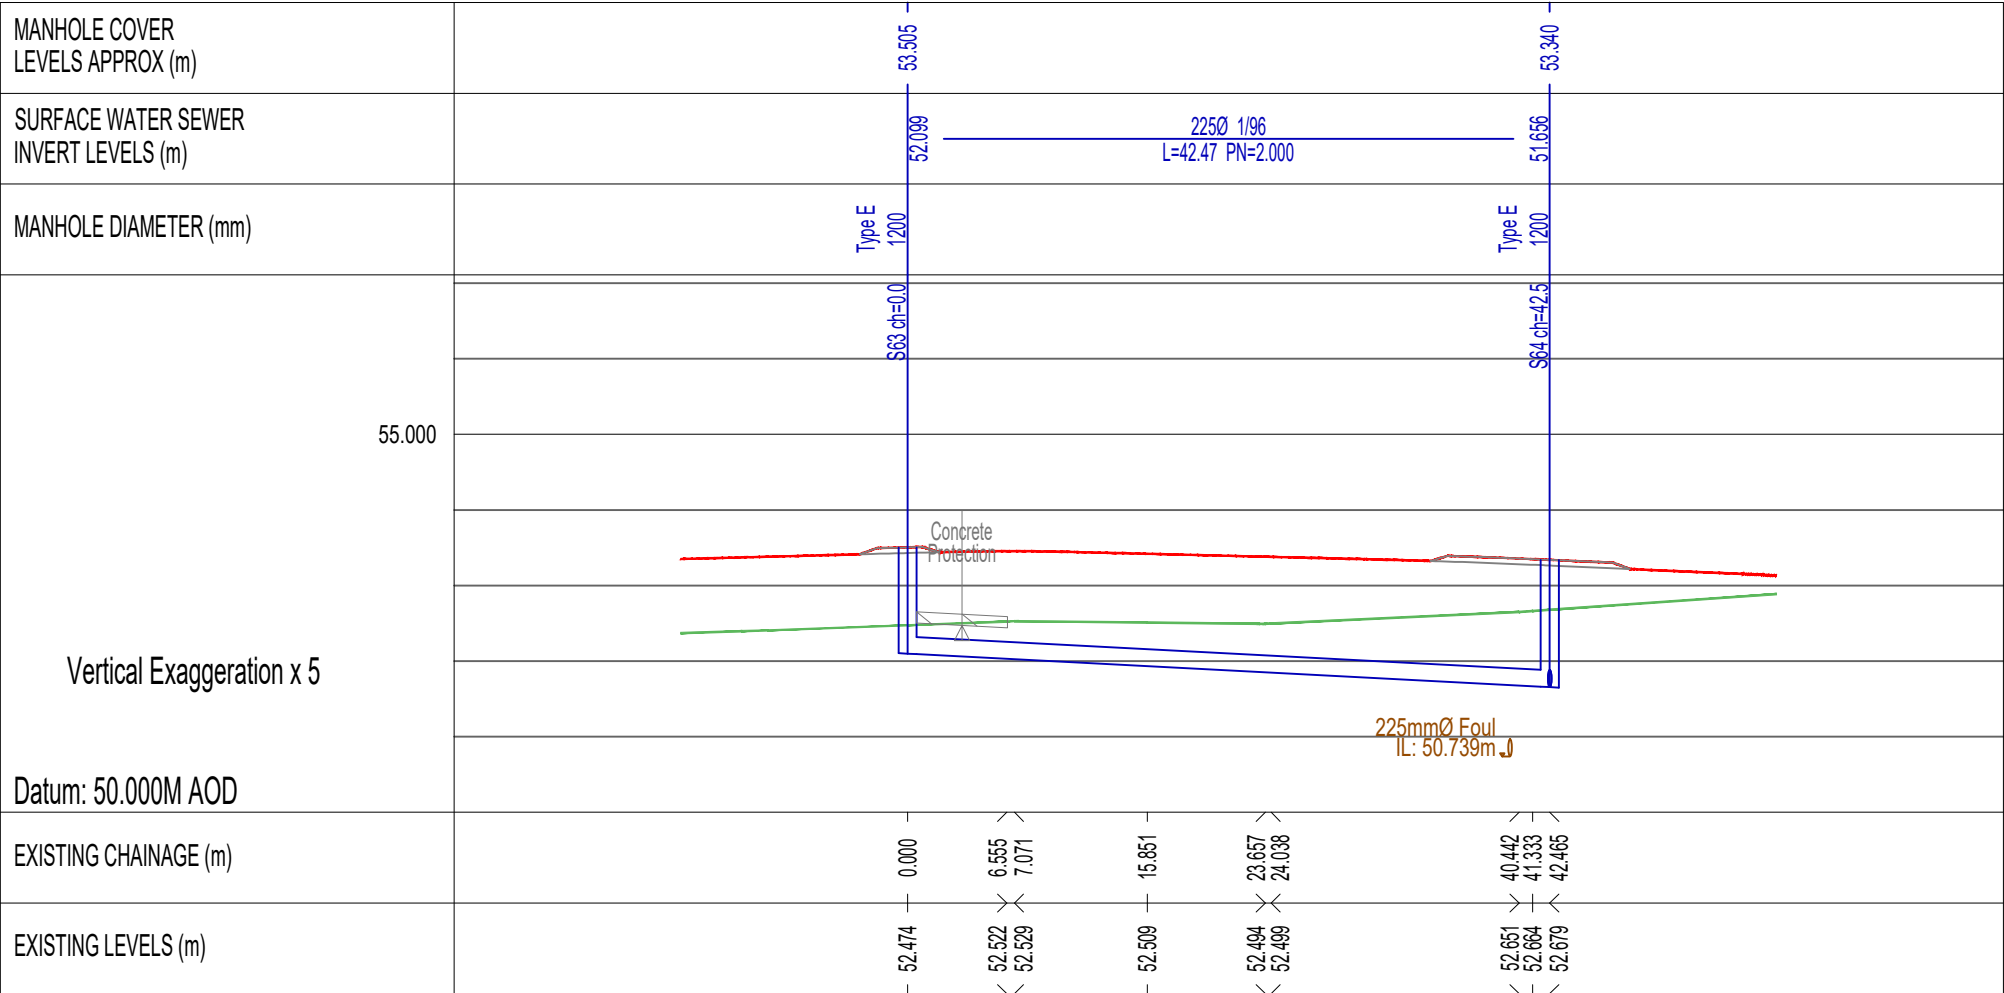


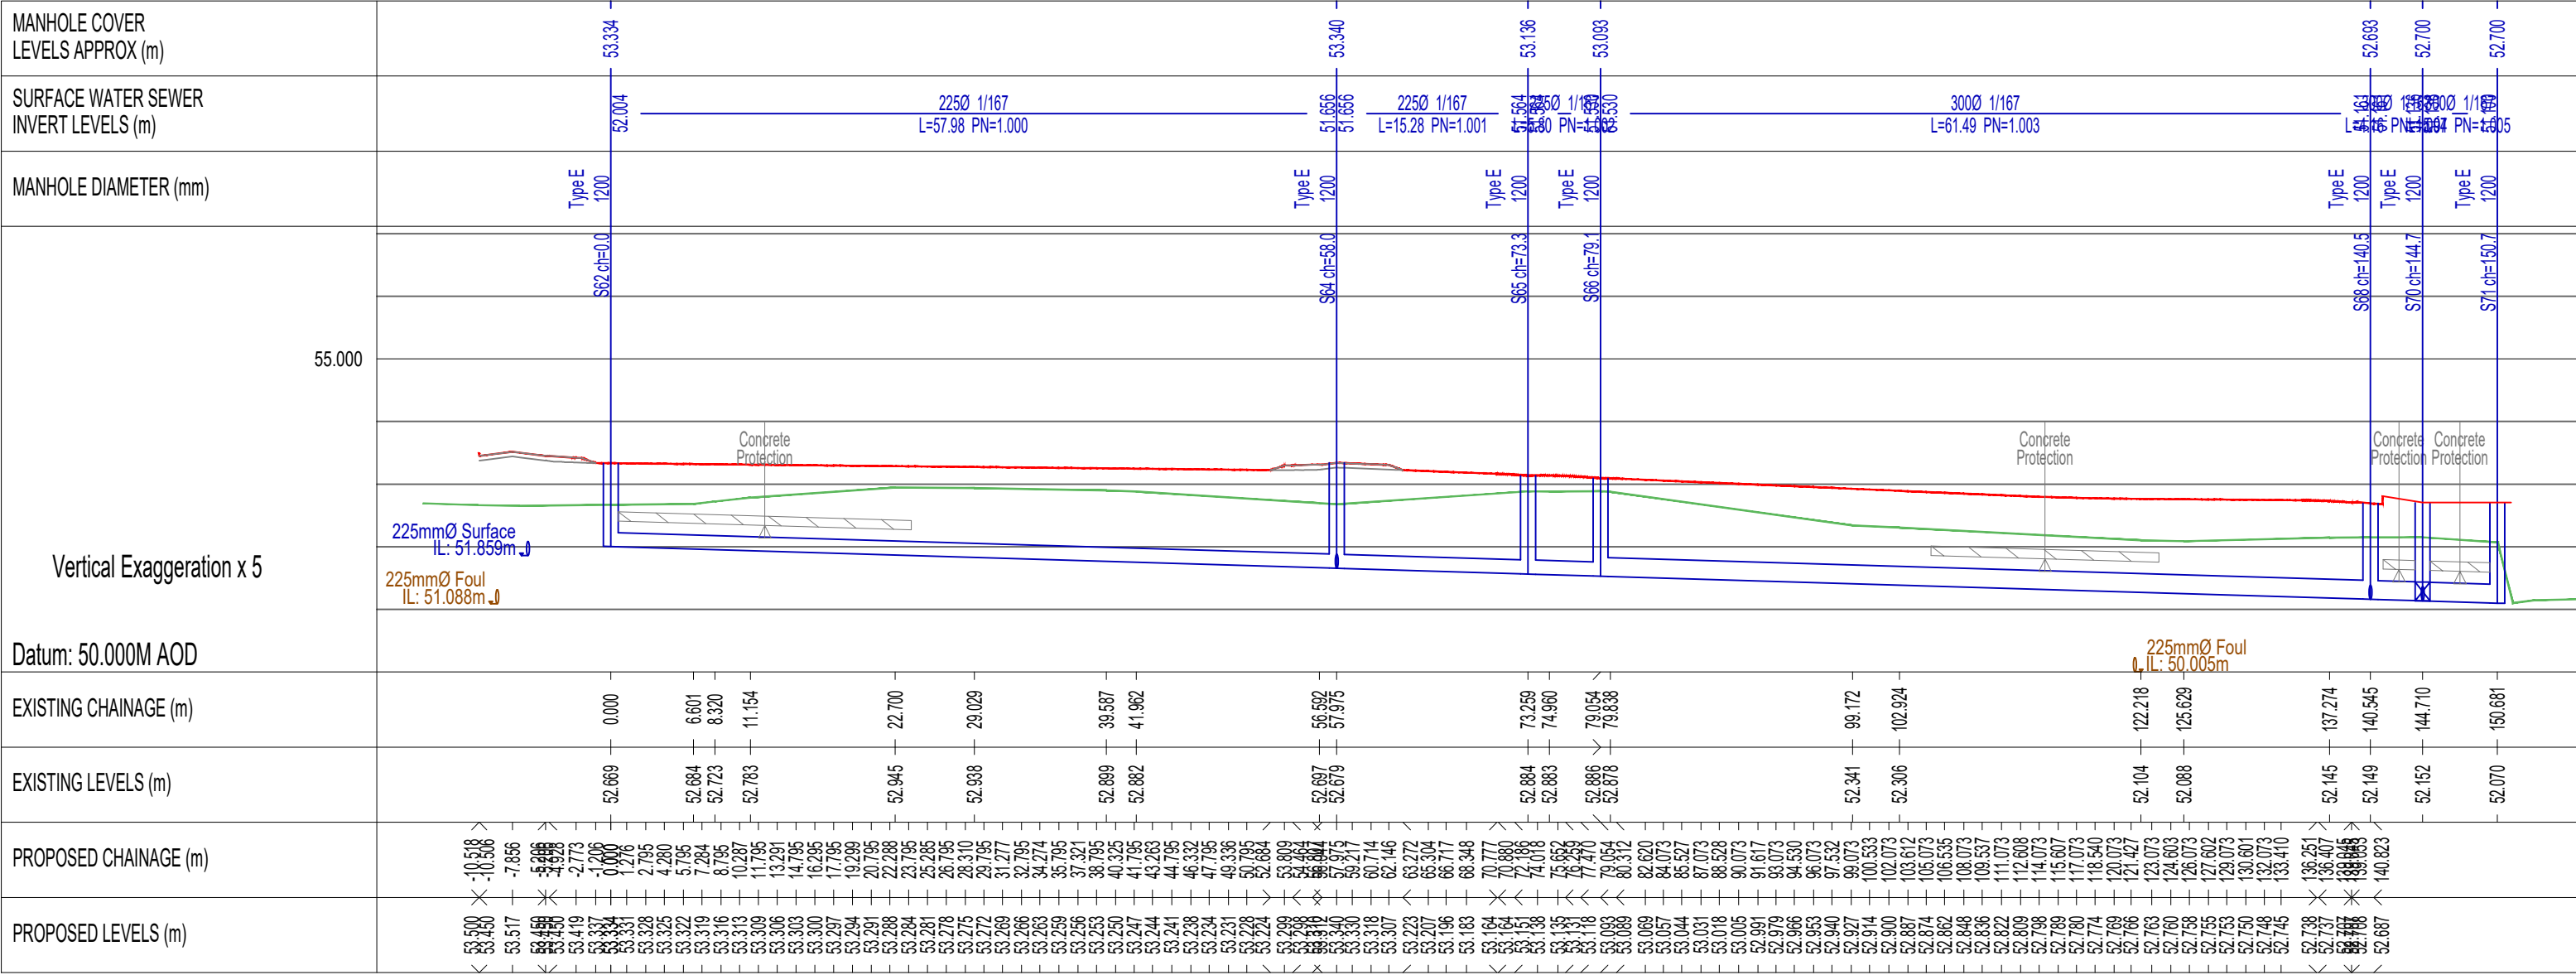

NOTE:
All Surface Water and Wastewater sewer Pipes shall be protected with a concrete surround, with flexible joints filled with compressible material, where the depth from the road surface to the crown of the pipe is less than 1200mm.
(See STD-WW-07 and STD-WW-08 on drawing no. 19074-P-501 for details of concrete surround to be used on both sewers.)

Note:
All foul sewer construction details to comply with the following Irish Water Documents:
'Recommendations for Site Development Works for Housing Areas' DoEHLG 1998

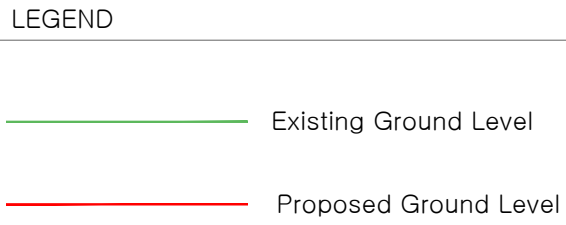

Project: Proposed Residential Development, Coolcarron, Fermoy, Co. Cork

Client: Cumnor Construction Ltd.

Scale: 1:500

Plan: Planning

WALSH design group

The Mall, Manorborough Woods, Douglas Co. Cork.

Tel. 021-4774940 Fax. 021-4775421 email.info@wdg.ie