

## **Daylight & Sunlight Assessments of a Strategic Housing Development, Ratoath, Co. Meath.**

**Applicant**    **Beo Properties Ltd.**

**Date:**            **18th May 2022**

**Prepared by John Healy**  
**MSc Environmental Design of Buildings**

# **1. Introduction**

Please refer to the development description within the statutory notices for a complete description of the proposed development.

## **1.1 Executive Summary**

The report assesses the impact of the proposed development for Daylight and Sunlight on the neighbouring buildings and the quality of daylight and sunlight to within the proposed development. This analysis is carried out based on the drawings of RKD and Brady Shipman Martin.

### **Impact on adjacent properties**

There will be minimal impact to the daylight and sunlight to the adjacent dwellings with no perceivable reduction in either daylight or sunlight. There will be a minimal reduction in the sunlight to any of the adjacent private or public amenity spaces.

### **Assessment of the quality of the proposed development.**

All the units within the proposed development exceed the recommendations of the BRE guidelines for quality of Daylight. The bedroom and living space layouts have been optimised for daylight and sunlight. All the living spaces with a kitchen exceed the target ADF value of 2% and all the bedrooms exceed the target ADF value of 1%. The proposed apartments were also assessed for daylight provision in accordance with EN17037:2018 and all the units exceed the minimum target levels.

The proposed communal amenity spaces will be bright and achieve sunlight levels that exceed 2 hours sunlight over 50% of the amenity space on the 21st March. This meets the recommendations of the BRE guidelines. In Excess of 70% of the private gardens / amenity spaces exceed 2 hours sunlight over 50% of the amenity space.

The results find that any impact on the adjacent residential structures would be minimal and imperceivable. There would be good quality of daylight in the apartments analysed and the amenity areas would have sufficient sunlight to be bright and pleasant spaces. The proposed development meets the recommendations of the BS 8206-2 2008 and BRE guidance document (2011) Site layout planning for daylight and sunlight.

## 2. Methodology

### 2.1 Notes on the use of BS 8206-2 2008 and BRE guidance document (2011) Site layout planning for daylight and sunlight (BR209).

This Daylight and Sunlight Assessment demonstrates compliance with the BRE guide 'Site Layout Planning for Daylight and Sunlight' (2nd edition) and BS 8206-2: 2008 – 'Lighting for Buildings – Part 2: Code of Practice for Daylighting'. This is in accordance with the most relevant S.28 Ministerial Guidelines including Section 6.6 of the Sustainable Urban Housing: Design Standards for New Apartments (2020), and Section 3.2 of the Urban Development and Building Heights Guidelines for Planning Authorities (2018).

Sustainable Urban Housing: Design Standards for New Apartments, Guidelines for Planning Authorities (2020) directs planning authorities to have regard to quantitative performance approaches to daylight provision outlined in guides like the BRE guide 'Site Layout Planning for Daylight and Sunlight' (2nd edition) or British Standard BS 8206-2: 2008 – 'Lighting for Buildings – Part 2: Code of Practice for Daylighting'. The standards for daylight and sunlight access in buildings (and the methodologies for assessment of same) suggested in both of these documents have been referenced in this Sunlight and Daylight Access Analysis.

The former standard BS 8206-2 was read in conjunction with BRE BR209 Site layout planning for daylight and sunlight and CIBSE LG10 as guidance only, but the launch of BS EN 17037 directly impacts on the recommendations of these other technical documents due to the withdrawal of BS8206-2:2008. The new standard can no longer be interpreted as guidance and cannot be incorporated into BR209 but BR209 continues to reference a standard that no longer exists. The updated 3rd Edition of the BRE guide 'Site Layout Planning for Daylight and Sunlight' intends to address this and is due to be published in spring 2022.

Neither the British Standard nor the BRE Guide set out rigid standards or limits. The BRE Guide is preceded by the following very clear warning as to how the design advice contained therein should be used:

*"The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aims is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design."*

That the recommendations of the BRE Guide are not suitable for rigid application to all developments in all contexts is of particular importance in the context of national and local policies for the consolidation and densification of urban areas.

### 2.2 Daylight to the existing dwellings

A proposed development could potentially have a negative effect on the level of daylight that a neighbouring property receives, if the obstructing building is large in relation to their distance from the existing dwelling. To ensure a neighbouring property is not adversely affected, the Vertical Sky Component (also referred to as VSC) is calculated and assessed. VSC can be defined as the amount of skylight that falls on a vertical wall or window. The site is analysed in plan, section and building use. Windows and amenity area are selected to test for impact from the proposed development.

BRE guidelines recommend that: *"Loss of light to existing windows need not be assessed if the distance of each part of the new development from the existing window is three or more times its height above the centre of the existing window."*

The diffuse light of the existing building may be adversely affected if part of a new building measured in a vertical section perpendicular to the main window wall of an existing building, from the centre of the lowest window, subtends an angle of more than 25° to the horizontal. If a window falls within a 45° angle both in plan and elevation with a new development in place then the window may be affected and should be assessed.

For loss of daylight and sunlight to existing buildings BRE guidance document (2011) "Site layout planning for daylight and sunlight" is used and BS8206 Part 2:2008 Lighting for Buildings, Code of Practice for Daylighting.

For loss of light the report recommends calculation of the Vertical Sky Component. This is the ratio of direct sky illuminance falling on the outside window, to the simultaneous horizontal illuminance under an unobstructed sky. The standard CIE Overcast Sky is used and the ratio is usually expressed as a percentage. The maximum value is just under 40% for a completely unobstructed vertical wall. The Vertical Sky Component on a window is a good measure of the amount of daylight entering it.

The BRE guidelines recommend one of two criteria is met when assessing for the Vertical Sky Component:

a) Where the Vertical Sky Component at the centre of the existing window exceeds 27% with the new development in place then enough sky light should still be reached by the existing window.

b) Where the Vertical Sky Component with the new development in place is both less than 27% and less than 0.8 times its former value, then the area lit by the window is likely to appear more gloomy, and electric light will be needed more of the time.

The BRE Guidelines state that if the VSC is:

- At least 27%, then conventional window design will usually give reasonable results;
- Between 15% and 27%, then special measures (larger windows, changes to room layout) are usually needed to provide adequate daylight;
- Between 5% and 15%, then it is very difficult to prove adequate daylight unless very large windows are used;
- Less than 5%, then it is often impossible to achieve reasonable daylight, even if the whole window wall is glazed

This report assesses the percentage of direct sky illuminance that falls on the centre point of neighbouring windows that could be affected by the proposed development.

## 2.3 Sunlight

The BRE guidelines recommend assessing the loss of sunlight to the main living rooms and conservatories if they have a window wall facing within 90° of due south. Kitchens and bedrooms are less important but care should be taken not to block too much sun. If the proposed development is fully north then sunlight need not be assessed.

The Annual Probable Sunlight Hours (APSH) is used to assess the quantity of sunlight for a given location. This is the total amount sunshine for a given location on an unobstructed horizontal surface taking cloud cover into account. Statistical data from the Irish Meteorological Service is used to assess the APSH and the Winter Probable Sunlight Hours (taken to fall between the 21st of September and the 21st of March). Table 1 shows the average sunlight hours for each month and the maximum possible without any cloud cover. This gives the factor of possible sunlight hours for each month.

Met Eireann Sunlight Hours Data Set 1981-2010													
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Average Sunlight Hours/ Day	1:54	2:45	3:36	5:32	6:44	6:40	5:17	5:13	4:16	3:17	2:10	1:44	
Average Sunlight Hours/ Month	58:54	77:00	111:36	166:00	208:44	200:00	163:47	161:43	128:00	101:47	65:00	53:44	1496.25
Total Available Sunlight Hours	252	265	358	412	488	485	496	451	375	320	250	248	4383
Probable Sunlight Hours Ratio	23.37%	29.06%	31.17%	40.29%	42.77%	41.24%	33.02%	35.86%	34.13%	31.81%	26.00%	21.67%	34.14%

**Table 1: Average monthly sunlight hours recorded at Dublin Airport - Data set 1981-2010**

The BRE guidelines recommend that the centre of a window or 1.6m above ground for a door be assessed and receive at least 25% of the APSH and at least 5% during the period of 21st September to 21st March. If the available APSH is less than this then it should not be reduced below 0.8 times its former value or noticeable loss of sunlight may occur.

## 2.4 Sunlight to gardens and open spaces

For calculations of sunlight analysis it is general practice to use March 21 and the recommendations of the BRE guidance document (2011) "Site layout planning for daylight and sunlight". P.J Littlefair, in relation to Gardens and open spaces section 3.3.17 state:

*"It is recommended that for it to appear adequately sunlit throughout the year, at least half of a garden or amenity area should receive at least two hours of sunlight on 21 March. If as a result of new development an existing garden or amenity area does not meet the above, and the area which can receive two hours of sun on 21 March is less than 0.8 times its former value, then the loss of sunlight is likely to be noticeable. If a detailed calculation cannot be carried out, it is recommended that the centre of the area should receive at least two hours of sunlight on 21 March."*

## 2.5 Calculations of Trees & Hedges

Trees are not usually included in the assessments of impact, unless specified otherwise. In relation to the effects of trees and hedges the BRE guidelines states,

*"It is generally more difficult to calculate the effects of trees on daylight because of their irregular shape and because some light will generally penetrate through the crown. Where the effects of a new building on existing buildings nearby is being analysed, it is usual to ignore the effects of existing trees. This is because daylight is at its scarcest and most valuable in winter when most trees will not be in leaf."*



## 2.6 Daylight in the Proposed Development.

The rooms are assessed for Average Daylight Factor (ADF) and compliance with EN 17037 (2018). Table 2 contains the Input values for material used in the assessment model.

Surface Reflectance			
Element	Reflectance	Transmissivity	Material Description
Internal walls	84%	0%	White Painted Walls
Internal ceiling	88%	0%	White Painted Ceiling
Floor	50%	0%	Beige Floor
External walls - proposed development	50%	0%	IES LM83
External walls - outside site	20%	0%	CIBSE
External ground	20%	0%	CIBSE
Glass	15%	77%	Double glazed clear glass

**Table 2: Surface reflectance parameters for ADF calculation**

Additional assessment model input parameters:

- Sensor Grid spacing 0.6m
- Sensor grid inset 0.35m
- Minimum inset 0.3m
- Work plane offset 0.85

## 2.7 EN17037:2018

EN 17037 is a unified daylighting standard published by the European Committee for Standardization (CEN) in 2018 (CEN 17037:2018). It is applicable across all countries within the EU including Ireland with the Irish edition IS EN17037:2018. The assessment is carried out in addition to the assessment of the Average Daylight Factor as specified in the BRE guidelines and BS8206 Part 2:2008 Lighting for Buildings, Code of Practice for Daylighting.

The EN17037:2018 Standard was enacted prior to the publication of Sustainable Urban Housing: Design Standards for New Apartments in 2020 which has no reference to the new standard. Additionally to date it is not referenced in any planning guidance document by any local authority.

The standard deals exclusively with new developments and does not give guidance or metrics on loss of light or sunlight to existing properties. EN17037:2018 sets out values for Minimum and Target levels but does not give guidance on the number of units within a development that should achieve these values. Additionally it does not differentiate between room use and weighted targets for rooms which would have a lesser requirement and to date there are no guidelines or directives on the implementation of their use.

The compliance calculation is based on an annual, climate-based simulation of interior illuminance distributions. For each hour of the year, the percentage of the floor area achieving minimum and target illuminance thresholds is measured on a room-by-room basis. To meet the standard, a room must achieve both of the following criteria:

- Target Illuminance: 300 lux over 50% of floor area for at least 50% of daylight hours.
- Minimum Illuminance: 100 lux over 95% of floor area for at least 50% of daylight hours.

Daylight hours are defined as the 4380 hours with the most diffuse horizontal illuminance in the weather file. In addition to this baseline (Minimum) requirement, rooms can achieve Medium and High levels of compliance by meeting higher illuminance thresholds, as outlined in the table below:

Minimum Illuminance			Target Illuminance		
High	500 lux	95%	High	750 lux	50%
Medium	300 lux	95%	Medium	500 lux	50%
Minimum	100 lux	95%	Minimum	300 lux	50%

**Table 3: EN 17037:2018 Compliance threshold levels.**

## 2.8 Environmental Impact Assessment (BRE Guidelines Appendix I)

The BRE guidelines sets out criteria for classification for assessment of impact where a new development affects a number of existing buildings or open spaces. The guide does not give a specific range or percentages but sets out parameters set out below.

*“Where the loss of skylight or sunlight fully meets the guidelines in this book, the impact is assessed as negligible or minor adverse. Where the loss of light is well within the guidelines, or only a small number of windows or limited area of open space lose light (within the guidelines), a classification of negligible impact is more appropriate. Where the loss of light is only just within the guidelines, and a larger number of windows or open space area are affected, a minor adverse impact would be more appropriate, especially if there is a particularly strong requirement for daylight and sunlight in the affected building or open space.*

*Where the loss of skylight or sunlight does not meet the guidelines in this book, the impact is assessed as minor, moderate or major adverse. Factors tending towards a minor adverse impact include:*

- only a small number of windows or limited area of open space are affected*
- the loss of light is only marginally outside the guidelines*
- an affected room has other sources of skylight or sunlight*
- the affected building or open space only has a low level requirement for skylight or sunlight*
- there are particular reasons why an alternative, less stringent, guideline should be applied.*

*Factors tending towards a major adverse impact include:*

- a large number of windows or large area of open space are affected*
- the loss of light is substantially outside the guidelines*
- all the windows in a particular property are affected*
- the affected indoor or outdoor spaces have a particularly strong requirement for skylight or sunlight, eg a living room in a dwelling or a children’s playground.*

*Beneficial impacts occur when there is a significant increase in the amount of skylight and sunlight reaching an existing building where it is required, or in the amount of sunlight reaching an open space.*

*Beneficial impacts should be worked out using the same principles as adverse impacts. Thus a tiny increase in light would be classified as a negligible impact, not a minor beneficial impact.”*

A flexible approach should be taken when assessing the impact with daylight and sunlight being one of many factors that influence the environment when planning a new development.

### 3. Daylight to adjacent buildings.

#### 3.1 Site Overview

The location is on a greenfield site in Ratoath, Co. Meath. There are a mixture of residential unit types in the proposed development consisting of 2-3 storey houses, 3-4 storey maisonettes apartment blocks that are 5 storeys over ground floor parking / ancillary services and some retail.

The South/ Eastern boundary is along the proposed Ratoath outer relief road. There are some established housing to the North and West. There are mature trees being retained along the boundaries, which would reduce any perceptible impact on Daylight and Sunlight.




Figure 1: Aerial view of site.

#### 3.2 Preliminary assessment of adjoining dwellings

The BRE guideline recommends that loss of light to existing windows need not be assessed if the distance of each part of the new development from the existing window is three or more times its height above the centre of the existing window.

The document also states that if part of a new building measured in a vertical section perpendicular to the main window wall of an existing building, from the centre of the lowest window, subtends an angle of more than 25° to the horizontal, then the diffuse light of the existing building may be adversely affected. If a window falls within a 45° angle both in plan and elevation with a new development in place then the window may be affected and should be assessed.



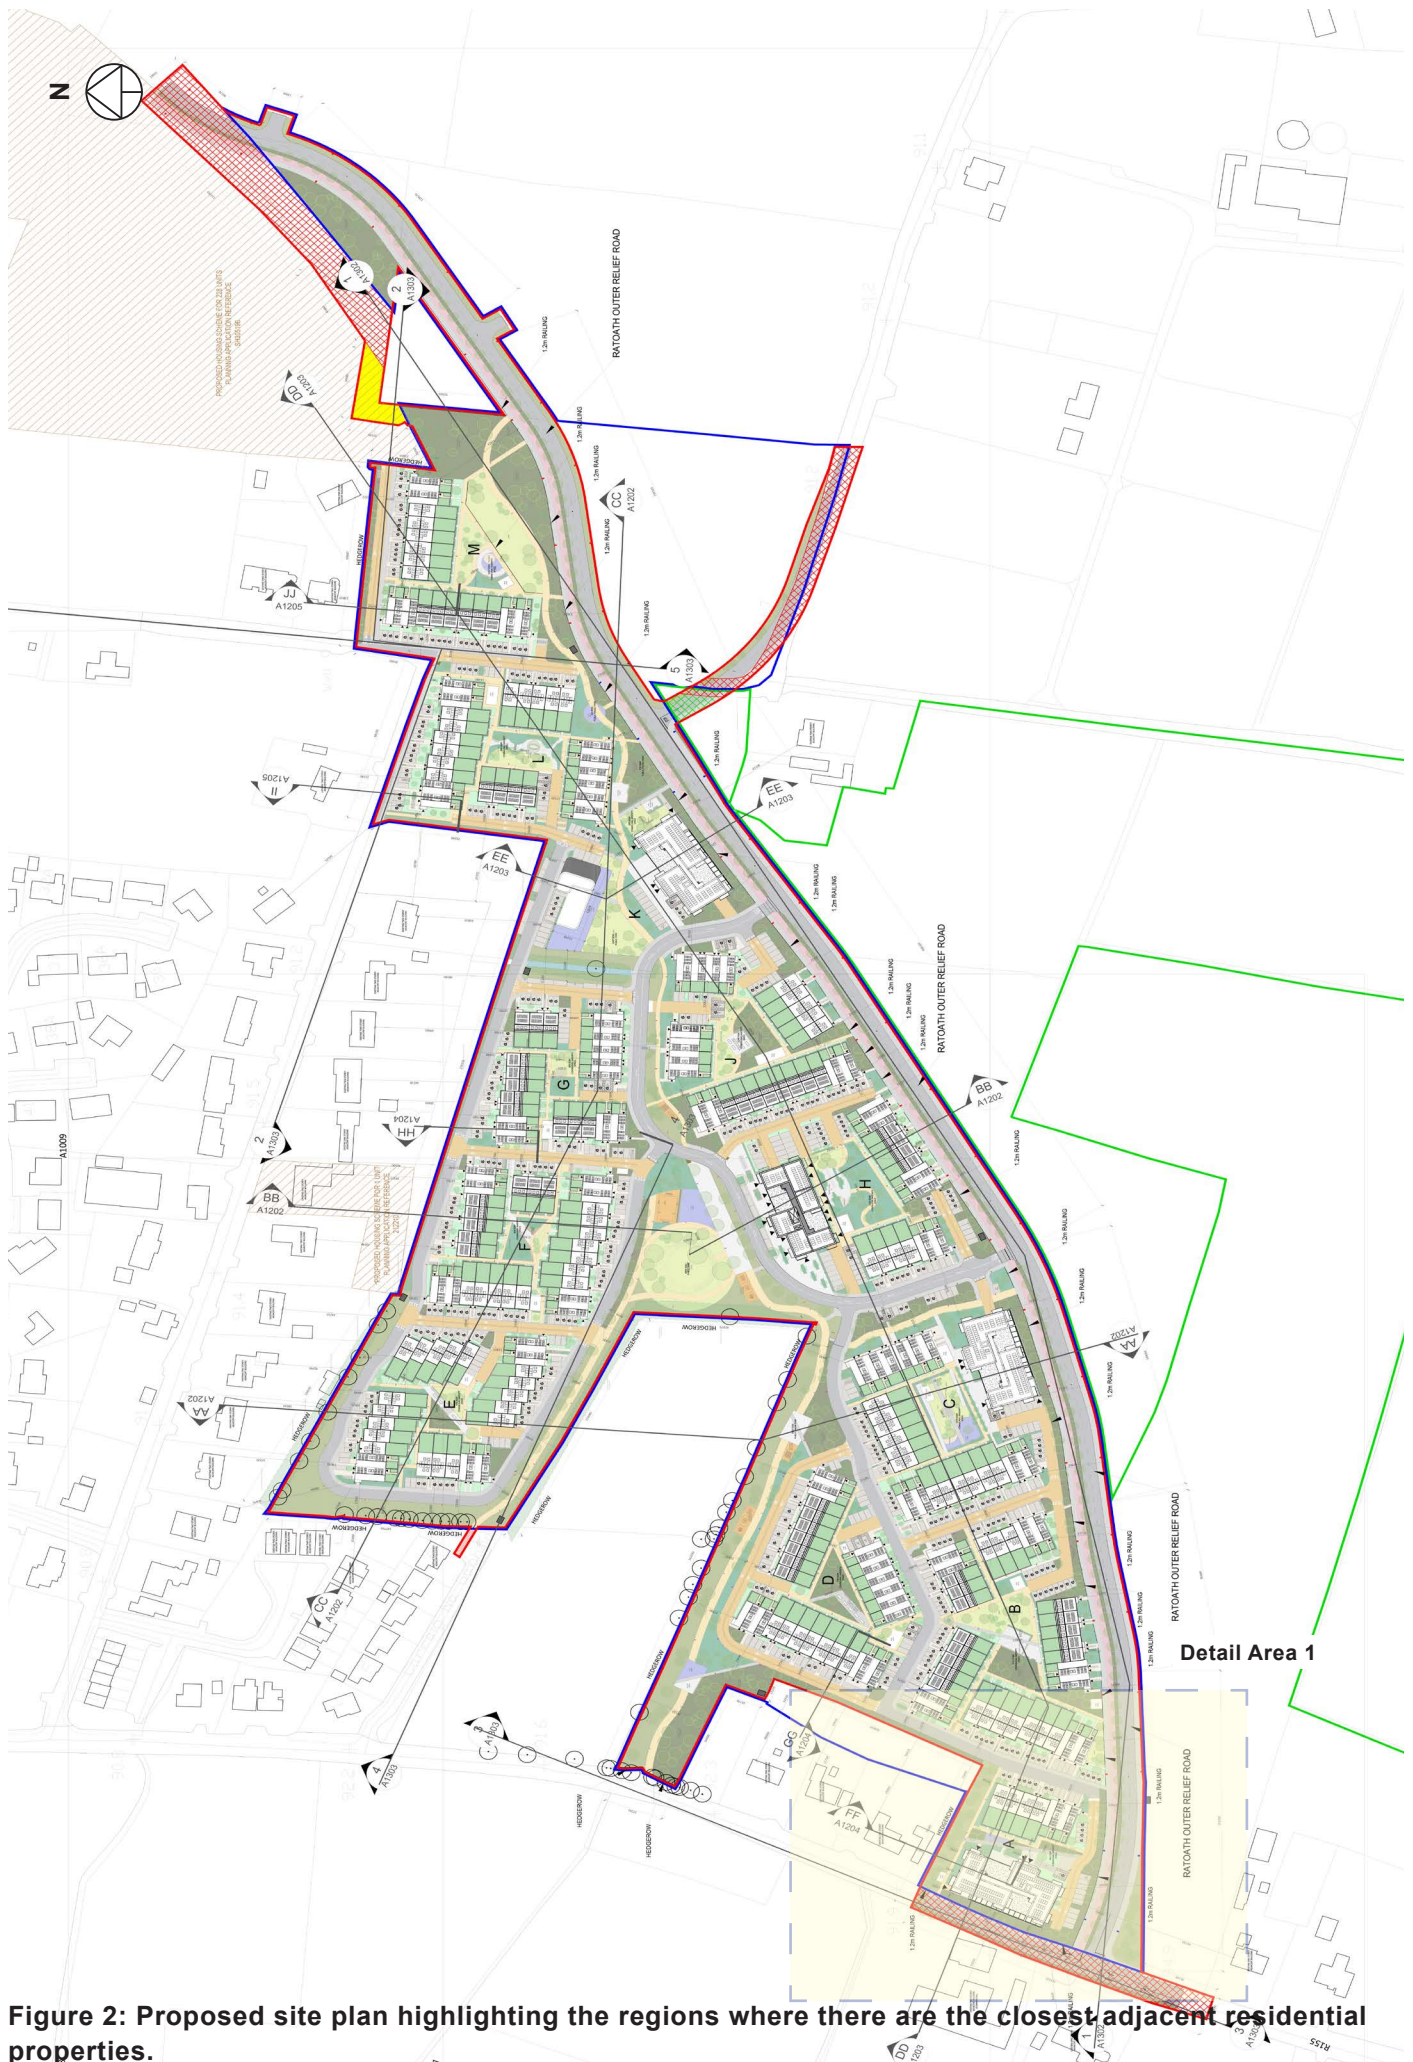

**Figure 2: Proposed site plan highlighting the regions where there are the closest adjacent residential properties.**

### 3.3 Detailed assessment to adjoining dwellings

There are generally 2/3 storey houses along the boundary and they are at a distance from the existing houses that is greater than 3 times the height of the proposed development closest to it. There is a single house on the Fairy House Road (eircode A85 RC66), that has a window facing an apartment block in Neighbourhood A. This is within 3 time the height of the proposed development from the house. This window has been selected for assessment. This is located in Detail Area 1 of Figure 2.

The BRE guidelines recommends assessing the Vertical Sky Component (VSC) of windows to adjacent properties. Test points representing window in the dwellings at locations indicated in Figures 3 & 4. The results are shown in Tables 4 & 5.



Figure 3: View of closest house on Fairy House Road

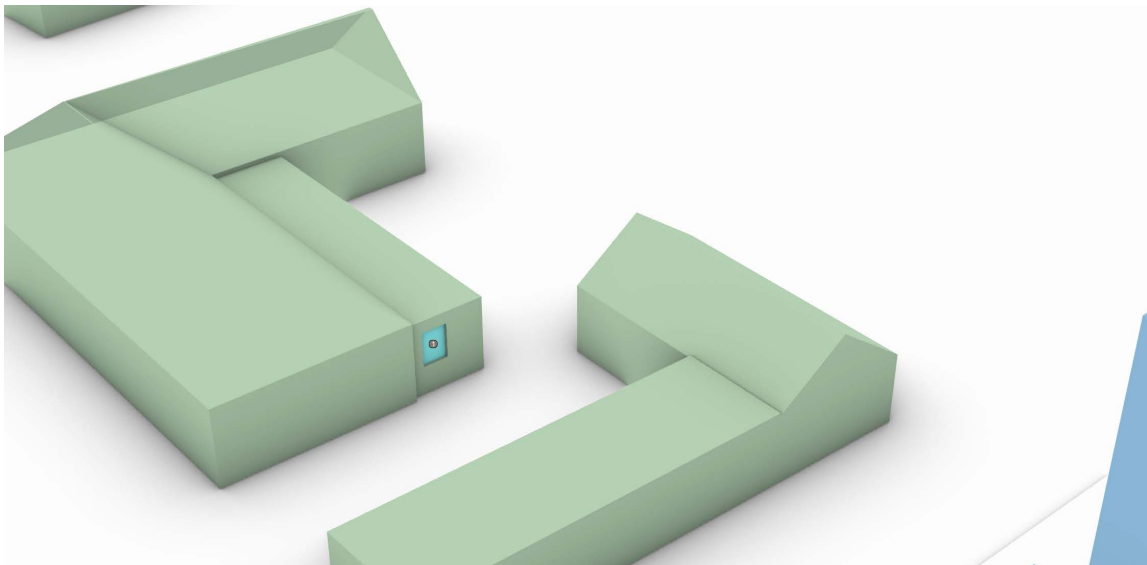


Figure 4: View of model of this house, locating relevant window facing the proposed development, assessed for VSC.

Vertical Sky Component				
Location	Vertical Sky Component Recommended Value > 27%		Ratio	Meets criteria if >27% VSC or <27% but >80% Existing Value
	Existing %	Proposed %	Proposal to Existing Recommended > 80%	
W1	33.19	27.06	81.53%	Yes

Table 4: Vertical sky component for window to side of house.

The BRE guidelines recommend that if a window retains a VSC in excess of 27% with the proposed development in place then it will still receive enough daylight. If the existing VSC is below 27% or is reduced below 27% and below 0.8 times its former value then the diffuse light maybe adversely affected.

### 3.4 Conclusion

There is a minor reduction to the VSC of this window but it meets the recommendations of the BRE guidelines. Any reduction to the daylight in neighbouring dwellings would be imperceptible. The proposed development meets the recommendations of the BRE guidelines.



## 4. Daylight to Proposed Development.

The habitable rooms in the apartment blocks have been assessed for compliance with the BRE guide by calculation of Average Daylight Factor. For supplementary information, compliance is also demonstrated with a calculation of Daylight Provision under EN 17037:2018.

### 4.1 Assessment for Average Daylight Factor

The BRE guidelines recommend that the Average Daylight Factor (ADF) be assessed in habitable rooms of new developments. BS 8206-2 gives minimum values of ADF of 2% for kitchens and living rooms which include a kitchen, 1.5% for living rooms and 1% for bedrooms. An average daylight factor of 5% is a well 'daylit' space. Where there are two room uses within a space then the higher ADF value should be used. The assessment plane covers 100% of living space being considered.

The factors that affect ADF are room depth, window size relative to floor area and closeness to an adjacent obstruction. There is a variety of building types in this development; houses, apartments and maisonette units. All multi-dwelling buildings have been assessed. A full schedule of results and the associated false colour plans representing the analysis of ADF are shown in Appendix A. The room numbering follows the architectural drawings. A summary of the results are displayed in the table below.

Summary of results of the assessment of Average Daylight Factor								
ID	Total Units	Total Bedrooms	LKD > 2% ADF	% reaching 2% target	LKD > 1.5% ADF	% reaching 1.5% target	Bedrooms > 1% ADF	% reaching target
<b>Apartments</b>								
Block A	30	65	30	100%		100%	65	100%
Block C	30	65	30	100%		100%	65	100%
Block H	30	65	30	100%		100%	65	100%
Block K	30	65	30	100%		100%	65	100%
Sub-total	120	260	120	100%		100%	260	100%
<b>Maisonettes</b>								
Neighbourhood A	4	12	3	75%	1	100%	12	100%
Neighbourhood B	20	60	17	85%	3	100%	60	100%
Neighbourhood C	20	56	18	90%	2	100%	56	100%
Neighbourhood D	24	64	23	96%	1	100%	64	100%
Neighbourhood E	12	36	12	100%		100%	36	100%
Neighbourhood F	16	48	16	100%		100%	48	100%
Neighbourhood G	18	48	18	100%		100%	48	100%
Neighbourhood H	12	36	12	100%		100%	36	100%
Neighbourhood J	24	64	24	100%		100%	64	100%
Neighbourhood L	20	56	20	100%		100%	56	100%
Neighbourhood M	12	36	12	100%		100%	36	100%
Sub-total	182	516	175	96%	7	100%	516	100%
<b>Total</b>	<b>302</b>	<b>776</b>	<b>295</b>	<b>98%</b>		<b>100%</b>	<b>776</b>	<b>100%</b>

**Table 5: Summary of the results of multi - dwelling units assessed for ADF. Individual room results can be viewed in Appendix A**

### 4.2 Conclusion

The multi unit buildings consist of 120 no. Apartments and 182 no. Maisonettes and all have been assessed for the average daylight factor. 100% of the apartment units exceed the minimum recommendations for the Average Daylight Factor.

In the maisonette units, 100% of bedrooms and 96% of Living/ Kitchen/ Dining rooms exceed the minimum recommendations for the Average Daylight Factor and will be well daylit. While a small number of LKD are marginally below the 2% target for ADF, they all exceed the 1.5% value. The living kitchens dining rooms that do not achieve the 2% have a layouts that consist of a long room with windows at both ends to the kitchen and the dining room. The layout is well designed with kitchen located beside the window and would receive ample levels of daylight if assessed as a standalone kitchen and would exceed an ADF of 2%. The proposed development meets the recommendations of the BRE Guidelines and BS8206 Part 2:2008 Lighting for Buildings, Code of Practice for Daylighting.

### 4.3 Assessment for Daylight Provision EN17037:2018

For supplementary information, the rooms were assessed for daylight provision in accordance with the criteria set out in EN17037:2018. A complete set of results are shown in Appendix B. In the assessment, the room numbering followed that of the architectural drawings. A summary of the results are displayed in here below.

Fraction of rooms at each compliance level (area-weighted)					
		Fail	Minimum	Medium	High
Apartment & Maisonettes	Target Illuminance	7.0%	12.2%	29.8%	51.1%
	Minimum Illuminance	0.4%	28.6%	28.3%	42.7%

**Table 6: Summary of compliance with EN 17037:2018. Individual room results shown in Appendix B**

### 4.4 Conclusion

The results indicate that the design is optimised for daylight provision with 99% of the units achieving the minimum target illuminance levels and 93% achieving the target levels set out in EN17037:2018.

## 5. Sunlight to habitable rooms of proposed multi-unit buildings

### 5.1 Annual Probable Sunlight Hours

The BRE guidelines recommends that living rooms with window that face within 90° of due South be assessed for Annual Probable Sunlight Hours (APSH) and Winter Probable Sunlight Hours (WPSH) for the winter period from September to March. It is recommended that the APSH be greater than 25% of the total sunlight hours possible and that the WPSH be greater than 5%. In Ireland this is an APSH of greater than 414 hours and WPSH of greater than 75 hours.

All windows to living rooms in the multi-unit buildings have been assessed. Bedrooms need not be assessed. Appendix C details the results per Living/ Kitchen/ Dining room, indicating if this room has a relevant South facing window. The unit numbering follows that of the architectural drawings. A summary of the results are displayed in the table below.

Annual Probable Sunlight Hours Summary Table							
	Total Units	No. of units with LKD window within 90° South	Ratio of units with LKD window within 90° South	APSH		WPSH	
				No. of windows meet criteria	Ratio meet criteria	No. of windows meet criteria	Ratio meet criteria
Apartments	120	100	83%	110	92%	108	90%
Maisonettes	182	173	95%	170	93%	171	94%
Total	302	273	90%	280	93%	279	92%

**Table 7: Summary of results of assessment of APSH & WPSH.**

### 5.2 Comment on the assessment of Annual Probable Sunlight Hours

The BRE Guidelines recommend maximising the amount of units that have a window within 90° due South but does not have set targets. Additionally windows with an aspect of greater than 90° due South, like West or North East, will still receive sunlight, but it is likely to be lesser amounts especially in the winter period.

This scheme is well designed for Sunlight, many units are dual aspect. Overall, a high percentage (90%), have a LKD with a window that faces within 90° South.

### 5.3 Conclusion

The design and layout of the multi-unit buildings are optimised to receive the available sunlight and maximise the number of units with a window wall within 90° of due South at 90%. Overall 92% of the multi-units buildings exceed the target values set out for both APSH and WPSH. The proposed development meets the recommendations of the BRE guidelines for sunlight.



## 6. Sunlight to gardens and open spaces

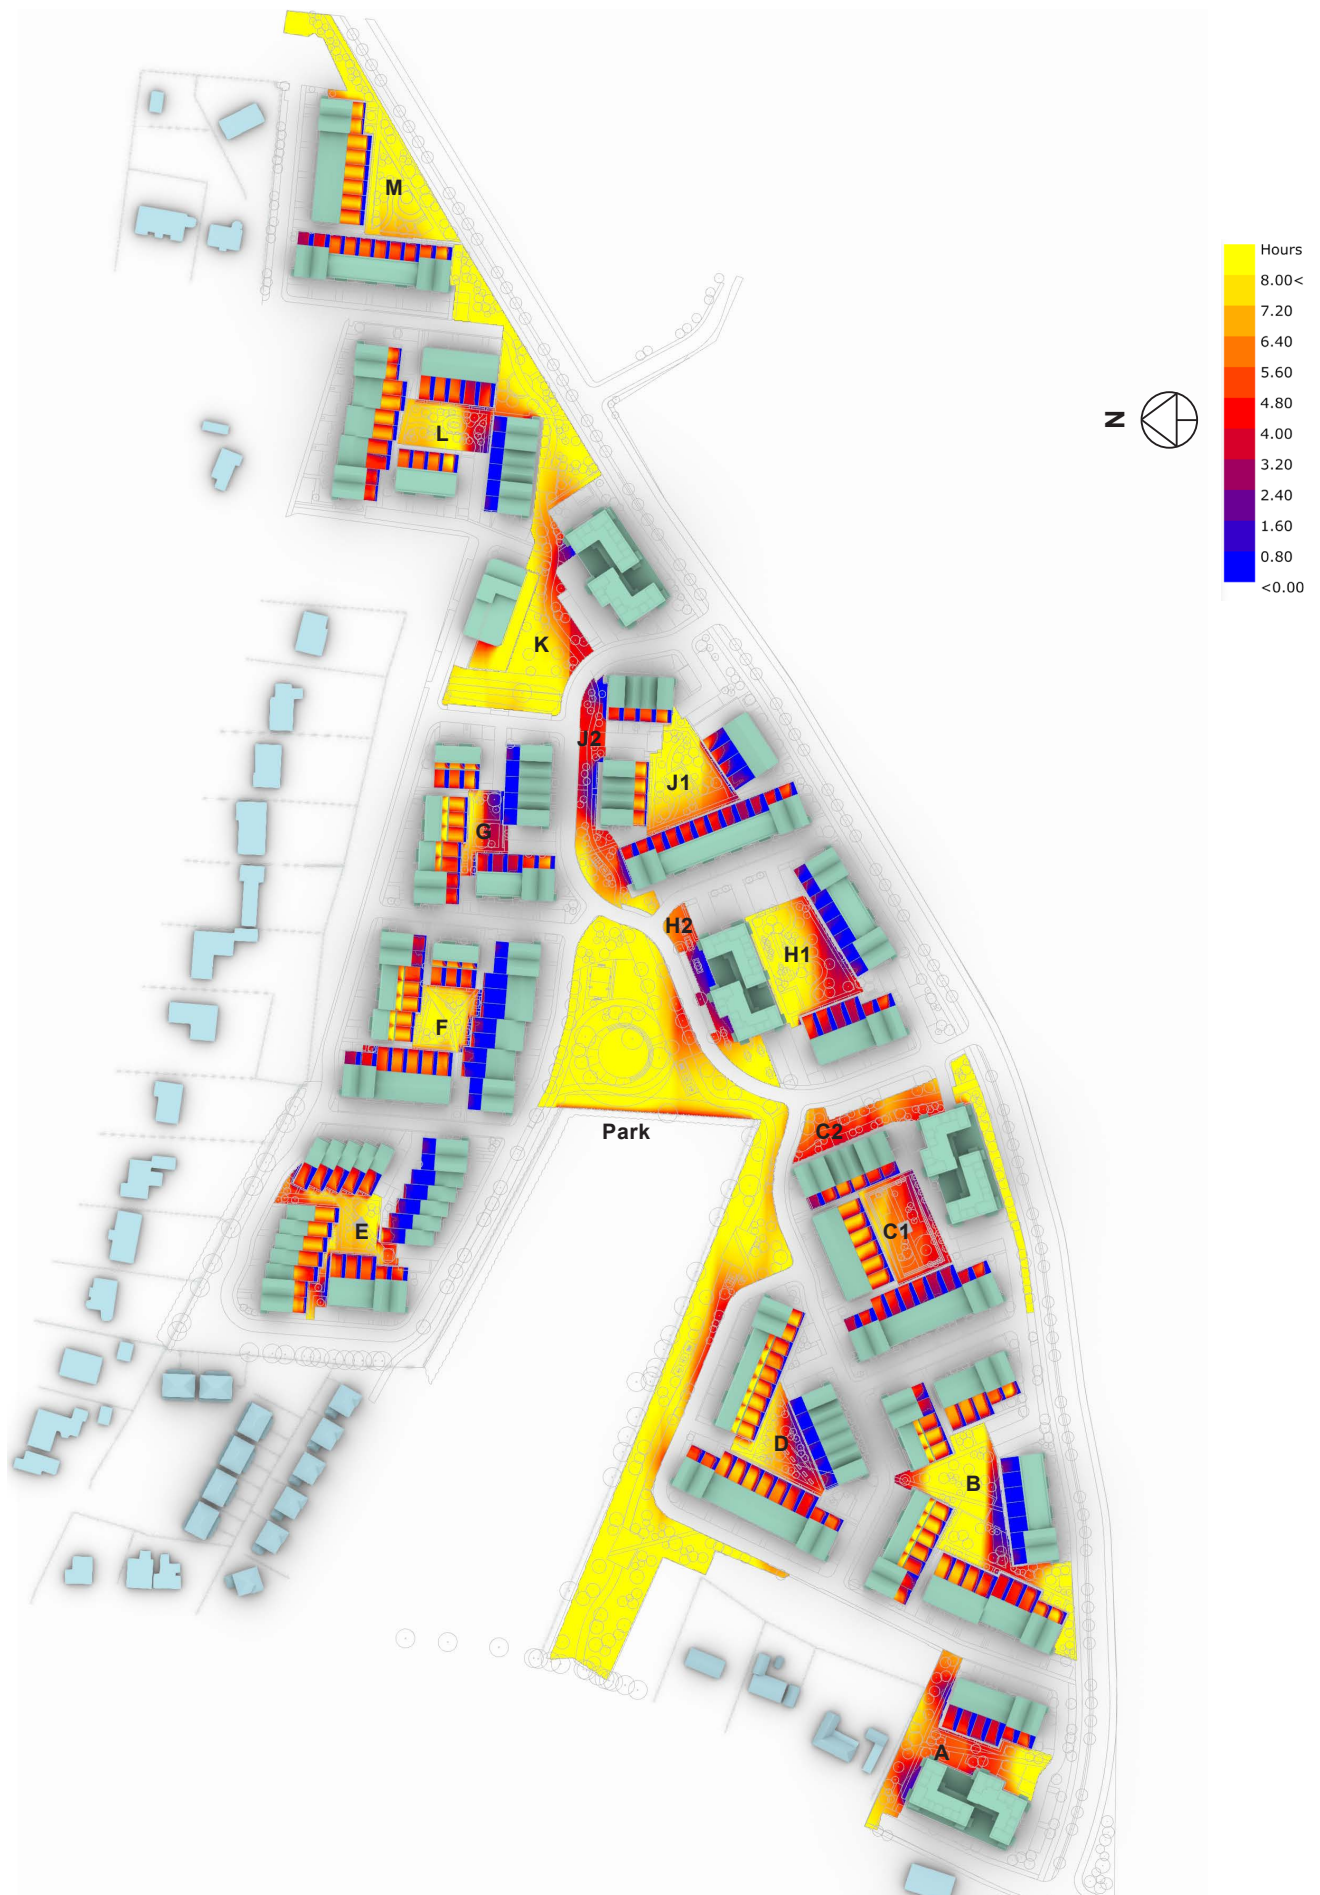


Figure 5: Radiation map of amenity areas, showing available sunlight on 21st March. The scale represents the percentage of daylight received from 0 - 8 hrs.

## 6.1 Sunlight to Amenity within the Proposed Development

The BRE document indicates that for an amenity area to have good quality sunlight throughout the year, 50% should receive in excess of 2 hours sunlight on the 21st March. It also states that front gardens need not be assessed for sunlight.

A plan with generated analysis from a calculation of Sun on the Ground is shown in Figure 5 above. A variety of public & communal amenity spaces have been designed into this scheme. These have all been assessed. Table 8 below shown the results for the communal areas.

All of the private amenity gardens in the development have been assessed. A summary of the results is shown in Table 9 below. A full schedule of results can be viewed in Appendix D.

Sunlight on the Ground - Communal Amenity		
Neighbourhood	Proposed: % Area receiving 2 hours sunlight on 21st March	Meets Criteria
A	93.5%	Yes
B	95.0%	Yes
C1	96.5%	Yes
C2	96.1%	Yes
D	97.2%	Yes
E	97.9%	Yes
F	100.0%	Yes
G	89.1%	Yes
H1	95.1%	Yes
H2	79.4%	Yes
J1	94.8%	Yes
J2	82.2%	Yes
K	99.4%	Yes
M	100.0%	Yes
Public Park	100.0%	Yes

**Table 8: Calculation of Sun on the Ground to public amenity spaces within the development**

Sunlight on the Ground - Summary of Private Amenity Gardens		
Total Spaces	No. meets criteria	% meets criteria
332	232	70%

**Table 9: Calculation of Sun on the Ground to private amenity spaces within the development**

## 6.2 Discussion

There is a variety of communal amenity spaces designed into the scheme. All the public amenity space will exceed the BRE recommendation that 50% of the area receive more than 2 hours of sunlight on the 21st March.

All of the private amenity gardens in the proposed development were assessed. It is the nature of a housing estate that plots orient in all directions. This estate is well designed for sunlight, with more that 70% meeting the BRE recommendation that 50% of the area receive more than 2 hours of sunlight on the 21st March.

## 6.3 Conclusion

100% of the public amenity spaces throughout the development receives in excess of 2 hours sunlight over 50% of the space and in most cases they achieve in excess of 90%. In excess of 70% of the private amenity spaces to the houses and maisonettes achieve 2 hours sunlight over 50% of the amenity space indicating that the layout of the houses is well considered to maximise available sunlight.

## 7. Shadow Diagrams

### 7.1 BRE Guidance on Shadow Studies

The BRE guidelines recommend using the 21st March for plotting shadow, it states:

*“If a space is used all year round, the equinox (21 March) is the best date for which to prepare shadow plots as it gives an average level of shadowing. Lengths of shadows at the autumn equinox (21 September) will be the same as those for 21 March, so a separate set of plots for September is not required.”*

June 21st and December 21st are provided below for information but it should be noted that the summer solstice is the best case scenario with shadows at their shortest. September is also shown with Daylight Saving applied, The guidelines recommends that “Sunlight at an altitude of 10° or less does not count”. In Winter even low buildings will cast long shadows and it is common for large areas of the ground to be in shadow throughout the day especially in a built up area as the sun barely rises above an altitude of 10° during the course of the day. Below are the times for the Equinox and Solstice that the sun is above 10° altitude rounded to the nearest half hour.

Equinox: Between 8:30 and 17:30

Summer Solstice: Between 6:30 and 20:00

Winter Solstice: Between 10:30 and 14:00

### 7.2 Discussion

The site is a greenfield site, there is no shadows cast from any structures on the site at present so only the proposed condition is plotted.

Shadow diagrams are a visual aid to understand where possible shading may occur. The use of shadow diagrams as an assessment method should be taken over the course of the day and not a specific time due to the transient nature of the sun and the shade caused by obstructions.

Section 7.3 shows the proposed shadow diagrams for the Equinox on the 21st March at two hour intervals during the day between 09:00 and 17:00.

Section 7.4 shows the proposed shadow diagrams for the Summer Solstice on the 21st June at two hourly intervals during the day between 10:00 and 18:00.

Section 7.5 shows the proposed shadow diagrams for the Equinox on the 21st September at two hour intervals during the day between 09:00 and 17:00.

Section 7.6 shows the proposed shadow diagrams for the Winter Solstice on the 21st December at two hourly intervals during the day between 09:00 and 15:00.

### 7.3 Shadow Casting diagrams March Equinox



Figure 6: Shadow diagrams 21 March 09:00 UTC





Figure 7: Shadow diagrams 21 March 11:00 UTC



Figure 8: Shadow diagrams 21 March 13:00 UTC



Figure 9: Shadow diagrams 21 March 15:00 UTC





Figure 10: Shadow diagrams 21 March 17:00 UTC



## 7.4 Shadow Casting diagrams June Solstice



Figure 11: Shadow diagrams 21 June 10:00 UTC+1



Figure 12: Shadow diagrams 21 June 12:00 UTC+1

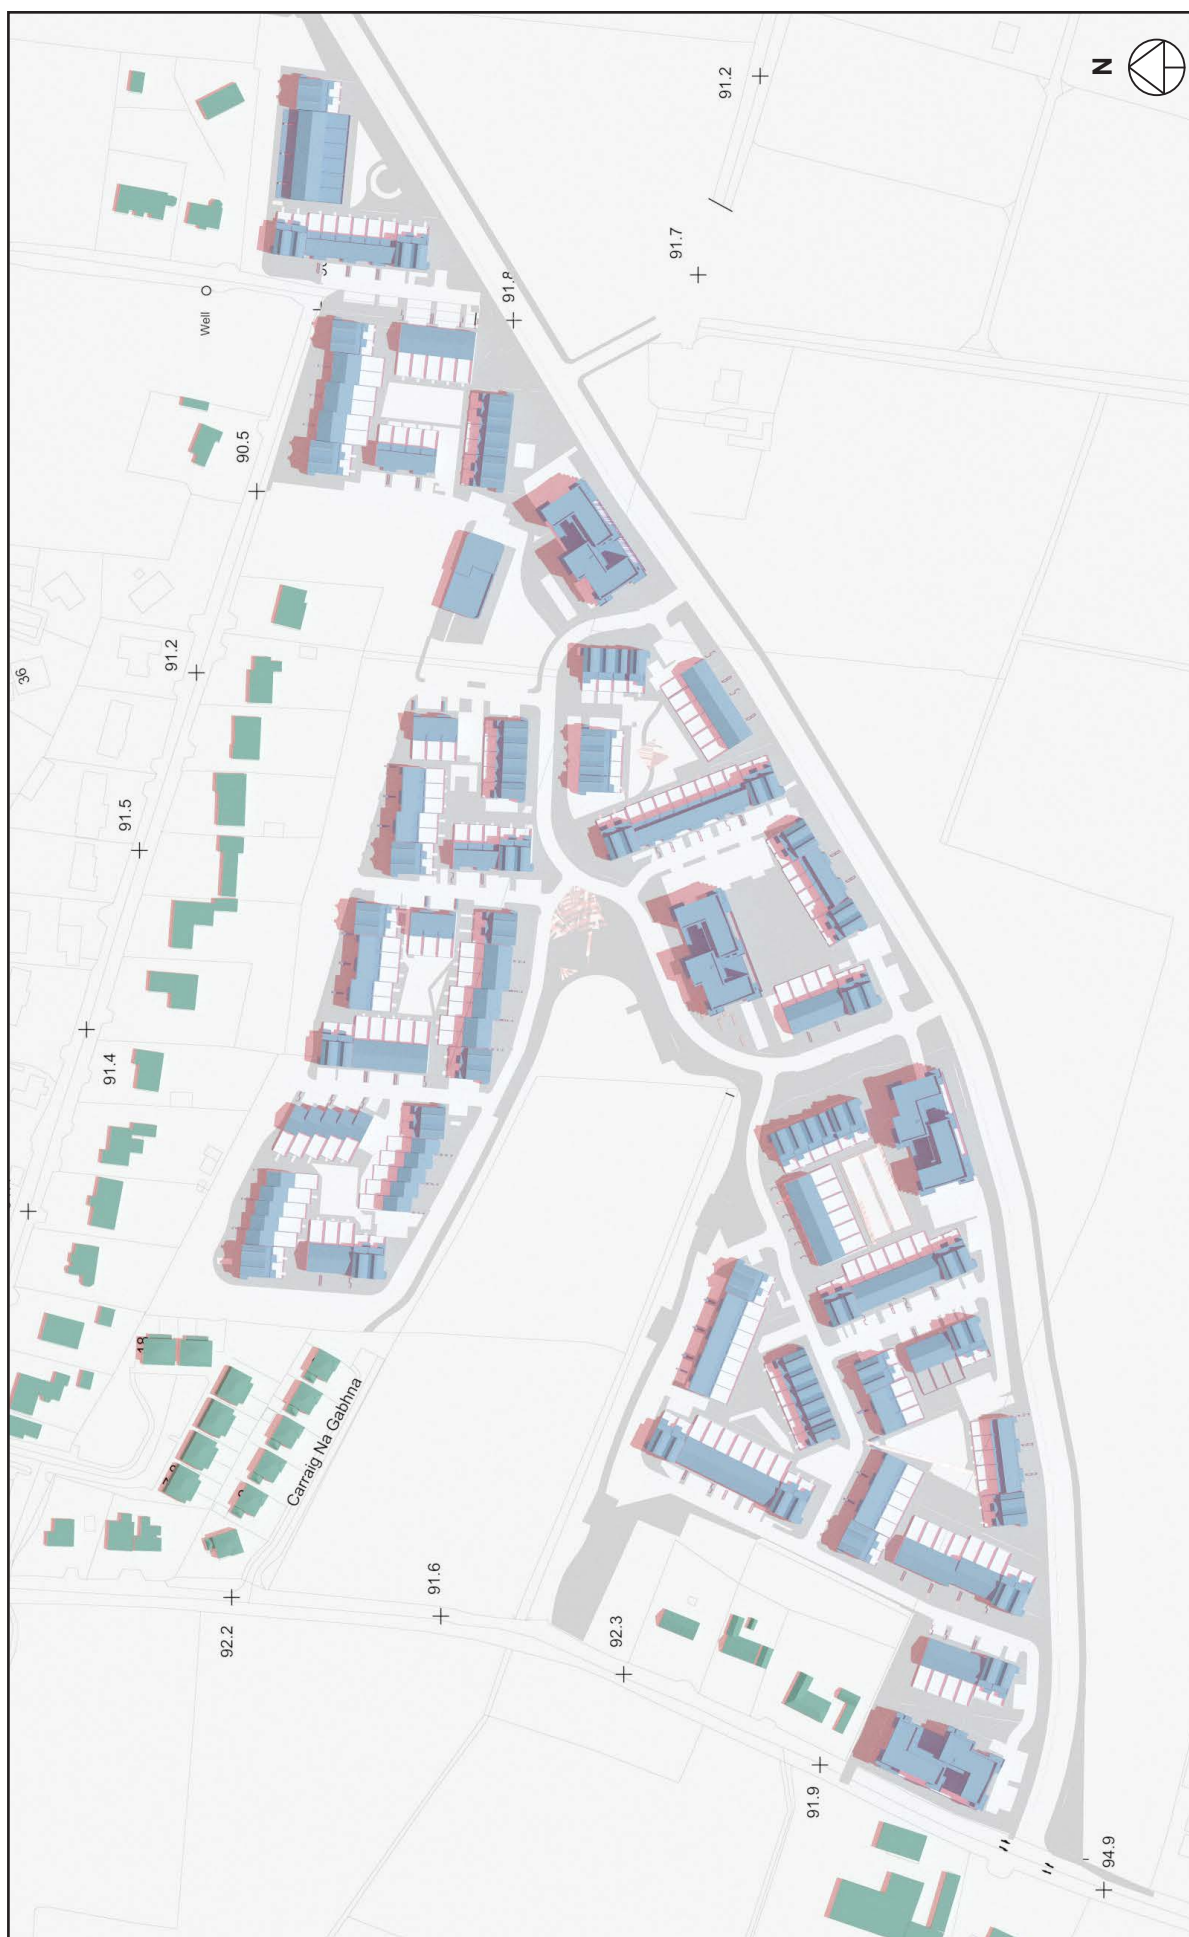


Figure 13: Shadow diagrams 21 June 14:00 UTC+1





Figure 14: Shadow diagrams 21 June 16:00 UTC+1



Figure 15: Shadow diagrams 21 June 18:00 UTC+1

## 7.5 Shadow Casting diagrams September Equinox



Figure 16: Shadow diagrams 21 September 09:00 UTC+1





Figure 17: Shadow diagrams 21 September 11:00 UTC+1



Figure 18: Shadow diagrams 21 September 13:00 UTC+1





Figure 19: Shadow diagrams 21 September 15:00 UTC+1



Figure 20: Shadow diagrams 21 September 17:00 UTC+1

## 7.6 Shadow Casting diagrams December Solstice



Figure 21: Shadow diagrams 21 December 09:00 UTC





Figure 22: Shadow diagrams 21 December 11:00 UTC



Figure 23: Shadow diagrams 21 December 13:00 UTC



Figure 24: Shadow diagrams 21 December 15:00 UTC



## Appendix A - Average Daylight Factor Tables for Habitable Rooms in Multi Unit Blocks

Fifth Floor



Fourth Floor



Third Floor


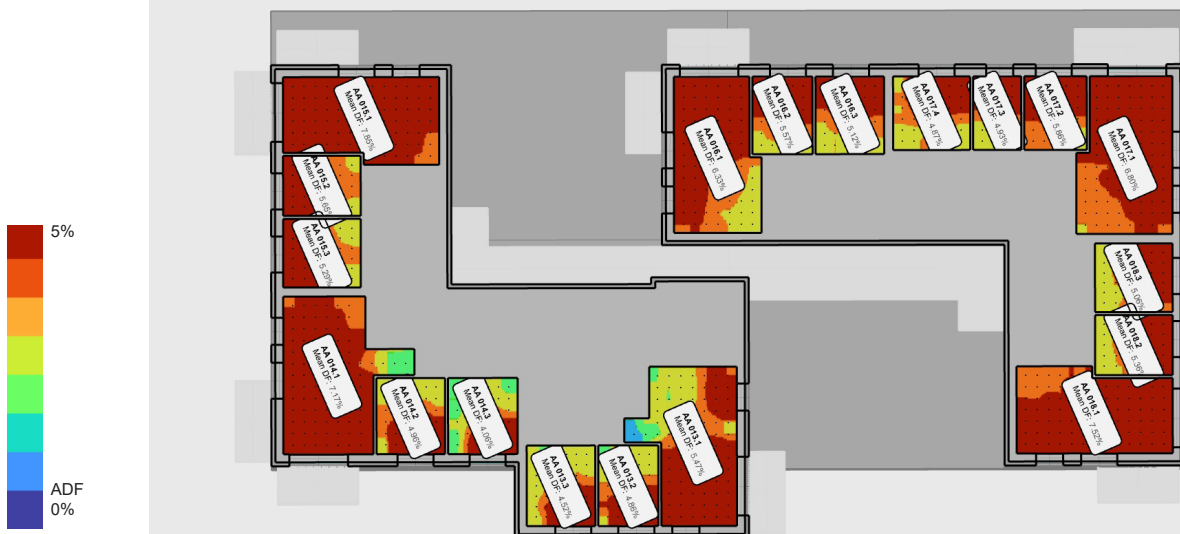


Figure 25: Apartment Block A - All floors false colour plans of ADF. Scale 0 - 5%

## Second Floor

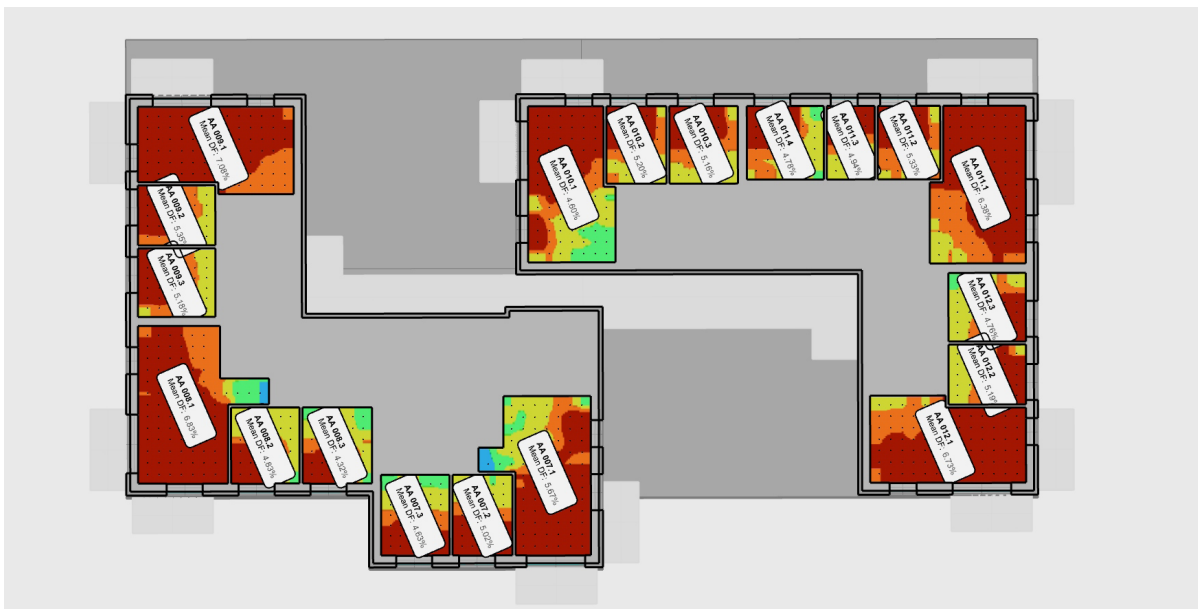

## First Floor


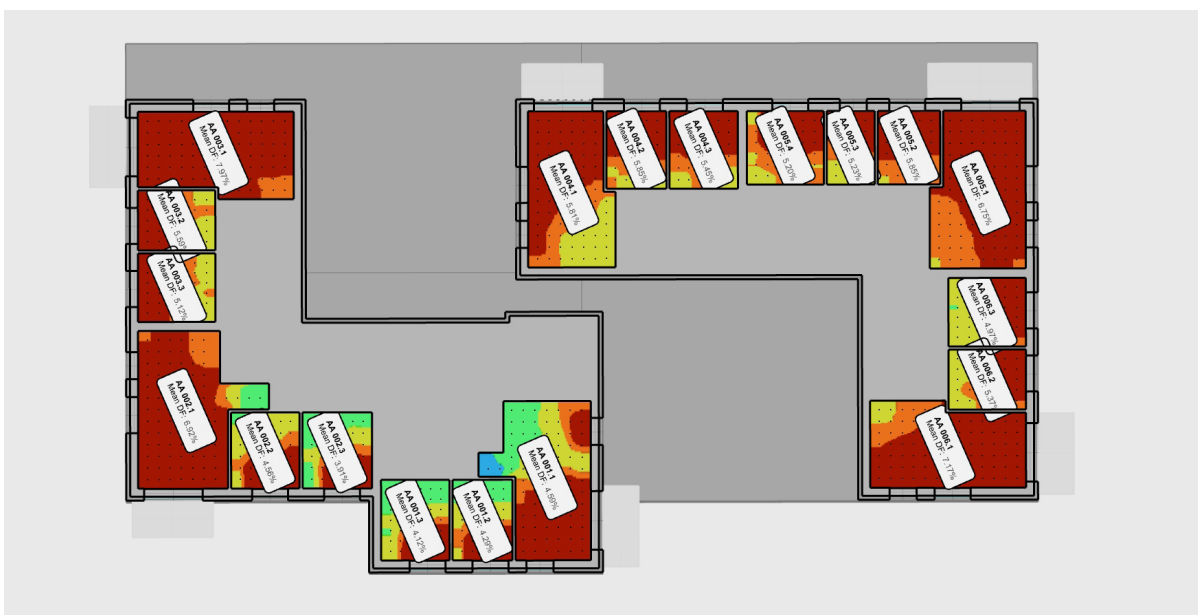


Figure 25 contd : Block A - All floors false colour plans of ADF. Scale 0 - 5%




## Average Daylight Factor - Apartment Block A

Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
AA 001.1	LKD	33.8	86	4.58%	2%	Y
AA 001.2	Bed	12.1	35	4.31%	1%	Y
AA 001.3	Bed	13.8	42	4.13%	1%	Y
AA 002.1	LKD	37.1	90	6.95%	2%	Y
AA 002.2	Bed	13.0	36	4.62%	1%	Y
AA 002.3	Bed	13.2	36	3.73%	1%	Y
AA 003.1	LKD	31.7	84	8.02%	2%	Y
AA 003.2	Bed	11.6	30	5.57%	1%	Y
AA 003.3	Bed	13.3	36	5.12%	1%	Y
AA 004.1	LKD	31.7	84	5.91%	2%	Y
AA 004.2	Bed	11.6	30	5.93%	1%	Y
AA 004.3	Bed	13.3	36	5.46%	1%	Y
AA 005.1	LKD	35.2	97	6.87%	2%	Y
AA 005.2	Bed	11.5	30	5.96%	1%	Y
AA 005.3	Bed	8.8	24	5.28%	1%	Y
AA 005.4	Bed	14.1	36	5.20%	1%	Y
AA 006.1	LKD	31.5	84	7.31%	2%	Y
AA 006.2	Bed	11.6	30	5.46%	1%	Y
AA 006.3	Bed	13.3	36	5.12%	1%	Y
AA 007.1	LKD	33.8	86	5.81%	2%	Y
AA 007.2	Bed	12.1	35	4.95%	1%	Y
AA 007.3	Bed	13.8	42	4.57%	1%	Y
AA 008.1	LKD	37.1	90	6.79%	2%	Y
AA 008.2	Bed	13.0	36	4.82%	1%	Y
AA 008.3	Bed	13.2	36	4.32%	1%	Y
AA 009.1	LKD	31.7	84	7.19%	2%	Y
AA 009.2	Bed	11.6	30	5.35%	1%	Y
AA 009.3	Bed	13.3	36	5.21%	1%	Y
AA 010.1	LKD	31.7	84	4.64%	2%	Y
AA 010.2	Bed	11.6	30	5.37%	1%	Y
AA 010.3	Bed	13.3	36	5.15%	1%	Y
AA 011.1	LKD	35.2	97	6.53%	2%	Y
AA 011.2	Bed	11.5	30	5.44%	1%	Y
AA 011.3	Bed	8.8	24	5.00%	1%	Y
AA 011.4	Bed	14.1	36	4.91%	1%	Y
AA 012.1	LKD	31.5	84	6.81%	2%	Y
AA 012.2	Bed	11.6	30	5.32%	1%	Y
AA 012.3	Bed	13.3	36	5.00%	1%	Y
AA 013.1	LKD	33.8	86	5.52%	2%	Y
AA 013.2	Bed	12.1	35	4.86%	1%	Y
AA 013.3	Bed	13.8	42	4.64%	1%	Y
AA 014.1	LKD	37.1	90	7.22%	2%	Y
AA 014.2	Bed	13.0	36	5.02%	1%	Y
AA 014.3	Bed	13.2	36	4.07%	1%	Y
AA 015.1	LKD	31.7	84	7.90%	2%	Y
AA 015.2	Bed	11.6	30	5.70%	1%	Y
AA 015.3	Bed	13.3	36	5.24%	1%	Y
AA 016.1	LKD	31.7	84	6.41%	2%	Y
AA 016.2	Bed	11.6	30	5.71%	1%	Y
AA 016.3	Bed	13.3	36	5.22%	1%	Y


Average Daylight Factor - Apartment Block A						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
AA 017.1	LKD	35.2	97	6.95%	2%	Y
AA 017.2	Bed	11.5	30	5.78%	1%	Y
AA 017.3	Bed	8.8	24	5.01%	1%	Y
AA 017.4	Bed	14.1	36	4.94%	1%	Y
AA 018.1	LKD	31.5	84	7.63%	2%	Y
AA 018.2	Bed	11.6	30	5.60%	1%	Y
AA 018.3	Bed	13.3	36	5.28%	1%	Y
AA 019.1	LKD	33.8	86	6.78%	2%	Y
AA 019.2	Bed	12.1	35	5.26%	1%	Y
AA 019.3	Bed	13.8	42	4.88%	1%	Y
AA 020.1	LKD	37.1	90	7.07%	2%	Y
AA 020.2	Bed	13.0	36	5.04%	1%	Y
AA 020.3	Bed	13.2	36	4.57%	1%	Y
AA 021.1	LKD	31.7	84	7.35%	2%	Y
AA 021.2	Bed	11.6	30	5.34%	1%	Y
AA 021.3	Bed	13.3	36	5.25%	1%	Y
AA 022.1	LKD	31.7	84	6.24%	2%	Y
AA 022.2	Bed	11.6	30	5.40%	1%	Y
AA 022.3	Bed	13.3	36	5.21%	1%	Y
AA 023.1	LKD	35.2	97	6.76%	2%	Y
AA 023.2	Bed	11.5	30	5.44%	1%	Y
AA 023.3	Bed	8.8	24	4.96%	1%	Y
AA 023.4	Bed	14.1	36	4.95%	1%	Y
AA 024.1	LKD	31.5	84	7.15%	2%	Y
AA 024.2	Bed	11.6	30	5.35%	1%	Y
AA 024.3	Bed	13.3	36	5.00%	1%	Y
AA 025.1	LKD	33.8	86	7.18%	2%	Y
AA 025.2	Bed	12.1	35	5.25%	1%	Y
AA 025.3	Bed	13.8	42	4.72%	1%	Y
AA 026.1	LKD	37.1	90	7.90%	2%	Y
AA 026.2	Bed	13.0	36	5.22%	1%	Y
AA 026.3	Bed	13.2	36	4.67%	1%	Y
AA 027.1	LKD	31.7	84	8.57%	2%	Y
AA 027.2	Bed	11.6	30	5.75%	1%	Y
AA 027.3	Bed	13.3	36	5.28%	1%	Y
AA 028.1	LKD	31.7	84	8.32%	2%	Y
AA 028.2	Bed	11.6	30	5.72%	1%	Y
AA 028.3	Bed	13.3	36	5.32%	1%	Y
AA 029.1	LKD	35.2	97	7.90%	2%	Y
AA 029.2	Bed	11.5	30	5.90%	1%	Y
AA 029.3	Bed	8.8	24	5.09%	1%	Y
AA 029.4	Bed	14.1	36	5.00%	1%	Y
AA 030.1	LKD	31.5	84	8.34%	2%	Y
AA 030.2	Bed	13.3	36	5.30%	1%	Y
AA 030.2	Bed	11.6	30	5.77%	1%	Y

**Table 10: Block A - Average Daylight Factor of all habitable rooms**

## Fifth Floor

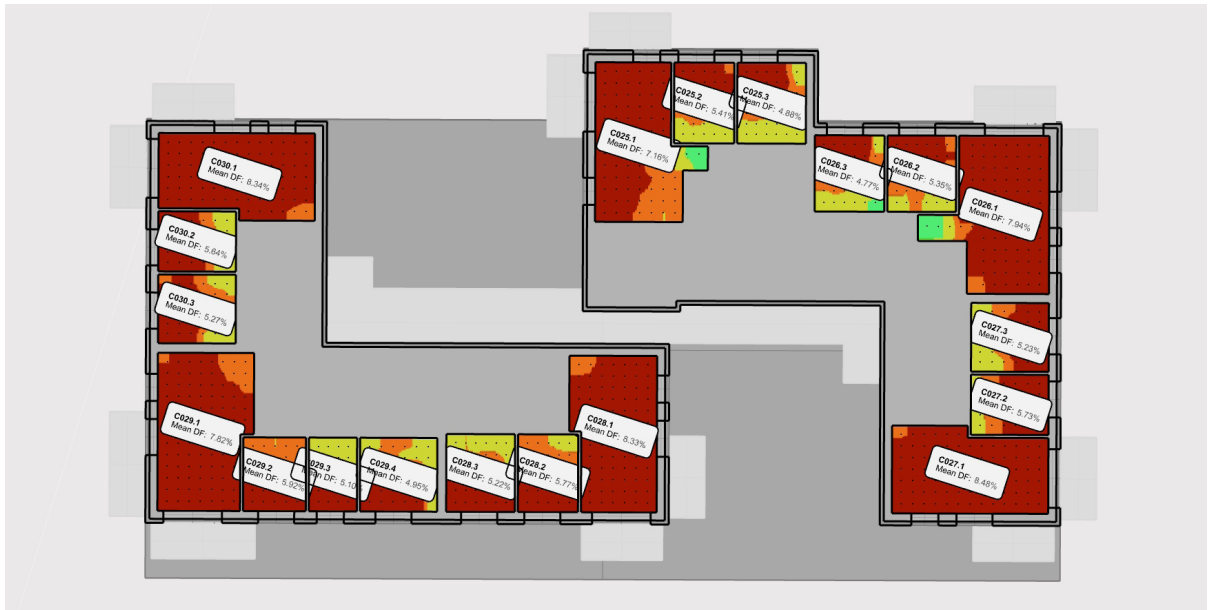

## Fourth Floor

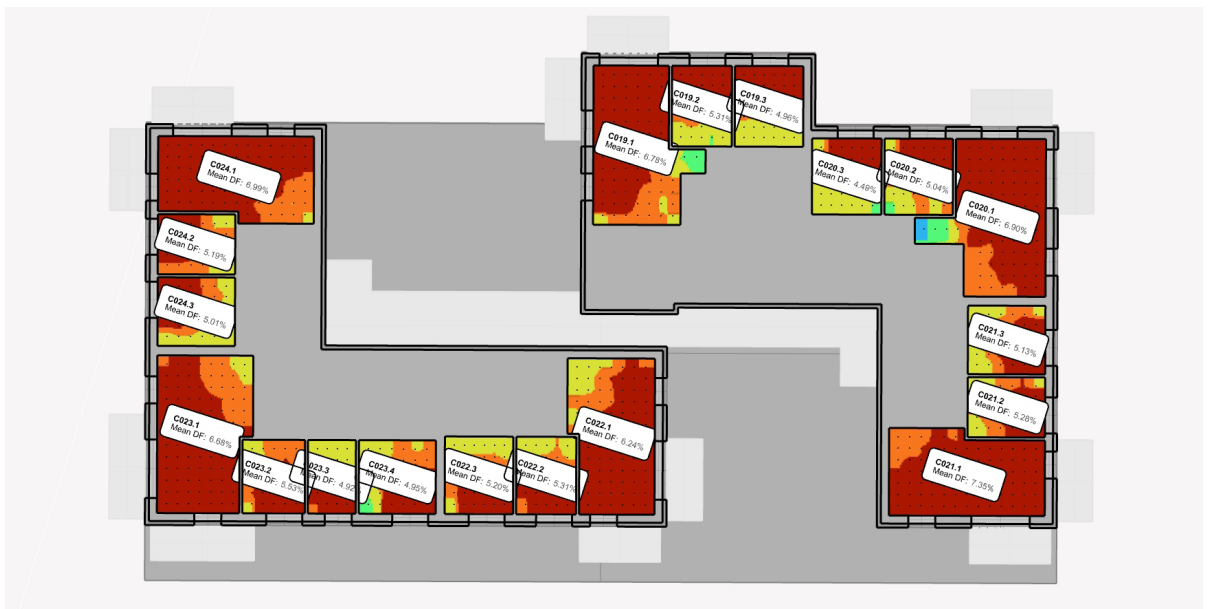

## Third Floor


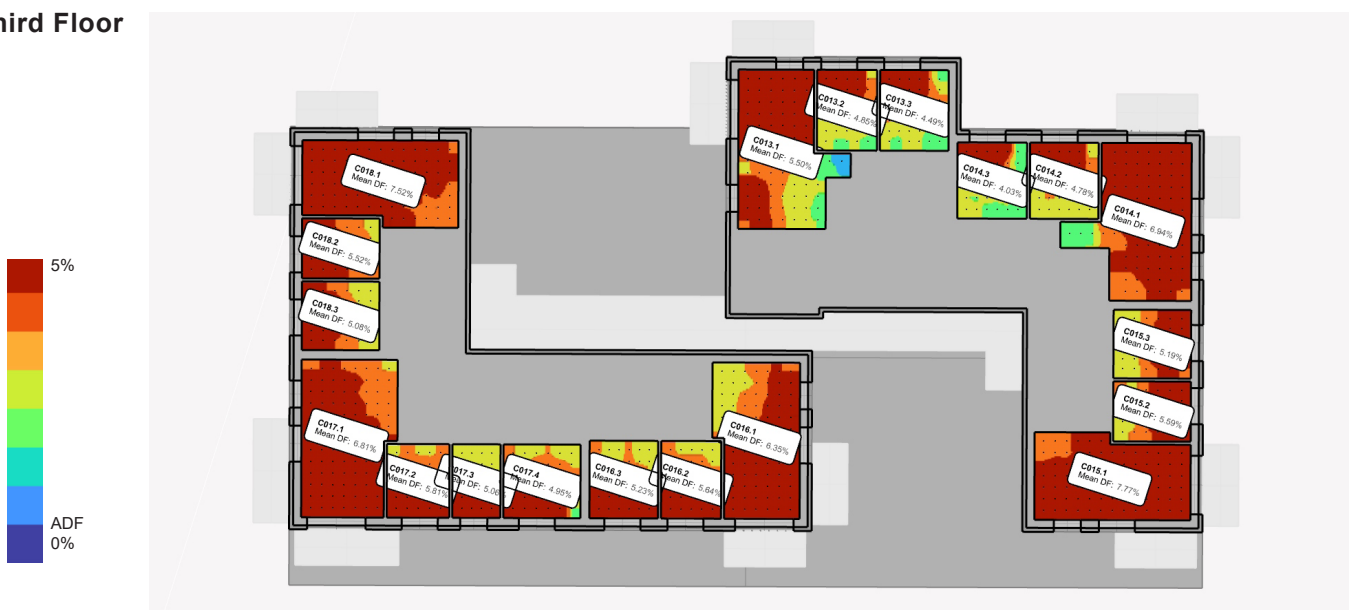


Figure 26: Apartment Block C - All floors false colour plans of ADF. Scale 0 - 5%

## Second Floor

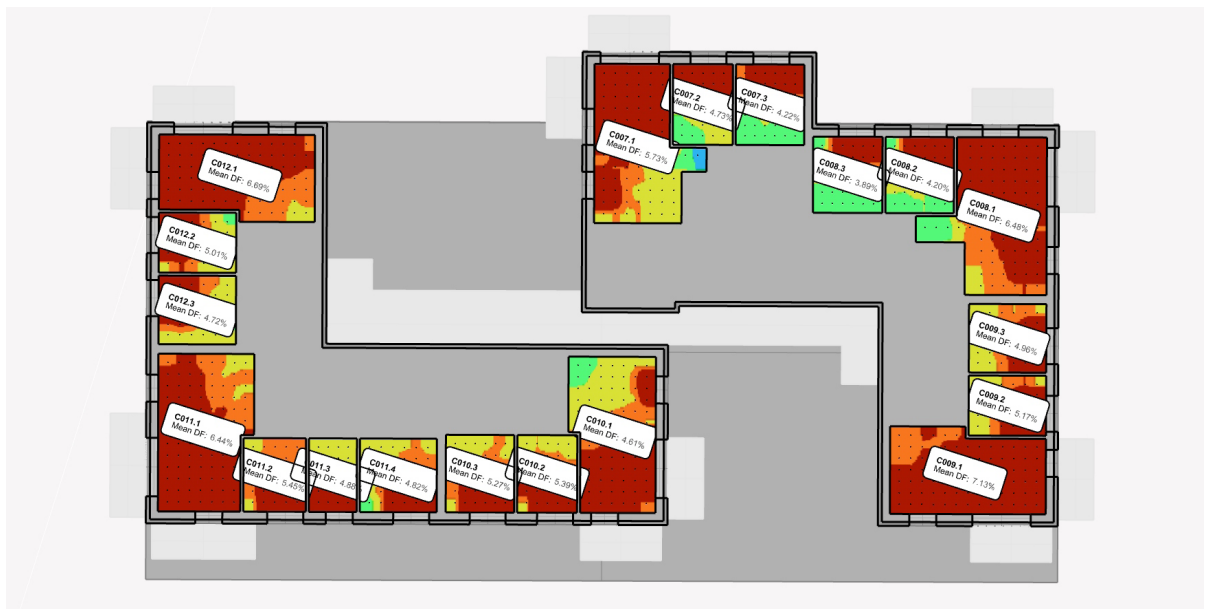

## First Floor

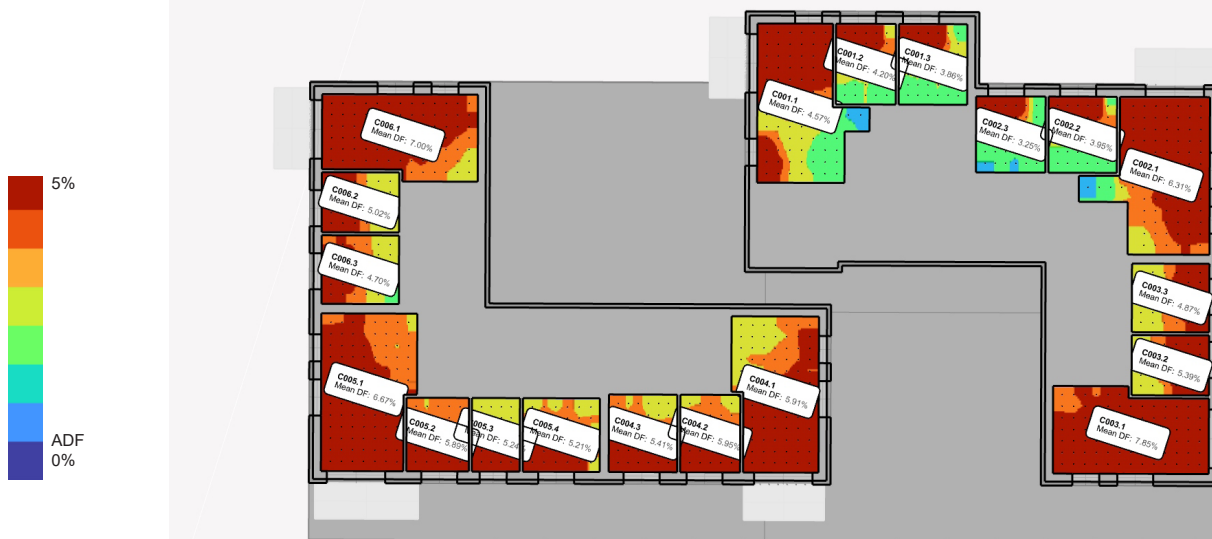


Figure 26 contd : Block C - All floors false colour plans of ADF. Scale 0 - 5%




## Average Daylight Factor - Apartment Block C

Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
C001.1	LKD	33.8	86	4.54%	2%	Y
C001.2	Bed	12.1	35	4.18%	1%	Y
C001.3	Bed	13.8	42	3.81%	1%	Y
C002.1	LKD	37.1	90	6.29%	2%	Y
C002.2	Bed	13.0	36	3.92%	1%	Y
C002.3	Bed	13.2	36	3.21%	1%	Y
C003.1	LKD	31.7	84	7.89%	2%	Y
C003.2	Bed	11.6	30	5.39%	1%	Y
C003.3	Bed	13.3	36	4.95%	1%	Y
C004.1	LKD	31.7	84	5.90%	2%	Y
C004.2	Bed	11.6	30	5.90%	1%	Y
C004.3	Bed	13.3	36	5.41%	1%	Y
C005.1	LKD	35.2	97	6.64%	2%	Y
C005.2	Bed	11.5	30	6.01%	1%	Y
C005.3	Bed	8.8	24	5.19%	1%	Y
C005.4	Bed	14.1	36	5.21%	1%	Y
C006.1	LKD	31.5	84	7.01%	2%	Y
C006.2	Bed	11.6	30	4.99%	1%	Y
C006.3	Bed	13.3	36	4.75%	1%	Y
C007.1	LKD	33.8	86	5.71%	2%	Y
C007.2	Bed	12.1	35	4.74%	1%	Y
C007.3	Bed	13.8	42	4.40%	1%	Y
C008.1	LKD	37.1	90	6.42%	2%	Y
C008.2	Bed	13.0	36	4.38%	1%	Y
C008.3	Bed	13.2	36	3.91%	1%	Y
C009.1	LKD	31.7	84	7.14%	2%	Y
C009.2	Bed	11.6	30	5.16%	1%	Y
C009.3	Bed	13.3	36	4.96%	1%	Y
C010.1	LKD	31.7	84	4.64%	2%	Y
C010.2	Bed	11.6	30	5.31%	1%	Y
C010.3	Bed	13.3	36	5.19%	1%	Y
C011.1	LKD	35.2	97	6.37%	2%	Y
C011.2	Bed	11.5	30	5.46%	1%	Y
C011.3	Bed	8.8	24	5.00%	1%	Y
C011.4	Bed	14.1	36	4.97%	1%	Y
C012.1	LKD	31.5	84	6.72%	2%	Y
C012.2	Bed	11.6	30	5.01%	1%	Y
C012.3	Bed	13.3	36	4.73%	1%	Y
C013.1	LKD	33.8	86	5.49%	2%	Y
C013.2	Bed	12.1	35	4.83%	1%	Y
C013.3	Bed	13.8	42	4.55%	1%	Y
C014.1	LKD	37.1	90	6.98%	2%	Y
C014.2	Bed	13.0	36	4.86%	1%	Y
C014.3	Bed	13.2	36	3.96%	1%	Y
C015.1	LKD	31.7	84	7.76%	2%	Y
C015.2	Bed	11.6	30	5.57%	1%	Y
C015.3	Bed	13.3	36	5.10%	1%	Y
C016.1	LKD	31.7	84	6.38%	2%	Y
C016.2	Bed	11.6	30	5.75%	1%	Y
C016.3	Bed	13.3	36	5.22%	1%	Y


Average Daylight Factor - Apartment Block C						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
C017.1	LKD	35.2	97	6.87%	2%	Y
C017.2	Bed	11.5	30	5.82%	1%	Y
C017.3	Bed	8.8	24	5.02%	1%	Y
C017.4	Bed	14.1	36	4.96%	1%	Y
C018.1	LKD	31.5	84	7.53%	2%	Y
C018.2	Bed	11.6	30	5.49%	1%	Y
C018.3	Bed	13.3	36	5.05%	1%	Y
C019.1	LKD	33.8	86	6.79%	2%	Y
C019.2	Bed	12.1	35	5.32%	1%	Y
C019.3	Bed	13.8	42	4.90%	1%	Y
C020.1	LKD	37.1	90	6.90%	2%	Y
C020.2	bed	13.0	36	5.03%	1%	Y
C020.3	Bed	13.2	36	4.55%	1%	Y
C021.1	LKD	31.7	84	7.32%	2%	Y
C021.2	Bed	11.6	30	5.37%	1%	Y
C021.3	Bed	13.3	36	5.14%	1%	Y
C022.1	LKD	31.7	84	6.21%	2%	Y
C022.2	Bed	11.6	30	5.33%	1%	Y
C022.3	Bed	13.3	36	5.14%	1%	Y
C023.1	LKD	35.2	97	6.72%	2%	Y
C023.2	Bed	11.5	30	5.53%	1%	Y
C023.3	Bed	8.8	24	4.96%	1%	Y
C023.4	Bed	14.1	36	4.85%	1%	Y
C024.1	LKD	31.5	84	7.09%	2%	Y
C024.2	Bed	11.6	30	5.22%	1%	Y
C024.3	Bed	13.3	36	4.94%	1%	Y
C025.1	LKD	33.8	86	7.18%	2%	Y
C025.2	Bed	12.1	35	5.39%	1%	Y
C025.3	Bed	13.8	42	4.82%	1%	Y
C026.1	LKD	37.1	90	7.89%	2%	Y
C026.2	Bed	13.0	36	5.32%	1%	Y
C026.3	Bed	13.2	36	4.81%	1%	Y
C027.1	LKD	31.7	84	8.48%	2%	Y
C027.2	Bed	11.6	30	5.69%	1%	Y
C027.3	Bed	13.3	36	5.24%	1%	Y
C028.1	LKD	31.7	84	8.28%	2%	Y
C028.2	Bed	11.6	30	5.74%	1%	Y
C028.3	Bed	13.3	36	5.24%	1%	Y
C029.1	LKD	35.2	97	7.88%	2%	Y
C029.2	Bed	11.5	30	5.91%	1%	Y
C029.3	Bed	8.8	24	5.10%	1%	Y
C029.4	Bed	14.1	36	4.97%	1%	Y
C030.1	LKD	31.5	84	8.39%	2%	Y
C030.2	Bed	11.6	30	5.65%	1%	Y
C030.3	Bed	13.3	36	5.21%	1%	Y

**Table 11: Block C - Average Daylight Factor of all habitable rooms**

## Fifth Floor

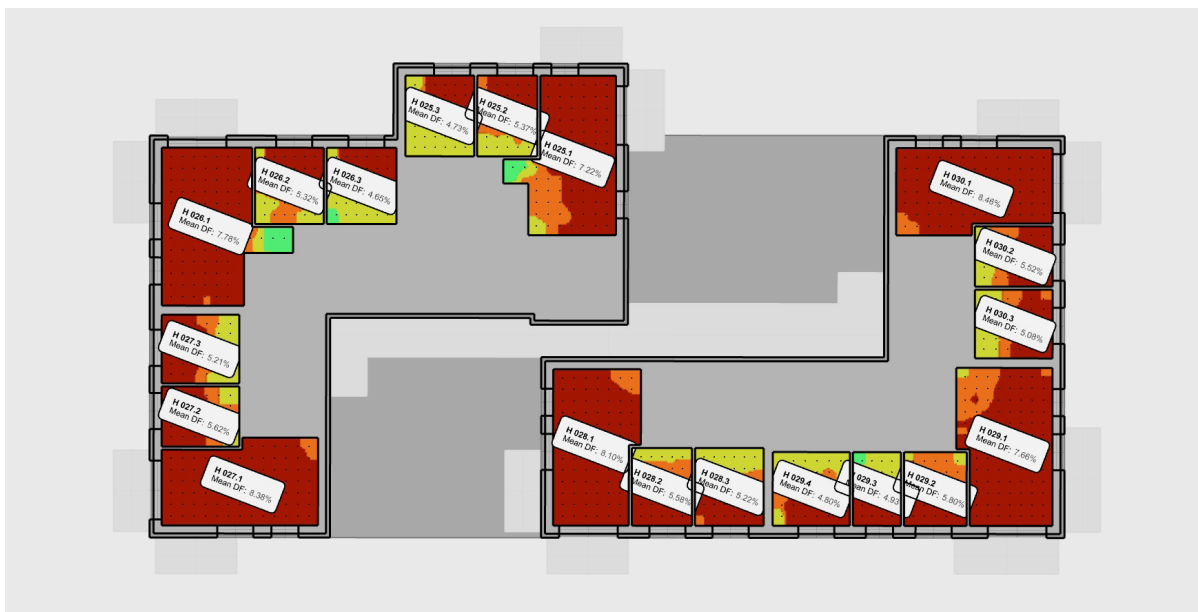

## Fourth Floor

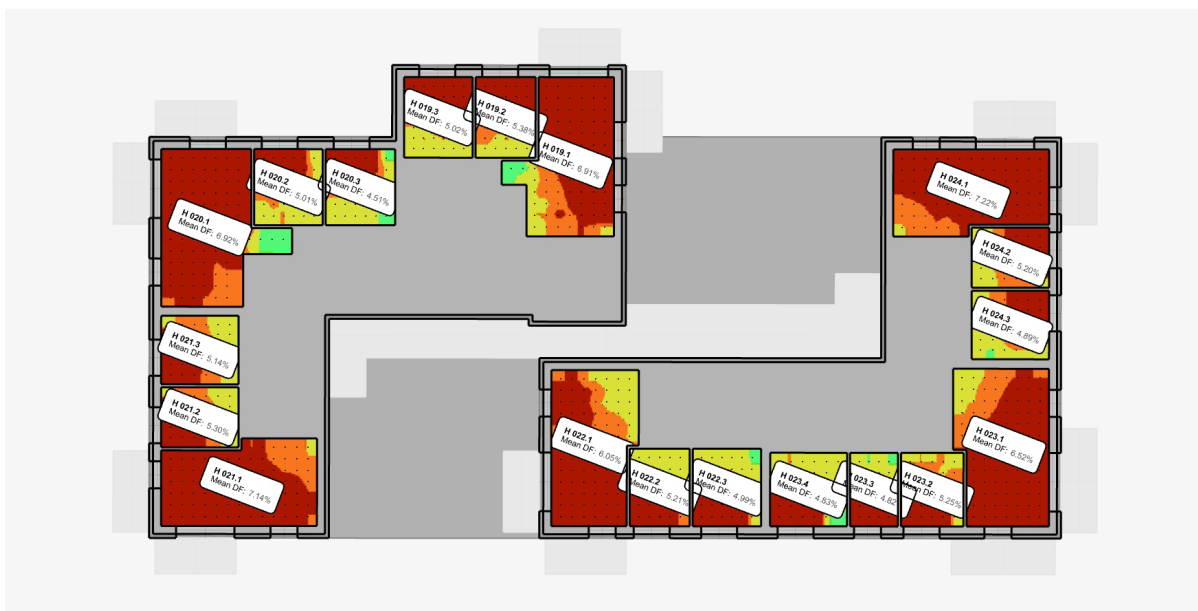

## Third Floor


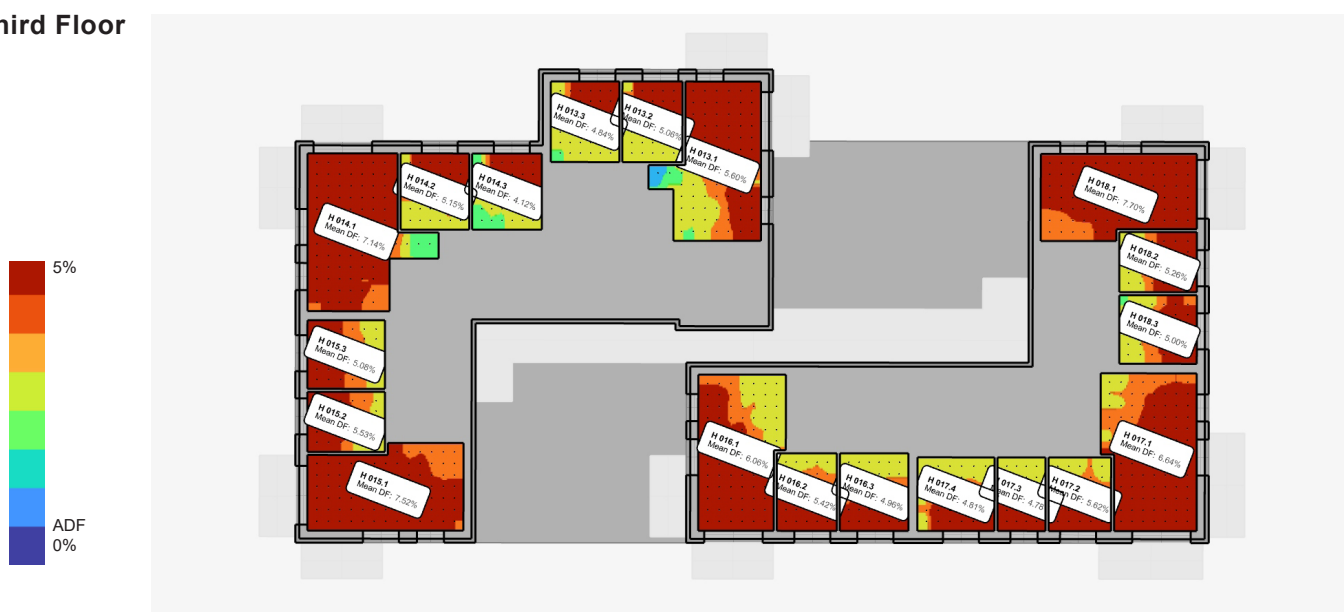


Figure 27: Apartment Block H - All floors false colour plans of ADF. Scale 0 - 5%



## Second Floor

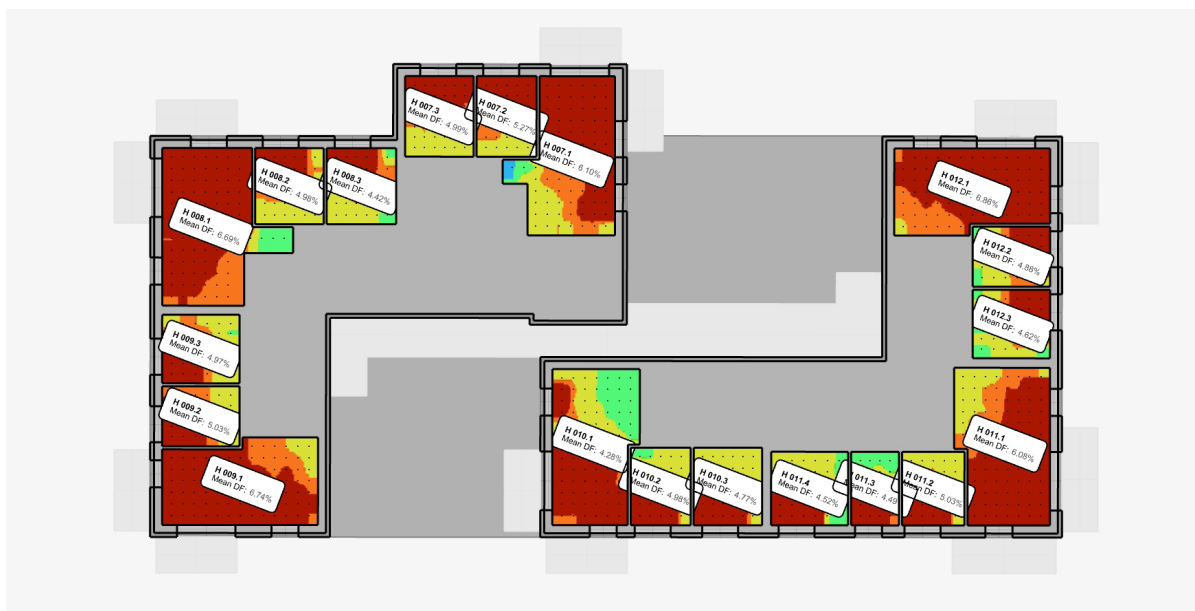

## First Floor



Figure 27 Cont: Apartment Block H - All floors false colour plans of ADF. Scale 0 - 5%

## Average Daylight Factor - Apartment Block H

Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
H 001.1	LKD	33.8	86	4.82%	2%	Y
H 001.2	Bed	12.1	35	4.91%	1%	Y
H 001.3	Bed	13.8	42	4.69%	1%	Y
H 002.1	LKD	37.1	90	6.98%	2%	Y
H 002.2	Bed	13.0	36	4.93%	1%	Y
H 002.3	Bed	13.2	36	4.08%	1%	Y
H 003.1	LKD	31.7	84	7.03%	2%	Y
H 003.2	Bed	13.3	36	4.87%	1%	Y
H 003.3	Bed	11.6	30	5.30%	1%	Y
H 004.1	LKD	31.7	84	5.30%	2%	Y
H 004.2	Bed	11.6	30	5.06%	1%	Y
H 004.3	Bed	13.3	36	4.63%	1%	Y
H 005.1	LKD	35.2	97	6.01%	2%	Y
H 005.2	Bed	11.5	30	5.15%	1%	Y
H 005.3	Bed	8.8	24	4.53%	1%	Y
H 005.4	Bed	14.1	36	4.40%	1%	Y
H 006.1	LKD	31.5	84	7.19%	2%	Y
H 006.2	Bed	11.6	30	4.93%	1%	Y
H 006.3	Bed	13.3	36	4.60%	1%	Y
H 007.1	LKD	33.8	86	6.09%	2%	Y
H 007.2	Bed	12.1	35	5.29%	1%	Y
H 007.3	Bed	13.8	42	4.90%	1%	Y
H 008.1	LKD	37.1	90	6.74%	2%	Y
H 008.2	Bed	13.0	36	4.98%	1%	Y
H 008.3	Bed	13.2	36	4.43%	1%	Y
H 009.1	LKD	31.7	84	6.69%	2%	Y
H 009.2	Bed	11.6	30	5.07%	1%	Y
H 009.3	Bed	13.3	36	4.95%	1%	Y
H 010.1	LKD	31.7	84	4.33%	2%	Y
H 010.2	Bed	11.6	30	5.00%	1%	Y
H 010.3	Bed	13.3	36	4.80%	1%	Y
H 011.1	LKD	35.2	97	6.02%	2%	Y
H 011.2	Bed	11.5	30	5.02%	1%	Y
H 011.3	Bed	8.8	24	4.60%	1%	Y
H 011.4	Bed	14.1	36	4.52%	1%	Y
H 012.1	LKD	31.5	84	6.96%	2%	Y
H 012.2	Bed	11.6	30	4.93%	1%	Y
H 012.3	Bed	13.3	36	4.67%	1%	Y
H 013.1	LKD	33.8	86	5.62%	2%	Y
H 013.2	Bed	12.1	35	5.08%	1%	Y
H 013.3	Bed	13.8	42	4.80%	1%	Y
H 014.1	LKD	37.1	90	7.16%	2%	Y
H 014.2	Bed	13.0	36	5.10%	1%	Y
H 014.3	Bed	13.2	36	4.16%	1%	Y
H 015.1	LKD	31.7	84	7.51%	2%	Y
H 015.2	Bed	11.6	30	5.49%	1%	Y
H 015.3	Bed	13.3	36	5.23%	1%	Y
H 016.1	LKD	31.7	84	6.11%	2%	Y
H 016.2	Bed	11.6	30	5.46%	1%	Y
H 016.3	Bed	13.3	36	5.06%	1%	Y

Average Daylight Factor - Apartment Block H						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
H 017.1	LKD	35.2	97	6.59%	2%	Y
H 017.2	Bed	11.5	30	5.54%	1%	Y
H 017.3	Bed	8.8	24	4.83%	1%	Y
H 017.4	Bed	14.1	36	4.71%	1%	Y
H 018.1	LKD	31.5	84	7.67%	2%	Y
H 018.2	Bed	11.6	30	5.37%	1%	Y
H 018.3	Bed	13.3	36	4.94%	1%	Y
H 019.1	LKD	33.8	86	6.85%	2%	Y
H 019.2	Bed	12.1	35	5.43%	1%	Y
H 019.3	Bed	13.8	42	5.04%	1%	Y
H 020.1	LKD	37.1	90	6.96%	2%	Y
H 020.2	Bed	13.0	36	5.07%	1%	Y
H 020.3	Bed	13.2	36	4.55%	1%	Y
H 021.1	LKD	31.7	84	7.15%	2%	Y
H 021.2	Bed	11.6	30	5.21%	1%	Y
H 021.3	Bed	13.3	36	5.09%	1%	Y
H 022.1	LKD	31.7	84	6.04%	2%	Y
H 022.2	Bed	11.6	30	5.12%	1%	Y
H 022.3	Bed	13.3	36	5.13%	1%	Y
H 023.1	LKD	35.2	97	6.49%	2%	Y
H 023.2	Bed	11.5	30	5.18%	1%	Y
H 023.3	Bed	8.8	24	4.84%	1%	Y
H 023.4	Bed	14.1	36	4.62%	1%	Y
H 024.1	LKD	31.5	84	7.23%	2%	Y
H 024.2	Bed	11.6	30	5.20%	1%	Y
H 024.3	Bed	13.3	36	4.91%	1%	Y
H 025.1	LKD	33.8	86	7.22%	2%	Y
H 025.2	Bed	12.1	35	5.36%	1%	Y
H 025.3	Bed	13.8	42	4.83%	1%	Y
H 026.1	LKD	37.1	90	7.87%	2%	Y
H 026.2	Bed	13.0	36	5.35%	1%	Y
H 026.3	Bed	13.2	36	4.67%	1%	Y
H 027.1	LKD	31.7	84	8.35%	2%	Y
H 027.2	Bed	11.6	30	5.64%	1%	Y
H 027.3	Bed	13.3	36	5.23%	1%	Y
H 028.1	LKD	31.7	84	8.17%	2%	Y
H 028.2	Bed	11.6	30	5.62%	1%	Y
H 028.3	Bed	13.3	36	5.12%	1%	Y
H 029.1	LKD	35.2	97	7.66%	2%	Y
H 029.2	Bed	11.5	30	5.75%	1%	Y
H 029.3	Bed	8.8	24	5.06%	1%	Y
H 029.4	Bed	14.1	36	4.87%	1%	Y
H 030.1	LKD	31.5	84	8.34%	2%	Y
H 030.2	Bed	11.6	30	5.53%	1%	Y
H 030.3	Bed	13.3	36	5.13%	1%	Y

**Table 12: Block H - Average Daylight Factor of all habitable rooms**



## Fifth Floor



## Fourth Floor



## Third Floor

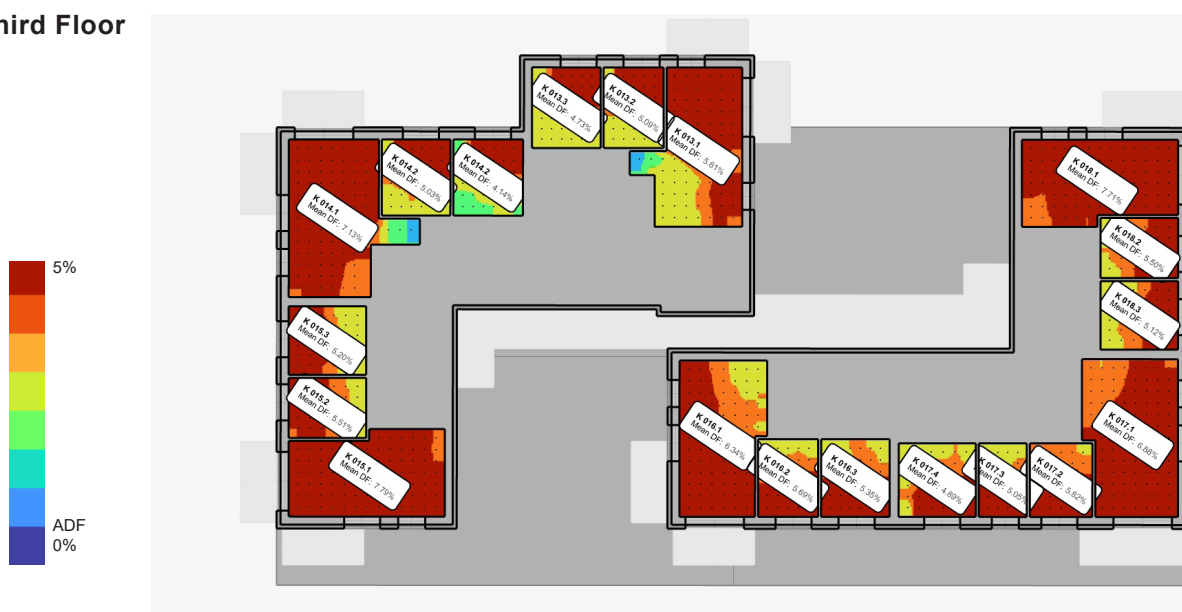


Figure 28: Apartment Block K - All floors false colour plans of ADF. Scale 0 - 5%

## Second Floor



## First Floor

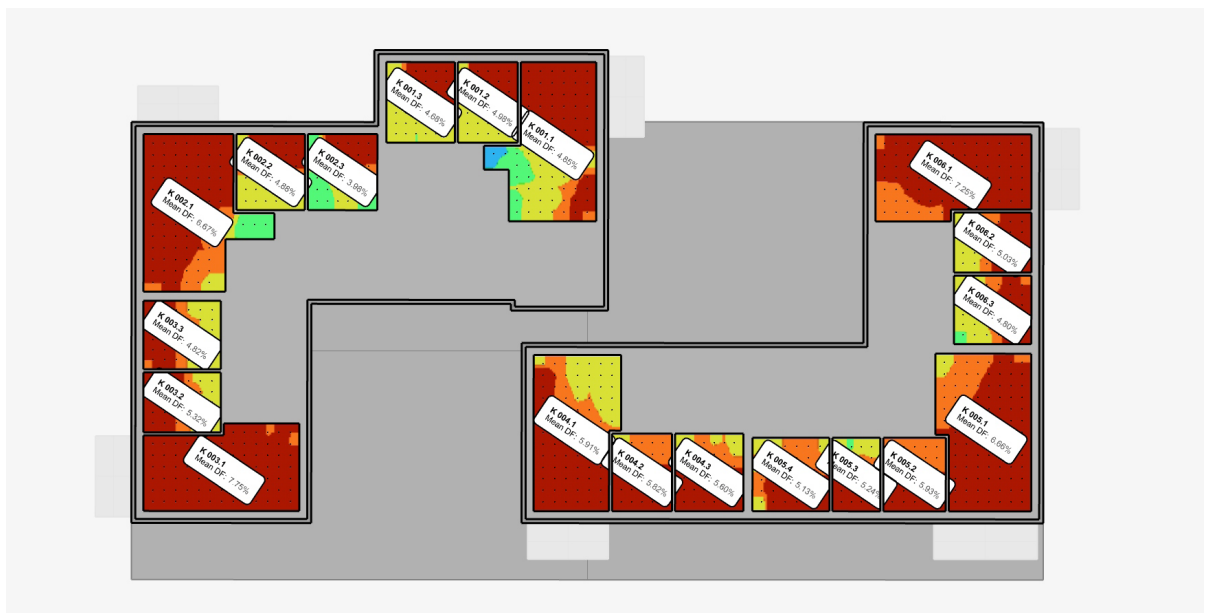


Figure 28 contd : Block K - All floors false colour plans of ADF. Scale 0 - 5%


## Average Daylight Factor - Apartment Block K

Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
K 001.1	LKD	33.8	86	4.82%	2%	Y
K 001.2	Bed	12.1	35	4.96%	1%	Y
K 001.3	Bed	13.8	42	4.73%	1%	Y
K 002.1	LKD	37.1	90	6.68%	2%	Y
K 002.2	Bed	13.0	36	4.90%	1%	Y
K 002.3	Bed	13.2	36	4.00%	1%	Y
K 003.1	LKD	31.7	84	7.86%	2%	Y
K 003.2	Bed	11.6	30	5.27%	1%	Y
K 003.3	Bed	13.3	36	4.90%	1%	Y
K 004.1	LKD	31.7	84	5.89%	2%	Y
K 004.2	Bed	11.6	30	5.84%	1%	Y
K 004.3	Bed	13.3	36	5.46%	1%	Y
K 005.1	LKD	35.2	97	6.66%	2%	Y
K 005.2	Bed	11.5	30	5.96%	1%	Y
K 005.3	Bed	8.8	24	5.22%	1%	Y
K 005.4	Bed	14.1	36	5.14%	1%	Y
K 006.1	LKD	31.5	84	7.23%	2%	Y
K 006.2	Bed	11.6	30	5.11%	1%	Y
K 006.3	Bed	13.3	36	4.74%	1%	Y
K 007.1	LKD	33.8	86	6.16%	2%	Y
K 007.2	Bed	12.1	35	5.36%	1%	Y
K 007.3	Bed	13.8	42	4.96%	1%	Y
K 008.1	LKD	37.1	90	6.56%	2%	Y
K 008.2	Bed	13.0	36	4.94%	1%	Y
K 008.3	Bed	13.2	36	4.45%	1%	Y
K 009.1	LKD	31.7	84	7.19%	2%	Y
K 009.2	Bed	11.6	30	5.20%	1%	Y
K 009.3	Bed	13.3	36	4.95%	1%	Y
K 010.1	LKD	31.7	84	4.65%	2%	Y
K 010.2	Bed	11.6	30	5.36%	1%	Y
K 010.3	Bed	13.3	36	5.21%	1%	Y
K 011.1	LKD	35.2	97	6.41%	2%	Y
K 011.2	Bed	11.5	30	5.39%	1%	Y
K 011.3	Bed	8.8	24	5.00%	1%	Y
K 011.4	Bed	14.1	36	4.89%	1%	Y
K 012.1	LKD	31.5	84	6.96%	2%	Y
K 012.2	Bed	11.6	30	5.06%	1%	Y
K 012.3	Bed	13.3	36	4.80%	1%	Y
K 013.1	LKD	33.8	86	5.61%	2%	Y
K 013.2	Bed	12.1	35	5.09%	1%	Y
K 013.3	Bed	13.8	42	4.83%	1%	Y
K 014.1	LKD	37.1	90	7.16%	2%	Y
K 014.2	Bed	13.0	36	5.12%	1%	Y
K 014.2	Bed	13.2	36	4.18%	1%	Y
K 015.1	LKD	31.7	84	7.79%	2%	Y
K 015.2	Bed	11.6	30	5.56%	1%	Y
K 015.3	Bed	13.3	36	5.16%	1%	Y
K 016.1	LKD	31.7	84	6.39%	2%	Y
K 016.2	Bed	11.6	30	5.65%	1%	Y
K 016.3	Bed	13.3	36	5.28%	1%	Y

Average Daylight Factor - Apartment Block K						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
K 017.1	LKD	35.2	97	6.90%	2%	Y
K 017.2	Bed	11.5	30	5.76%	1%	Y
K 017.3	Bed	8.8	24	5.00%	1%	Y
K 017.4	Bed	14.1	36	4.94%	1%	Y
K 018.1	LKD	31.5	84	7.73%	2%	Y
K 018.2	Bed	11.6	30	5.56%	1%	Y
K 018.3	Bed	13.3	36	5.10%	1%	Y
K 019.1	LKD	33.8	86	6.86%	2%	Y
K 019.2	Bed	12.1	35	5.48%	1%	Y
K 019.3	Bed	13.8	42	5.03%	1%	Y
K 020.1	LKD	37.1	90	6.97%	2%	Y
K 020.2	Bed	13.0	36	5.14%	1%	Y
K 020.3	Bed	13.2	36	4.58%	1%	Y
K 021.1	LKD	31.7	84	7.31%	2%	Y
K 021.2	Bed	11.6	30	5.31%	1%	Y
K 021.3	Bed	13.3	36	5.08%	1%	Y
K 022.1	LKD	31.7	84	6.20%	2%	Y
K 022.2	Bed	11.6	30	5.42%	1%	Y
K 022.3	Bed	13.3	36	5.28%	1%	Y
K 023.1	LKD	35.2	97	6.71%	2%	Y
K 023.2	Bed	11.5	30	5.43%	1%	Y
K 023.3	Bed	8.8	24	5.02%	1%	Y
K 023.4	Bed	14.1	36	4.92%	1%	Y
K 024.1	LKD	31.5	84	7.32%	2%	Y
K 024.2	Bed	11.6	30	5.34%	1%	Y
K 024.3	Bed	13.3	36	5.07%	1%	Y
K 025.1	LKD	33.8	86	7.28%	2%	Y
K 025.2	Bed	12.1	35	5.42%	1%	Y
K 025.3	Bed	13.8	42	4.85%	1%	Y
K 026.1	LKD	37.1	90	7.87%	2%	Y
K 026.2	Bed	13.0	36	5.24%	1%	Y
K 026.3	Bed	13.2	36	4.63%	1%	Y
K 027.1	LKD	31.7	84	8.47%	2%	Y
K 027.2	Bed	13.3	36	5.20%	1%	Y
K 027.3	Bed	11.6	30	5.51%	1%	Y
K 028.1	LKD	31.7	84	8.30%	2%	Y
K 028.2	Bed	11.6	30	5.73%	1%	Y
K 028.3	Bed	13.3	36	5.30%	1%	Y
K 029.1	LKD	35.2	97	7.91%	2%	Y
K 029.2	Bed	11.5	30	5.88%	1%	Y
K 029.3	Bed	8.8	24	5.11%	1%	Y
K 029.4	Bed	14.1	36	4.99%	1%	Y
K 030.1	LKD	31.5	84	8.60%	2%	Y
K 030.2	Bed	11.6	30	5.72%	1%	Y
K 030.3	Bed	13.3	36	5.34%	1%	Y

**Table 13: Block K - Average Daylight Factor of all habitable rooms**









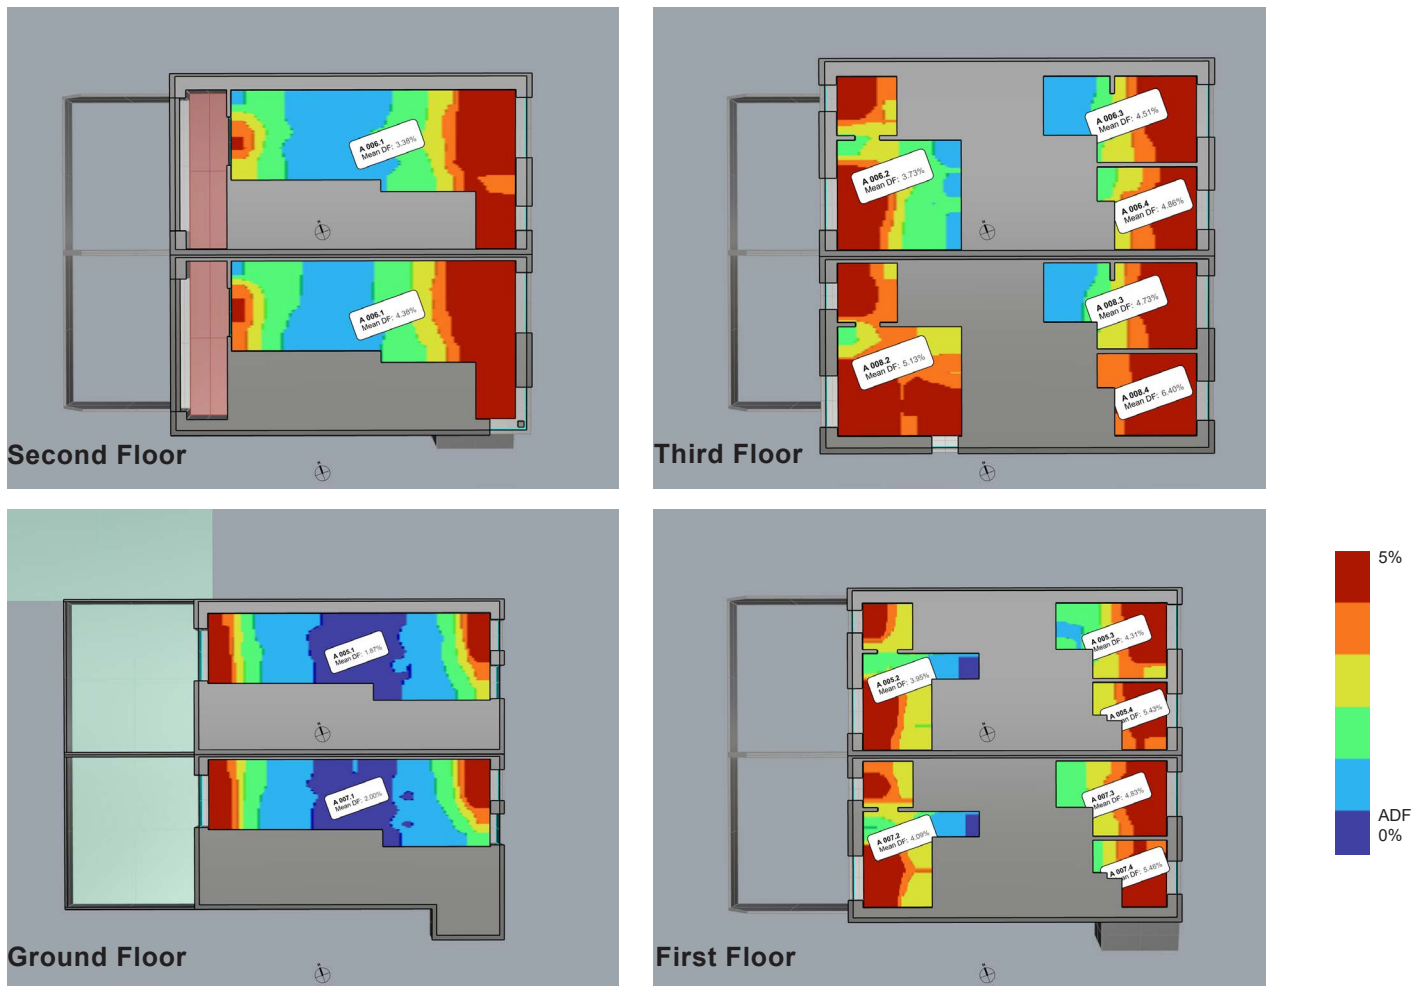








**Figure 29: Neighbourhood A Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**

Average Daylight Factor - Neighbourhood A Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
A 005.1	LKD	41.4	96	1.87%	2%	N
A 005.2	Bed	16.8	36	3.95%	1%	Y
A 005.3	Bed	11.9	29	4.31%	1%	Y
A 005.4	Bed	6.7	15	5.44%	1%	Y
A 006.1	LKD	41.1	101	3.38%	2%	Y
A 006.2	Bed	20.2	52	3.73%	1%	Y
A 006.3	Bed	13.7	35	4.51%	1%	Y
A 006.4	Bed	8.7	26	4.86%	1%	Y
A 007.1	LKD	41.1	94	2.00%	2%	Y
A 007.2	Bed	16.8	36	4.09%	1%	Y
A 007.3	Bed	11.9	29	4.83%	1%	Y
A 007.4	Bed	6.7	15	5.46%	1%	Y
A 008.1	LKD	41.1	101	4.38%	2%	Y
A 008.2	Bed	20.2	52	5.13%	1%	Y
A 008.3	Bed	13.7	35	4.73%	1%	Y
A 008.4	Bed	8.7	26	6.40%	1%	Y


**Table 14: Neighbourhood A Maisonettes: Average Daylight Factor of all habitable rooms**

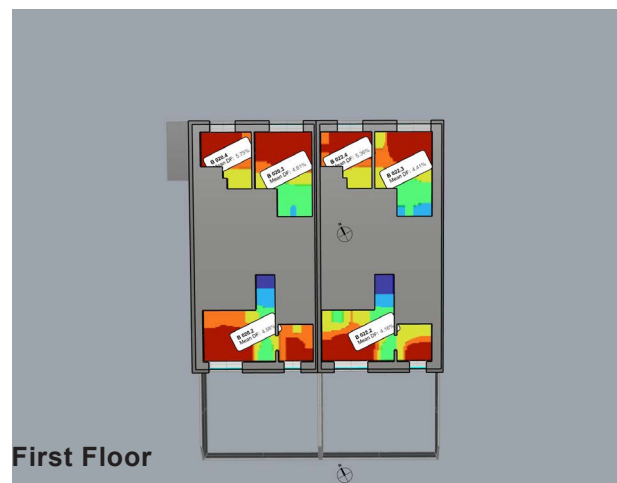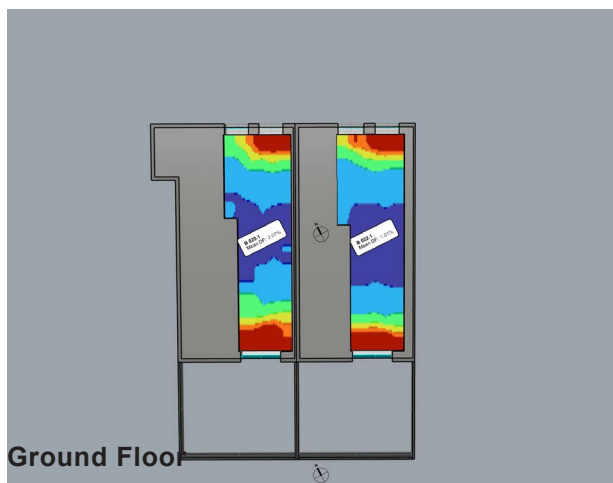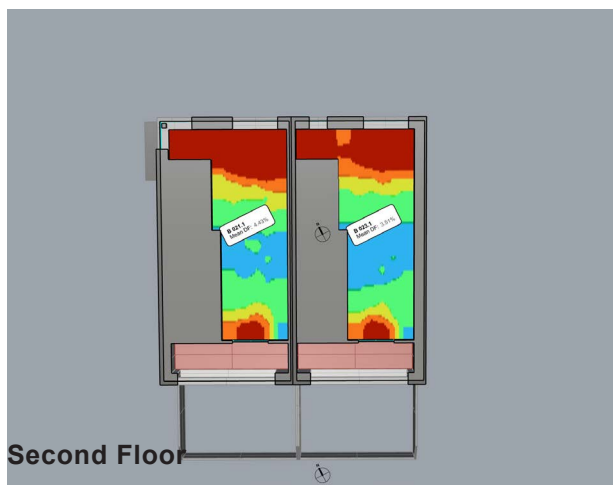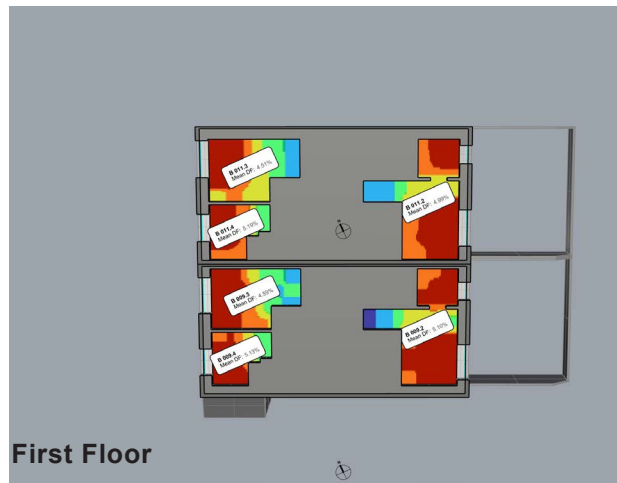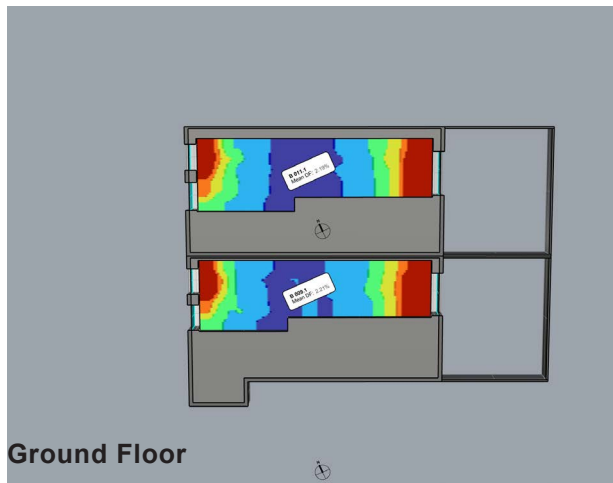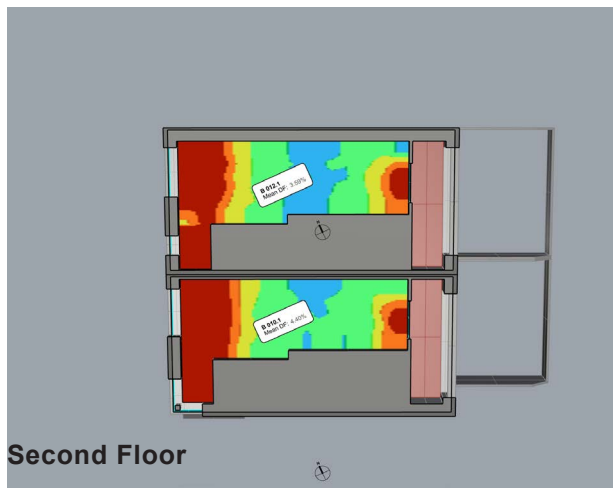

**Figure 30: Neighbourhood B Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**

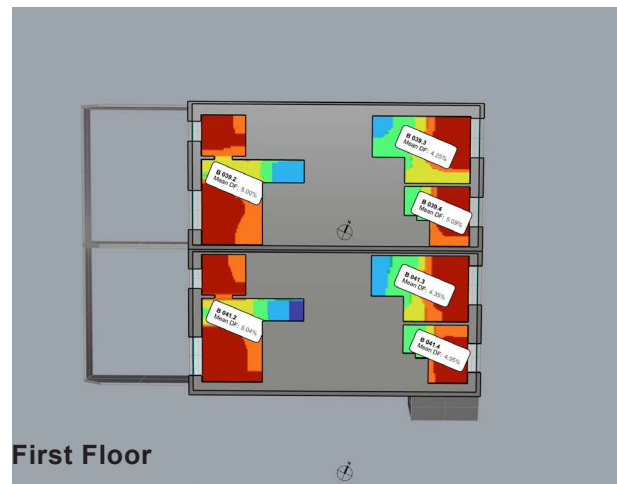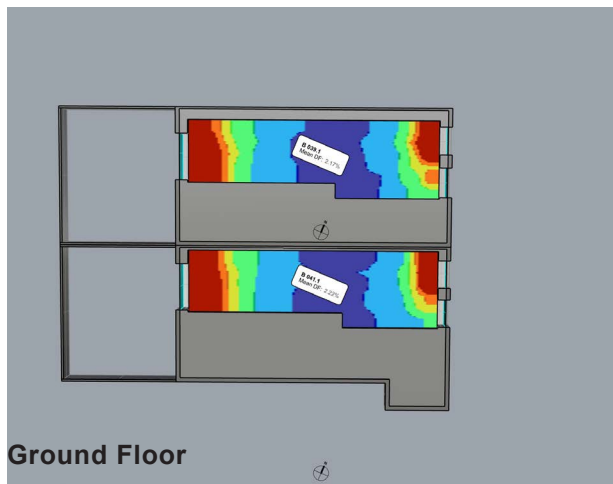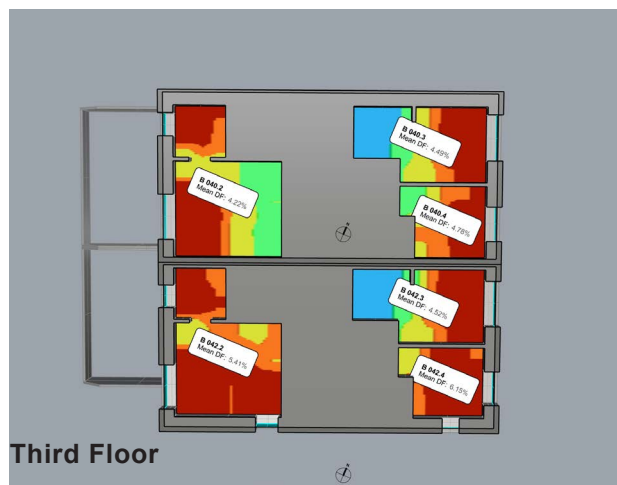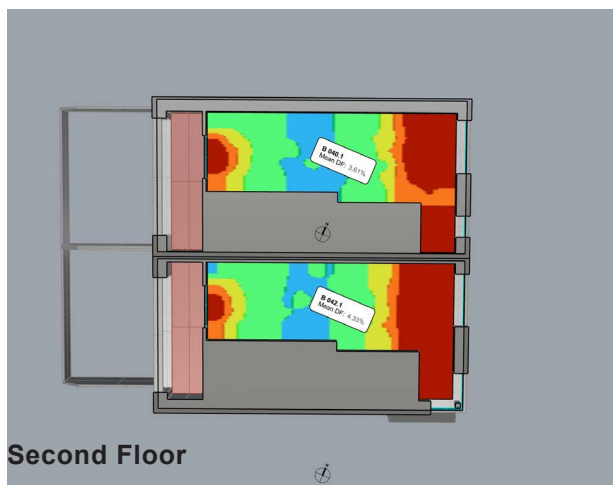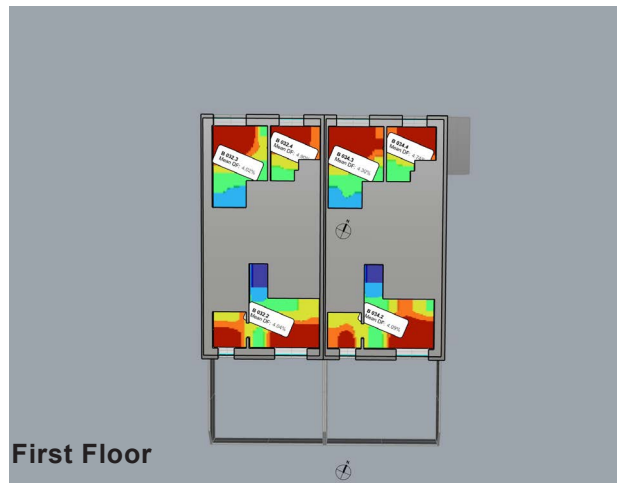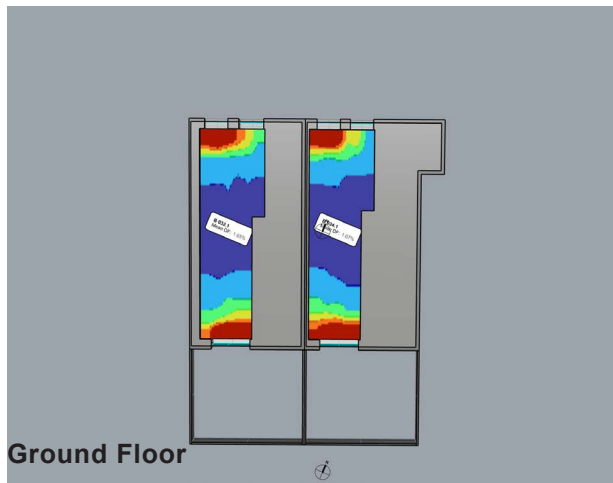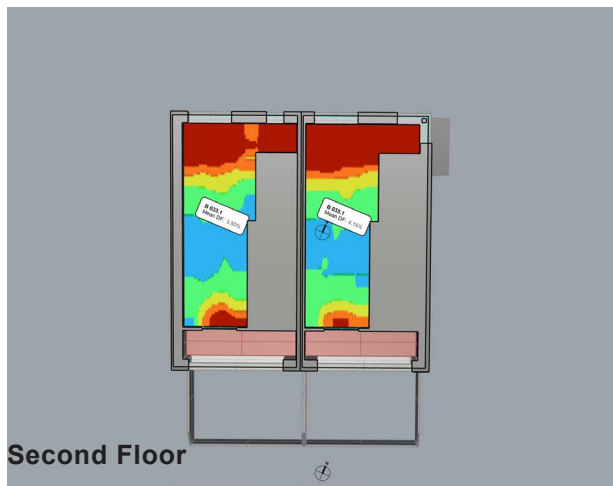

**Figure 31: Neighbourhood B Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**

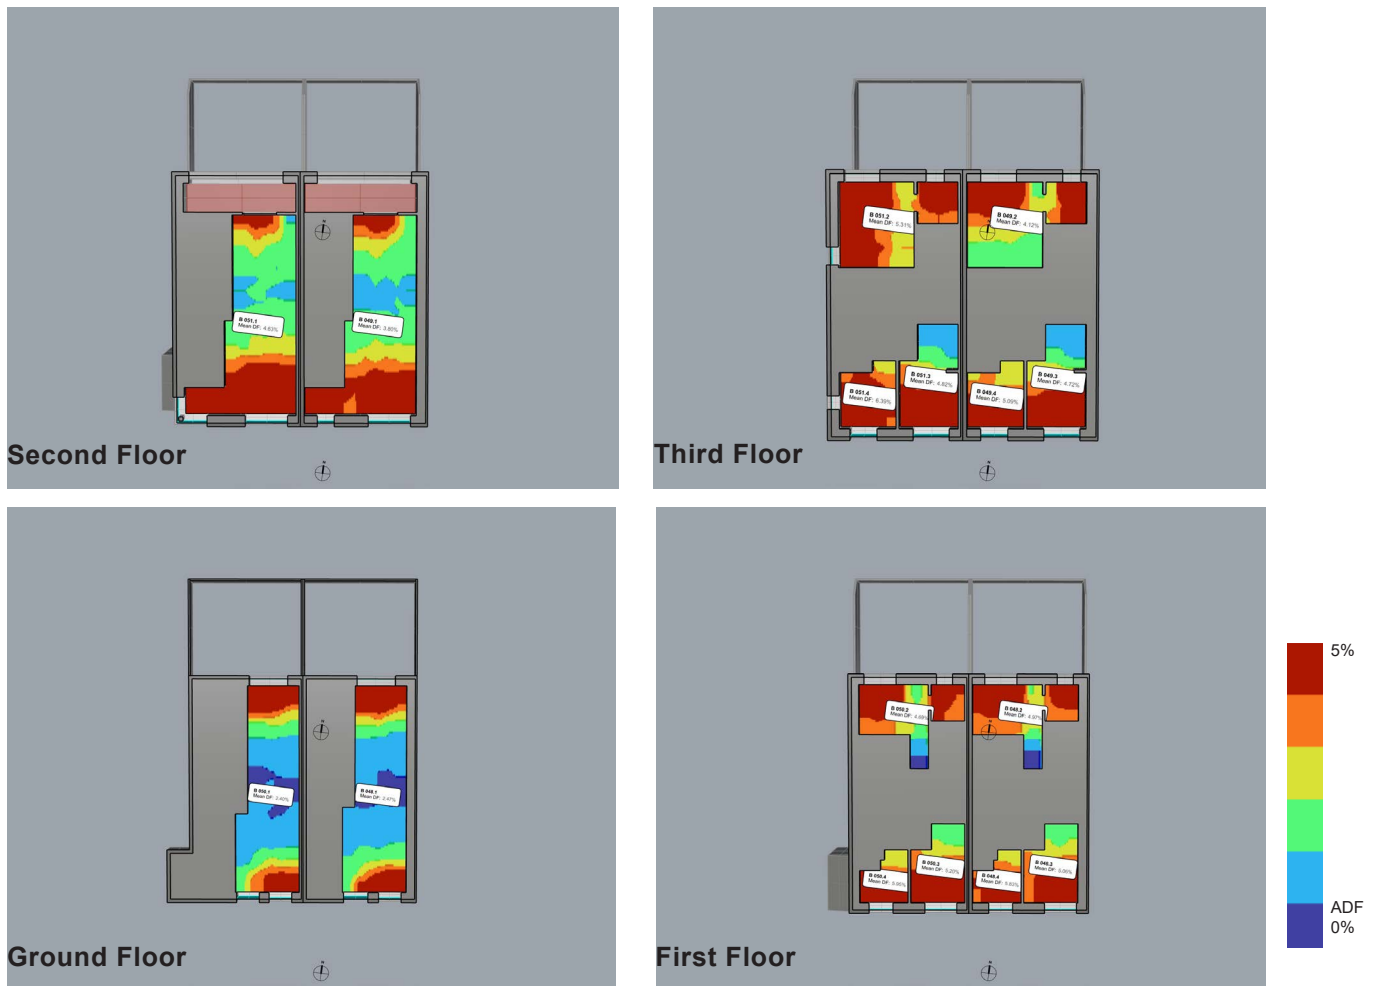







**Figure 32: Neighbourhood B Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**



Average Daylight Factor - Neighbourhood B Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
B 009.1	LKD	41.1	94	2.21%	2%	Y
B 009.2	Bed	16.8	36	5.10%	1%	Y
B 009.3	Bed	11.9	29	4.59%	1%	Y
B 009.4	Bed	6.7	15	5.13%	1%	Y
B 010.1	LKD	41.1	101	4.40%	2%	Y
B 010.2	Bed	20.2	52	5.57%	1%	Y
B 010.3	Bed	13.7	35	4.56%	1%	Y
B 010.4	Bed	8.7	26	6.18%	1%	Y
B 011.1	LKD	41.4	96	2.19%	2%	Y
B 011.2	Bed	16.8	36	4.99%	1%	Y
B 011.3	Bed	11.9	29	4.51%	1%	Y
B 011.4	Bed	6.7	15	5.19%	1%	Y
B 012.1	LKD	41.1	101	3.59%	2%	Y
B 012.2	Bed	20.2	52	4.32%	1%	Y
B 012.3	Bed	13.7	35	4.55%	1%	Y
B 012.4	Bed	8.7	26	4.75%	1%	Y
B 020.1	LKD	41.1	94	2.07%	2%	Y
B 020.2	Bed	16.8	36	4.58%	1%	Y
B 020.3	Bed	11.9	29	4.61%	1%	Y
B 020.4	Bed	6.7	15	5.75%	1%	Y
B 021.1	LKD	41.1	101	4.43%	2%	Y
B 021.2	Bed	20.2	52	5.40%	1%	Y
B 021.3	Bed	13.7	35	4.71%	1%	Y
B 021.4	Bed	8.7	26	6.37%	1%	Y
B 022.1	LKD	41.4	96	1.81%	2%	N
B 022.2	Bed	16.8	36	4.16%	1%	Y
B 022.3	Bed	11.9	29	4.41%	1%	Y
B 022.4	Bed	6.7	15	5.36%	1%	Y
B 023.1	LKD	41.1	101	3.51%	2%	Y
B 023.2	Bed	20.2	52	4.04%	1%	Y
B 023.3	Bed	13.7	35	4.57%	1%	Y
B 023.4	Bed	8.7	26	4.94%	1%	Y
B 032.1	LKD	41.4	96	1.65%	2%	N
B 032.2	Bed	16.8	36	4.04%	1%	Y
B 032.3	Bed	11.9	29	4.02%	1%	Y
B 032.4	Bed	6.7	15	4.90%	1%	Y
B 033.1	LKD	41.1	101	3.50%	2%	Y
B 033.2	Bed	20.2	52	4.08%	1%	Y
B 033.3	Bed	13.7	35	4.56%	1%	Y
B 033.4	Bed	8.7	26	4.91%	1%	Y
B 034.1	LKD	41.1	94	1.67%	2%	N
B 034.2	Bed	16.8	36	4.09%	1%	Y
B 034.3	Bed	11.9	29	4.30%	1%	Y
B 034.4	Bed	6.7	15	4.74%	1%	Y
B 035.1	LKD	41.1	101	4.15%	2%	Y
B 035.2	Bed	20.2	52	5.23%	1%	Y
B 035.3	Bed	13.7	35	4.74%	1%	Y
B 035.4	Bed	8.7	26	6.23%	1%	Y
B 039.1	LKD	41.4	96	2.17%	2%	Y
B 039.2	Bed	16.8	36	5.00%	1%	Y

Average Daylight Factor - Neighbourhood B Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
B 039.3	Bed	11.9	29	4.25%	1%	Y
B 039.4	Bed	6.7	15	5.09%	1%	Y
B 040.1	LKD	41.1	101	3.61%	2%	Y
B 040.2	Bed	20.2	52	4.22%	1%	Y
B 040.3	Bed	13.7	35	4.49%	1%	Y
B 040.4	Bed	8.7	26	4.78%	1%	Y
B 041.1	LKD	41.1	94	2.22%	2%	Y
B 041.2	Bed	16.8	36	5.04%	1%	Y
B 041.3	Bed	11.9	29	4.35%	1%	Y
B 041.4	Bed	6.7	15	4.95%	1%	Y
B 042.1	LKD	41.1	101	4.33%	2%	Y
B 042.2	Bed	20.2	52	5.41%	1%	Y
B 042.3	Bed	13.7	35	4.52%	1%	Y
B 042.4	Bed	8.7	26	6.15%	1%	Y
B 048.1	LKD	41.4	96	2.47%	2%	Y
B 048.2	Bed	16.8	36	4.97%	1%	Y
B 048.3	Bed	11.9	29	5.06%	1%	Y
B 048.4	Bed	6.7	15	5.83%	1%	Y
B 049.1	LKD	41.1	101	3.80%	2%	Y
B 049.2	Bed	20.2	52	4.12%	1%	Y
B 049.3	Bed	13.7	35	4.72%	1%	Y
B 049.4	Bed	8.7	26	5.09%	1%	Y
B 050.1	LKD	41.1	94	2.40%	2%	Y
B 050.2	Bed	16.8	36	4.69%	1%	Y
B 050.3	Bed	11.9	29	5.20%	1%	Y
B 050.4	Bed	6.7	15	5.95%	1%	Y
B 051.1	LKD	41.1	101	4.63%	2%	Y
B 051.2	Bed	20.2	52	5.31%	1%	Y
B 051.3	Bed	13.7	35	4.82%	1%	Y
B 051.4	Bed	8.7	26	6.39%	1%	Y

**Table 15: Neighbourhood B Maisonettes: Average Daylight Factor of all habitable rooms**

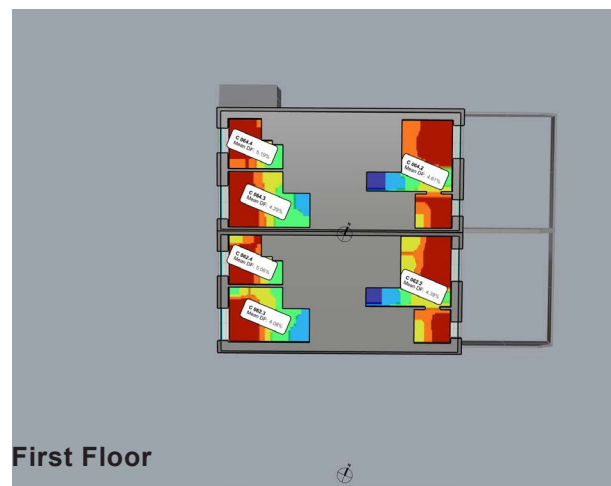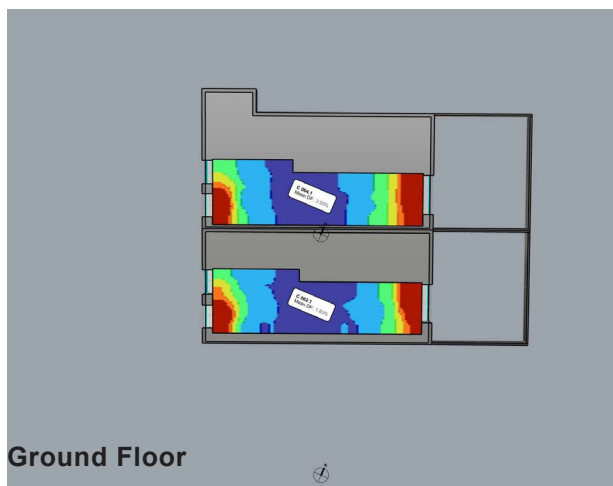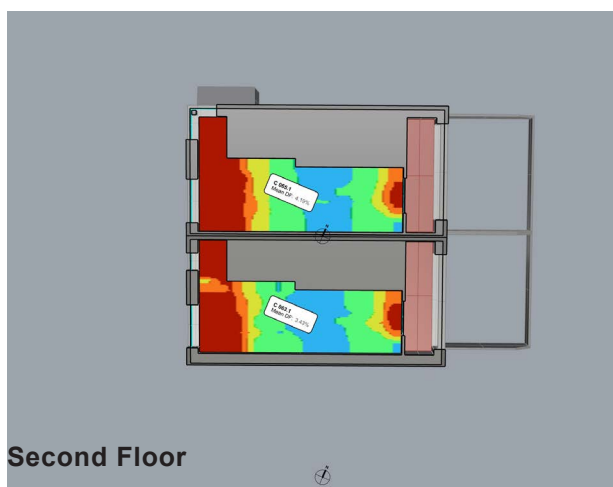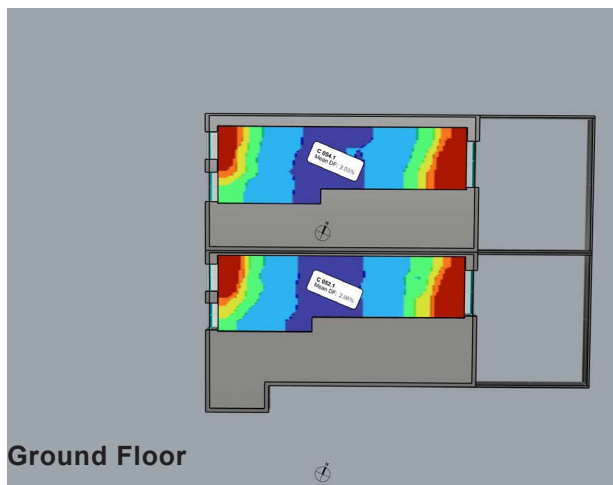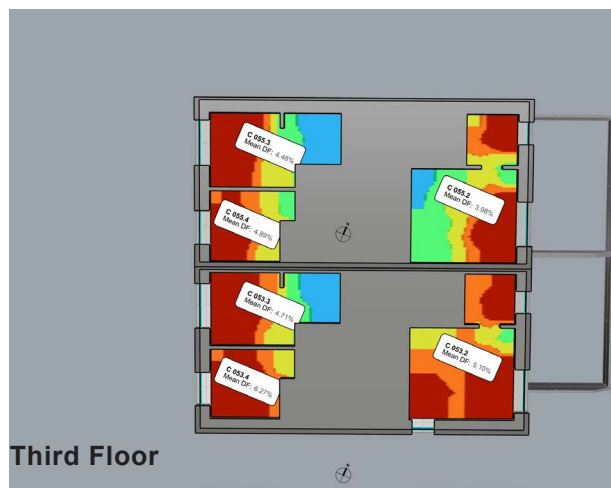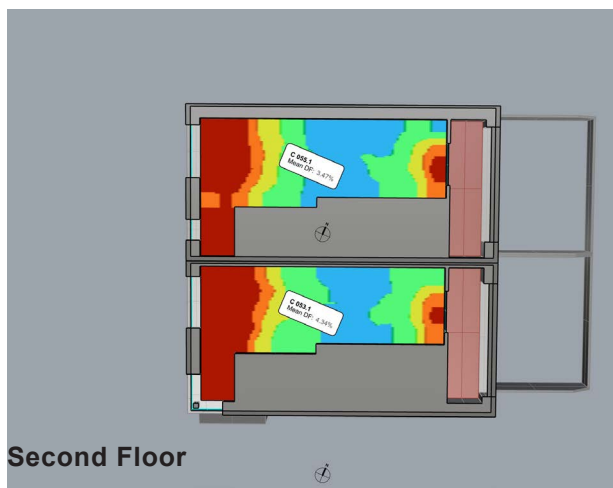


**Figure 33: Neighbourhood C Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**


Third Floor



Second Floor

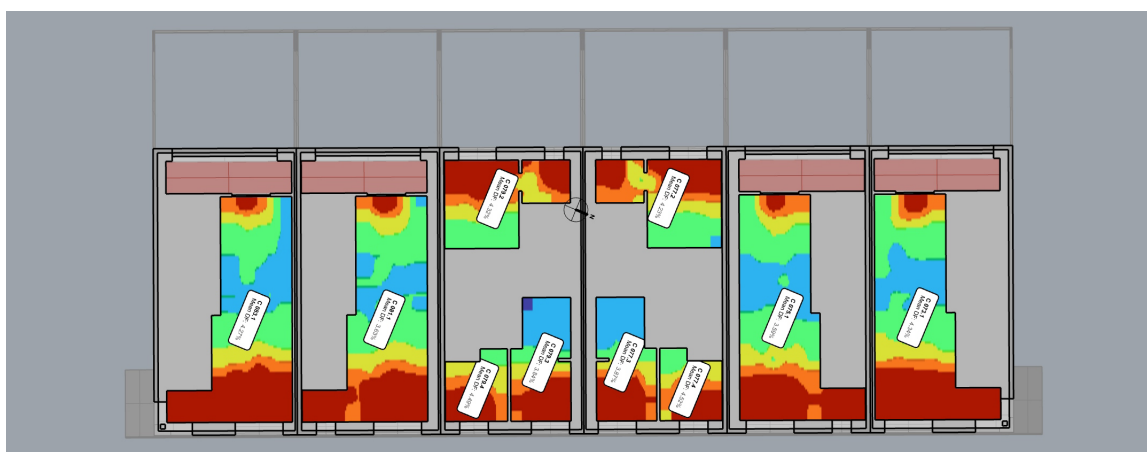

First Floor

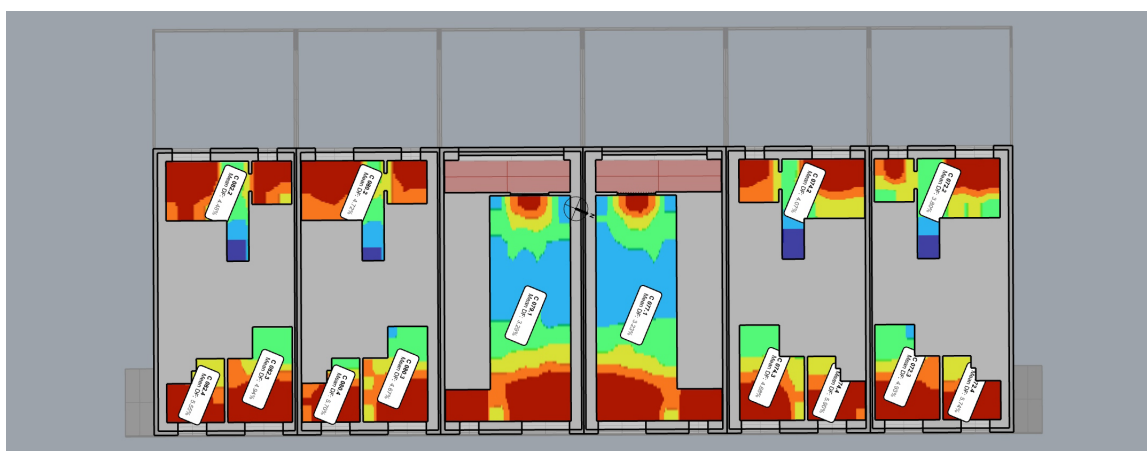

Ground Floor

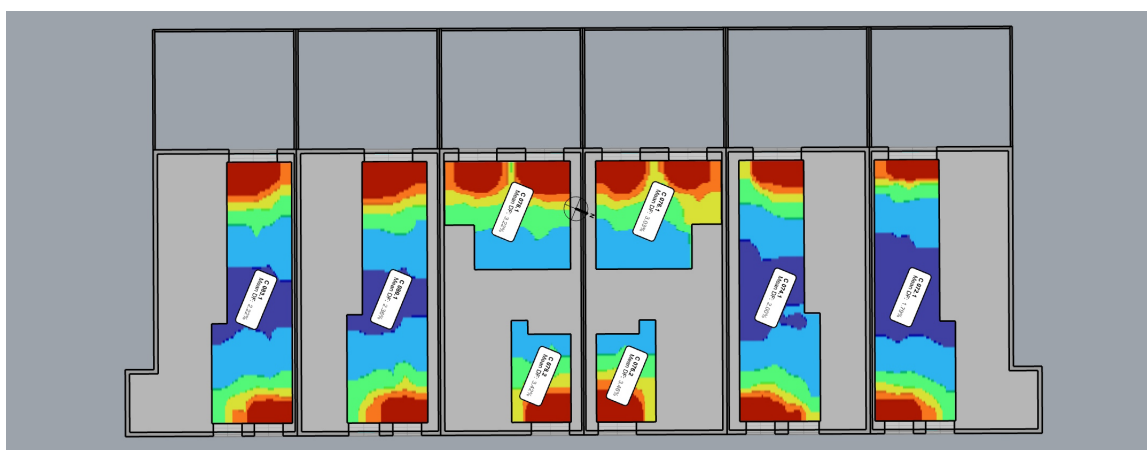









Figure 34: Neighbourhood C Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.



Average Daylight Factor - Neighbourhood C Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
C 052.1	LKD	41.1	94	2.06%	2%	Y
C 052.2	Bed	16.8	36	4.26%	1%	Y
C 052.3	Bed	11.9	29	4.78%	1%	Y
C 052.4	Bed	6.7	15	5.74%	1%	Y
C 053.1	LKD	41.1	101	4.34%	2%	Y
C 053.2	Bed	20.2	52	5.10%	1%	Y
C 053.3	Bed	13.7	35	4.71%	1%	Y
C 053.4	Bed	8.7	26	6.27%	1%	Y
C 054.1	LKD	41.4	96	2.03%	2%	Y
C 054.2	Bed	16.8	36	4.49%	1%	Y
C 054.3	Bed	11.9	29	4.19%	1%	Y
C 054.4	Bed	6.7	15	5.36%	1%	Y
C 055.1	LKD	41.1	101	3.47%	2%	Y
C 055.2	Bed	20.2	52	3.98%	1%	Y
C 055.3	Bed	13.7	35	4.48%	1%	Y
C 055.4	Bed	8.7	26	4.89%	1%	Y
C 062.1	LKD	41.4	96	1.83%	2%	N
C 062.2	Bed	16.8	36	4.39%	1%	Y
C 062.3	Bed	11.9	29	4.08%	1%	Y
C 062.4	Bed	6.7	15	5.06%	1%	Y
C 063.1	LKD	41.1	101	3.43%	2%	Y
C 063.2	Bed	20.2	52	3.98%	1%	Y
C 063.3	Bed	13.7	35	4.47%	1%	Y
C 063.4	Bed	8.7	26	4.85%	1%	Y
C 064.1	LKD	41.1	94	2.03%	2%	Y
C 064.2	Bed	16.8	36	4.61%	1%	Y
C 064.3	Bed	11.9	29	4.29%	1%	Y
C 064.4	Bed	6.7	15	5.19%	1%	Y
C 065.1	LKD	41.1	101	4.19%	2%	Y
C 065.2	Bed	20.2	52	5.24%	1%	Y
C 065.3	Bed	13.7	35	4.58%	1%	Y
C 065.4	Bed	8.7	26	6.12%	1%	Y
C 072.1	LKD	41.1	94	1.79%	2%	N
C 072.2	Bed	16.8	36	3.80%	1%	Y
C 072.3	Bed	11.9	29	4.93%	1%	Y
C 072.4	Bed	6.7	15	5.74%	1%	Y
C 073.1	LKD	41.1	101	4.34%	2%	Y
C 073.2	Bed	20.2	52	5.21%	1%	Y
C 073.3	Bed	13.7	35	4.66%	1%	Y
C 073.4	Bed	8.7	26	6.29%	1%	Y
C 074.1	LKD	41.4	96	2.00%	2%	Y
C 074.2	Bed	16.8	36	4.07%	1%	Y
C 074.3	Bed	11.9	29	4.68%	1%	Y
C 074.4	Bed	6.7	15	5.90%	1%	Y
C 075.1	LKD	41.1	101	3.59%	2%	Y
C 075.2	Bed	20.2	52	4.02%	1%	Y
C 075.3	Bed	13.7	35	4.60%	1%	Y
C 075.4	Bed	8.7	26	4.94%	1%	Y
C 076.1	LKD	27.3	68	3.03%	2%	Y
C 076.2	Bed	12.1	36	3.46%	1%	Y

Average Daylight Factor - Neighbourhood C Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
C 077.1	LKD	43.6	110	3.23%	2%	Y
C 077.2	Bed	19.3	46	4.23%	1%	Y
C 077.3	Bed	15.1	43	3.87%	1%	Y
C 077.4	Bed	9.0	27	4.52%	1%	Y
C 078.1	LKD	27.3	68	3.22%	2%	Y
C 078.2	Bed	12.1	36	3.42%	1%	Y
C 079.1	LKD	43.6	110	3.29%	2%	Y
C 079.2	Bed	19.3	46	4.32%	1%	Y
C 079.3	Bed	15.1	43	3.84%	1%	Y
C 079.4	Bed	9.0	27	4.49%	1%	Y
C 080.1	LKD	41.4	96	2.36%	2%	Y
C 080.2	Bed	16.8	36	4.72%	1%	Y
C 080.3	Bed	11.9	29	4.67%	1%	Y
C 080.4	Bed	6.7	15	5.70%	1%	Y
C 081.1	LKD	41.1	101	3.63%	2%	Y
C 081.2	Bed	20.2	52	4.11%	1%	Y
C 081.3	Bed	13.7	35	4.60%	1%	Y
C 081.4	Bed	8.7	26	4.78%	1%	Y
C 082.2	Bed	16.8	36	4.48%	1%	Y
C 082.3	Bed	11.9	29	4.94%	1%	Y
C 082.4	Bed	6.7	15	5.55%	1%	Y
C 083.1	LKD	41.1	94	2.22%	2%	Y
C 083.1	LKD	41.1	101	4.27%	2%	Y
C 083.2	Bed	20.2	52	4.78%	1%	Y
C 083.3	Bed	13.7	35	4.62%	1%	Y
C 083.4	Bed	8.7	26	6.11%	1%	Y

**Table 16: Neighbourhood C Maisonettes: Average Daylight Factor of all habitable rooms**

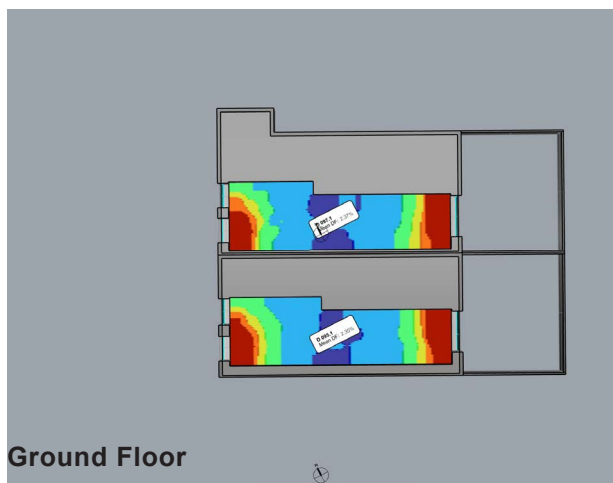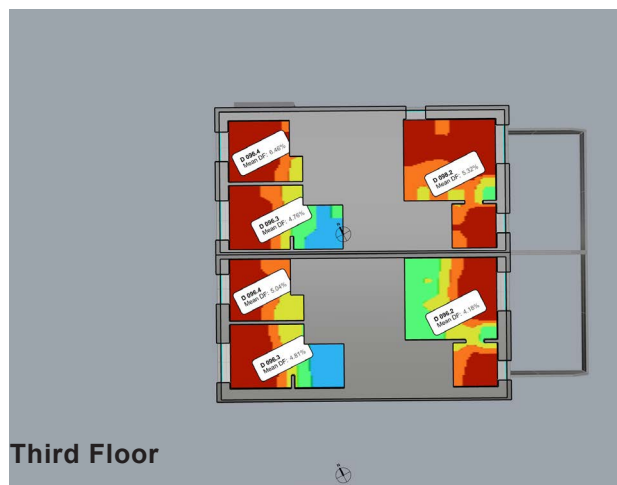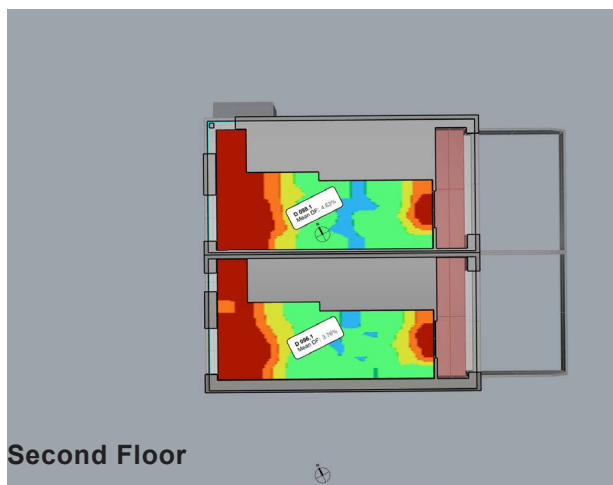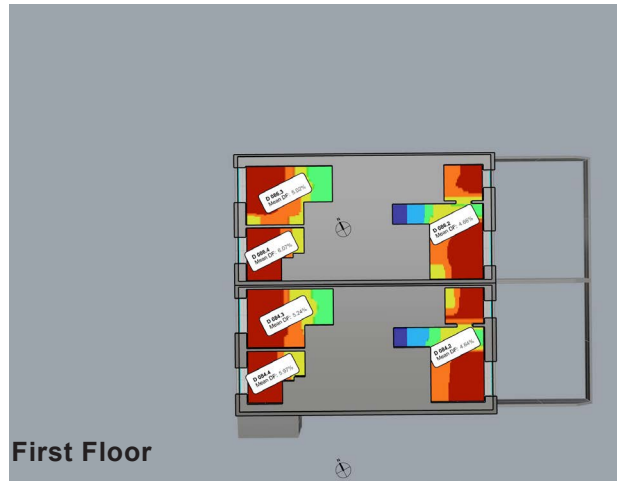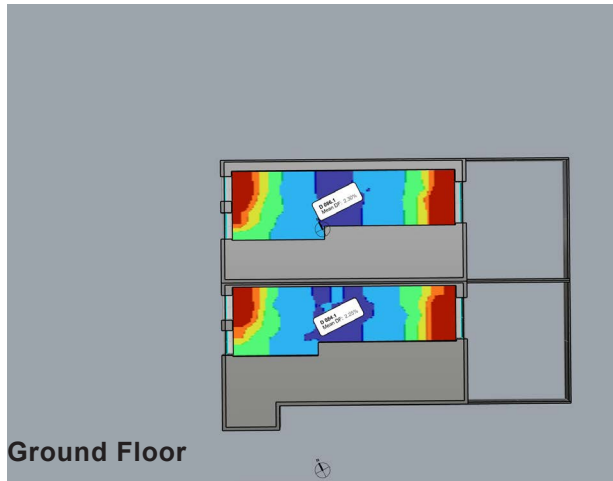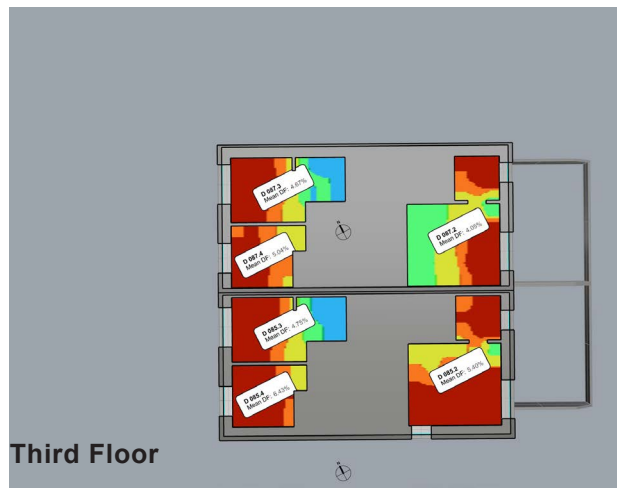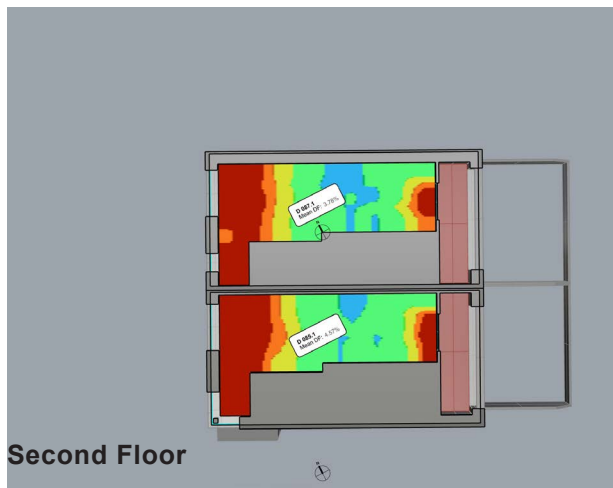

**Figure 35: Neighbourhood D Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**












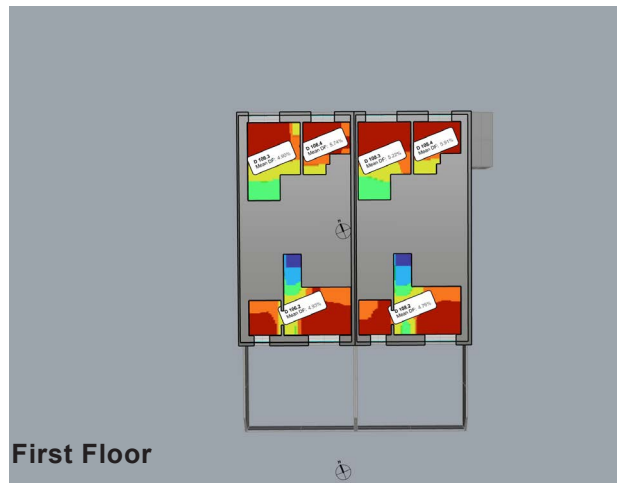


Figure 37: Neighbourhood D Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.

Average Daylight Factor - Neighbourhood D Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
D 084.1	LKD	41.1	94	2.25%	2%	Y
D 084.2	Bed	16.8	36	4.64%	1%	Y
D 084.3	Bed	11.9	29	5.24%	1%	Y
D 084.4	Bed	6.7	15	5.97%	1%	Y
D 085.1	LKD	41.1	101	4.57%	2%	Y
D 085.2	Bed	20.2	52	5.40%	1%	Y
D 085.3	Bed	13.7	35	4.75%	1%	Y
D 085.4	Bed	8.7	26	6.43%	1%	Y
D 086.1	LKD	41.4	96	2.30%	2%	Y
D 086.2	Bed	16.8	36	4.66%	1%	Y
D 086.3	Bed	11.9	29	5.02%	1%	Y
D 086.4	Bed	6.7	15	6.07%	1%	Y
D 087.1	LKD	41.1	101	3.78%	2%	Y
D 087.2	Bed	20.2	52	4.05%	1%	Y
D 087.3	Bed	13.7	35	4.67%	1%	Y
D 087.4	Bed	8.7	26	5.04%	1%	Y
D 095.1	LKD	41.4	96	2.35%	2%	Y
D 095.2	Bed	16.8	36	4.68%	1%	Y
D 095.3	Bed	11.9	29	4.97%	1%	Y
D 095.4	Bed	6.7	15	5.95%	1%	Y
D 096.1	LKD	41.1	101	3.76%	2%	Y
D 096.2	Bed	20.2	52	4.18%	1%	Y
D 096.3	Bed	13.7	35	4.76%	1%	Y
D 096.3	Bed	13.7	35	4.81%	1%	Y
D 096.4	Bed	8.7	26	6.46%	1%	Y
D 096.4	Bed	8.7	26	5.04%	1%	Y
D 097.1	LKD	41.1	94	2.37%	2%	Y
D 097.2	Bed	16.8	36	4.77%	1%	Y
D 097.3	Bed	11.9	29	5.22%	1%	Y
D 097.4	Bed	6.7	15	6.03%	1%	Y
D 098.1	LKD	41.1	101	4.63%	2%	Y
D 098.2	Bed	20.2	52	5.32%	1%	Y
D 106.1	LKD	27.3	68	3.09%	2%	Y
D 106.1	LKD	41.4	96	2.42%	2%	Y
D 106.2	Bed	16.8	36	4.93%	1%	Y
D 106.3	Bed	11.9	29	4.90%	1%	Y
D 106.4	Bed	6.7	15	5.74%	1%	Y
D 107.1	LKD	41.1	101	3.81%	2%	Y
D 107.2	Bed	20.2	52	4.21%	1%	Y
D 107.3	Bed	13.7	35	4.63%	1%	Y
D 107.4	Bed	8.7	26	5.00%	1%	Y
D 108.1	LKD	41.1	94	2.32%	2%	Y
D 108.2	Bed	16.8	36	4.76%	1%	Y
D 108.3	Bed	11.9	29	5.22%	1%	Y
D 108.4	Bed	6.7	15	5.91%	1%	Y
D 109.1	LKD	41.1	101	4.59%	2%	Y
D 109.2	Bed	20.2	52	5.33%	1%	Y
D 109.3	Bed	13.7	35	4.74%	1%	Y
D 109.4	Bed	8.7	26	6.36%	1%	Y
D 110.1	LKD	41.1	94	2.07%	2%	Y

Average Daylight Factor - Neighbourhood D Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
D 110.2	Bed	16.8	36	4.45%	1%	Y
D 110.3	Bed	11.9	29	4.58%	1%	Y
D 110.4	Bed	6.7	15	5.15%	1%	Y
D 111.1	LKD	41.1	101	4.23%	2%	Y
D 111.2	Bed	20.2	52	5.28%	1%	Y
D 111.3	Bed	13.7	35	4.54%	1%	Y
D 111.4	Bed	8.7	26	6.19%	1%	Y
D 112.1	LKD	27.3	68	3.10%	2%	Y
D 112.2	Bed	12.1	36	3.07%	1%	Y
D 113.1	LKD	43.6	110	3.07%	2%	Y
D 113.2	Bed	19.3	46	4.24%	1%	Y
D 113.3	Bed	15.1	43	3.71%	1%	Y
D 113.4	Bed	9.0	27	4.26%	1%	Y
D 114.1	LKD	27.3	68	3.17%	2%	Y
D 114.2	Bed	12.1	36	2.84%	1%	Y
D 115.1	LKD	43.6	110	2.95%	2%	Y
D 115.2	Bed	19.3	46	4.38%	1%	Y
D 115.3	Bed	15.1	43	3.52%	1%	Y
D 115.4	Bed	9.0	27	4.15%	1%	Y
D 116.1	LKD	27.3	68	3.20%	2%	Y
D 116.2	Bed	12.1	36	2.51%	1%	Y
D 117.1	LKD	43.6	110	2.83%	2%	Y
D 117.2	Bed	19.3	46	4.27%	1%	Y
D 117.3	Bed	15.1	43	3.36%	1%	Y
D 117.4	Bed	9.0	27	4.04%	1%	Y
D 118.2	Bed	12.1	36	2.48%	1%	Y
D 119.1	LKD	43.6	110	2.82%	2%	Y
D 119.2	Bed	19.3	46	4.36%	1%	Y
D 119.3	Bed	15.1	43	3.34%	1%	Y
D 119.4	Bed	9.0	27	4.14%	1%	Y
D 120.1	LKD	41.1	94	1.98%	2%	N
D 120.2	Bed	16.8	36	4.51%	1%	Y
D 120.3	Bed	11.9	29	4.13%	1%	Y
D 120.4	Bed	6.7	15	5.09%	1%	Y
D 121.1	LKD	41.1	101	4.14%	2%	Y
D 121.2	Bed	20.2	52	5.35%	1%	Y
D 121.3	Bed	13.7	35	4.55%	1%	Y
D 121.4	Bed	8.7	26	5.97%	1%	Y

**Table 17: Neighbourhood D Maisonettes: Average Daylight Factor of all habitable rooms**

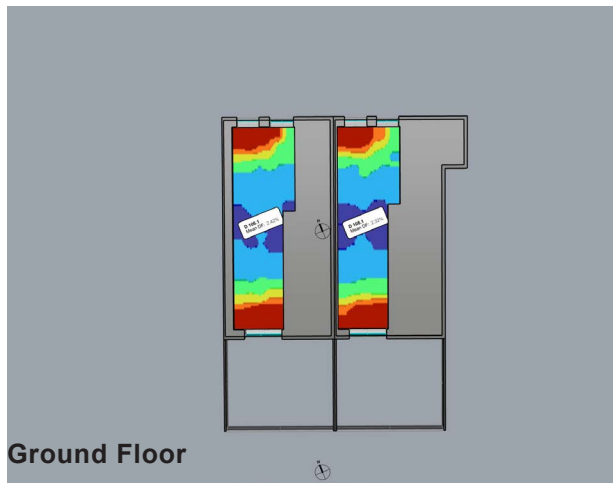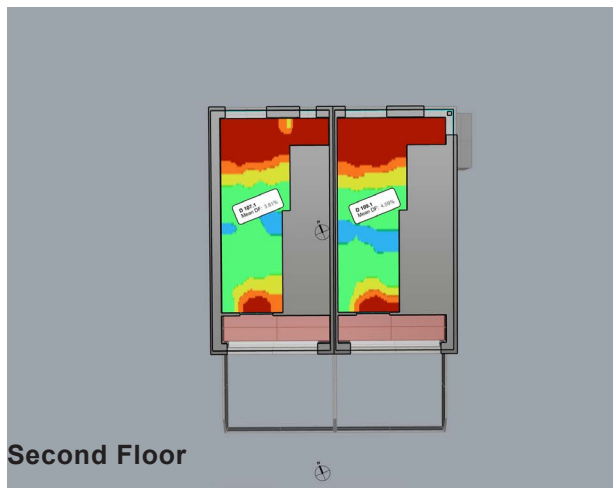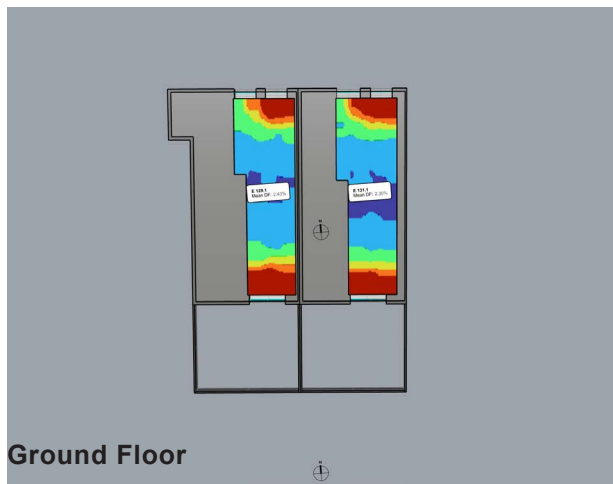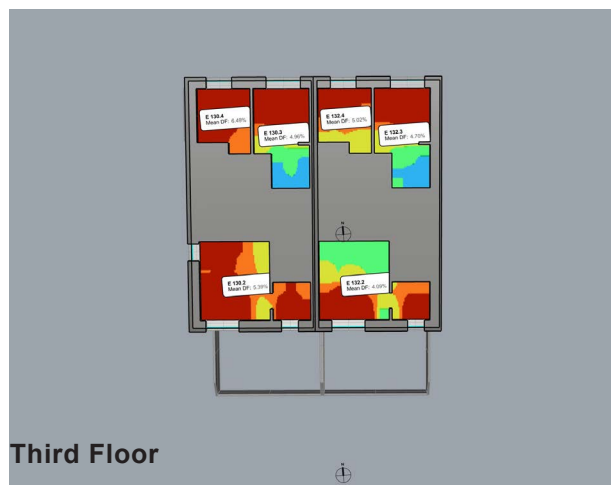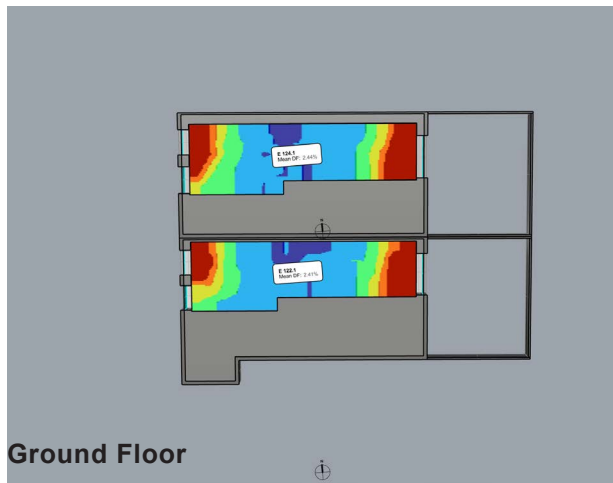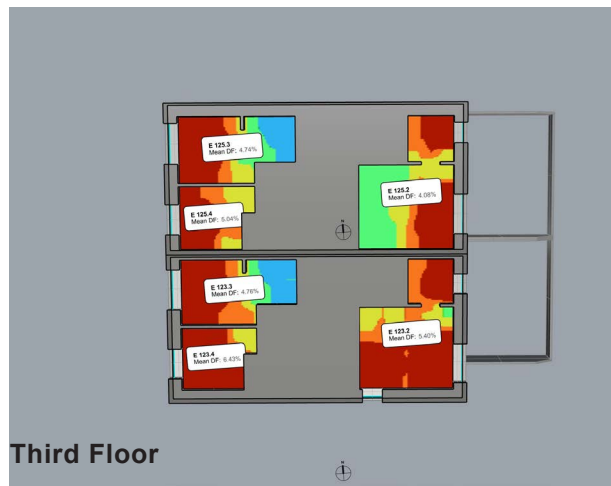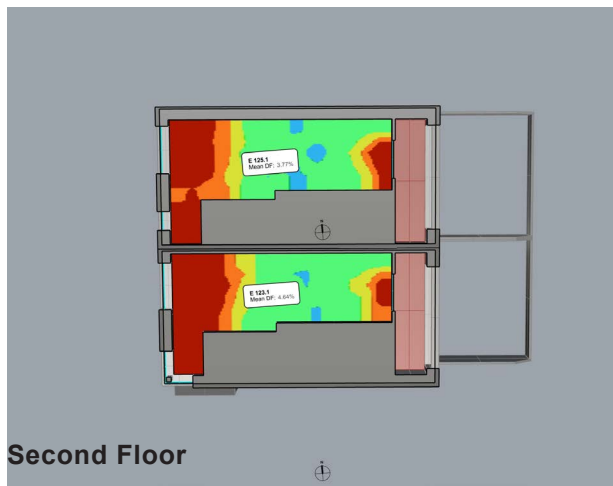

**Figure 38: Neighbourhood E Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**










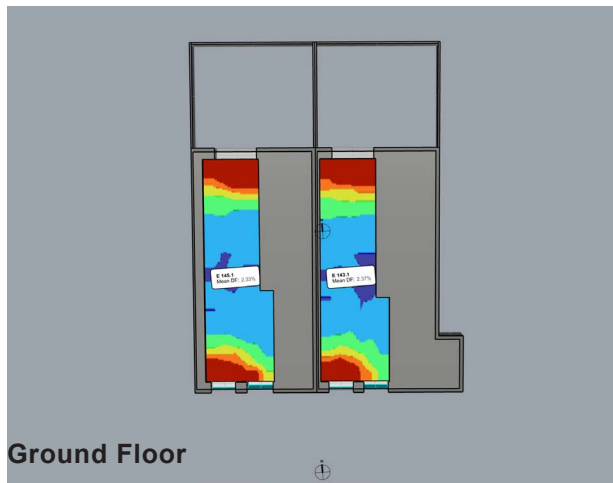








Figure 39: Neighbourhood E Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.

Average Daylight Factor - Neighbourhood E Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
E 122.1	LKD	41.1	94	2.41%	2%	Y
E 122.2	Bed	16.8	36	4.70%	1%	Y
E 122.3	Bed	11.9	29	5.21%	1%	Y
E 122.4	Bed	6.7	15	5.93%	1%	Y
E 123.1	LKD	41.1	101	4.64%	2%	Y
E 123.2	Bed	20.2	52	5.40%	1%	Y
E 123.3	Bed	13.7	35	4.76%	1%	Y
E 123.4	Bed	8.7	26	6.43%	1%	Y
E 124.1	LKD	41.4	96	2.44%	2%	Y
E 124.2	Bed	16.8	36	4.98%	1%	Y
E 124.3	Bed	11.9	29	5.08%	1%	Y
E 124.4	Bed	6.7	15	6.14%	1%	Y
E 125.1	LKD	41.1	101	3.77%	2%	Y
E 125.2	Bed	20.2	52	4.08%	1%	Y
E 125.3	Bed	13.7	35	4.74%	1%	Y
E 125.4	Bed	8.7	26	5.04%	1%	Y
E 129.1	LKD	41.1	94	2.43%	2%	Y
E 129.2	Bed	16.8	36	4.74%	1%	Y
E 129.3	Bed	6.7	15	5.77%	1%	Y
E 129.3	Bed	11.9	29	5.17%	1%	Y
E 130.1	LKD	41.1	101	4.67%	2%	Y
E 130.2	Bed	20.2	52	5.39%	1%	Y
E 130.3	Bed	13.7	35	4.96%	1%	Y
E 130.4	Bed	8.7	26	6.49%	1%	Y
E 131.1	LKD	41.4	96	2.30%	2%	Y
E 131.2	Bed	16.8	36	4.79%	1%	Y
E 131.3	Bed	11.9	29	5.03%	1%	Y
E 131.4	Bed	6.7	15	5.83%	1%	Y
E 132.1	LKD	41.1	101	3.82%	2%	Y
E 132.2	Bed	20.2	52	4.09%	1%	Y
E 132.3	Bed	13.7	35	4.70%	1%	Y
E 132.4	Bed	8.7	26	5.02%	1%	Y
E 143.1	LKD	41.1	94	2.37%	2%	Y
E 143.2	Bed	16.8	36	4.73%	1%	Y
E 143.3	Bed	11.9	29	5.02%	1%	Y
E 143.4	Bed	6.7	15	5.58%	1%	Y
E 144.1	LKD	41.1	101	4.41%	2%	Y
E 144.2	Bed	20.2	52	5.31%	1%	Y
E 144.3	Bed	13.7	35	4.79%	1%	Y
E 144.4	Bed	8.7	26	6.34%	1%	Y
E 145.1	LKD	41.4	96	2.33%	2%	Y
E 145.2	Bed	16.8	36	4.86%	1%	Y
E 145.3	Bed	11.9	29	4.99%	1%	Y
E 146.1	LKD	41.1	101	3.76%	2%	Y
E 146.2	Bed	20.2	52	4.18%	1%	Y
E 146.3	Bed	13.7	35	4.69%	1%	Y
E 146.4	Bed	6.7	15	6.00%	1%	Y
E 146.4	Bed	8.7	26	4.87%	1%	Y

**Table 18: Neighbourhood E Maisonettes: Average Daylight Factor of all habitable rooms**

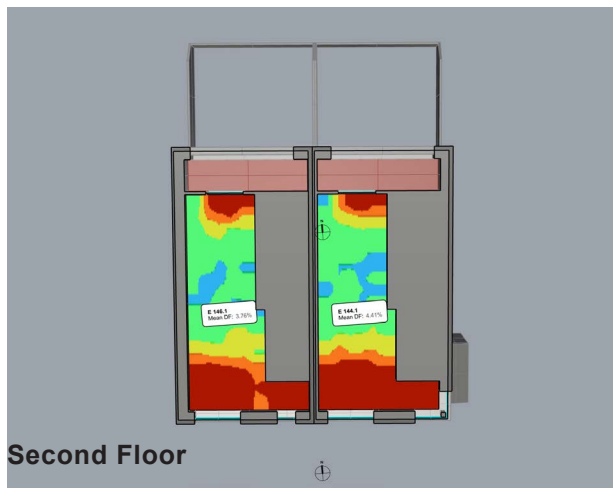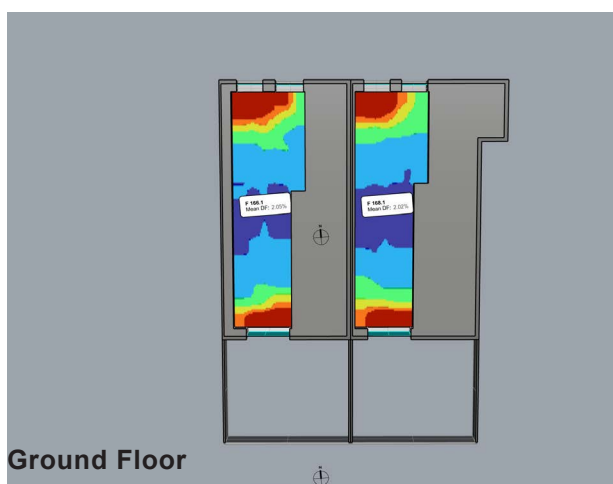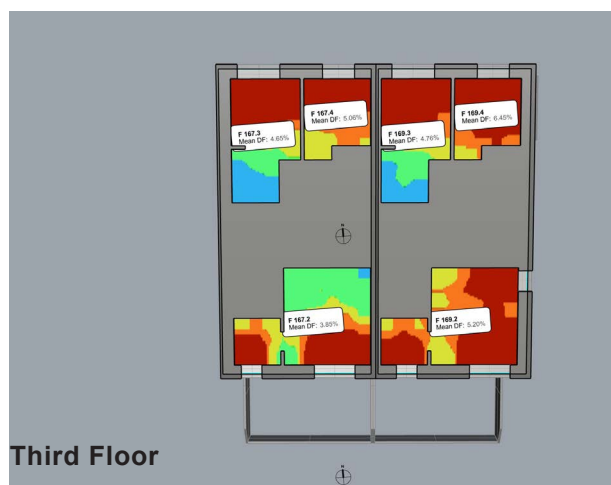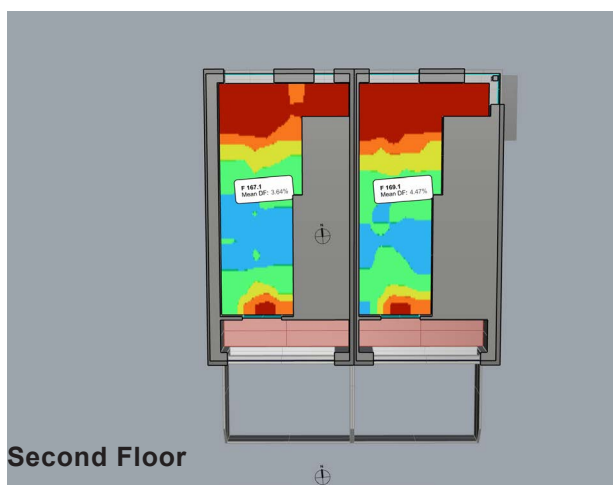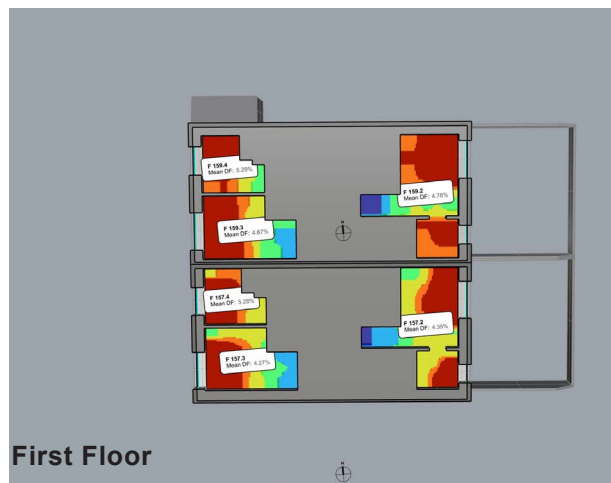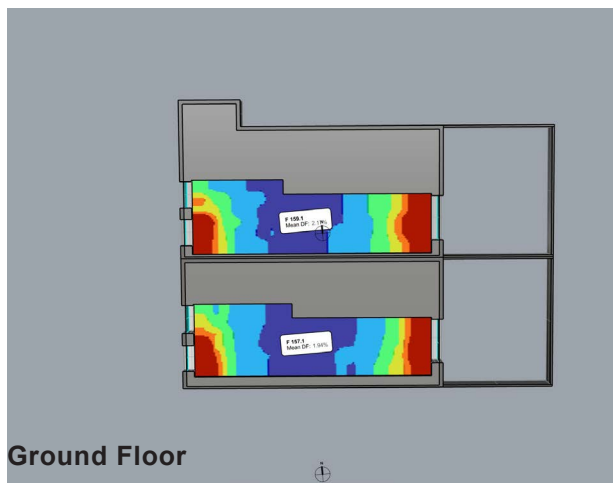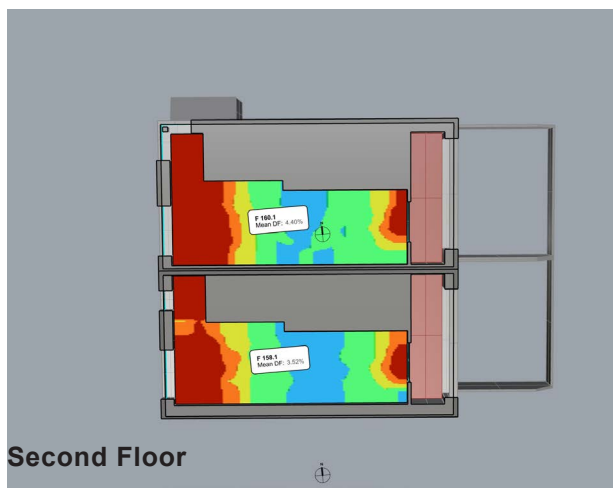

**Figure 40: Neighbourhood F Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**

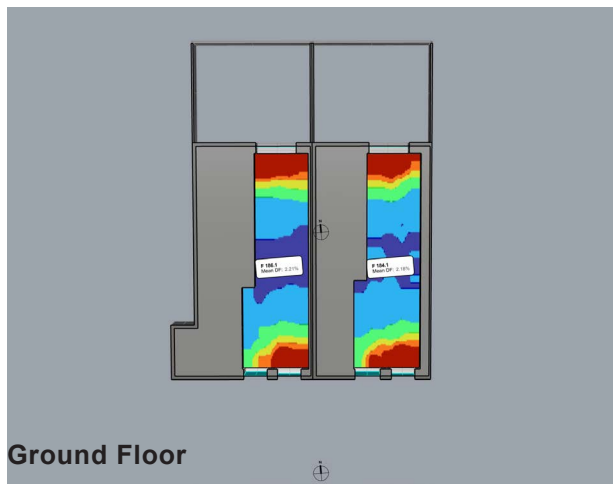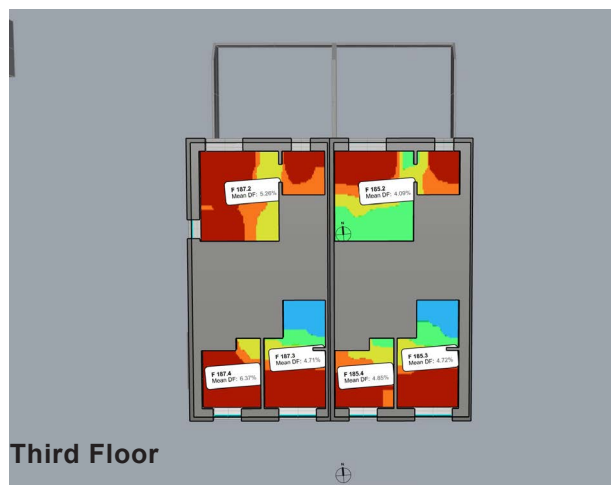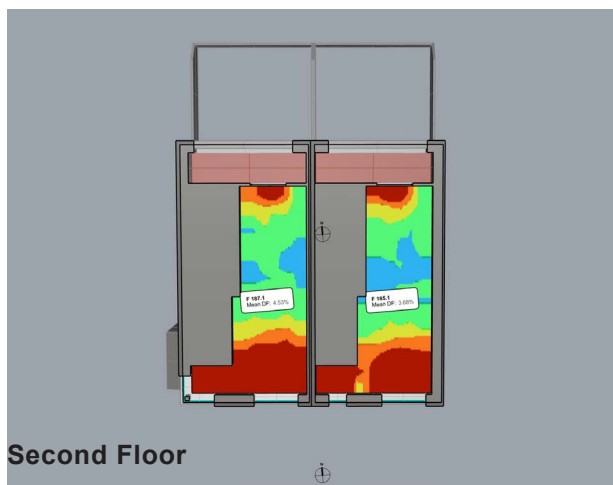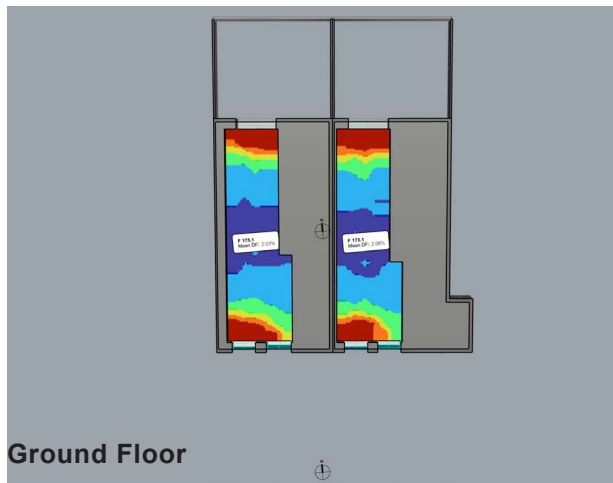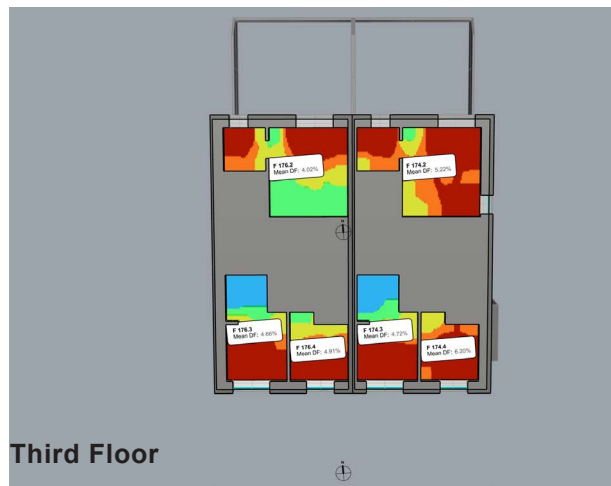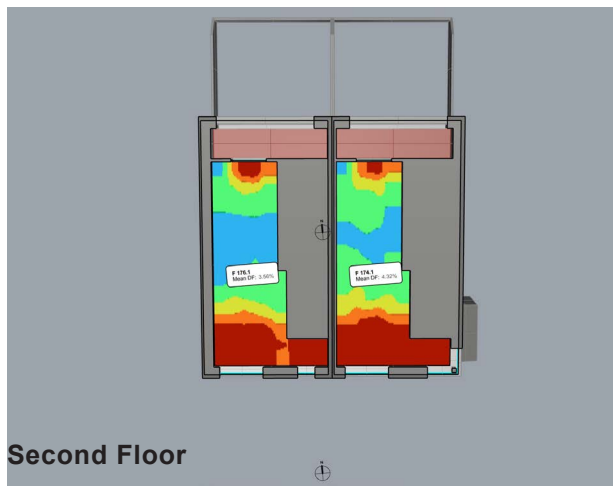







**Figure 41: Neighbourhood F Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**



Average Daylight Factor - Neighbourhood F Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
F 157.1	LKD	41.4	96	1.94%	2%	N
F 157.2	Bed	16.8	36	4.35%	1%	Y
F 157.3	Bed	11.9	29	4.27%	1%	Y
F 157.4	Bed	6.7	15	5.28%	1%	Y
F 158.1	LKD	41.1	101	3.52%	2%	Y
F 158.2	Bed	20.2	52	3.99%	1%	Y
F 158.3	Bed	13.7	35	4.42%	1%	Y
F 158.4	Bed	8.7	26	4.78%	1%	Y
F 159.1	LKD	41.1	94	2.17%	2%	Y
F 159.2	Bed	16.8	36	4.78%	1%	Y
F 159.3	Bed	11.9	29	4.67%	1%	Y
F 159.4	Bed	6.7	15	5.29%	1%	Y
F 160.1	LKD	41.1	101	4.40%	2%	Y
F 160.2	Bed	20.2	52	5.46%	1%	Y
F 160.3	Bed	13.7	35	4.72%	1%	Y
F 160.4	Bed	8.7	26	6.21%	1%	Y
F 166.1	LKD	41.4	96	2.05%	2%	Y
F 166.2	Bed	16.8	36	3.38%	1%	Y
F 166.3	Bed	11.9	29	5.00%	1%	Y
F 166.4	Bed	6.7	15	6.02%	1%	Y
F 167.1	LKD	41.1	101	3.64%	2%	Y
F 167.2	Bed	20.2	52	3.85%	1%	Y
F 167.3	Bed	13.7	35	4.65%	1%	Y
F 167.4	Bed	8.7	26	5.06%	1%	Y
F 168.1	LKD	41.1	94	2.02%	2%	Y
F 168.2	Bed	16.8	36	3.85%	1%	Y
F 168.3	Bed	11.9	29	5.27%	1%	Y
F 168.4	Bed	6.7	15	5.81%	1%	Y
F 169.1	LKD	41.1	101	4.47%	2%	Y
F 169.2	Bed	20.2	52	5.20%	1%	Y
F 169.3	Bed	13.7	35	4.76%	1%	Y
F 169.4	Bed	8.7	26	6.45%	1%	Y
F 173.1	LKD	41.1	94	2.08%	2%	Y
F 173.2	Bed	16.8	36	4.14%	1%	Y
F 173.3	Bed	11.9	29	5.01%	1%	Y
F 173.4	Bed	6.7	15	5.56%	1%	Y
F 174.1	LKD	41.1	101	4.32%	2%	Y
F 174.2	Bed	20.2	52	5.22%	1%	Y
F 174.3	Bed	13.7	35	4.72%	1%	Y
F 174.4	Bed	8.7	26	6.20%	1%	Y
F 175.1	LKD	41.4	96	2.03%	2%	Y
F 175.2	Bed	16.8	36	4.04%	1%	Y
F 175.3	Bed	11.9	29	4.79%	1%	Y
F 175.4	Bed	6.7	15	5.79%	1%	Y
F 176.1	LKD	41.1	101	3.56%	2%	Y
F 176.2	Bed	20.2	52	4.02%	1%	Y
F 176.3	Bed	13.7	35	4.66%	1%	Y
F 176.4	Bed	8.7	26	4.91%	1%	Y
F 184.1	LKD	41.4	96	2.18%	2%	Y
F 184.2	Bed	16.8	36	4.45%	1%	Y

Average Daylight Factor - Neighbourhood F Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
F 184.3	Bed	11.9	29	4.83%	1%	Y
F 184.4	Bed	6.7	15	5.86%	1%	Y
F 185.1	LKD	41.1	101	3.68%	2%	Y
F 185.2	Bed	20.2	52	4.09%	1%	Y
F 185.3	Bed	13.7	35	4.72%	1%	Y
F 185.4	Bed	8.7	26	4.85%	1%	Y
F 186.1	LKD	41.1	94	2.21%	2%	Y
F 186.2	Bed	16.8	36	4.45%	1%	Y
F 186.3	Bed	11.9	29	5.17%	1%	Y
F 186.4	Bed	6.7	15	5.73%	1%	Y
F 187.1	LKD	41.1	101	4.53%	2%	Y
F 187.2	Bed	20.2	52	5.26%	1%	Y
F 187.3	Bed	13.7	35	4.71%	1%	Y
F 187.4	Bed	8.7	26	6.37%	1%	Y

**Table 19: Neighbourhood F Maisonettes: Average Daylight Factor of all habitable rooms**

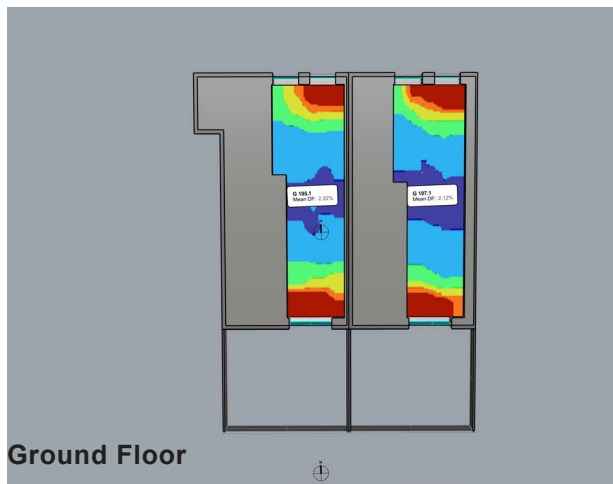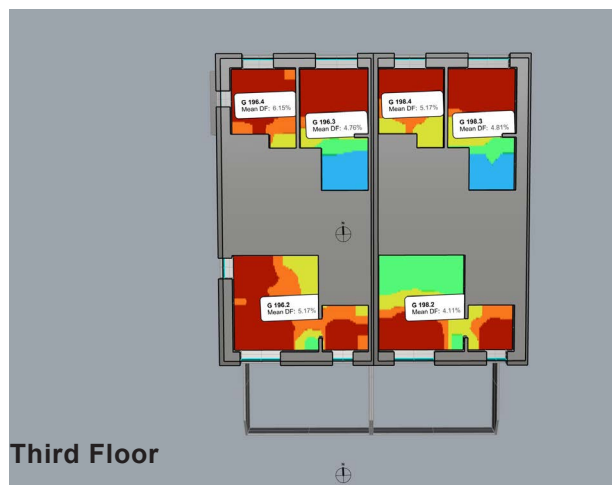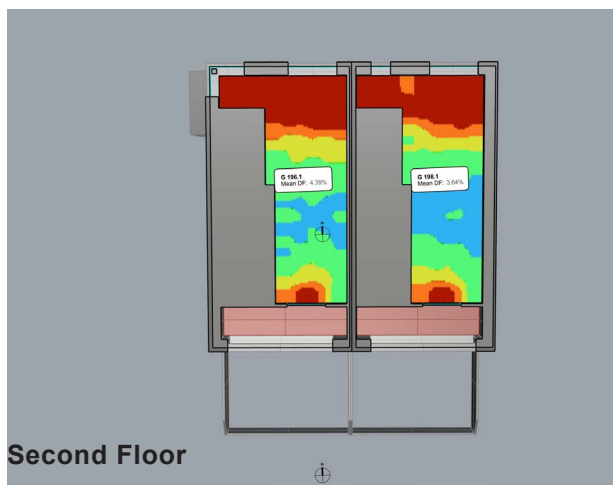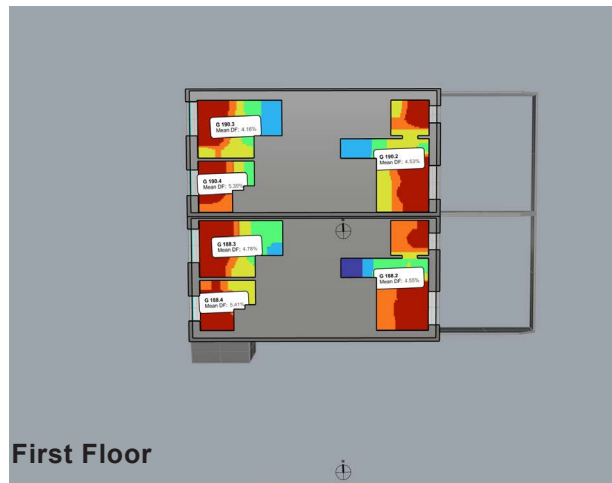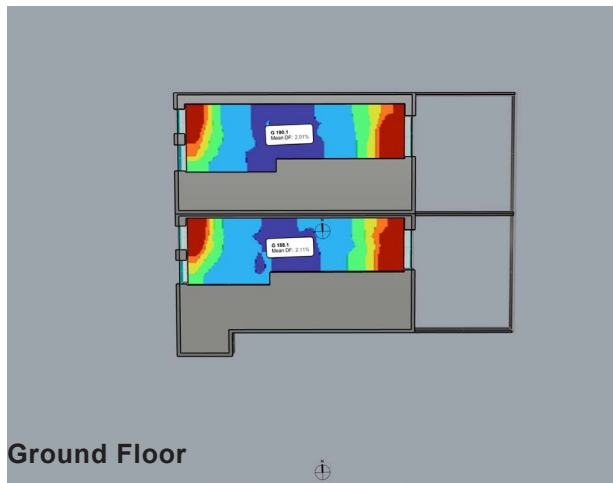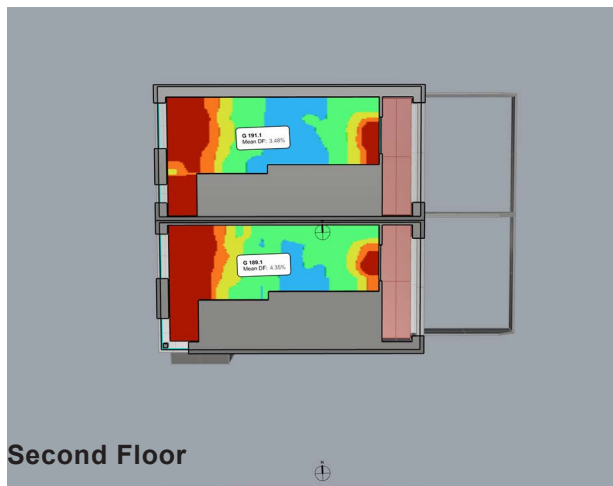


**Figure 42: Neighbourhood G Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**


### Third Floor



### Second Floor

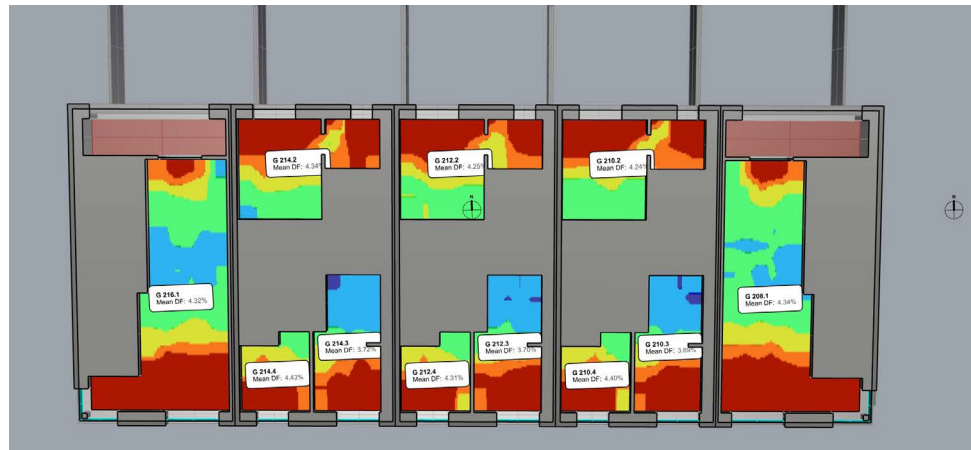

### First Floor

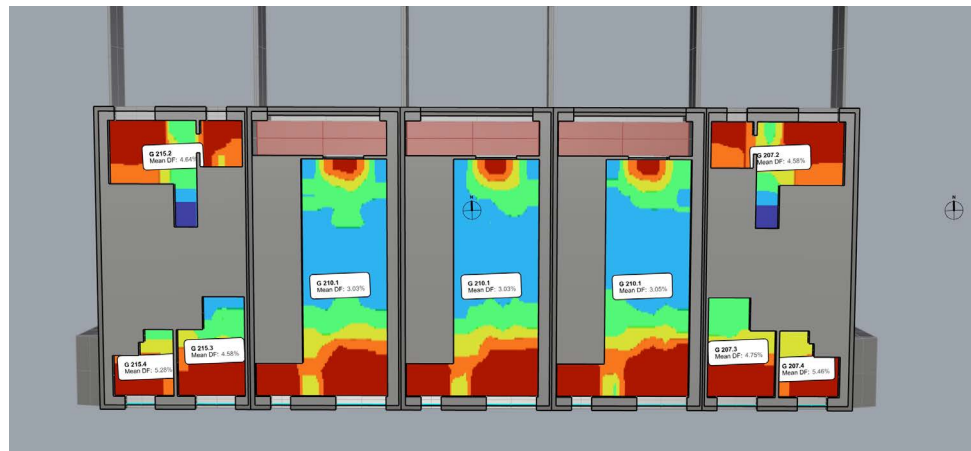

### Ground Floor

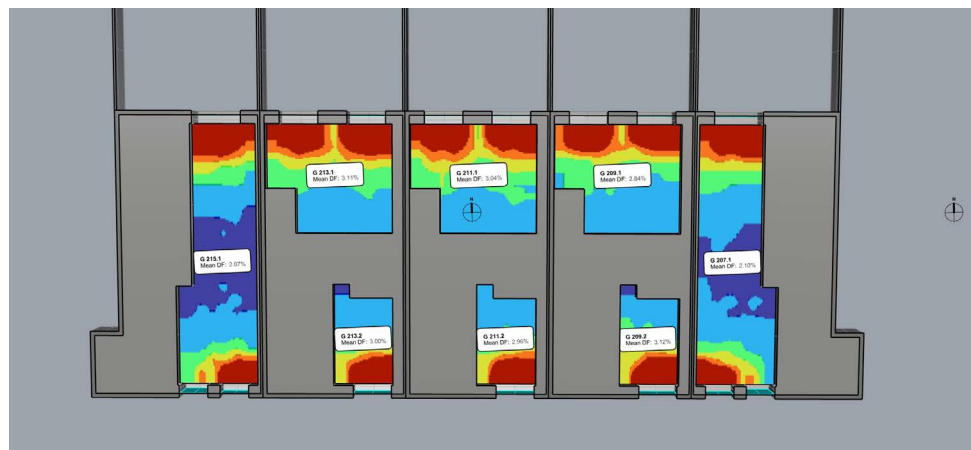







Figure 43: Neighbourhood G Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.



Average Daylight Factor - Neighbourhood G Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
G 188.1	LKD	41.1	94	2.11%	2%	Y
G 188.2	Bed	16.8	36	4.55%	1%	Y
G 188.3	Bed	11.9	29	4.78%	1%	Y
G 188.4	Bed	6.7	15	5.41%	1%	Y
G 189.1	LKD	41.1	101	4.35%	2%	Y
G 189.2	Bed	8.7	26	6.32%	1%	Y
G 189.2	Bed	13.7	35	4.64%	1%	Y
G 189.2	Bed	20.2	52	5.24%	1%	Y
G 190.1	LKD	41.4	96	2.01%	2%	Y
G 190.2	Bed	16.8	36	4.53%	1%	Y
G 190.3	Bed	11.9	29	4.16%	1%	Y
G 190.4	Bed	6.7	15	5.39%	1%	Y
G 191.1	LKD	41.1	101	3.48%	2%	Y
G 191.2	Bed	20.2	52	4.10%	1%	Y
G 191.3	Bed	13.7	35	4.66%	1%	Y
G 191.4	Bed	8.7	26	4.92%	1%	Y
G 195.1	LKD	41.1	94	2.22%	2%	Y
G 195.2	Bed	16.8	36	4.32%	1%	Y
G 195.3	Bed	11.9	29	5.08%	1%	Y
G 195.4	Bed	6.7	15	5.79%	1%	Y
G 196.1	LKD	41.1	101	4.39%	2%	Y
G 196.2	Bed	20.2	52	5.17%	1%	Y
G 196.3	Bed	13.7	35	4.76%	1%	Y
G 196.4	Bed	8.7	26	6.15%	1%	Y
G 197.1	LKD	41.4	96	2.12%	2%	Y
G 197.2	Bed	16.8	36	4.16%	1%	Y
G 197.3	Bed	11.9	29	5.00%	1%	Y
G 197.4	Bed	6.7	15	6.08%	1%	Y
G 198.1	LKD	41.1	101	3.64%	2%	Y
G 198.2	Bed	20.2	52	4.11%	1%	Y
G 198.3	Bed	13.7	35	4.81%	1%	Y
G 198.4	Bed	8.7	26	5.17%	1%	Y
G 207.1	LKD	41.1	94	2.10%	2%	Y
G 207.2	Bed	16.8	36	4.58%	1%	Y
G 207.3	Bed	11.9	29	4.75%	1%	Y
G 207.4	Bed	6.7	15	5.46%	1%	Y
G 208.1	LKD	41.1	101	4.34%	2%	Y
G 208.2	Bed	20.2	52	5.33%	1%	Y
G 208.3	Bed	13.7	35	4.69%	1%	Y
G 208.4	Bed	8.7	26	6.27%	1%	Y
G 209.1	LKD	27.3	68	2.84%	2%	Y
G 209.2	Bed	12.1	36	3.12%	1%	Y
G 210.1	LKD	43.6	110	3.05%	2%	Y
G 210.1	LKD	43.6	110	3.03%	2%	Y
G 210.1	LKD	43.6	110	3.03%	2%	Y
G 210.2	Bed	19.3	46	4.24%	1%	Y
G 210.3	Bed	15.1	43	3.69%	1%	Y
G 210.4	Bed	9.0	27	4.40%	1%	Y
G 211.1	LKD	27.3	68	3.04%	2%	Y
G 211.2	Bed	12.1	36	2.96%	1%	Y

Average Daylight Factor - Neighbourhood G Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
G 212.2	Bed	19.3	46	4.25%	1%	Y
G 212.3	Bed	15.1	43	3.70%	1%	Y
G 212.4	Bed	9.0	27	4.31%	1%	Y
G 213.1	LKD	27.3	68	3.11%	2%	Y
G 213.2	Bed	12.1	36	3.00%	1%	Y
G 214.2	Bed	19.3	46	4.34%	1%	Y
G 214.3	Bed	15.1	43	3.72%	1%	Y
G 214.4	Bed	9.0	27	4.43%	1%	Y
G 215.1	LKD	41.1	94	2.07%	2%	Y
G 215.2	Bed	16.8	36	4.64%	1%	Y
G 215.3	Bed	11.9	29	4.58%	1%	Y
G 215.4	Bed	6.7	15	5.28%	1%	Y
G 216.1	LKD	41.1	101	4.32%	2%	Y
G 216.2	Bed	20.2	52	5.27%	1%	Y
G 216.3	Bed	13.7	35	4.56%	1%	Y
G 216.4	Bed	8.7	26	6.21%	1%	Y

**Table 20: Neighbourhood G Maisonettes: Average Daylight Factor of all habitable rooms**

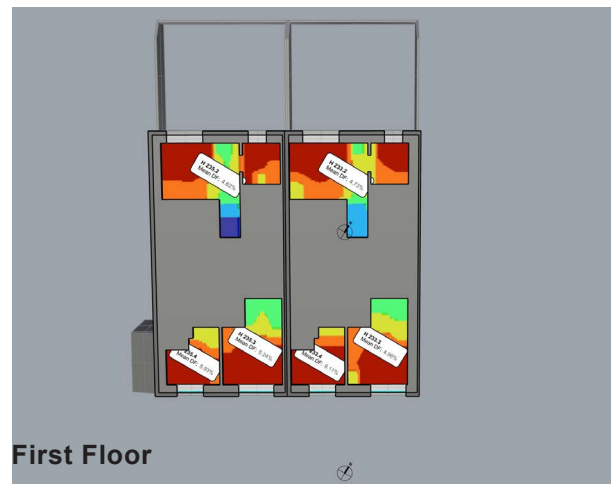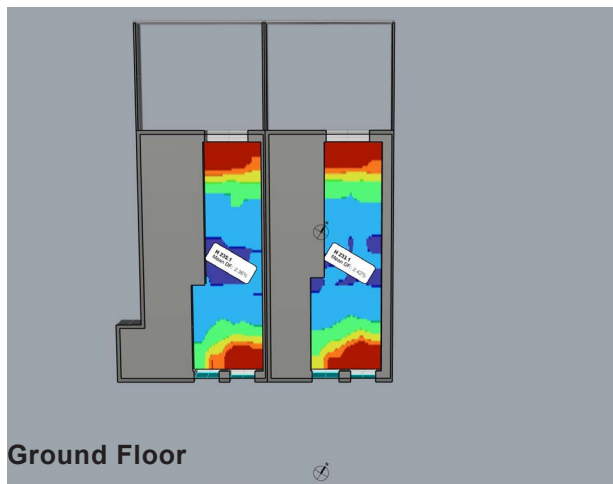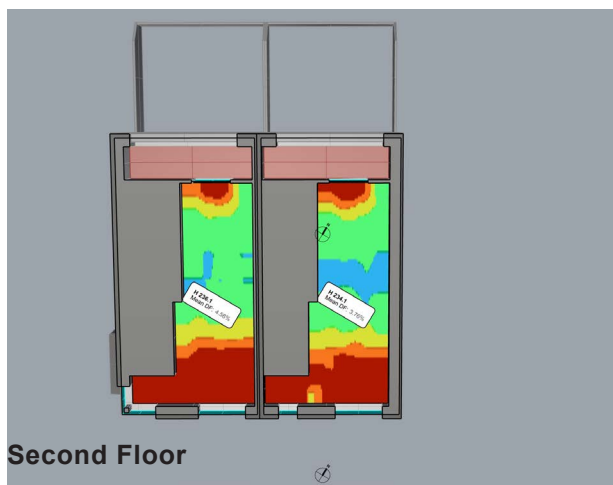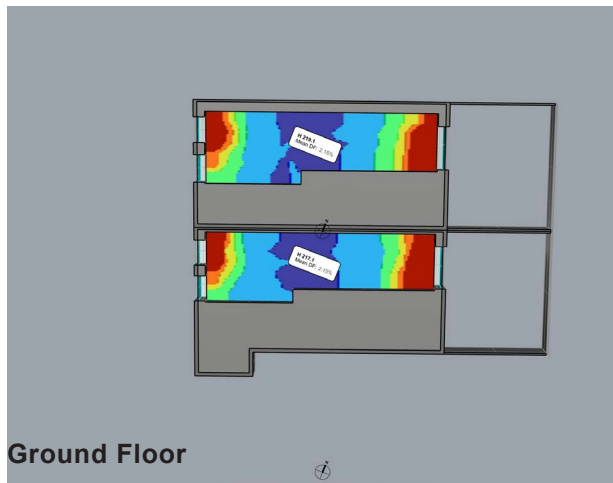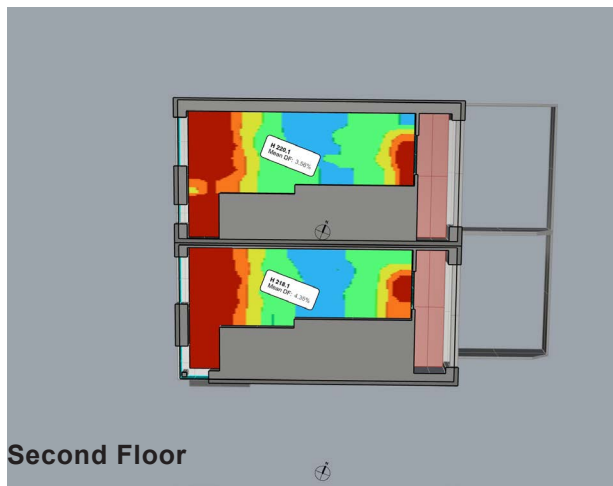

**Figure 44: Neighbourhood H Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**







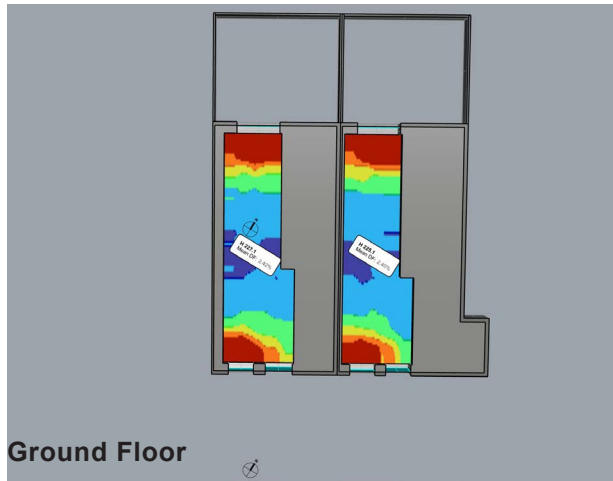


Figure 45: Neighbourhood H Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.

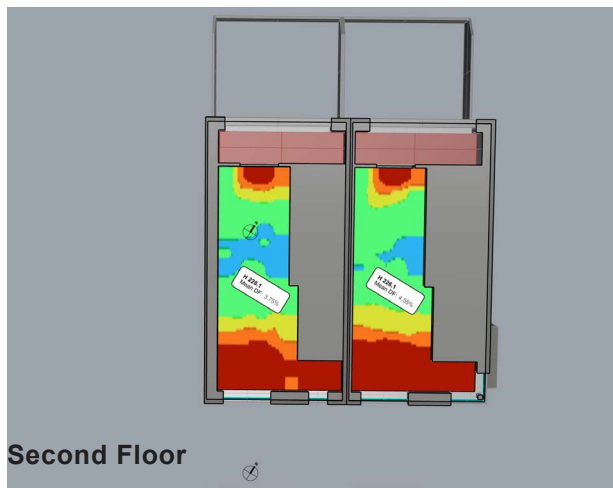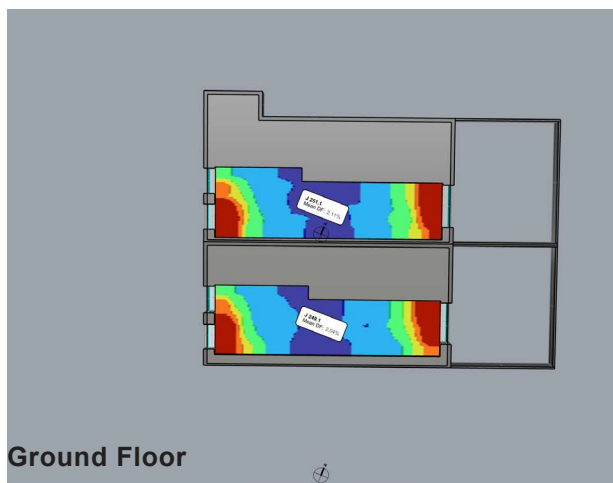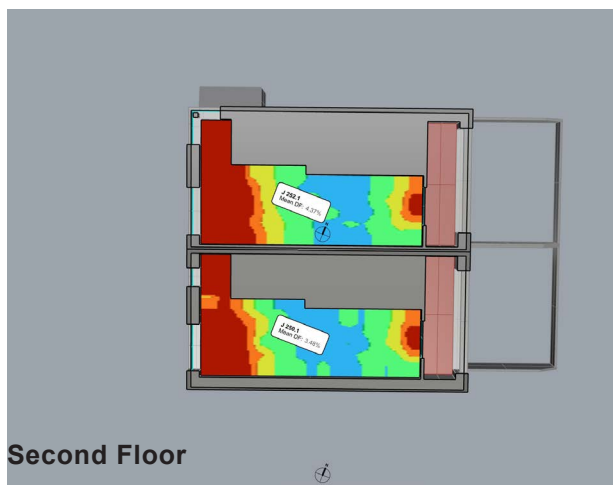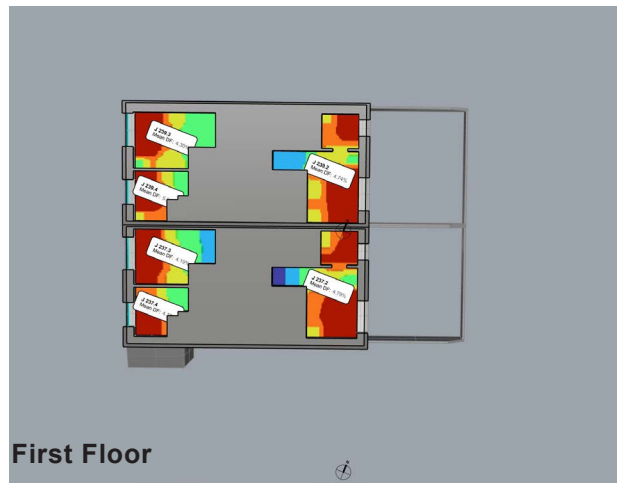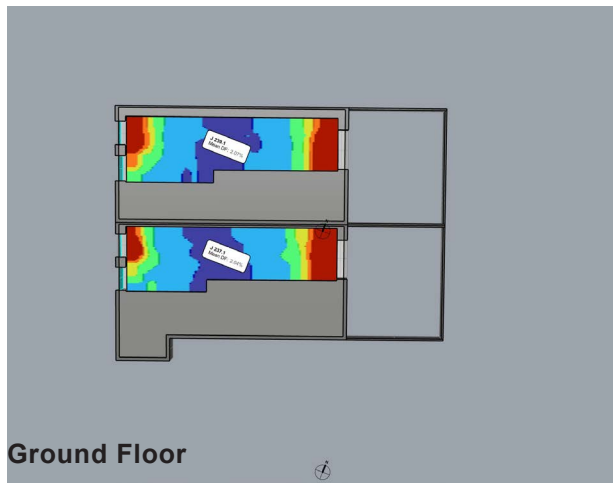

Average Daylight Factor - Neighbourhood H Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
H 217.1	LKD	41.1	94	2.15%	2%	Y
H 217.2	Bed	16.8	36	4.66%	1%	Y
H 217.3	Bed	11.9	29	4.61%	1%	Y
H 217.4	Bed	6.7	15	5.48%	1%	Y
H 218.1	LKD	41.1	101	4.35%	2%	Y
H 218.2	Bed	20.2	52	5.39%	1%	Y
H 218.3	Bed	13.7	35	4.54%	1%	Y
H 218.4	Bed	8.7	26	6.16%	1%	Y
H 219.1	LKD	41.4	96	2.15%	2%	Y
H 219.2	Bed	16.8	36	4.77%	1%	Y
H 219.3	Bed	11.9	29	4.55%	1%	Y
H 219.4	Bed	6.7	15	5.36%	1%	Y
H 220.1	LKD	41.1	101	3.56%	2%	Y
H 220.2	Bed	20.2	52	4.11%	1%	Y
H 220.3	Bed	13.7	35	4.53%	1%	Y
H 220.4	Bed	8.7	26	4.74%	1%	Y
H 225.1	LKD	41.1	94	2.40%	2%	Y
H 225.2	Bed	16.8	36	4.72%	1%	Y
H 225.3	Bed	11.9	29	5.26%	1%	Y
H 225.4	Bed	6.7	15	5.93%	1%	Y
H 226.1	LKD	41.1	101	4.55%	2%	Y
H 226.2	Bed	20.2	52	5.13%	1%	Y
H 226.3	Bed	13.7	35	4.86%	1%	Y
H 226.4	Bed	8.7	26	6.50%	1%	Y
H 227.1	LKD	41.4	96	2.43%	2%	Y
H 227.2	Bed	16.8	36	4.73%	1%	Y
H 227.3	Bed	11.9	29	4.93%	1%	Y
H 227.4	Bed	6.7	15	5.98%	1%	Y
H 228.1	LKD	41.1	101	3.75%	2%	Y
H 228.2	Bed	20.2	52	4.00%	1%	Y
H 228.3	Bed	13.7	35	4.66%	1%	Y
H 228.4	Bed	8.7	26	5.05%	1%	Y
H 233.1	LKD	41.4	96	2.42%	2%	Y
H 233.2	Bed	16.8	36	4.73%	1%	Y
H 233.3	Bed	11.9	29	4.96%	1%	Y
H 233.4	Bed	6.7	15	6.11%	1%	Y
H 234.1	LKD	41.1	101	3.76%	2%	Y
H 234.2	Bed	20.2	52	4.04%	1%	Y
H 234.3	Bed	13.7	35	4.68%	1%	Y
H 234.4	Bed	8.7	26	5.06%	1%	Y
H 235.1	LKD	41.1	94	2.36%	2%	Y
H 235.2	Bed	16.8	36	4.62%	1%	Y
H 235.3	Bed	11.9	29	5.24%	1%	Y
H 235.4	Bed	6.7	15	5.93%	1%	Y
H 236.1	LKD	41.1	101	4.58%	2%	Y
H 236.2	Bed	20.2	52	5.19%	1%	Y
H 236.3	Bed	13.7	35	4.87%	1%	Y
H 236.4	Bed	8.7	26	6.41%	1%	Y

**Table 21: Neighbourhood H Maisonettes: Average Daylight Factor of all habitable rooms**

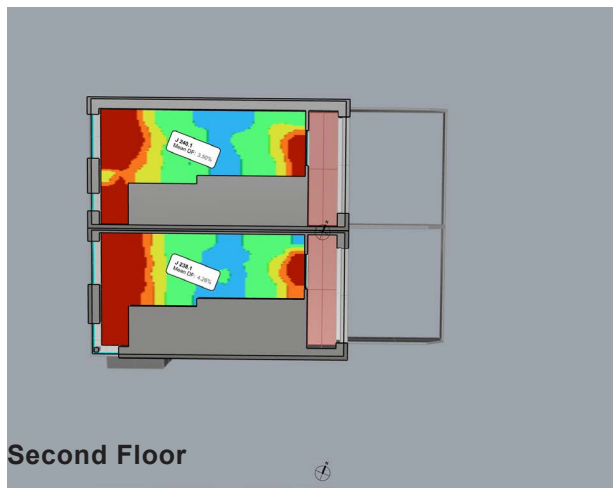


**Figure 46: Neighbourhood J Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**


Third Floor



Second Floor

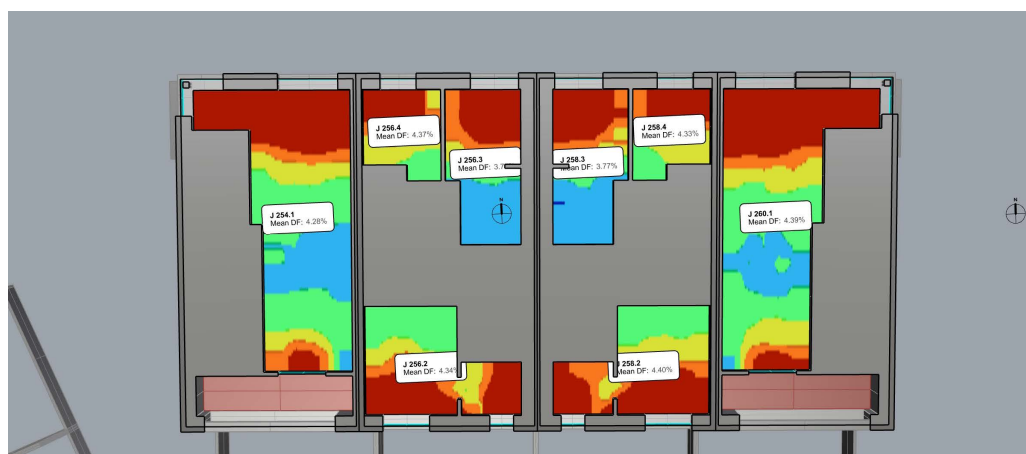

First Floor

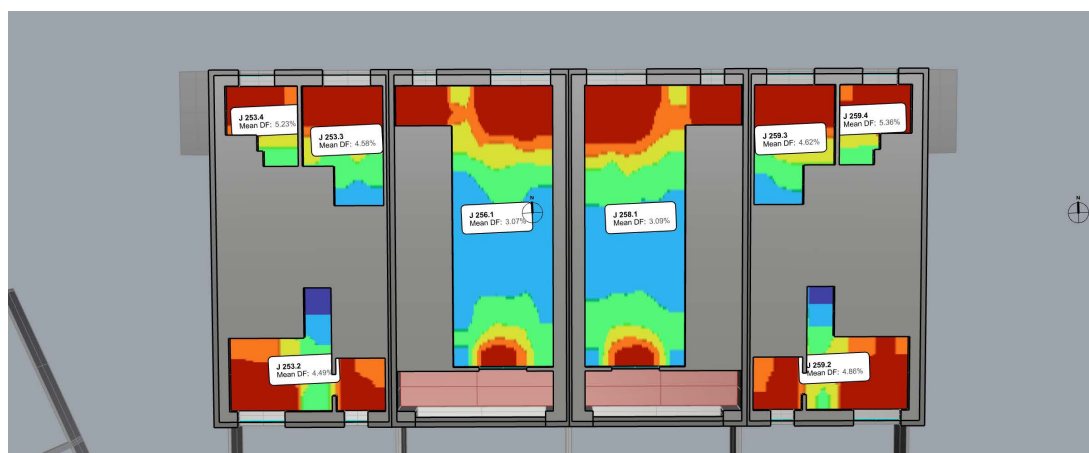

Ground Floor


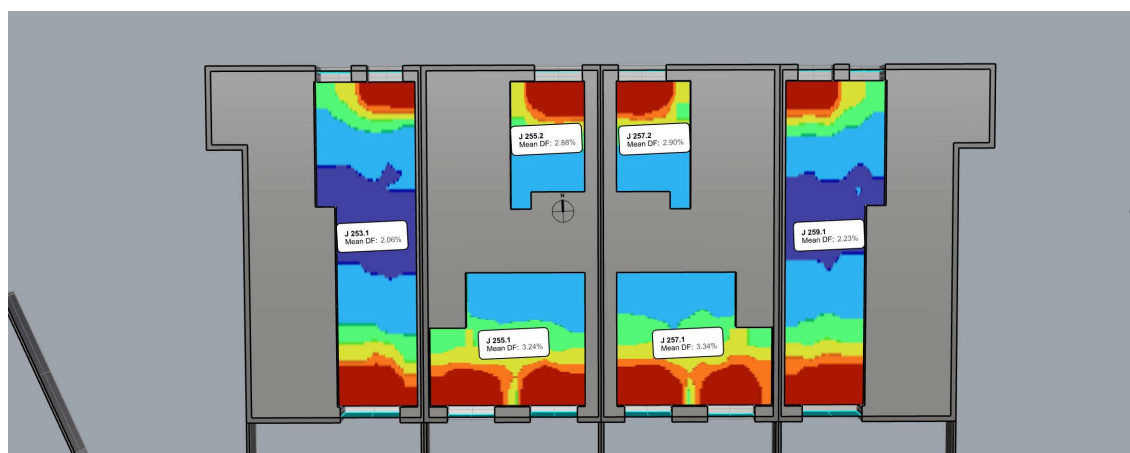


Figure 47: Neighbourhood J Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.


### Third Floor



### Second Floor

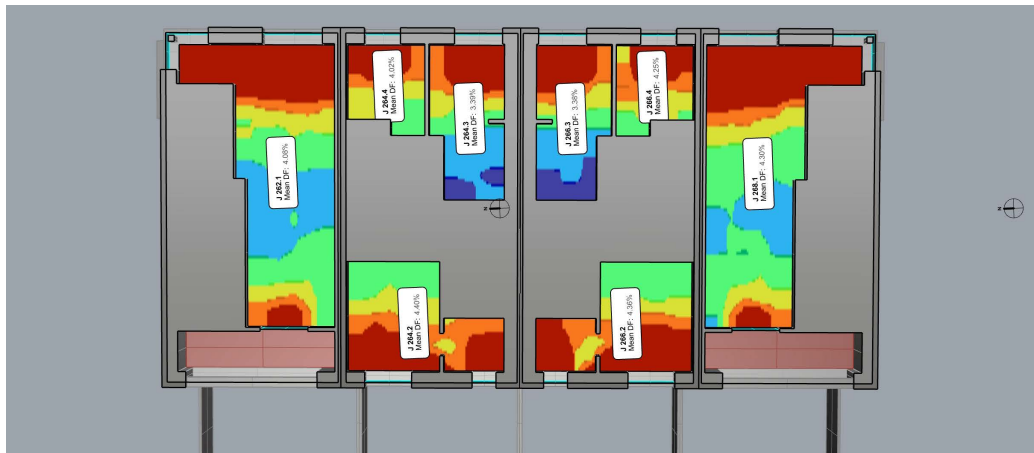

### First Floor

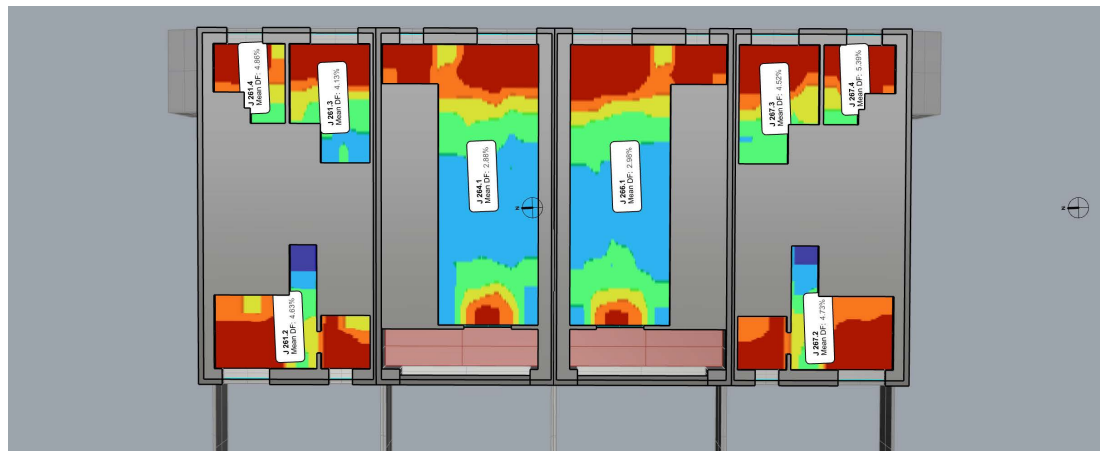

### Ground Floor

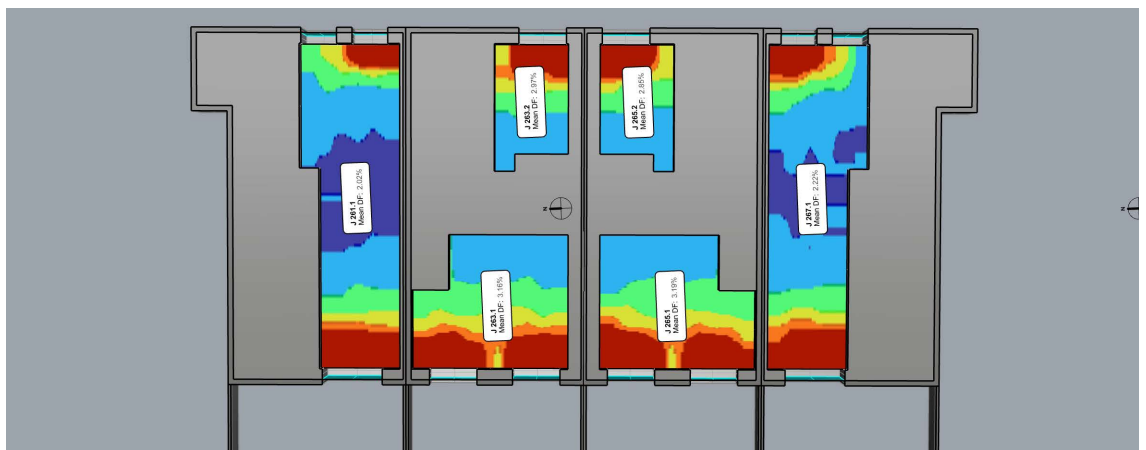










Figure 48: Neighbourhood J Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.

Average Daylight Factor - Neighbourhood J Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
J 050.2	Bed	20.2	52	4.15%	1%	Y
J 050.3	Bed	13.7	35	4.46%	1%	Y
J 050.4	Bed	8.7	26	4.68%	1%	Y
J 052.2	Bed	20.2	52	5.38%	1%	Y
J 052.3	Bed	13.7	35	4.61%	1%	Y
J 052.4	Bed	8.7	26	6.27%	1%	Y
J 054.2	Bed	20.2	52	5.21%	1%	Y
J 054.3	Bed	13.7	35	4.70%	1%	Y
J 054.4	Bed	8.7	26	6.18%	1%	Y
J 060.1	Bed	20.2	52	5.35%	1%	Y
J 060.2	Bed	13.7	35	4.57%	1%	Y
J 060.3	Bed	8.7	26	6.24%	1%	Y
J 062.1	Bed	20.2	52	5.44%	1%	Y
J 062.2	Bed	13.7	35	4.25%	1%	Y
J 062.3	Bed	8.7	26	5.99%	1%	Y
J 068.1	Bed	20.2	52	5.47%	1%	Y
J 068.2	Bed	13.7	35	4.50%	1%	Y
J 068.3	Bed	8.7	26	6.09%	1%	Y
J 237.1	LKD	41.1	94	2.04%	2%	Y
J 237.2	Bed	16.8	36	4.79%	1%	Y
J 237.2	Bed	20.2	52	5.48%	1%	Y
J 237.3	Bed	11.9	29	4.19%	1%	Y
J 237.3	Bed	13.7	35	4.58%	1%	Y
J 237.4	Bed	6.7	15	4.75%	1%	Y
J 237.4	Bed	8.7	26	6.12%	1%	Y
J 238.1	LKD	41.1	101	4.26%	2%	Y
J 239.1	LKD	41.4	96	2.07%	2%	Y
J 239.2	Bed	16.8	36	4.74%	1%	Y
J 239.2	Bed	20.2	52	4.12%	1%	Y
J 239.3	Bed	11.9	29	4.30%	1%	Y
J 239.3	Bed	13.7	35	4.46%	1%	Y
J 239.4	Bed	6.7	15	5.04%	1%	Y
J 239.4	Bed	8.7	26	4.78%	1%	Y
J 240.1	LKD	41.1	101	3.50%	2%	Y
J 249.1	LKD	41.4	96	2.04%	2%	Y
J 249.2	Bed	16.8	36	4.41%	1%	Y
J 249.3	Bed	11.9	29	4.44%	1%	Y
J 249.4	Bed	6.7	15	5.36%	1%	Y
J 250.1	LKD	41.1	101	3.48%	2%	Y
J 251.1	LKD	41.1	94	2.11%	2%	Y
J 251.2	Bed	16.8	36	4.24%	1%	Y
J 251.3	Bed	11.9	29	4.91%	1%	Y
J 251.4	Bed	6.7	15	5.53%	1%	Y
J 252.1	LKD	41.1	101	4.37%	2%	Y
J 253.1	LKD	41.1	94	2.06%	2%	Y
J 253.2	Bed	16.8	36	4.49%	1%	Y
J 253.3	Bed	11.9	29	4.58%	1%	Y
J 253.4	Bed	6.7	15	5.23%	1%	Y
J 254.1	LKD	41.1	101	4.28%	2%	Y
J 255.1	LKD	27.3	68	3.24%	2%	Y



Average Daylight Factor - Neighbourhood J Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
J 255.2	Bed	12.1	36	2.88%	1%	Y
J 256.1	LKD	43.6	110	3.07%	2%	Y
J 256.2	Bed	19.3	46	4.34%	1%	Y
J 256.3	Bed	15.1	43	3.75%	1%	Y
J 256.4	Bed	9.0	27	4.37%	1%	Y
J 257.1	LKD	27.3	68	3.34%	2%	Y
J 257.2	Bed	12.1	36	2.90%	1%	Y
J 258.1	LKD	43.6	110	3.09%	2%	Y
J 258.2	Bed	19.3	46	4.40%	1%	Y
J 258.3	Bed	15.1	43	3.77%	1%	Y
J 258.4	Bed	9.0	27	4.33%	1%	Y
J 259.1	LKD	41.1	94	2.23%	2%	Y
J 259.2	Bed	16.8	36	4.86%	1%	Y
J 259.3	Bed	11.9	29	4.62%	1%	Y
J 259.4	Bed	6.7	15	5.36%	1%	Y
J 260.1	LKD	41.1	101	4.39%	2%	Y
J 261.1	LKD	41.1	94	2.02%	2%	Y
J 261.2	Bed	16.8	36	4.63%	1%	Y
J 261.3	Bed	11.9	29	4.13%	1%	Y
J 261.4	Bed	6.7	15	4.86%	1%	Y
J 262.1	LKD	41.1	101	4.08%	2%	Y
J 263.1	LKD	27.3	68	3.16%	2%	Y
J 263.2	Bed	12.1	36	2.97%	1%	Y
J 264.1	LKD	43.6	110	2.88%	2%	Y
J 264.2	Bed	19.3	46	4.40%	1%	Y
J 264.3	Bed	15.1	43	3.39%	1%	Y
J 264.4	Bed	9.0	27	4.02%	1%	Y
J 265.1	LKD	27.3	68	3.19%	2%	Y
J 265.2	Bed	12.1	36	2.85%	1%	Y
J 266.1	LKD	43.6	110	2.98%	2%	Y
J 266.2	Bed	19.3	46	4.36%	1%	Y
J 266.3	Bed	15.1	43	3.38%	1%	Y
J 266.4	Bed	9.0	27	4.25%	1%	Y
J 267.1	LKD	41.1	94	2.22%	2%	Y
J 267.2	Bed	16.8	36	4.73%	1%	Y
J 267.3	Bed	11.9	29	4.52%	1%	Y
J 267.4	Bed	6.7	15	5.39%	1%	Y
J 268.1	LKD	41.1	101	4.31%	2%	Y


**Table 22: Neighbourhood J Maisonettes: Average Daylight Factor of all habitable rooms**

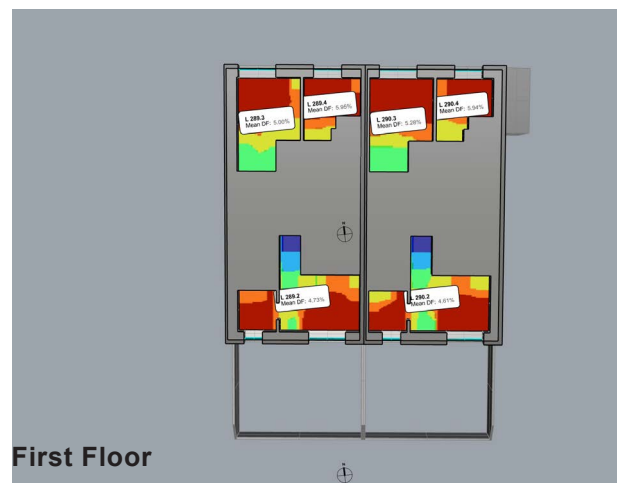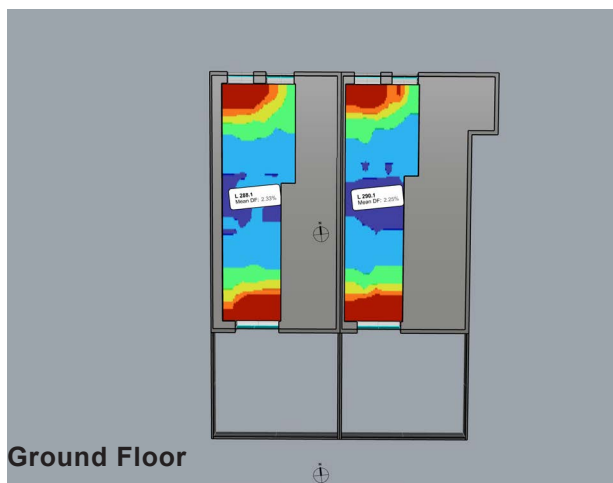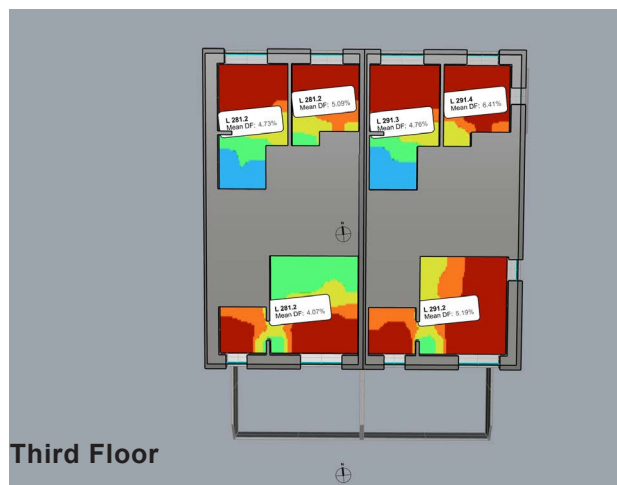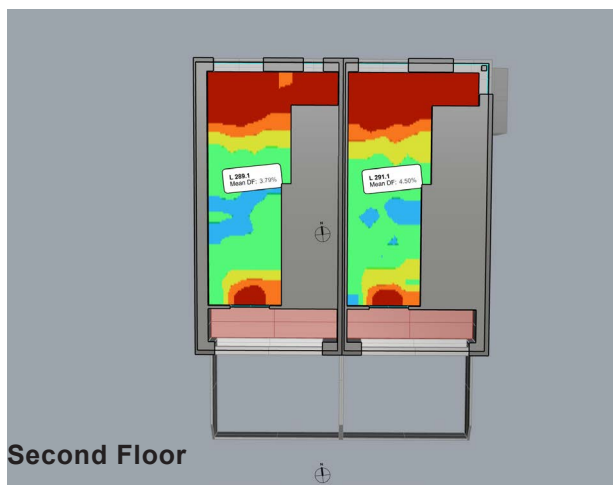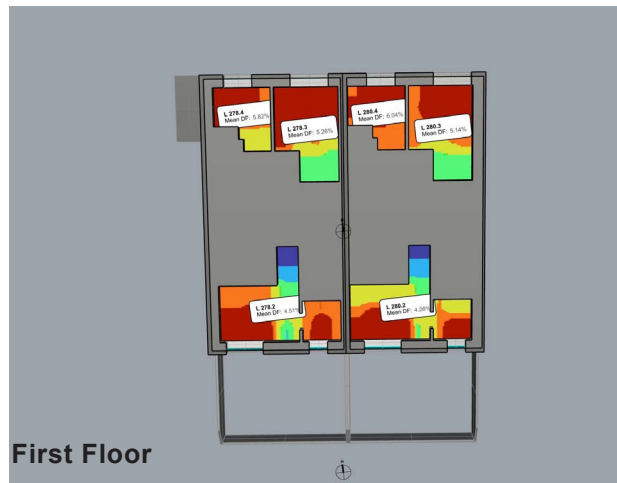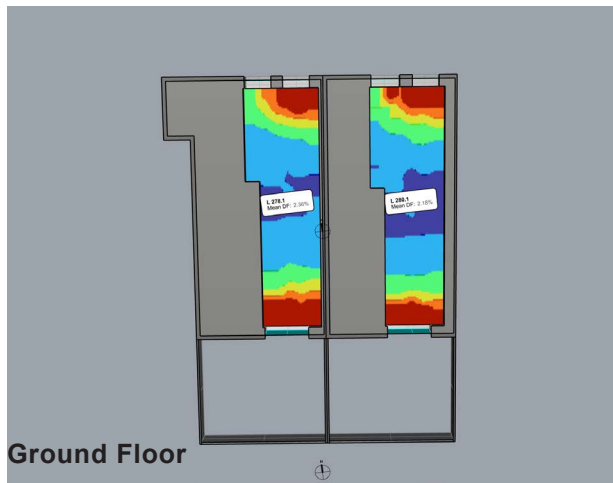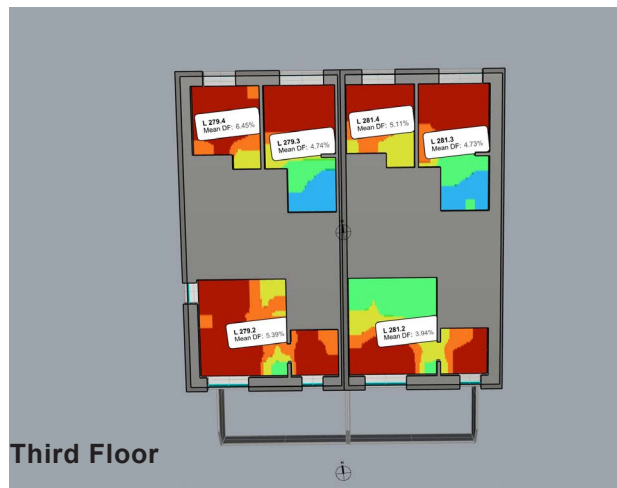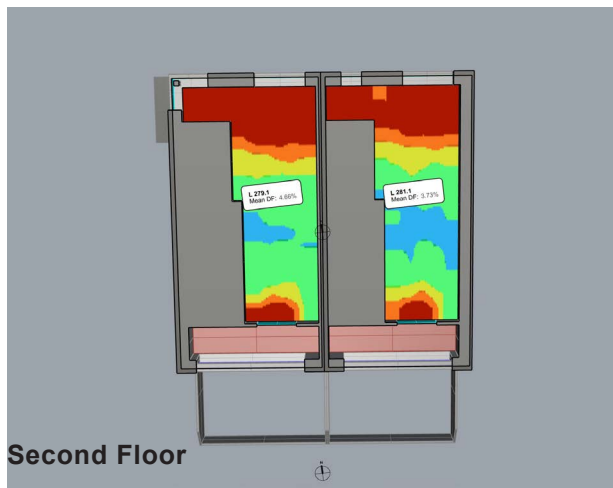


**Figure 49: Neighbourhood L Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**




Third Floor



Second Floor

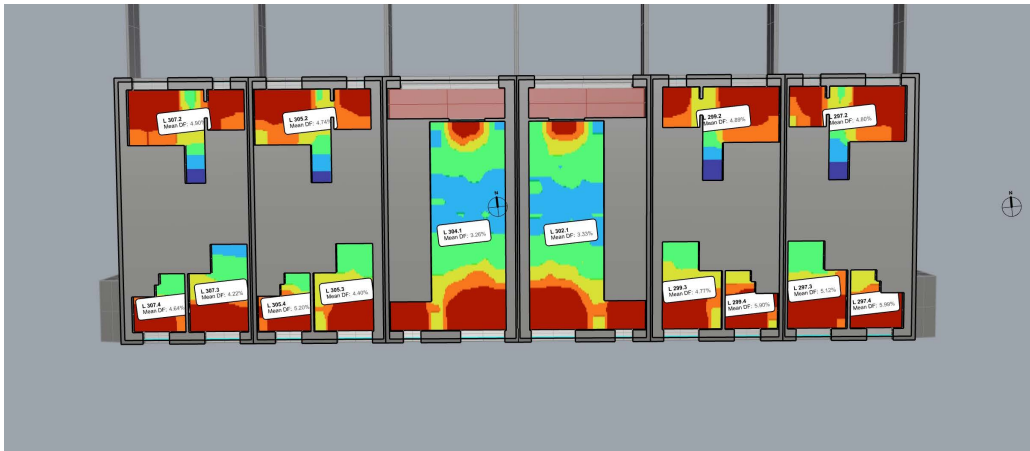

First Floor

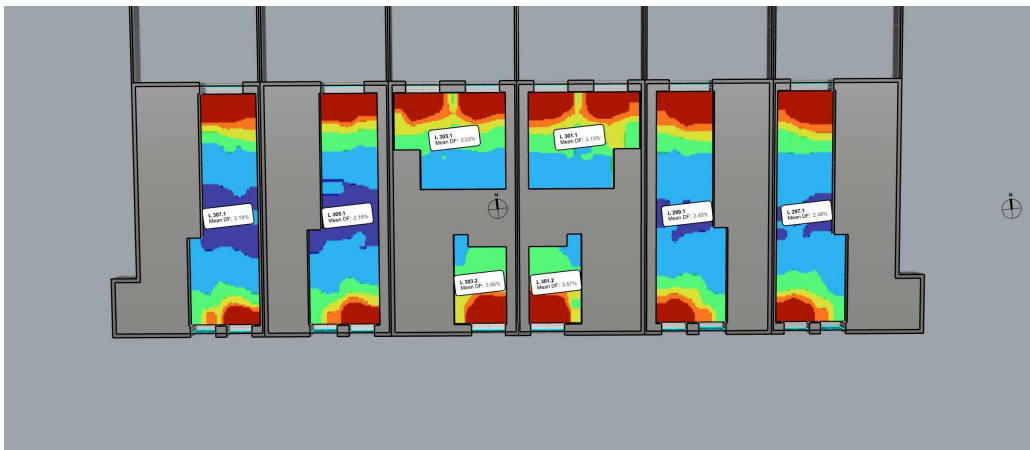

Ground Floor









Figure 50: Neighbourhood L Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.

Average Daylight Factor - Neighbourhood L Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
L 278.1	LKD	41.1	94	2.36%	2%	Y
L 278.2	Bed	16.8	36	4.51%	1%	Y
L 278.3	Bed	11.9	29	5.26%	1%	Y
L 278.4	Bed	6.7	15	5.82%	1%	Y
L 279.1	LKD	41.1	101	4.66%	2%	Y
L 279.2	Bed	20.2	52	5.39%	1%	Y
L 279.3	Bed	13.7	35	4.74%	1%	Y
L 279.4	Bed	8.7	26	6.45%	1%	Y
L 280.1	LKD	41.4	96	2.18%	2%	Y
L 280.2	Bed	16.8	36	4.26%	1%	Y
L 280.3	Bed	11.9	29	5.14%	1%	Y
L 280.4	Bed	6.7	15	6.04%	1%	Y
L 281.1	LKD	41.1	101	3.73%	2%	Y
L 281.2	Bed	20.2	52	3.94%	1%	Y
L 281.2	Bed	8.7	26	5.09%	1%	Y
L 281.2	Bed	13.7	35	4.73%	1%	Y
L 281.2	Bed	20.2	52	4.07%	1%	Y
L 281.3	Bed	13.7	35	4.73%	1%	Y
L 281.4	Bed	8.7	26	5.11%	1%	Y
L 288.1	LKD	41.4	96	2.33%	2%	Y
L 289.1	LKD	41.1	101	3.79%	2%	Y
L 289.2	Bed	16.8	36	4.73%	1%	Y
L 289.3	Bed	11.9	29	5.00%	1%	Y
L 289.4	Bed	6.7	15	5.95%	1%	Y
L 290.1	LKD	41.1	94	2.25%	2%	Y
L 290.2	Bed	16.8	36	4.61%	1%	Y
L 290.3	Bed	11.9	29	5.28%	1%	Y
L 290.4	Bed	6.7	15	5.94%	1%	Y
L 291.1	LKD	41.1	101	4.50%	2%	Y
L 291.2	Bed	20.2	52	5.19%	1%	Y
L 291.3	Bed	13.7	35	4.76%	1%	Y
L 291.4	Bed	8.7	26	6.41%	1%	Y
L 297.1	LKD	41.1	94	2.48%	2%	Y
L 297.2	Bed	16.8	36	4.80%	1%	Y
L 297.3	Bed	11.9	29	5.12%	1%	Y
L 297.4	Bed	6.7	15	5.99%	1%	Y
L 298.1	LKD	41.1	101	4.54%	2%	Y
L 298.2	Bed	20.2	52	5.31%	1%	Y
L 298.3	Bed	13.7	35	4.82%	1%	Y
L 298.4	Bed	8.7	26	6.36%	1%	Y
L 299.1	LKD	41.4	96	2.40%	2%	Y
L 299.2	Bed	16.8	36	4.89%	1%	Y
L 299.3	Bed	11.9	29	4.77%	1%	Y
L 299.4	Bed	6.7	15	5.90%	1%	Y
L 300.1	LKD	41.1	101	3.76%	2%	Y
L 300.2	Bed	20.2	52	4.15%	1%	Y
L 300.3	Bed	13.7	35	4.68%	1%	Y
L 300.4	Bed	8.7	26	4.88%	1%	Y
L 301.1	LKD	27.3	68	3.15%	2%	Y
L 301.2	Bed	12.1	36	3.57%	1%	Y


Average Daylight Factor - Neighbourhood L Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
L 302.1	LKD	43.6	110	3.33%	2%	Y
L 303.1	LKD	27.3	68	3.03%	2%	Y
L 303.2	Bed	12.1	36	3.56%	1%	Y
L 304.1	LKD	43.6	110	3.26%	2%	Y
L 305.1	LKD	41.4	96	2.18%	2%	Y
L 305.2	Bed	16.8	36	4.74%	1%	Y
L 305.3	Bed	11.9	29	4.40%	1%	Y
L 305.4	Bed	6.7	15	5.20%	1%	Y
L 306.1	LKD	41.1	101	3.53%	2%	Y
L 306.2	Bed	20.2	52	4.14%	1%	Y
L 306.3	Bed	13.7	35	4.44%	1%	Y
L 306.4	Bed	8.7	26	4.75%	1%	Y
L 307.1	LKD	41.1	94	2.14%	2%	Y
L 307.2	Bed	16.8	36	4.90%	1%	Y
L 307.3	Bed	11.9	29	4.22%	1%	Y
L 307.4	Bed	6.7	15	4.64%	1%	Y
L 308.1	LKD	41.1	101	4.11%	2%	Y
L 308.2	Bed	20.2	52	5.43%	1%	Y
L 308.3	Bed	13.7	35	4.33%	1%	Y
L 308.4	Bed	8.7	26	5.80%	1%	Y

**Table 23: Neighbourhood L Maisonettes: Average Daylight Factor of all habitable rooms**



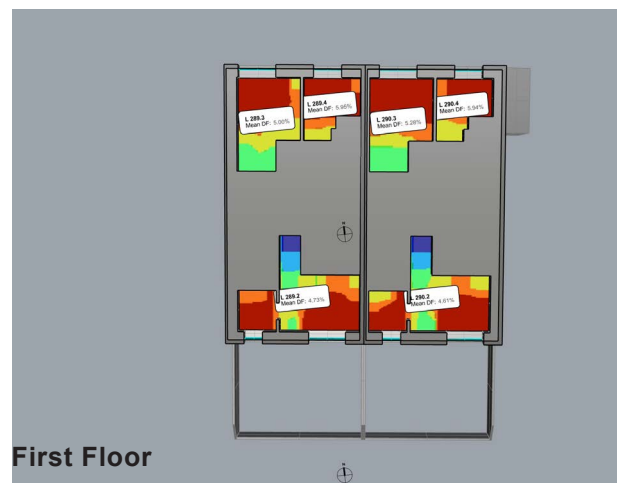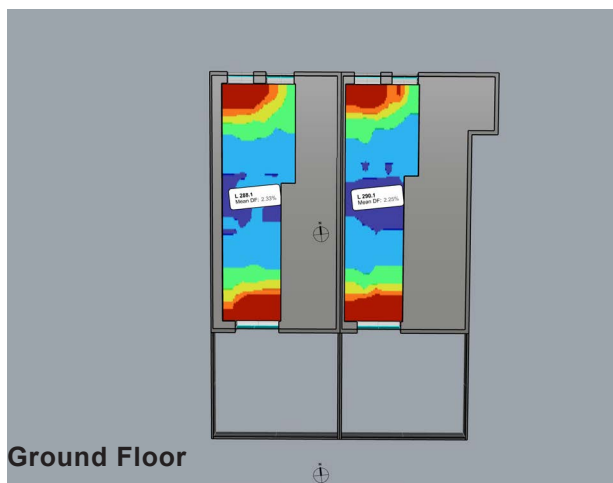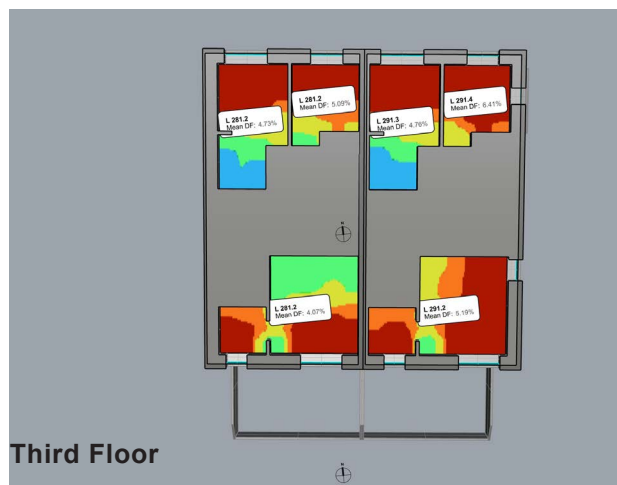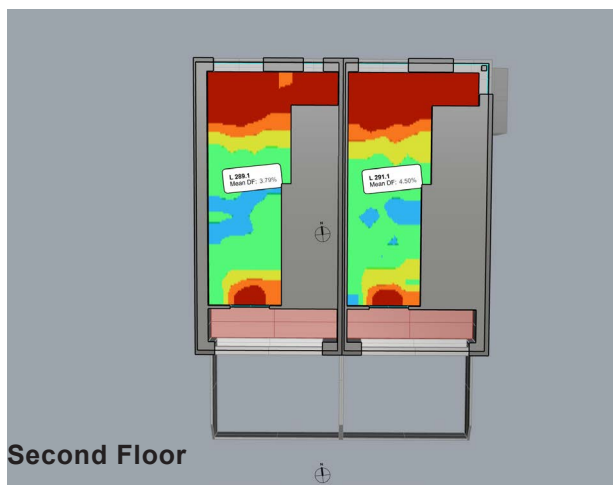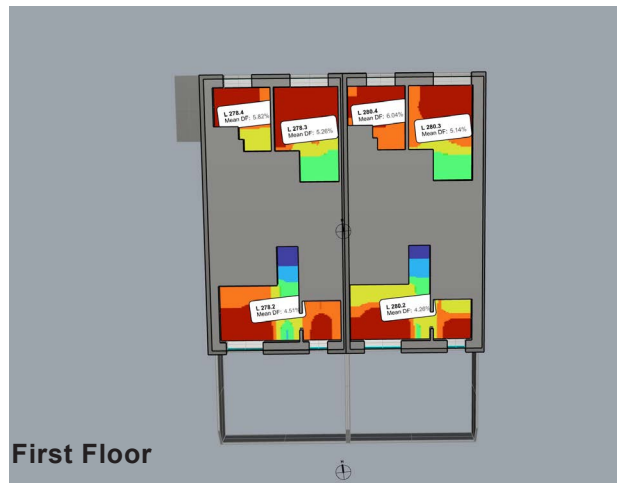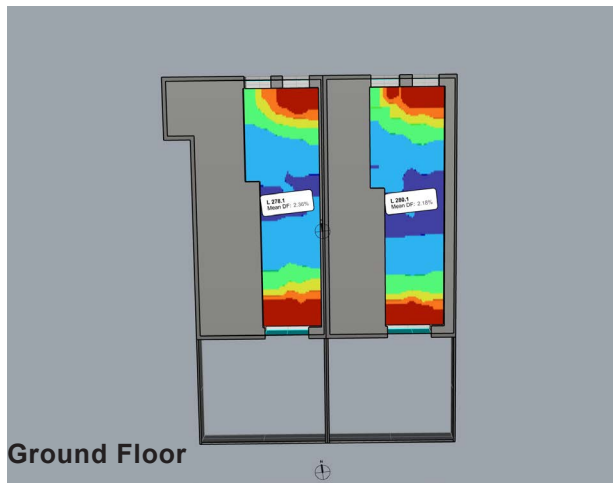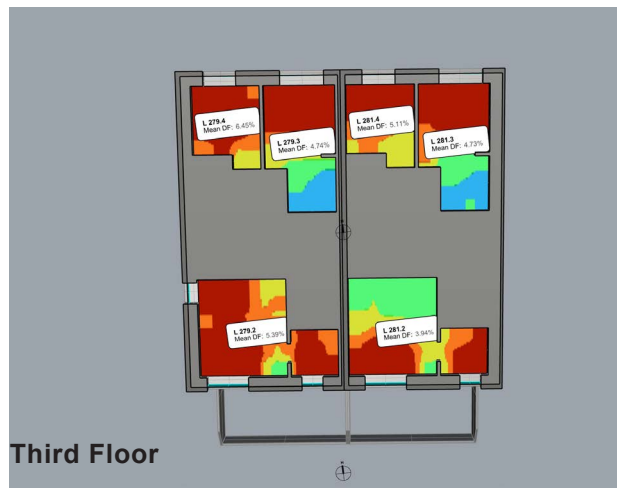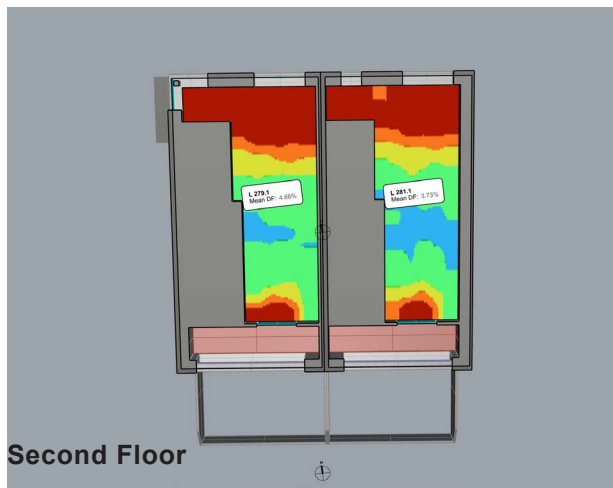

**Figure 51: Neighbourhood M Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**

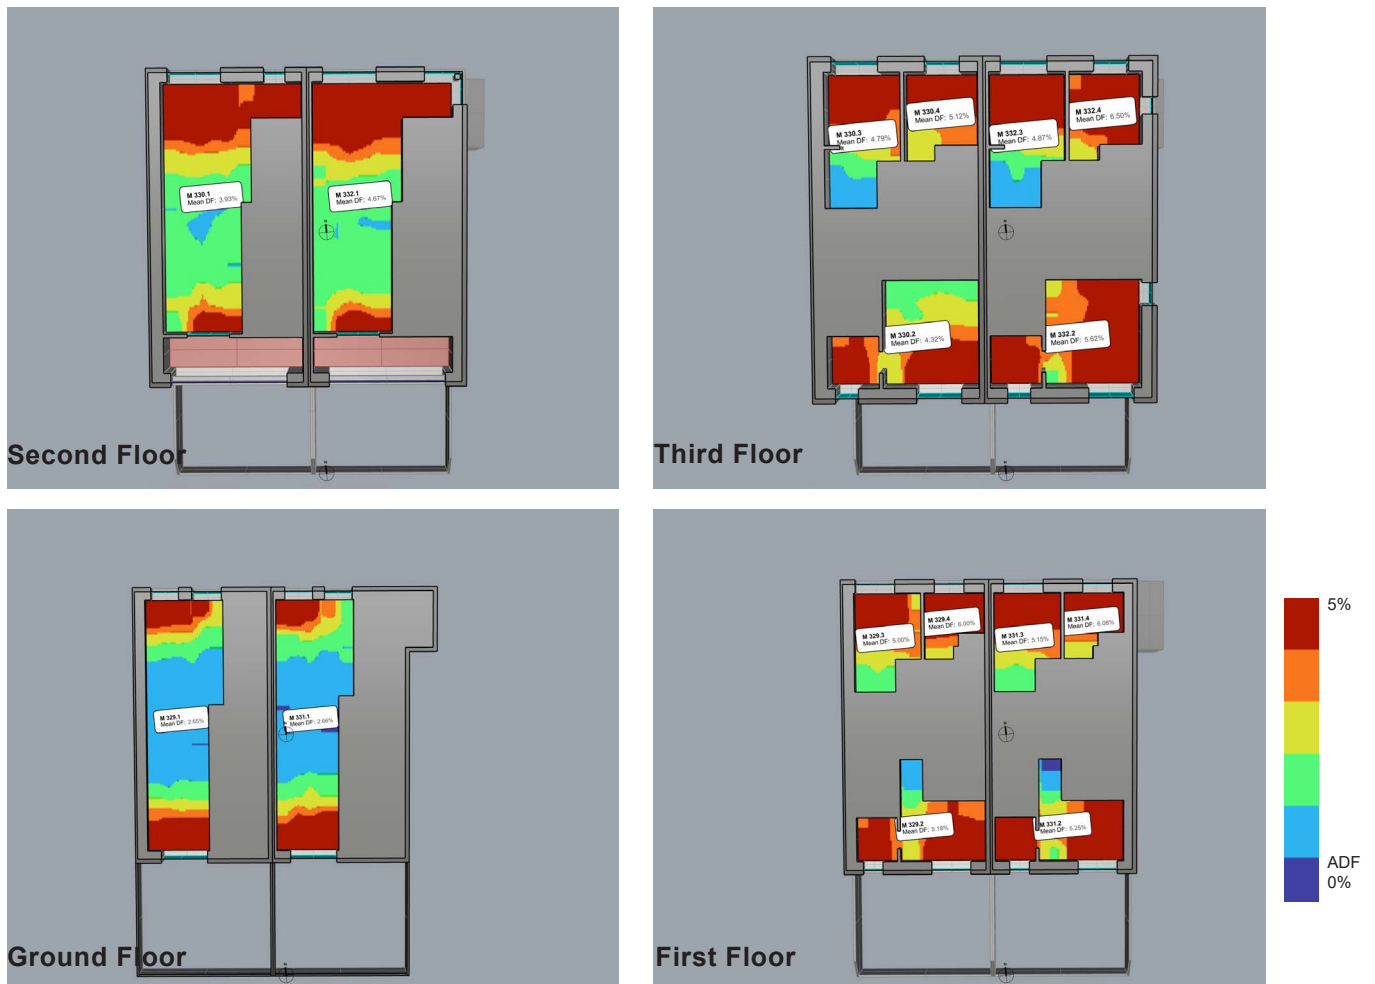

**Figure 52: Neighbourhood M Maisonettes. All habitable rooms assessed with false colour plan for ADF. Scale is 0-5%.**

Average Daylight Factor - Neighbourhood M Maisonettes							
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria	
M 302.2	Bed	19.3	46	4.28%	1%	Y	
M 302.3	Bed	15.1	43	3.84%	1%	Y	
M 302.4	Bed	9.0	27	4.63%	1%	Y	
M 304.2	Bed	19.3	46	4.29%	1%	Y	
M 304.3	Bed	15.1	43	3.82%	1%	Y	
M 304.4	Bed	9.0	27	4.39%	1%	Y	
M 309.1	LKD	41.1	94	2.46%	2%	Y	
M 309.2	Bed	16.8	36	5.06%	1%	Y	
M 309.2	Bed	6.7	15	6.08%	1%	Y	
M 309.2	Bed	11.9	29	4.91%	1%	Y	
M 309.2	Bed	16.8	36	4.43%	1%	Y	
M 309.3	Bed	11.9	29	4.77%	1%	Y	
M 309.4	Bed	6.7	15	5.62%	1%	Y	
M 310.1	LKD	41.1	101	4.52%	2%	Y	
M 310.2	Bed	20.2	52	5.58%	1%	Y	
M 310.3	Bed	13.7	35	4.66%	1%	Y	
M 310.4	Bed	8.7	26	6.16%	1%	Y	
M 311.1	LKD	41.4	96	2.45%	2%	Y	
M 311.2	Bed	16.8	36	5.34%	1%	Y	
M 311.3	Bed	11.9	29	4.55%	1%	Y	
M 311.4	Bed	6.7	15	5.42%	1%	Y	

Average Daylight Factor - Neighbourhood M Maisonettes						
Space ID	Description	Area m2	Sensor Count	ADF	Minimum Recommended ADF	Meets Criteria
M 312.1	LKD	41.1	101	3.72%	2%	Y
M 312.2	Bed	20.2	52	4.35%	1%	Y
M 312.3	Bed	13.7	35	4.55%	1%	Y
M 312.4	Bed	8.7	26	4.92%	1%	Y
M 319.1	LKD	41.4	96	2.08%	2%	Y
M 320.1	LKD	41.1	101	3.69%	2%	Y
M 320.2	Bed	20.2	52	4.10%	1%	Y
M 320.3	Bed	13.7	35	4.71%	1%	Y
M 320.4	Bed	8.7	26	4.83%	1%	Y
M 321.1	LKD	41.1	94	2.29%	2%	Y
M 321.2	Bed	16.8	36	4.69%	1%	Y
M 321.3	Bed	11.9	29	5.12%	1%	Y
M 321.4	Bed	6.7	15	5.87%	1%	Y
M 322.1	LKD	41.1	101	4.61%	2%	Y
M 322.2	Bed	20.2	52	5.44%	1%	Y
M 322.3	Bed	13.7	35	4.71%	1%	Y
M 322.4	Bed	8.7	26	6.52%	1%	Y
M 329.1	LKD	41.4	96	2.65%	2%	Y
M 329.2	Bed	16.8	36	5.18%	1%	Y
M 329.3	Bed	11.9	29	5.00%	1%	Y
M 329.4	Bed	6.7	15	6.00%	1%	Y
M 330.1	LKD	41.1	101	3.93%	2%	Y
M 330.2	Bed	20.2	52	4.32%	1%	Y
M 330.3	Bed	13.7	35	4.79%	1%	Y
M 330.4	Bed	8.7	26	5.12%	1%	Y
M 331.1	LKD	41.1	94	2.66%	2%	Y
M 331.2	Bed	16.8	36	5.25%	1%	Y
M 331.3	Bed	11.9	29	5.15%	1%	Y
M 331.4	Bed	6.7	15	6.08%	1%	Y
M 332.1	LKD	41.1	101	4.67%	2%	Y
M 332.2	Bed	20.2	52	5.62%	1%	Y
M 332.3	Bed	13.7	35	4.87%	1%	Y
M 332.4	Bed	8.7	26	6.50%	1%	Y

**Table 24: Neighbourhood M Maisonettes: Average Daylight Factor of all habitable rooms**

## Appendix B - EN17037:2018 Daylight Provision Room Compliance Complete Results

EN17037:2018 Daylight Provision Room Compliance - Block A											
Space ID	Description	Area [m^2]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
AA 001.1	LKD	33.8	86	High	76.4%	64.7%	50.3%	Medium	84.2%	61.0%	40.6%
AA 001.2	Bed	12.1	35	Medium	74.2%	62.6%	49.2%	Medium	84.1%	63.5%	47.1%
AA 001.3	Bed	13.8	42	Medium	73.0%	61.1%	47.7%	Medium	84.7%	64.5%	48.3%
AA 002.1	LKD	37.1	90	High	85.1%	78.6%	72.1%	High	90.1%	79.1%	70.6%
AA 002.2	Bed	13.0	36	High	76.5%	66.3%	55.0%	High	86.1%	69.3%	55.4%
AA 002.3	Bed	13.2	36	Medium	73.2%	61.3%	49.3%	Medium	84.1%	63.2%	48.3%
AA 003.1	LKD	31.7	84	High	86.4%	80.5%	73.9%	High	91.2%	81.1%	72.8%
AA 003.2	Bed	11.6	30	High	81.3%	72.9%	63.4%	High	89.1%	77.0%	65.7%
AA 003.3	Bed	13.3	36	High	80.3%	71.5%	61.8%	High	88.5%	75.9%	64.3%
AA 004.1	LKD	31.7	84	High	80.8%	71.3%	57.7%	High	87.7%	71.8%	55.1%
AA 004.2	Bed	11.6	30	High	80.5%	70.1%	55.9%	High	88.9%	75.2%	60.3%
AA 004.3	Bed	13.3	36	High	79.2%	68.7%	54.0%	High	88.6%	74.7%	59.2%
AA 005.1	LKD	35.2	97	High	84.7%	76.8%	67.8%	High	89.5%	76.6%	64.5%
AA 005.2	Bed	11.5	30	High	82.1%	72.7%	59.7%	High	89.5%	76.6%	63.2%
AA 005.3	Bed	8.8	24	High	80.0%	69.8%	54.9%	High	87.9%	72.1%	55.2%
AA 005.4	Bed	14.1	36	High	77.9%	66.3%	51.2%	High	88.0%	72.6%	55.6%
AA 006.1	LKD	31.5	84	High	85.3%	77.7%	69.5%	High	89.5%	76.3%	65.2%
AA 006.2	Bed	11.6	30	Medium	77.7%	65.3%	49.3%	High	87.9%	72.0%	54.9%
AA 006.3	Bed	13.3	36	Medium	76.6%	63.4%	46.7%	High	87.4%	70.6%	52.3%
AA 007.1	LKD	33.8	86	High	80.5%	71.1%	60.6%	High	86.2%	68.8%	53.3%
AA 007.2	Bed	12.1	35	High	78.1%	68.3%	57.5%	High	86.3%	70.1%	55.9%
AA 007.3	Bed	13.8	42	High	77.6%	67.5%	56.0%	High	86.2%	70.0%	56.1%
AA 008.1	LKD	37.1	90	High	84.2%	77.8%	70.5%	High	89.9%	78.9%	69.8%
AA 008.2	Bed	13.0	36	High	77.1%	67.1%	55.9%	High	86.9%	71.3%	58.2%
AA 008.3	Bed	13.2	36	High	75.3%	64.8%	53.8%	High	86.2%	70.0%	56.2%
AA 009.1	LKD	31.7	84	High	85.3%	78.2%	70.7%	High	90.0%	78.3%	67.9%
AA 009.2	Bed	11.6	30	High	80.4%	71.7%	61.8%	High	88.8%	76.3%	64.9%
AA 009.3	Bed	13.3	36	High	80.0%	70.8%	60.9%	High	88.2%	74.8%	63.0%
AA 010.1	LKD	31.7	84	High	78.8%	68.4%	55.1%	High	86.3%	68.2%	50.5%
AA 010.2	Bed	11.6	30	High	78.1%	66.7%	52.1%	High	88.4%	74.3%	58.4%
AA 010.3	Bed	13.3	36	High	77.7%	65.8%	50.7%	High	87.9%	72.8%	56.0%
AA 011.1	LKD	35.2	97	High	83.7%	75.0%	64.0%	High	88.9%	75.1%	60.8%
AA 011.2	Bed	11.5	30	High	79.0%	68.2%	54.3%	High	88.3%	74.4%	58.9%
AA 011.3	Bed	8.8	24	Medium	76.9%	63.7%	48.6%	High	87.7%	71.6%	54.6%
AA 011.4	Bed	14.1	36	Medium	76.8%	63.8%	48.2%	High	87.4%	70.8%	53.4%
AA 012.1	LKD	31.5	84	High	84.5%	76.3%	68.5%	High	89.7%	76.7%	66.1%
AA 012.2	Bed	11.6	30	High	77.9%	65.8%	50.5%	High	87.7%	71.6%	54.4%
AA 012.3	Bed	13.3	36	Medium	75.7%	61.6%	45.1%	High	87.1%	69.9%	51.3%
AA 013.1	LKD	33.8	86	High	80.5%	70.8%	59.7%	High	86.2%	68.4%	51.9%
AA 013.2	Bed	12.1	35	High	77.3%	67.4%	56.4%	High	86.7%	71.5%	58.8%
AA 013.3	Bed	13.8	42	High	75.5%	65.3%	53.4%	High	86.7%	71.5%	58.3%
AA 014.1	LKD	37.1	90	High	85.6%	79.3%	72.8%	High	90.4%	80.0%	71.7%
AA 014.2	Bed	13.0	36	High	78.9%	69.9%	59.4%	High	87.6%	72.9%	60.7%
AA 014.3	Bed	13.2	36	High	75.4%	64.7%	53.8%	High	85.8%	68.0%	54.3%
AA 015.1	LKD	31.7	84	High	86.2%	80.4%	73.9%	High	91.1%	80.8%	72.4%
AA 015.2	Bed	11.6	30	High	81.7%	73.3%	63.8%	High	89.0%	76.9%	65.8%
AA 015.3	Bed	13.3	36	High	81.0%	72.3%	62.4%	High	88.5%	76.0%	64.6%
AA 016.1	LKD	31.7	84	High	82.7%	74.0%	63.4%	High	88.3%	74.1%	59.6%

EN17037:2018 Daylight Provision Room Compliance - Block A											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
AA 016.2	Bed	11.6	30	High	80.4%	70.2%	56.5%	High	88.8%	75.2%	60.5%
AA 016.3	Bed	13.3	36	High	78.5%	67.8%	53.5%	High	88.1%	73.6%	56.9%
AA 017.1	LKD	35.2	97	High	84.8%	77.1%	68.4%	High	89.6%	77.1%	65.9%
AA 017.2	Bed	11.5	30	High	81.3%	71.9%	58.6%	High	89.1%	75.9%	62.1%
AA 017.3	Bed	8.8	24	High	78.2%	67.0%	52.1%	High	87.9%	72.2%	55.2%
AA 017.4	Bed	14.1	36	High	77.6%	65.8%	50.8%	High	87.9%	72.4%	55.7%
AA 018.1	LKD	31.5	84	High	85.9%	79.2%	71.7%	High	90.7%	79.4%	69.6%
AA 018.2	Bed	11.6	30	High	78.4%	67.2%	52.1%	High	88.3%	73.2%	57.2%
AA 018.3	Bed	13.3	36	High	77.6%	65.5%	50.0%	High	87.7%	71.6%	54.5%
AA 019.1	LKD	33.8	86	High	84.0%	75.4%	67.1%	High	88.5%	74.6%	62.7%
AA 019.2	Bed	12.1	35	High	80.5%	71.4%	61.4%	High	88.3%	74.5%	63.2%
AA 019.3	Bed	13.8	42	High	79.1%	70.1%	59.6%	High	88.1%	74.1%	62.8%
AA 020.1	LKD	37.1	90	High	85.0%	78.5%	71.5%	High	90.1%	79.4%	70.7%
AA 020.2	Bed	13.0	36	High	78.7%	69.6%	59.1%	High	87.8%	73.4%	61.5%
AA 020.3	Bed	13.2	36	High	77.1%	67.4%	56.6%	High	87.5%	72.6%	60.2%
AA 021.1	LKD	31.7	84	High	85.6%	78.5%	71.3%	High	90.3%	78.8%	68.9%
AA 021.2	Bed	11.6	30	High	80.5%	71.6%	61.8%	High	88.6%	76.1%	64.6%
AA 021.3	Bed	13.3	36	High	80.1%	71.1%	61.2%	High	88.3%	75.3%	63.7%
AA 022.1	LKD	31.7	84	High	82.8%	74.6%	64.8%	High	88.4%	74.6%	62.1%
AA 022.2	Bed	11.6	30	High	78.1%	67.1%	52.6%	High	88.4%	74.3%	59.1%
AA 022.3	Bed	13.3	36	High	77.9%	66.5%	52.1%	High	87.9%	72.5%	56.1%
AA 023.1	LKD	35.2	97	High	84.4%	76.0%	66.1%	High	89.3%	76.0%	63.3%
AA 023.2	Bed	11.5	30	High	80.0%	69.8%	56.1%	High	88.6%	75.0%	60.5%
AA 023.3	Bed	8.8	24	High	77.7%	65.9%	51.6%	High	87.7%	71.5%	54.6%
AA 023.4	Bed	14.1	36	Medium	76.8%	64.0%	48.5%	High	86.7%	69.4%	51.5%
AA 024.1	LKD	31.5	84	High	85.5%	78.2%	70.5%	High	90.0%	77.9%	67.7%
AA 024.2	Bed	11.6	30	High	78.0%	66.2%	50.6%	High	87.9%	72.3%	55.6%
AA 024.3	Bed	13.3	36	Medium	76.4%	63.5%	47.2%	High	86.9%	69.7%	51.0%
AA 025.1	LKD	33.8	86	High	84.3%	75.8%	67.2%	High	88.9%	75.3%	63.2%
AA 025.2	Bed	12.1	35	High	79.3%	69.8%	59.7%	High	88.4%	74.8%	63.6%
AA 025.3	Bed	13.8	42	High	77.0%	67.2%	56.1%	High	87.6%	72.7%	60.7%
AA 026.1	LKD	37.1	90	High	86.2%	81.1%	74.4%	High	91.0%	81.2%	73.2%
AA 026.2	Bed	13.0	36	High	79.7%	70.6%	60.4%	High	88.6%	75.1%	64.2%
AA 026.3	Bed	13.2	36	High	77.5%	67.8%	57.2%	High	87.2%	72.3%	60.1%
AA 027.1	LKD	31.7	84	High	86.7%	81.5%	74.8%	High	91.3%	81.2%	73.0%
AA 027.2	Bed	11.6	30	High	82.2%	73.8%	64.9%	High	88.5%	75.9%	64.8%
AA 027.3	Bed	13.3	36	High	81.1%	72.6%	62.9%	High	88.5%	75.9%	64.6%
AA 028.1	LKD	31.7	84	High	86.5%	80.5%	73.9%	High	90.7%	80.2%	71.7%
AA 028.2	Bed	11.6	30	High	79.5%	69.2%	55.2%	High	88.8%	75.2%	61.0%
AA 028.3	Bed	13.3	36	High	78.8%	68.5%	54.2%	High	88.4%	74.5%	59.2%
AA 029.1	LKD	35.2	97	High	85.8%	78.7%	71.2%	High	90.1%	78.2%	68.2%
AA 029.2	Bed	11.5	30	High	81.5%	72.0%	59.2%	High	89.4%	76.5%	63.4%
AA 029.3	Bed	8.8	24	High	78.4%	67.2%	52.5%	High	87.9%	72.5%	55.7%
AA 029.4	Bed	14.1	36	High	78.1%	67.0%	52.6%	High	88.1%	73.2%	56.9%
AA 030.1	LKD	31.5	84	High	86.7%	81.1%	74.1%	High	91.2%	80.9%	71.9%
AA 030.2	Bed	13.3	36	High	78.1%	66.4%	51.1%	High	87.9%	72.3%	55.9%
AA 030.2	Bed	11.6	30	High	78.8%	68.1%	52.9%	High	88.7%	74.1%	58.6%

**Table 25: EN17037:2018 Daylight Provision individual room compliance values - Block A.**



# EN17037:2018 Daylight Provision Room Compliance - Block C

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
C001.1	LKD	33.8	86	Medium	77.0%	63.0%	48.3%	Medium	84.1%	58.1%	38.5%
C001.2	Bed	12.1	35	Medium	71.3%	53.8%	37.0%	Medium	84.3%	59.1%	39.1%
C001.3	Bed	13.8	42	Minimum	68.0%	49.5%	32.7%	Medium	83.8%	56.6%	36.6%
C002.1	LKD	37.1	90	High	83.4%	74.5%	63.8%	High	88.3%	74.2%	60.3%
C002.2	Bed	13.0	36	Medium	69.2%	50.8%	33.9%	Medium	83.3%	54.7%	33.9%
C002.3	Bed	13.2	36	Minimum	58.9%	39.6%	16.9%	Minimum	79.2%	45.7%	17.8%
C003.1	LKD	31.7	84	High	86.2%	80.6%	73.8%	High	91.1%	81.4%	72.8%
C003.2	Bed	11.6	30	High	78.4%	67.6%	53.7%	High	87.3%	71.9%	57.6%
C003.3	Bed	13.3	36	High	77.8%	66.7%	51.8%	High	87.0%	70.8%	53.8%
C004.1	LKD	31.7	84	High	82.0%	73.3%	64.1%	High	88.0%	74.2%	62.8%
C004.2	Bed	11.6	30	High	82.2%	74.0%	64.6%	High	89.1%	76.7%	66.4%
C004.3	Bed	13.3	36	High	81.6%	72.9%	63.4%	High	88.7%	75.8%	65.0%
C005.1	LKD	35.2	97	High	84.5%	77.9%	70.8%	High	89.7%	78.4%	69.0%
C005.2	Bed	11.5	30	High	82.9%	74.2%	65.9%	High	89.5%	77.4%	67.6%
C005.3	Bed	8.8	24	High	81.8%	73.0%	63.3%	High	88.0%	74.7%	63.4%
C005.4	Bed	14.1	36	High	80.7%	71.8%	62.5%	High	88.3%	74.9%	63.5%
C006.1	LKD	31.5	84	High	84.3%	76.5%	67.1%	High	88.8%	75.1%	62.1%
C006.2	Bed	11.6	30	High	79.2%	69.7%	57.7%	High	86.8%	71.6%	57.1%
C006.3	Bed	13.3	36	High	77.7%	66.4%	54.6%	High	86.3%	69.8%	54.8%
C007.1	LKD	33.8	86	High	80.2%	70.3%	56.2%	Medium	86.4%	67.3%	48.8%
C007.2	Bed	12.1	35	Medium	75.5%	59.7%	44.5%	Medium	85.3%	62.7%	44.2%
C007.3	Bed	13.8	42	Medium	74.6%	58.5%	42.8%	Medium	84.3%	59.7%	41.5%
C008.1	LKD	37.1	90	High	83.1%	74.2%	63.8%	High	88.7%	74.4%	60.6%
C008.2	Bed	13.0	36	Medium	71.9%	54.6%	38.7%	Medium	85.0%	61.8%	42.5%
C008.3	Bed	13.2	36	Medium	69.7%	50.6%	31.6%	Medium	83.3%	54.9%	33.2%
C009.1	LKD	31.7	84	High	85.6%	79.1%	72.4%	High	90.4%	79.5%	70.7%
C009.2	Bed	11.6	30	High	78.5%	68.0%	54.2%	High	87.9%	72.9%	58.9%
C009.3	Bed	13.3	36	High	77.3%	66.2%	52.1%	High	87.1%	71.6%	56.9%
C010.1	LKD	31.7	84	High	79.2%	70.5%	60.2%	High	86.3%	70.5%	57.9%
C010.2	Bed	11.6	30	High	80.5%	71.6%	62.1%	High	88.8%	75.8%	65.0%
C010.3	Bed	13.3	36	High	80.0%	71.0%	61.6%	High	88.4%	74.9%	63.4%
C011.1	LKD	35.2	97	High	83.8%	76.8%	69.0%	High	89.3%	77.2%	66.6%
C011.2	Bed	11.5	30	High	80.5%	71.5%	62.0%	High	89.1%	76.4%	65.9%
C011.3	Bed	8.8	24	High	79.7%	70.7%	60.8%	High	87.7%	73.7%	62.2%
C011.4	Bed	14.1	36	High	77.8%	68.4%	58.6%	High	87.7%	73.5%	61.5%
C012.1	LKD	31.5	84	High	84.1%	75.7%	65.8%	High	88.9%	75.4%	61.4%
C012.2	Bed	11.6	30	High	77.7%	67.1%	56.0%	High	87.4%	72.9%	59.0%
C012.3	Bed	13.3	36	High	76.7%	65.0%	52.8%	High	86.4%	69.8%	54.9%
C013.1	LKD	33.8	86	High	80.2%	70.4%	56.8%	Medium	86.3%	67.6%	49.7%
C013.2	Bed	12.1	35	Medium	76.3%	62.3%	46.9%	High	86.9%	69.4%	50.7%
C013.3	Bed	13.8	42	Medium	73.5%	57.4%	42.1%	Medium	86.3%	67.4%	47.6%
C014.1	LKD	37.1	90	High	84.6%	76.6%	67.7%	High	89.4%	76.3%	64.5%
C014.2	Bed	13.0	36	Medium	75.9%	61.6%	46.4%	Medium	86.7%	68.4%	49.6%
C014.3	Bed	13.2	36	Medium	70.3%	52.2%	34.2%	Medium	84.4%	57.9%	36.1%
C015.1	LKD	31.7	84	High	86.3%	80.6%	73.8%	High	90.9%	80.8%	72.4%
C015.2	Bed	11.6	30	High	80.1%	70.1%	57.9%	High	88.4%	74.1%	61.1%
C015.3	Bed	13.3	36	High	79.0%	68.6%	55.2%	High	87.7%	72.4%	58.1%
C016.1	LKD	31.7	84	High	83.4%	75.0%	67.5%	High	88.6%	75.2%	64.8%

EN17037:2018 Daylight Provision Room Compliance - Block C											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
C016.2	Bed	11.6	30	High	81.4%	72.7%	63.2%	High	88.9%	76.5%	65.9%
C016.3	Bed	13.3	36	High	81.0%	72.1%	62.7%	High	88.3%	74.9%	63.9%
C017.1	LKD	35.2	97	High	85.5%	79.2%	72.7%	High	90.2%	79.7%	71.1%
C017.2	Bed	11.5	30	High	82.5%	73.9%	64.9%	High	89.7%	77.6%	67.9%
C017.3	Bed	8.8	24	High	80.8%	71.8%	62.4%	High	88.0%	74.2%	63.0%
C017.4	Bed	14.1	36	High	79.9%	70.8%	61.6%	High	88.6%	75.3%	64.0%
C018.1	LKD	31.5	84	High	85.5%	78.3%	71.0%	High	89.9%	77.9%	67.6%
C018.2	Bed	11.6	30	High	79.9%	71.1%	60.2%	High	88.3%	75.1%	62.7%
C018.3	Bed	13.3	36	High	79.4%	70.0%	58.8%	High	88.2%	74.6%	61.4%
C019.1	LKD	33.8	86	High	84.1%	76.0%	66.3%	High	88.5%	74.1%	59.5%
C019.2	Bed	12.1	35	High	79.0%	68.5%	53.4%	High	87.9%	72.3%	55.9%
C019.3	Bed	13.8	42	High	77.4%	65.7%	50.1%	High	87.7%	71.9%	54.3%
C020.1	LKD	37.1	90	High	84.2%	75.8%	67.1%	High	89.9%	77.2%	66.3%
C020.2	bed	13.0	36	Medium	77.2%	65.2%	48.9%	High	87.2%	70.5%	52.3%
C020.3	Bed	13.2	36	Medium	74.9%	59.7%	43.3%	Medium	87.0%	69.4%	49.8%
C021.1	LKD	31.7	84	High	85.8%	79.5%	72.8%	High	90.5%	79.8%	71.0%
C021.2	Bed	11.6	30	High	79.1%	68.7%	55.8%	High	88.4%	74.1%	60.9%
C021.3	Bed	13.3	36	High	78.2%	67.8%	54.2%	High	87.9%	72.9%	58.3%
C022.1	LKD	31.7	84	High	83.3%	74.8%	67.0%	High	88.4%	74.6%	64.0%
C022.2	Bed	11.6	30	High	80.5%	71.7%	62.3%	High	88.9%	76.1%	65.4%
C022.3	Bed	13.3	36	High	79.6%	70.5%	61.3%	High	88.3%	75.0%	63.9%
C023.1	LKD	35.2	97	High	84.8%	78.2%	71.0%	High	89.7%	78.2%	68.2%
C023.2	Bed	11.5	30	High	81.2%	72.4%	63.0%	High	88.9%	76.2%	65.8%
C023.3	Bed	8.8	24	High	79.5%	70.3%	60.6%	High	88.0%	74.2%	63.0%
C023.4	Bed	14.1	36	High	77.5%	67.9%	58.1%	High	87.4%	73.4%	61.0%
C024.1	LKD	31.5	84	High	85.2%	77.6%	69.3%	High	89.8%	77.4%	66.7%
C024.2	Bed	11.6	30	High	79.7%	70.6%	59.9%	High	88.8%	75.9%	63.9%
C024.3	Bed	13.3	36	High	78.5%	68.2%	57.3%	High	87.2%	72.4%	59.2%
C025.1	LKD	33.8	86	High	84.5%	77.0%	68.2%	High	88.9%	76.0%	63.7%
C025.2	Bed	12.1	35	High	78.2%	67.7%	52.8%	High	88.3%	73.5%	58.1%
C025.3	Bed	13.8	42	Medium	76.3%	63.4%	48.3%	High	87.6%	71.3%	53.9%
C026.1	LKD	37.1	90	High	85.8%	79.0%	71.2%	High	90.6%	79.4%	69.7%
C026.2	Bed	13.0	36	High	78.2%	67.5%	52.3%	High	88.4%	73.7%	58.1%
C026.3	Bed	13.2	36	Medium	76.3%	63.4%	46.8%	Medium	86.8%	68.4%	49.5%
C027.1	LKD	31.7	84	High	86.7%	81.9%	74.8%	High	91.3%	81.6%	72.9%
C027.2	Bed	11.6	30	High	80.4%	70.5%	59.1%	High	88.6%	74.8%	62.1%
C027.3	Bed	13.3	36	High	79.2%	68.9%	56.4%	High	88.3%	73.9%	60.5%
C028.1	LKD	31.7	84	High	86.5%	81.3%	74.2%	High	91.0%	81.1%	72.4%
C028.2	Bed	11.6	30	High	82.0%	73.6%	64.5%	High	88.8%	76.1%	65.5%
C028.3	Bed	13.3	36	High	80.8%	71.8%	62.6%	High	88.7%	75.9%	64.9%
C029.1	LKD	35.2	97	High	86.2%	80.8%	74.6%	High	90.7%	80.7%	72.7%
C029.2	Bed	11.5	30	High	82.7%	74.2%	65.6%	High	89.7%	77.9%	68.3%
C029.3	Bed	8.8	24	High	81.0%	72.1%	62.6%	High	87.9%	74.1%	62.9%
C029.4	Bed	14.1	36	High	79.2%	70.1%	60.8%	High	88.2%	74.7%	63.2%
C030.1	LKD	31.5	84	High	86.6%	81.0%	74.0%	High	91.0%	80.4%	71.7%
C030.2	Bed	11.6	30	High	80.7%	72.6%	62.5%	High	89.1%	76.4%	65.1%
C030.3	Bed	13.3	36	High	79.7%	70.9%	60.6%	High	88.5%	75.5%	63.3%

**Table 26: EN17037:2018 Daylight Provision individual room compliance values - Block C.**

# EN17037:2018 Daylight Provision Room Compliance - Block H

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
H 001.1	LKD	33.8	86	High	78.0%	65.6%	50.1%	Medium	84.7%	60.5%	39.8%
H 001.2	Bed	12.1	35	Medium	75.9%	61.6%	45.3%	Medium	86.7%	68.2%	48.4%
H 001.3	Bed	13.8	42	Medium	75.0%	59.3%	42.1%	Medium	86.3%	66.9%	46.9%
H 002.1	LKD	37.1	90	High	84.5%	76.9%	68.1%	High	89.3%	76.7%	65.0%
H 002.2	Bed	13.0	36	Medium	76.6%	62.8%	46.1%	Medium	86.7%	68.3%	49.4%
H 002.3	Bed	13.2	36	Medium	72.4%	55.1%	36.6%	Medium	85.2%	61.9%	40.2%
H 003.1	LKD	31.7	84	High	85.4%	78.7%	71.6%	High	88.9%	76.8%	66.3%
H 003.2	Bed	13.3	36	High	77.8%	66.9%	55.0%	High	87.2%	72.0%	57.7%
H 003.3	Bed	11.6	30	High	78.7%	68.6%	57.3%	High	87.5%	72.7%	59.0%
H 004.1	LKD	31.7	84	High	79.2%	69.9%	60.2%	High	86.0%	68.9%	55.5%
H 004.2	Bed	11.6	30	High	77.8%	67.8%	58.0%	High	86.5%	71.0%	58.6%
H 004.3	Bed	13.3	36	High	77.1%	66.8%	56.6%	High	86.2%	69.7%	56.9%
H 005.1	LKD	35.2	97	High	82.7%	74.1%	65.6%	High	86.9%	71.5%	59.5%
H 005.2	Bed	11.5	30	High	80.6%	71.5%	61.2%	High	86.7%	71.4%	59.0%
H 005.3	Bed	8.8	24	High	77.3%	66.8%	56.5%	High	85.4%	66.8%	53.1%
H 005.4	Bed	14.1	36	High	76.3%	65.9%	55.5%	High	86.0%	68.8%	55.5%
H 006.1	LKD	31.5	84	High	84.9%	77.1%	68.4%	High	89.1%	75.6%	62.7%
H 006.2	Bed	11.6	30	High	77.0%	65.3%	50.6%	Medium	85.9%	66.5%	47.9%
H 006.3	Bed	13.3	36	Medium	74.6%	60.4%	45.9%	Medium	85.8%	65.4%	46.8%
H 007.1	LKD	33.8	86	High	80.8%	71.2%	57.1%	High	87.2%	70.2%	51.6%
H 007.2	Bed	12.1	35	High	77.9%	66.3%	50.6%	High	87.7%	71.7%	54.1%
H 007.3	Bed	13.8	42	Medium	77.1%	64.4%	48.5%	High	87.1%	69.9%	51.4%
H 008.1	LKD	37.1	90	High	83.3%	75.7%	65.9%	High	89.3%	76.6%	64.7%
H 008.2	Bed	13.0	36	Medium	76.5%	62.9%	46.3%	High	87.2%	69.3%	50.3%
H 008.3	Bed	13.2	36	Medium	74.7%	58.9%	41.8%	Medium	86.2%	66.7%	47.1%
H 009.1	LKD	31.7	84	High	84.9%	78.1%	71.0%	High	89.2%	77.4%	67.4%
H 009.2	Bed	11.6	30	High	78.3%	67.8%	56.5%	High	87.8%	73.6%	60.1%
H 009.3	Bed	13.3	36	High	78.0%	67.1%	55.8%	High	87.2%	72.3%	58.2%
H 010.1	LKD	31.7	84	High	77.8%	68.2%	58.0%	High	85.0%	65.9%	52.4%
H 010.2	Bed	11.6	30	High	77.9%	68.2%	58.1%	High	87.1%	72.5%	60.0%
H 010.3	Bed	13.3	36	High	77.7%	68.1%	58.1%	High	86.3%	70.8%	58.0%
H 011.1	LKD	35.2	97	High	82.7%	73.9%	64.4%	High	87.4%	72.4%	60.3%
H 011.2	Bed	11.5	30	High	79.1%	69.6%	59.5%	High	86.7%	71.9%	59.7%
H 011.3	Bed	8.8	24	High	77.6%	67.7%	56.9%	High	86.1%	69.7%	56.6%
H 011.4	Bed	14.1	36	High	76.2%	65.6%	55.0%	High	86.1%	69.8%	56.6%
H 012.1	LKD	31.5	84	High	84.7%	76.7%	67.5%	High	89.3%	76.1%	63.2%
H 012.2	Bed	11.6	30	Medium	76.4%	64.3%	49.7%	High	86.6%	69.8%	53.4%
H 012.3	Bed	13.3	36	Medium	74.7%	61.4%	46.1%	Medium	85.9%	67.0%	48.8%
H 013.1	LKD	33.8	86	High	80.8%	70.7%	56.3%	High	86.6%	68.5%	50.3%
H 013.2	Bed	12.1	35	Medium	76.7%	63.6%	47.6%	High	87.6%	71.4%	53.7%
H 013.3	Bed	13.8	42	Medium	75.0%	59.9%	43.3%	High	87.2%	70.0%	51.2%
H 014.1	LKD	37.1	90	High	84.9%	77.6%	69.1%	High	90.1%	78.1%	67.6%
H 014.2	Bed	13.0	36	Medium	77.1%	64.6%	48.9%	High	87.5%	70.6%	52.5%
H 014.3	Bed	13.2	36	Medium	74.3%	58.4%	41.4%	Medium	85.5%	63.5%	43.3%
H 015.1	LKD	31.7	84	High	86.0%	80.5%	74.4%	High	90.5%	80.4%	72.3%
H 015.2	Bed	11.6	30	High	80.2%	71.0%	60.5%	High	88.8%	75.8%	63.6%
H 015.3	Bed	13.3	36	High	79.0%	69.1%	58.7%	High	88.3%	74.8%	62.0%
H 016.1	LKD	31.7	84	High	82.7%	74.5%	65.9%	High	87.5%	73.7%	62.0%
H 016.2	Bed	11.6	30	High	80.3%	71.3%	62.0%	High	88.2%	74.6%	63.5%

EN17037:2018 Daylight Provision Room Compliance - Block H											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
H 016.3	Bed	13.3	36	High	79.4%	70.3%	60.5%	High	87.9%	74.2%	62.6%
H 017.1	LKD	35.2	97	High	84.7%	77.0%	69.9%	High	89.3%	76.8%	67.1%
H 017.2	Bed	11.5	30	High	82.0%	73.3%	64.1%	High	89.0%	76.3%	65.7%
H 017.3	Bed	8.8	24	High	80.7%	71.7%	62.1%	High	87.0%	72.8%	60.3%
H 017.4	Bed	14.1	36	High	77.9%	68.5%	58.7%	High	87.5%	73.3%	61.5%
H 018.1	LKD	31.5	84	High	85.8%	78.8%	71.3%	High	90.5%	78.8%	69.1%
H 018.2	Bed	11.6	30	High	79.4%	69.5%	56.9%	High	87.9%	73.1%	59.0%
H 018.3	Bed	13.3	36	High	78.3%	67.4%	53.4%	High	87.5%	72.2%	56.8%
H 019.1	LKD	33.8	86	High	84.2%	75.8%	65.9%	High	88.5%	74.5%	59.5%
H 019.2	Bed	12.1	35	High	78.4%	67.7%	52.5%	High	88.0%	72.5%	55.9%
H 019.3	Bed	13.8	42	High	77.7%	65.8%	50.2%	High	87.6%	71.3%	54.1%
H 020.1	LKD	37.1	90	High	84.5%	77.1%	68.4%	High	89.8%	77.6%	66.7%
H 020.2	Bed	13.0	36	Medium	77.0%	64.5%	48.7%	High	87.6%	71.1%	53.2%
H 020.3	Bed	13.2	36	Medium	75.4%	61.2%	44.6%	High	86.8%	69.0%	50.3%
H 021.1	LKD	31.7	84	High	85.9%	80.0%	73.3%	High	90.3%	79.9%	71.2%
H 021.2	Bed	11.6	30	High	79.3%	70.0%	59.2%	High	88.6%	75.6%	63.4%
H 021.3	Bed	13.3	36	High	78.8%	69.3%	58.2%	High	88.2%	74.8%	62.0%
H 022.1	LKD	31.7	84	High	83.2%	75.3%	66.5%	High	88.2%	75.0%	63.3%
H 022.2	Bed	11.6	30	High	80.0%	70.9%	61.4%	High	88.5%	75.2%	64.2%
H 022.3	Bed	13.3	36	High	79.3%	70.0%	60.4%	High	87.8%	74.0%	62.4%
H 023.1	LKD	35.2	97	High	84.0%	75.7%	67.7%	High	89.5%	76.5%	66.5%
H 023.2	Bed	11.5	30	High	80.1%	71.0%	61.5%	High	88.3%	75.1%	64.0%
H 023.3	Bed	8.8	24	High	79.2%	69.8%	60.1%	High	87.4%	73.4%	61.7%
H 023.4	Bed	14.1	36	High	77.4%	67.9%	57.9%	High	87.1%	73.2%	61.1%
H 024.1	LKD	31.5	84	High	85.3%	77.5%	69.2%	High	90.0%	77.8%	67.2%
H 024.2	Bed	11.6	30	High	78.7%	68.0%	55.1%	High	88.0%	73.3%	59.5%
H 024.3	Bed	13.3	36	High	77.3%	65.5%	51.0%	High	86.9%	71.1%	56.0%
H 025.1	LKD	33.8	86	High	84.2%	75.8%	66.5%	High	88.8%	74.9%	61.4%
H 025.2	Bed	12.1	35	High	78.0%	67.0%	51.0%	High	88.2%	72.8%	56.6%
H 025.3	Bed	13.8	42	Medium	76.0%	62.2%	46.1%	High	87.5%	70.9%	52.6%
H 026.1	LKD	37.1	90	High	86.0%	79.3%	72.4%	High	90.7%	79.7%	70.4%
H 026.2	Bed	13.0	36	High	77.8%	66.6%	51.2%	High	88.3%	73.0%	56.3%
H 026.3	Bed	13.2	36	Medium	76.3%	62.8%	46.8%	Medium	86.8%	68.4%	50.0%
H 027.1	LKD	31.7	84	High	86.7%	82.0%	76.1%	High	91.5%	82.3%	74.9%
H 027.2	Bed	11.6	30	High	80.7%	72.2%	62.4%	High	88.9%	76.0%	64.2%
H 027.3	Bed	13.3	36	High	79.9%	71.0%	60.4%	High	88.9%	76.0%	63.8%
H 028.1	LKD	31.7	84	High	86.6%	81.8%	75.4%	High	91.0%	81.2%	73.6%
H 028.2	Bed	11.6	30	High	81.6%	72.9%	63.8%	High	88.9%	76.1%	65.6%
H 028.3	Bed	13.3	36	High	80.5%	71.6%	62.2%	High	88.4%	75.2%	64.3%
H 029.1	LKD	35.2	97	High	86.1%	80.0%	72.9%	High	90.6%	79.5%	70.6%
H 029.2	Bed	11.5	30	High	82.8%	74.3%	65.5%	High	89.4%	77.2%	67.4%
H 029.3	Bed	8.8	24	High	80.7%	71.7%	61.9%	High	87.5%	73.6%	62.2%
H 029.4	Bed	14.1	36	High	79.0%	69.8%	60.1%	High	87.8%	73.9%	62.6%
H 030.1	LKD	31.5	84	High	86.6%	80.5%	73.3%	High	91.2%	80.4%	71.1%
H 030.2	Bed	11.6	30	High	80.2%	70.6%	59.2%	High	88.7%	74.8%	62.3%
H 030.3	Bed	13.3	36	High	79.0%	68.6%	55.5%	High	88.3%	74.1%	60.6%

**Table 27: EN17037:2018 Daylight Provision individual room compliance values - Block H.**

# EN17037:2018 Daylight Provision Room Compliance - Block K

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
K 001.1	LKD	33.8	86	Medium	78.0%	65.5%	49.0%	Medium	85.4%	61.9%	40.8%
K 001.2	Bed	12.1	35	Medium	76.6%	62.2%	45.8%	High	87.2%	69.5%	50.4%
K 001.3	Bed	13.8	42	Medium	74.7%	58.0%	41.2%	Medium	86.6%	68.0%	48.3%
K 002.1	LKD	37.1	90	High	84.2%	76.6%	67.5%	High	88.6%	75.5%	63.8%
K 002.2	Bed	13.0	36	Medium	76.0%	61.6%	45.0%	High	87.4%	70.0%	51.4%
K 002.3	Bed	13.2	36	Medium	73.3%	56.2%	38.2%	Medium	84.7%	59.8%	38.4%
K 003.1	LKD	31.7	84	High	86.3%	81.3%	74.8%	High	91.1%	81.5%	73.6%
K 003.2	Bed	11.6	30	High	79.7%	70.6%	59.5%	High	87.8%	74.3%	61.5%
K 003.3	Bed	13.3	36	High	77.9%	67.4%	56.9%	High	86.5%	71.2%	57.7%
K 004.1	LKD	31.7	84	High	82.3%	73.7%	64.3%	High	87.9%	74.1%	62.2%
K 004.2	Bed	11.6	30	High	82.3%	73.5%	64.7%	High	89.3%	76.4%	66.6%
K 004.3	Bed	13.3	36	High	81.4%	72.4%	62.7%	High	88.7%	75.2%	64.7%
K 005.1	LKD	35.2	97	High	84.6%	76.7%	69.3%	High	89.7%	77.1%	67.3%
K 005.2	Bed	11.5	30	High	82.7%	74.2%	65.5%	High	89.6%	77.4%	67.6%
K 005.3	Bed	8.8	24	High	81.1%	72.1%	62.6%	High	88.2%	74.5%	63.0%
K 005.4	Bed	14.1	36	High	80.4%	71.5%	61.4%	High	88.6%	75.0%	64.0%
K 006.1	LKD	31.5	84	High	85.0%	77.4%	69.6%	High	89.6%	77.2%	66.4%
K 006.2	Bed	11.6	30	High	77.8%	66.8%	53.2%	High	86.8%	70.3%	54.5%
K 006.3	Bed	13.3	36	Medium	75.8%	64.1%	49.5%	High	86.3%	68.9%	52.5%
K 007.1	LKD	33.8	86	High	81.1%	71.2%	56.8%	High	87.5%	70.7%	51.9%
K 007.2	Bed	12.1	35	High	78.0%	66.1%	51.0%	High	88.0%	72.4%	55.3%
K 007.3	Bed	13.8	42	Medium	77.3%	64.3%	48.4%	High	87.5%	70.4%	52.3%
K 008.1	LKD	37.1	90	High	83.4%	75.7%	66.9%	High	88.8%	75.9%	64.6%
K 008.2	Bed	13.0	36	Medium	76.7%	63.6%	47.8%	High	87.1%	69.6%	51.3%
K 008.3	Bed	13.2	36	Medium	74.4%	58.4%	42.3%	Medium	86.3%	66.9%	47.7%
K 009.1	LKD	31.7	84	High	85.7%	79.5%	72.8%	High	90.3%	80.0%	71.3%
K 009.2	Bed	11.6	30	High	79.0%	69.7%	58.7%	High	88.1%	74.9%	61.8%
K 009.3	Bed	13.3	36	High	78.1%	68.2%	57.7%	High	87.3%	73.2%	59.8%
K 010.1	LKD	31.7	84	High	80.1%	71.4%	61.2%	High	86.3%	71.3%	58.4%
K 010.2	Bed	11.6	30	High	80.6%	72.0%	62.0%	High	88.8%	75.4%	64.8%
K 010.3	Bed	13.3	36	High	79.4%	70.5%	60.3%	High	88.0%	74.2%	62.4%
K 011.1	LKD	35.2	97	High	83.7%	74.9%	66.2%	High	89.1%	75.6%	64.7%
K 011.2	Bed	11.5	30	High	80.2%	71.6%	61.6%	High	88.7%	75.7%	65.3%
K 011.3	Bed	8.8	24	High	79.2%	70.0%	60.2%	High	87.8%	73.6%	61.5%
K 011.4	Bed	14.1	36	High	78.4%	69.0%	59.1%	High	87.2%	73.0%	60.4%
K 012.1	LKD	31.5	84	High	84.9%	77.0%	68.2%	High	89.4%	76.4%	64.2%
K 012.2	Bed	11.6	30	High	76.6%	65.0%	51.2%	High	86.7%	70.2%	55.3%
K 012.3	Bed	13.3	36	Medium	75.7%	63.6%	48.6%	High	86.2%	68.2%	51.6%
K 013.1	LKD	33.8	86	High	81.1%	71.1%	56.8%	Medium	86.4%	67.4%	48.3%
K 013.2	Bed	12.1	35	Medium	77.4%	65.2%	49.1%	High	87.7%	71.4%	53.4%
K 013.3	Bed	13.8	42	Medium	75.2%	59.8%	43.4%	High	86.9%	69.3%	50.6%
K 014.1	LKD	37.1	90	High	84.9%	77.8%	70.1%	High	89.9%	78.2%	68.4%
K 014.2	Bed	13.0	36	Medium	77.2%	64.7%	49.2%	High	87.6%	71.0%	52.8%
K 014.2	Bed	13.2	36	Medium	74.3%	58.0%	41.7%	Medium	85.3%	63.5%	43.0%
K 015.1	LKD	31.7	84	High	86.2%	81.1%	75.0%	High	90.8%	81.1%	73.4%
K 015.2	Bed	11.6	30	High	80.7%	72.7%	62.5%	High	88.9%	76.3%	65.2%
K 015.3	Bed	13.3	36	High	80.2%	71.6%	60.6%	High	88.1%	75.1%	62.8%
K 016.1	LKD	31.7	84	High	83.3%	75.0%	67.3%	High	88.6%	75.5%	64.6%
K 016.2	Bed	11.6	30	High	81.3%	72.5%	63.2%	High	89.2%	76.3%	66.2%



EN17037:2018 Daylight Provision Room Compliance - Block K											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
K 016.3	Bed	13.3	36	High	80.3%	71.3%	61.3%	High	88.5%	75.0%	64.1%
K 017.1	LKD	35.2	97	High	85.2%	77.7%	70.6%	High	90.1%	78.4%	69.1%
K 017.2	Bed	11.5	30	High	82.5%	74.0%	65.0%	High	89.5%	77.2%	67.3%
K 017.3	Bed	8.8	24	High	80.6%	71.9%	61.6%	High	88.1%	74.2%	62.4%
K 017.4	Bed	14.1	36	High	79.4%	70.4%	60.1%	High	88.0%	74.0%	62.3%
K 018.1	LKD	31.5	84	High	85.9%	78.9%	71.6%	High	90.3%	78.7%	68.9%
K 018.2	Bed	11.6	30	High	79.1%	68.5%	56.1%	High	88.2%	73.4%	60.5%
K 018.3	Bed	13.3	36	High	78.7%	67.9%	54.8%	High	87.6%	72.2%	58.2%
K 019.1	LKD	33.8	86	High	84.4%	76.0%	65.8%	High	88.4%	73.9%	58.1%
K 019.2	Bed	12.1	35	High	78.9%	68.2%	53.6%	High	87.9%	72.4%	55.8%
K 019.3	Bed	13.8	42	High	77.6%	65.5%	50.4%	High	87.8%	71.8%	54.5%
K 020.1	LKD	37.1	90	High	84.6%	77.4%	69.6%	High	89.9%	78.2%	68.2%
K 020.2	Bed	13.0	36	Medium	76.9%	64.1%	49.4%	High	87.6%	71.5%	54.1%
K 020.3	Bed	13.2	36	Medium	75.9%	61.5%	46.3%	High	86.8%	68.9%	50.3%
K 021.1	LKD	31.7	84	High	85.9%	80.0%	73.2%	High	90.5%	80.4%	71.8%
K 021.2	Bed	11.6	30	High	80.0%	71.1%	60.8%	High	88.5%	75.5%	64.2%
K 021.3	Bed	13.3	36	High	79.6%	70.6%	60.0%	High	88.3%	75.3%	63.2%
K 022.1	LKD	31.7	84	High	83.7%	76.0%	68.2%	High	88.2%	75.0%	63.7%
K 022.2	Bed	11.6	30	High	80.0%	71.3%	61.2%	High	88.8%	75.8%	65.2%
K 022.3	Bed	13.3	36	High	80.0%	71.1%	60.9%	High	88.3%	74.5%	63.2%
K 023.1	LKD	35.2	97	High	84.5%	76.2%	68.1%	High	89.7%	76.8%	66.5%
K 023.2	Bed	11.5	30	High	80.8%	72.1%	62.3%	High	88.7%	75.5%	64.9%
K 023.3	Bed	8.8	24	High	79.6%	70.6%	60.3%	High	87.7%	73.7%	61.6%
K 023.4	Bed	14.1	36	High	78.3%	69.0%	59.0%	High	87.5%	73.3%	60.8%
K 024.1	LKD	31.5	84	High	85.4%	77.8%	69.3%	High	90.1%	77.9%	67.1%
K 024.2	Bed	11.6	30	High	78.3%	67.7%	54.9%	High	88.6%	74.4%	61.5%
K 024.3	Bed	13.3	36	High	77.0%	65.8%	51.5%	High	87.2%	71.3%	57.0%
K 025.1	LKD	33.8	86	High	84.3%	75.9%	66.3%	High	88.9%	75.0%	61.0%
K 025.2	Bed	12.1	35	High	77.9%	66.6%	51.3%	High	88.0%	72.7%	56.0%
K 025.3	Bed	13.8	42	Medium	76.1%	62.1%	45.8%	High	87.1%	69.7%	51.3%
K 026.1	LKD	37.1	90	High	86.1%	79.7%	72.9%	High	90.6%	79.7%	70.7%
K 026.2	Bed	13.0	36	High	77.8%	66.3%	51.3%	High	88.2%	72.7%	56.0%
K 026.3	Bed	13.2	36	Medium	76.6%	63.6%	47.8%	High	86.7%	69.1%	50.9%
K 027.1	LKD	31.7	84	High	87.0%	82.4%	76.5%	High	91.6%	82.4%	74.8%
K 027.2	Bed	13.3	36	High	80.0%	71.5%	61.1%	High	88.4%	75.5%	63.8%
K 027.3	Bed	11.6	30	High	80.9%	72.9%	63.0%	High	89.1%	76.5%	65.6%
K 028.1	LKD	31.7	84	High	86.5%	81.9%	75.4%	High	90.9%	81.1%	73.3%
K 028.2	Bed	11.6	30	High	81.3%	72.7%	63.3%	High	89.2%	76.3%	66.2%
K 028.3	Bed	13.3	36	High	80.0%	71.5%	61.3%	High	88.4%	74.7%	63.9%
K 029.1	LKD	35.2	97	High	86.1%	79.8%	72.8%	High	90.7%	79.6%	70.7%
K 029.2	Bed	11.5	30	High	82.3%	73.9%	64.9%	High	89.6%	77.3%	67.3%
K 029.3	Bed	8.8	24	High	81.2%	72.2%	62.4%	High	87.7%	73.5%	61.5%
K 029.4	Bed	14.1	36	High	79.5%	70.7%	60.6%	High	88.1%	74.1%	62.6%
K 030.1	LKD	31.5	84	High	86.6%	80.3%	73.4%	High	91.3%	80.4%	71.5%
K 030.2	Bed	11.6	30	High	80.3%	70.4%	59.2%	High	89.0%	75.1%	62.9%
K 030.3	Bed	13.3	36	High	79.0%	68.4%	55.7%	High	88.3%	73.5%	60.5%

**Table 28: EN17037:2018 Daylight Provision individual room compliance values - Block K.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood A											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
A 005.1	LKD	41.4	96	Fail	44.5%	24.8%	4.1%	Minimum	59.2%	9.3%	0.0%
A 005.2	Bed	16.8	36	Medium	74.7%	61.8%	48.3%	Minimum	71.3%	32.4%	10.0%
A 005.3	Bed	11.9	29	Medium	73.2%	61.3%	47.0%	Medium	80.8%	56.8%	36.2%
A 005.4	Bed	6.7	15	High	78.7%	69.5%	59.5%	High	87.4%	72.3%	59.2%
A 006.1	LKD	41.1	101	Medium	68.8%	54.2%	39.2%	Medium	78.7%	52.4%	32.8%
A 006.2	Bed	20.2	52	Medium	72.4%	58.0%	43.3%	Medium	82.0%	57.7%	38.4%
A 006.3	Bed	13.7	35	High	77.5%	67.5%	56.1%	Minimum	77.0%	47.7%	22.1%
A 006.4	Bed	8.7	26	High	79.3%	70.0%	59.2%	High	87.4%	72.4%	60.3%
A 007.1	LKD	41.1	94	Minimum	50.6%	31.8%	8.6%	Minimum	63.8%	25.0%	0.2%
A 007.2	Bed	16.8	36	Medium	75.3%	63.2%	49.3%	Minimum	73.1%	35.4%	14.5%
A 007.3	Bed	11.9	29	High	76.9%	66.8%	55.3%	Medium	84.8%	65.4%	49.3%
A 007.4	Bed	6.7	15	High	81.1%	72.4%	62.5%	High	87.7%	72.9%	60.5%
A 008.1	LKD	41.1	101	Medium	71.7%	60.0%	47.2%	Medium	80.8%	58.6%	40.9%
A 008.2	Bed	20.2	52	High	79.6%	70.7%	61.0%	High	88.2%	74.5%	62.3%
A 008.3	Bed	13.7	35	High	77.6%	67.7%	56.6%	Medium	78.3%	51.3%	26.7%
A 008.4	Bed	8.7	26	High	84.1%	76.3%	69.0%	High	90.0%	78.2%	69.4%

**Table 29: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood A.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood B											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
B 009.1	LKD	41.1	94	Minimum	52.1%	33.2%	8.7%	Minimum	64.7%	24.4%	0.0%
B 009.2	Bed	16.8	36	High	80.8%	71.7%	61.6%	Minimum	75.7%	47.9%	26.1%
B 009.3	Bed	11.9	29	Medium	76.7%	64.1%	48.7%	Medium	80.5%	53.7%	33.5%
B 009.4	Bed	6.7	15	High	78.9%	69.3%	55.8%	Medium	85.2%	65.8%	48.5%
B 010.1	LKD	41.1	101	Medium	73.1%	61.4%	49.1%	Medium	82.7%	61.8%	45.1%
B 010.2	Bed	20.2	52	High	82.3%	73.8%	65.7%	High	88.6%	75.8%	65.6%
B 010.3	Bed	13.7	35	High	77.2%	65.4%	51.2%	Minimum	76.8%	44.7%	17.3%
B 010.4	Bed	8.7	26	High	82.9%	75.1%	65.6%	High	89.0%	76.6%	65.7%
B 011.1	LKD	41.4	96	Minimum	50.3%	30.0%	4.1%	Minimum	63.3%	18.8%	0.0%
B 011.2	Bed	16.8	36	High	79.8%	70.8%	60.8%	Minimum	76.6%	48.8%	26.9%
B 011.3	Bed	11.9	29	Medium	73.5%	58.4%	42.4%	Medium	80.3%	52.3%	28.1%
B 011.4	Bed	6.7	15	High	78.2%	67.5%	53.1%	Medium	84.7%	63.1%	45.5%
B 012.1	LKD	41.1	101	Medium	71.4%	57.4%	42.8%	Medium	81.7%	59.0%	39.5%
B 012.2	Bed	20.2	52	High	76.3%	66.1%	55.1%	High	85.8%	68.5%	53.8%
B 012.3	Bed	13.7	35	Medium	77.1%	64.8%	50.0%	Minimum	76.3%	42.5%	12.7%
B 012.4	Bed	8.7	26	High	77.9%	66.9%	52.7%	High	86.6%	69.7%	53.0%
B 020.1	LKD	41.1	94	Fail	47.4%	25.0%	6.3%	Minimum	61.3%	17.8%	0.0%
B 020.2	Bed	16.8	36	High	78.3%	68.3%	57.8%	Minimum	71.6%	39.7%	24.7%
B 020.3	Bed	11.9	29	Medium	75.7%	62.9%	47.9%	Medium	82.1%	55.5%	35.0%
B 020.4	Bed	6.7	15	High	78.6%	67.9%	54.1%	High	87.3%	70.0%	51.3%
B 021.1	LKD	41.1	101	Medium	71.3%	57.8%	44.0%	Medium	81.9%	58.4%	38.1%
B 021.2	Bed	20.2	52	High	81.1%	72.7%	62.5%	High	88.5%	75.3%	63.4%
B 021.3	Bed	13.7	35	Medium	76.7%	64.4%	49.3%	Minimum	76.5%	44.4%	13.1%
B 021.4	Bed	8.7	26	High	83.0%	74.1%	63.3%	High	88.7%	74.7%	60.3%
B 022.1	LKD	41.4	96	Fail	39.2%	15.1%	0.7%	Minimum	53.0%	6.0%	0.0%
B 022.2	Bed	16.8	36	High	76.7%	65.5%	55.2%	Minimum	73.7%	41.4%	24.8%

# EN17037:2018 Daylight Provision Room Compliance - Neighbourhood B

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
B 022.3	Bed	11.9	29	Medium	72.3%	57.3%	41.5%	Medium	80.9%	54.0%	33.6%
B 022.4	Bed	6.7	15	High	77.2%	65.4%	51.3%	Medium	85.7%	65.5%	47.7%
B 023.1	LKD	41.1	101	Medium	68.7%	55.0%	39.0%	Medium	80.7%	56.0%	34.6%
B 023.2	Bed	20.2	52	High	76.4%	65.4%	54.9%	High	85.4%	66.8%	52.5%
B 023.3	Bed	13.7	35	Medium	76.8%	64.7%	49.7%	Minimum	76.1%	42.5%	8.8%
B 023.4	Bed	8.7	26	High	78.0%	66.4%	51.6%	High	86.7%	69.1%	51.9%
B 032.1	LKD	41.4	96	Fail	35.4%	13.1%	2.0%	Minimum	51.8%	5.8%	0.0%
B 032.2	Bed	16.8	36	High	74.0%	62.7%	52.1%	Minimum	61.4%	28.5%	12.0%
B 032.3	Bed	11.9	29	Medium	69.7%	53.7%	38.1%	Minimum	77.3%	47.3%	24.4%
B 032.4	Bed	6.7	15	Medium	76.3%	63.6%	49.0%	Medium	84.4%	62.2%	43.7%
B 033.1	LKD	41.1	101	Medium	67.7%	53.4%	35.2%	Medium	79.7%	54.9%	31.5%
B 033.2	Bed	20.2	52	High	75.6%	65.0%	54.4%	High	85.5%	67.5%	54.0%
B 033.3	Bed	13.7	35	Medium	76.5%	64.1%	48.8%	Minimum	76.8%	43.2%	10.2%
B 033.4	Bed	8.7	26	High	77.4%	66.2%	51.3%	High	86.6%	69.3%	51.9%
B 034.1	LKD	41.1	94	Fail	33.3%	10.8%	1.3%	Fail	48.7%	5.5%	0.0%
B 034.2	Bed	16.8	36	High	74.9%	64.1%	53.1%	Minimum	68.3%	35.8%	20.2%
B 034.3	Bed	11.9	29	Medium	73.5%	58.5%	43.7%	Minimum	77.7%	47.1%	23.5%
B 034.4	Bed	6.7	15	Medium	76.4%	64.1%	49.6%	Medium	83.4%	58.6%	39.0%
B 035.1	LKD	41.1	101	Medium	69.6%	55.7%	38.2%	Medium	79.8%	55.3%	32.3%
B 035.2	Bed	20.2	52	High	80.3%	71.7%	62.1%	High	88.1%	74.2%	63.0%
B 035.3	Bed	13.7	35	Medium	76.5%	63.8%	48.5%	Minimum	77.4%	44.4%	11.2%
B 035.4	Bed	8.7	26	High	82.2%	72.9%	61.8%	High	88.9%	75.2%	62.4%
B 039.1	LKD	41.4	96	Fail	47.2%	25.2%	2.9%	Minimum	60.0%	11.5%	0.0%
B 039.2	Bed	16.8	36	High	80.0%	71.0%	59.9%	Minimum	77.4%	49.3%	29.4%
B 039.3	Bed	11.9	29	Medium	71.0%	54.6%	37.9%	Medium	80.0%	51.6%	27.9%
B 039.4	Bed	6.7	15	High	77.6%	66.1%	52.0%	Medium	84.8%	64.2%	46.9%
B 040.1	LKD	41.1	101	Medium	71.3%	57.7%	42.2%	Medium	82.5%	59.4%	40.6%
B 040.2	Bed	20.2	52	High	76.5%	65.2%	53.1%	High	85.6%	67.2%	52.1%
B 040.3	Bed	13.7	35	Medium	76.8%	64.7%	49.6%	Minimum	75.9%	42.2%	13.0%
B 040.4	Bed	8.7	26	High	78.7%	67.9%	54.2%	High	86.0%	68.1%	51.6%
B 041.1	LKD	41.1	94	Fail	49.8%	29.7%	7.7%	Minimum	62.5%	21.6%	0.0%
B 041.2	Bed	16.8	36	High	79.8%	70.8%	59.5%	Minimum	75.8%	45.3%	27.1%
B 041.3	Bed	11.9	29	Medium	76.0%	63.7%	48.5%	Medium	78.7%	50.9%	29.9%
B 041.4	Bed	6.7	15	High	78.7%	68.5%	55.2%	Medium	84.9%	64.4%	47.5%
B 042.1	LKD	41.1	101	Medium	73.1%	61.2%	49.1%	Medium	82.5%	61.3%	43.6%
B 042.2	Bed	20.2	52	High	81.9%	74.5%	65.4%	High	89.2%	77.0%	66.1%
B 042.3	Bed	13.7	35	High	77.7%	66.8%	52.3%	Minimum	76.6%	44.2%	16.4%
B 042.4	Bed	8.7	26	High	83.2%	74.7%	66.3%	High	89.2%	76.1%	66.3%
B 048.1	LKD	41.4	96	Minimum	60.1%	43.5%	24.8%	Minimum	69.7%	32.7%	1.5%
B 048.2	Bed	16.8	36	Medium	77.8%	65.3%	48.7%	Minimum	71.4%	21.6%	0.0%
B 048.3	Bed	11.9	29	High	79.9%	70.6%	61.0%	High	86.1%	69.6%	56.2%
B 048.4	Bed	6.7	15	High	83.1%	74.8%	66.8%	High	89.1%	76.8%	66.0%
B 049.1	LKD	41.1	101	Medium	73.2%	60.5%	47.8%	Medium	83.4%	60.9%	44.1%
B 049.2	Bed	20.2	52	Medium	73.7%	58.5%	40.6%	Medium	84.7%	61.5%	39.5%
B 049.3	Bed	13.7	35	High	79.6%	70.3%	60.4%	Medium	80.8%	57.1%	40.4%
B 049.4	Bed	8.7	26	High	80.8%	71.8%	62.4%	High	87.5%	73.8%	62.5%
B 050.1	LKD	41.1	94	Minimum	57.6%	39.2%	19.9%	Minimum	66.4%	27.3%	0.3%
B 050.2	Bed	16.8	36	Medium	76.6%	63.0%	46.3%	Minimum	65.8%	6.2%	0.0%
B 050.3	Bed	11.9	29	High	81.7%	72.8%	63.2%	High	86.4%	71.3%	58.4%
B 050.4	Bed	6.7	15	High	84.6%	77.1%	69.5%	High	88.7%	76.0%	65.0%

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood B											
Space ID	Description	Area [m^2]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
B 051.1	LKD	41.1	101	Medium	73.8%	61.8%	50.0%	Medium	83.4%	61.3%	45.3%
B 051.2	Bed	20.2	52	High	80.2%	70.7%	57.8%	High	87.8%	72.7%	56.9%
B 051.3	Bed	13.7	35	High	80.4%	71.4%	61.9%	Medium	82.0%	59.5%	42.7%
B 051.4	Bed	8.7	26	High	83.9%	77.2%	69.6%	High	89.8%	78.8%	69.2%

**Table 30: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood B.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood C											
Space ID	Description	Area [m^2]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
C 052.1	LKD	41.1	94	Minimum	50.1%	31.9%	11.2%	Minimum	63.6%	23.9%	0.2%
C 052.2	Bed	16.8	36	Medium	74.6%	61.5%	47.3%	Minimum	70.1%	28.4%	4.9%
C 052.3	Bed	11.9	29	High	76.6%	65.4%	54.3%	High	85.1%	65.7%	50.7%
C 052.4	Bed	6.7	15	High	81.2%	73.4%	63.2%	High	87.0%	72.4%	58.1%
C 053.1	LKD	41.1	101	Medium	72.2%	60.0%	47.2%	Medium	81.5%	59.0%	40.8%
C 053.2	Bed	20.2	52	High	80.1%	71.2%	61.6%	High	87.9%	73.8%	61.5%
C 053.3	Bed	13.7	35	High	78.9%	69.2%	57.7%	Medium	79.4%	53.7%	32.4%
C 053.4	Bed	8.7	26	High	83.5%	76.7%	68.8%	High	89.6%	78.0%	67.4%
C 054.1	LKD	41.4	96	Fail	47.9%	26.4%	5.6%	Minimum	61.5%	14.4%	0.0%
C 054.2	Bed	16.8	36	High	76.4%	64.8%	50.4%	Minimum	70.4%	33.3%	4.4%
C 054.3	Bed	11.9	29	Medium	74.3%	61.8%	48.6%	Medium	81.2%	58.4%	40.5%
C 054.4	Bed	6.7	15	High	79.3%	70.1%	58.9%	High	87.4%	73.4%	59.4%
C 055.1	LKD	41.1	101	Medium	69.0%	55.1%	40.1%	Medium	80.0%	54.7%	34.6%
C 055.2	Bed	20.2	52	Medium	73.4%	59.1%	43.9%	Medium	82.5%	57.7%	37.9%
C 055.3	Bed	13.7	35	High	78.6%	68.4%	56.4%	Minimum	77.4%	48.7%	25.7%
C 055.4	Bed	8.7	26	High	79.7%	70.7%	59.4%	High	87.2%	72.5%	58.9%
C 062.1	LKD	41.4	96	Fail	38.9%	16.9%	1.2%	Minimum	52.5%	5.3%	0.0%
C 062.2	Bed	16.8	36	Medium	75.7%	62.2%	46.4%	Minimum	73.1%	31.2%	6.3%
C 062.3	Bed	11.9	29	Medium	73.2%	60.3%	48.3%	Medium	80.3%	55.4%	37.2%
C 062.4	Bed	6.7	15	High	77.6%	66.7%	56.4%	High	85.6%	66.9%	53.0%
C 063.1	LKD	41.1	101	Medium	69.4%	55.0%	40.2%	Medium	80.4%	53.9%	33.2%
C 063.2	Bed	20.2	52	Medium	73.8%	59.7%	43.5%	Medium	84.9%	63.4%	43.2%
C 063.3	Bed	13.7	35	High	78.2%	67.5%	56.4%	Minimum	76.4%	48.4%	26.3%
C 063.4	Bed	8.7	26	High	79.0%	69.4%	58.3%	High	87.1%	72.0%	58.5%
C 064.1	LKD	41.1	94	Fail	42.8%	19.5%	1.5%	Minimum	57.4%	5.4%	0.0%
C 064.2	Bed	16.8	36	Medium	76.5%	63.1%	47.7%	Minimum	69.6%	22.6%	3.5%
C 064.3	Bed	11.9	29	High	74.6%	62.3%	50.1%	Medium	80.0%	54.7%	37.6%
C 064.4	Bed	6.7	15	High	77.7%	67.1%	55.6%	High	86.0%	67.8%	52.4%
C 065.1	LKD	41.1	101	Medium	70.4%	55.4%	41.2%	Medium	81.0%	55.0%	34.8%
C 065.2	Bed	20.2	52	High	79.6%	69.1%	55.3%	High	87.9%	72.9%	57.0%
C 065.3	Bed	13.7	35	High	77.9%	67.3%	56.6%	Minimum	76.9%	48.2%	25.7%
C 065.4	Bed	8.7	26	High	82.6%	74.3%	64.2%	High	88.8%	75.7%	64.0%
C 072.1	LKD	41.1	94	Fail	39.3%	13.0%	0.1%	Minimum	52.1%	1.5%	0.0%
C 072.2	Bed	16.8	36	Medium	72.4%	58.2%	43.0%	Minimum	64.1%	23.7%	10.4%
C 072.3	Bed	11.9	29	High	78.0%	66.5%	51.3%	Medium	83.9%	59.8%	39.5%
C 072.4	Bed	6.7	15	High	81.6%	71.8%	58.9%	High	86.8%	69.8%	52.8%
C 073.1	LKD	41.1	101	Medium	71.4%	56.4%	41.6%	Medium	81.2%	55.1%	34.8%
C 073.2	Bed	20.2	52	High	80.2%	71.3%	60.3%	High	88.1%	74.1%	61.0%

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood C											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
C 073.3	Bed	13.7	35	High	77.6%	66.3%	51.6%	Minimum	76.6%	43.2%	13.8%
C 073.4	Bed	8.7	26	High	83.1%	73.7%	62.1%	High	89.6%	76.6%	64.9%
C 074.1	LKD	41.4	96	Fail	46.1%	22.7%	1.6%	Minimum	59.2%	10.7%	0.0%
C 074.2	Bed	16.8	36	Medium	75.4%	62.2%	49.3%	Minimum	56.8%	19.4%	7.1%
C 074.3	Bed	11.9	29	Medium	74.6%	60.3%	44.3%	Medium	83.5%	58.4%	38.2%
C 074.4	Bed	6.7	15	High	79.9%	69.6%	55.9%	High	87.7%	72.1%	56.1%
C 075.1	LKD	41.1	101	Medium	70.6%	55.1%	39.8%	Medium	81.3%	55.9%	35.4%
C 075.2	Bed	20.2	52	High	76.0%	63.9%	51.2%	Medium	85.0%	65.6%	49.3%
C 075.3	Bed	13.7	35	Medium	76.7%	64.4%	49.1%	Minimum	78.0%	45.3%	16.8%
C 075.4	Bed	8.7	26	High	79.3%	68.7%	54.4%	High	86.8%	70.4%	54.2%
C 076.1	LKD	27.3	68	Minimum	64.4%	48.4%	32.4%	Minimum	75.1%	42.2%	26.0%
C 076.2	Bed	12.1	36	Minimum	67.7%	48.9%	27.3%	Minimum	75.0%	40.0%	13.2%
C 077.1	LKD	43.6	110	Medium	66.6%	50.2%	34.3%	Medium	79.1%	51.2%	30.3%
C 077.2	Bed	19.3	46	High	76.1%	64.0%	50.9%	Medium	84.8%	64.8%	48.2%
C 077.3	Bed	15.1	43	Medium	70.1%	53.1%	35.4%	Minimum	72.5%	31.3%	7.3%
C 077.4	Bed	9.0	27	Medium	75.2%	62.1%	46.5%	Medium	86.3%	67.9%	49.2%
C 078.1	LKD	27.3	68	Minimum	65.4%	48.4%	32.6%	Minimum	77.5%	45.6%	27.6%
C 078.2	Bed	12.1	36	Minimum	66.9%	48.3%	25.4%	Minimum	77.8%	45.0%	18.3%
C 079.1	LKD	43.6	110	Medium	67.3%	51.8%	35.9%	Medium	80.2%	53.6%	32.8%
C 079.2	Bed	19.3	46	High	76.0%	63.8%	50.8%	Medium	85.3%	65.8%	49.1%
C 079.3	Bed	15.1	43	Medium	70.5%	54.1%	36.0%	Minimum	72.6%	33.0%	7.1%
C 079.4	Bed	9.0	27	Medium	75.0%	62.3%	46.9%	High	86.3%	67.8%	50.1%
C 080.1	LKD	41.4	96	Minimum	51.4%	32.2%	7.2%	Minimum	64.7%	21.6%	0.0%
C 080.2	Bed	16.8	36	High	78.6%	68.1%	55.0%	Minimum	74.2%	36.9%	23.0%
C 080.3	Bed	11.9	29	Medium	74.5%	60.3%	43.8%	Medium	83.0%	57.4%	36.1%
C 080.4	Bed	6.7	15	High	79.2%	68.5%	54.5%	High	87.1%	70.1%	53.1%
C 081.1	LKD	41.1	101	Medium	71.0%	56.3%	41.1%	Medium	82.0%	58.2%	38.7%
C 081.2	Bed	20.2	52	Medium	75.7%	63.3%	49.7%	Medium	85.0%	65.1%	47.8%
C 081.3	Bed	13.7	35	Medium	77.1%	65.2%	49.5%	Minimum	77.1%	43.5%	14.8%
C 081.4	Bed	8.7	26	High	79.2%	68.3%	54.2%	High	87.4%	71.6%	55.7%
C 082.2	Bed	16.8	36	High	77.9%	66.1%	52.6%	Minimum	61.5%	21.3%	9.4%
C 082.3	Bed	11.9	29	Medium	75.6%	63.2%	47.5%	Medium	83.2%	57.8%	37.0%
C 082.4	Bed	6.7	15	High	80.7%	70.1%	56.8%	High	86.3%	68.3%	50.6%
C 083.1	LKD	41.1	94	Fail	48.4%	28.0%	4.0%	Minimum	59.4%	13.9%	0.0%
C 083.1	LKD	41.1	101	Medium	72.6%	58.1%	44.4%	Medium	81.8%	57.3%	37.9%
C 083.2	Bed	20.2	52	High	79.2%	69.7%	58.2%	High	86.2%	69.1%	53.7%
C 083.3	Bed	13.7	35	High	78.4%	67.0%	52.3%	Minimum	77.7%	45.8%	17.0%
C 083.4	Bed	8.7	26	High	82.8%	73.9%	64.1%	High	89.0%	75.7%	64.5%

**Table 31: EN17037:2018 Daylight Provision individual room compliance values. - Neighbourhood C**



# EN17037:2018 Daylight Provision Room Compliance - Neighbourhood D

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
D 084.1	LKD	41.1	94	Minimum	51.6%	31.8%	7.1%	Minimum	64.4%	22.3%	0.0%
D 084.2	Bed	16.8	36	High	76.3%	66.3%	54.8%	Minimum	71.5%	34.3%	19.2%
D 084.3	Bed	11.9	29	High	79.0%	68.6%	53.6%	Medium	86.0%	66.2%	46.9%
D 084.4	Bed	6.7	15	High	83.0%	74.0%	61.3%	High	88.2%	73.9%	57.5%
D 085.1	LKD	41.1	101	Medium	73.5%	61.0%	47.8%	Medium	83.4%	61.5%	44.0%
D 085.2	Bed	20.2	52	High	81.3%	73.0%	63.9%	High	87.8%	74.3%	62.9%
D 085.3	Bed	13.7	35	High	77.8%	66.0%	51.2%	Minimum	79.2%	48.6%	22.5%
D 085.4	Bed	8.7	26	High	83.1%	75.1%	65.5%	High	89.5%	77.1%	65.5%
D 086.1	LKD	41.4	96	Minimum	51.5%	31.0%	5.9%	Minimum	65.9%	21.8%	0.0%
D 086.2	Bed	16.8	36	High	77.2%	67.1%	55.7%	Minimum	72.1%	35.9%	20.3%
D 086.3	Bed	11.9	29	Medium	76.9%	64.0%	48.0%	Medium	86.5%	67.6%	48.5%
D 086.4	Bed	6.7	15	High	81.3%	71.6%	57.9%	High	88.6%	74.6%	59.0%
D 087.1	LKD	41.1	101	Medium	72.3%	58.5%	44.2%	Medium	82.6%	60.0%	40.8%
D 087.2	Bed	20.2	52	High	75.5%	65.1%	52.9%	High	85.2%	66.3%	50.7%
D 087.3	Bed	13.7	35	High	78.2%	67.2%	52.1%	Minimum	78.4%	46.4%	19.2%
D 087.4	Bed	8.7	26	High	78.7%	67.9%	53.7%	High	87.3%	70.7%	53.9%
D 095.1	LKD	41.4	96	Minimum	52.9%	32.4%	6.8%	Minimum	67.8%	24.1%	0.0%
D 095.2	Bed	16.8	36	High	77.9%	67.9%	56.2%	Minimum	75.7%	45.3%	21.7%
D 095.3	Bed	11.9	29	Medium	76.9%	63.9%	48.4%	Medium	85.9%	66.2%	46.7%
D 095.4	Bed	6.7	15	High	82.0%	72.5%	59.5%	High	89.2%	75.8%	61.3%
D 096.1	LKD	41.1	101	Medium	72.9%	58.6%	44.0%	Medium	83.2%	60.5%	41.6%
D 096.2	Bed	20.2	52	High	75.4%	64.9%	52.1%	High	85.3%	66.3%	50.1%
D 096.3	Bed	13.7	35	High	77.8%	66.1%	51.4%	Minimum	78.8%	46.9%	21.6%
D 096.3	Bed	13.7	35	High	77.9%	66.4%	51.6%	Minimum	78.7%	47.3%	23.0%
D 096.4	Bed	8.7	26	High	83.4%	74.8%	63.1%	High	89.6%	76.9%	64.7%
D 096.4	Bed	8.7	26	High	78.9%	68.2%	53.4%	High	87.9%	72.4%	55.4%
D 097.1	LKD	41.1	94	Minimum	53.6%	33.4%	5.6%	Minimum	68.8%	24.2%	0.0%
D 097.2	Bed	16.8	36	High	78.1%	67.9%	56.1%	Minimum	73.4%	39.2%	20.0%
D 097.3	Bed	11.9	29	High	79.8%	69.5%	54.9%	Medium	86.0%	66.6%	47.4%
D 097.4	Bed	6.7	15	High	83.1%	74.5%	62.4%	High	88.2%	73.4%	56.9%
D 098.1	LKD	41.1	101	Medium	73.9%	61.0%	46.6%	Medium	83.7%	61.6%	43.3%
D 098.2	Bed	20.2	52	High	80.3%	71.0%	61.0%	High	88.4%	74.2%	61.9%
D 106.1	LKD	27.3	68	Minimum	59.9%	37.7%	9.2%	Minimum	71.8%	26.0%	1.4%
D 106.1	LKD	41.4	96	Minimum	50.9%	28.8%	2.7%	Minimum	65.8%	20.7%	0.0%
D 106.2	Bed	16.8	36	High	79.4%	69.7%	59.3%	Minimum	72.0%	42.5%	25.5%
D 106.3	Bed	11.9	29	Medium	75.3%	60.3%	42.9%	Medium	85.4%	62.8%	40.8%
D 106.4	Bed	6.7	15	High	79.9%	69.1%	54.5%	High	88.0%	72.4%	55.6%
D 107.1	LKD	41.1	101	Medium	71.3%	57.7%	42.3%	Medium	82.6%	59.1%	40.0%
D 107.2	Bed	20.2	52	High	77.1%	66.4%	55.9%	High	85.4%	67.2%	52.9%
D 107.3	Bed	13.7	35	Medium	77.6%	65.1%	49.1%	Minimum	78.3%	43.6%	7.2%
D 107.4	Bed	8.7	26	High	77.8%	65.2%	50.1%	High	87.1%	70.3%	52.7%
D 108.1	LKD	41.1	94	Minimum	50.6%	28.1%	1.2%	Minimum	64.5%	20.1%	0.0%
D 108.2	Bed	16.8	36	High	77.8%	68.1%	57.7%	Minimum	67.1%	35.1%	20.0%
D 108.3	Bed	11.9	29	Medium	77.9%	65.9%	49.9%	Medium	85.2%	62.0%	40.7%
D 108.4	Bed	6.7	15	High	82.1%	71.8%	57.8%	High	87.6%	71.3%	53.6%
D 109.1	LKD	41.1	101	Medium	72.1%	59.6%	46.3%	Medium	82.9%	60.1%	41.6%
D 109.2	Bed	20.2	52	High	81.4%	73.2%	63.8%	High	88.1%	74.8%	63.6%
D 109.3	Bed	13.7	35	Medium	77.1%	64.7%	48.4%	Minimum	78.1%	43.2%	8.0%
D 109.4	Bed	8.7	26	High	83.2%	74.1%	63.7%	High	89.5%	76.0%	63.9%
D 110.1	LKD	41.1	94	Fail	45.4%	24.0%	5.2%	Minimum	59.4%	13.6%	0.0%

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood D											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
D 110.2	Bed	16.8	36	Medium	75.6%	60.4%	44.5%	Minimum	55.8%	6.0%	0.3%
D 110.3	Bed	11.9	29	High	75.6%	64.6%	53.4%	Medium	84.1%	63.0%	47.8%
D 110.4	Bed	6.7	15	High	81.7%	72.6%	63.0%	High	84.5%	64.1%	50.5%
D 111.1	LKD	41.1	101	Medium	70.2%	56.6%	42.1%	Medium	80.7%	55.9%	34.1%
D 111.2	Bed	20.2	52	High	79.1%	69.3%	54.8%	High	87.6%	71.7%	55.3%
D 111.3	Bed	13.7	35	High	78.4%	68.9%	58.7%	Medium	78.2%	53.4%	35.1%
D 111.4	Bed	8.7	26	High	83.4%	75.2%	67.3%	High	88.6%	75.2%	65.1%
D 112.1	LKD	27.3	68	Minimum	59.2%	36.8%	9.9%	Minimum	72.0%	27.4%	3.0%
D 112.2	Bed	12.1	36	Medium	65.5%	51.5%	36.7%	Minimum	75.5%	48.1%	29.2%
D 113.1	LKD	43.6	110	Minimum	62.9%	47.2%	29.9%	Medium	78.2%	50.2%	26.0%
D 113.2	Bed	19.3	46	Medium	74.1%	57.7%	41.1%	Medium	84.6%	60.8%	39.5%
D 113.3	Bed	15.1	43	Medium	72.6%	60.3%	48.5%	Minimum	74.2%	44.7%	27.7%
D 113.4	Bed	9.0	27	High	75.6%	64.9%	54.6%	High	84.5%	64.8%	50.5%
D 114.1	LKD	27.3	68	Minimum	60.1%	37.4%	10.2%	Minimum	72.6%	28.7%	2.9%
D 114.2	Bed	12.1	36	Minimum	63.3%	47.9%	32.9%	Minimum	75.6%	45.4%	28.2%
D 115.1	LKD	43.6	110	Minimum	62.9%	45.8%	28.1%	Minimum	77.9%	47.8%	23.4%
D 115.2	Bed	19.3	46	Medium	74.7%	58.7%	41.6%	Medium	84.7%	60.6%	39.3%
D 115.3	Bed	15.1	43	Medium	70.6%	58.9%	45.4%	Minimum	70.8%	38.8%	22.1%
D 115.4	Bed	9.0	27	High	74.6%	63.7%	52.9%	Medium	84.2%	63.8%	49.3%
D 116.1	LKD	27.3	68	Minimum	60.5%	38.7%	11.6%	Minimum	73.4%	30.1%	2.4%
D 116.2	Bed	12.1	36	Minimum	56.7%	38.7%	26.0%	Minimum	70.3%	34.5%	20.4%
D 117.1	LKD	43.6	110	Minimum	58.7%	41.2%	22.2%	Minimum	75.9%	42.8%	16.0%
D 117.2	Bed	19.3	46	Medium	74.1%	57.8%	40.8%	Medium	84.6%	60.7%	39.3%
D 117.3	Bed	15.1	43	Medium	69.9%	57.3%	42.8%	Minimum	67.5%	31.2%	13.4%
D 117.4	Bed	9.0	27	High	73.8%	62.6%	51.3%	Medium	83.4%	62.4%	47.3%
D 118.2	Bed	12.1	36	Minimum	56.1%	37.6%	26.5%	Minimum	66.0%	29.3%	13.5%
D 119.1	LKD	43.6	110	Minimum	58.7%	41.0%	22.3%	Minimum	74.8%	41.8%	16.1%
D 119.2	Bed	19.3	46	Medium	73.0%	56.5%	39.4%	Medium	84.8%	61.2%	39.7%
D 119.3	Bed	15.1	43	Medium	68.1%	55.5%	40.8%	Minimum	68.0%	32.6%	16.1%
D 119.4	Bed	9.0	27	High	74.1%	63.1%	52.1%	Medium	83.6%	62.8%	48.2%
D 120.1	LKD	41.1	94	Fail	36.1%	15.2%	2.9%	Fail	48.6%	3.0%	0.0%
D 120.2	Bed	16.8	36	Medium	74.3%	58.3%	42.0%	Minimum	59.5%	8.9%	0.2%
D 120.3	Bed	11.9	29	Medium	72.7%	61.2%	49.4%	Medium	77.3%	52.1%	33.3%
D 120.4	Bed	6.7	15	High	77.3%	67.3%	57.0%	High	85.0%	65.0%	50.4%
D 121.1	LKD	41.1	101	Medium	69.1%	56.2%	42.5%	Medium	79.7%	54.8%	32.9%
D 121.2	Bed	20.2	52	High	78.9%	69.7%	57.5%	High	88.1%	73.5%	58.8%
D 121.3	Bed	13.7	35	High	77.8%	68.2%	58.0%	Medium	77.0%	51.5%	34.0%
D 121.4	Bed	8.7	26	High	83.5%	75.9%	68.2%	High	89.5%	77.8%	67.8%

**Table 32: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood D.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood E											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
E 122.1	LKD	41.1	94	Minimum	54.9%	36.2%	11.2%	Minimum	68.2%	28.2%	0.1%
E 122.2	Bed	16.8	36	High	78.1%	67.4%	54.7%	Minimum	67.9%	25.8%	10.7%
E 122.3	Bed	11.9	29	High	78.2%	67.4%	54.3%	Medium	85.9%	67.0%	49.2%
E 122.4	Bed	6.7	15	High	82.7%	74.2%	63.2%	High	87.6%	72.2%	57.3%
E 123.1	LKD	41.1	101	High	74.5%	64.1%	50.9%	Medium	83.5%	64.1%	46.6%
E 123.2	Bed	20.2	52	High	81.7%	73.0%	64.1%	High	88.8%	75.3%	65.0%
E 123.3	Bed	13.7	35	High	78.5%	67.8%	54.7%	Medium	79.5%	50.5%	25.5%
E 123.4	Bed	8.7	26	High	84.0%	76.5%	68.3%	High	89.7%	78.1%	67.5%
E 124.1	LKD	41.4	96	Minimum	56.9%	37.7%	12.2%	Minimum	69.7%	28.4%	0.0%
E 124.2	Bed	16.8	36	High	79.1%	68.8%	56.5%	Minimum	69.8%	26.7%	13.1%
E 124.3	Bed	11.9	29	High	77.3%	65.3%	50.7%	Medium	85.4%	65.6%	47.2%
E 124.4	Bed	6.7	15	High	82.2%	73.5%	62.5%	High	89.5%	76.8%	64.4%
E 125.1	LKD	41.1	101	Medium	73.4%	60.5%	46.3%	Medium	83.3%	62.1%	43.3%
E 125.2	Bed	20.2	52	Medium	75.1%	63.7%	48.3%	Medium	85.4%	66.1%	47.9%
E 125.3	Bed	13.7	35	High	77.9%	66.9%	53.6%	Minimum	79.4%	49.8%	24.9%
E 125.4	Bed	8.7	26	High	80.2%	70.3%	58.0%	High	88.2%	73.8%	59.3%
E 129.1	LKD	41.1	94	Minimum	53.2%	30.7%	6.3%	Minimum	68.2%	25.0%	0.1%
E 129.2	Bed	16.8	36	High	79.1%	69.4%	58.6%	Minimum	71.6%	40.4%	26.8%
E 129.3	Bed	6.7	15	High	82.2%	72.3%	58.5%	High	87.8%	71.7%	53.8%
E 129.3	Bed	11.9	29	High	78.5%	66.7%	50.5%	Medium	85.5%	63.8%	41.8%
E 130.1	LKD	41.1	101	Medium	73.3%	60.4%	47.0%	Medium	83.3%	61.0%	43.2%
E 130.2	Bed	20.2	52	High	81.5%	73.5%	64.0%	High	88.6%	76.0%	64.5%
E 130.3	Bed	13.7	35	Medium	77.2%	65.0%	48.4%	Minimum	78.5%	44.0%	6.9%
E 130.4	Bed	8.7	26	High	82.7%	73.7%	62.4%	High	89.4%	76.4%	63.9%
E 131.1	LKD	41.4	96	Minimum	50.3%	26.0%	1.9%	Minimum	65.4%	19.5%	0.0%
E 131.2	Bed	16.8	36	High	79.5%	70.1%	59.5%	Minimum	75.3%	47.2%	32.6%
E 131.3	Bed	11.9	29	Medium	76.2%	62.7%	45.6%	Medium	85.6%	64.3%	42.5%
E 131.4	Bed	6.7	15	High	81.2%	71.0%	56.1%	High	88.2%	72.6%	55.3%
E 132.1	LKD	41.1	101	Medium	72.4%	58.3%	42.7%	Medium	83.0%	59.7%	40.3%
E 132.2	Bed	20.2	52	High	76.7%	66.2%	55.3%	High	85.5%	67.5%	53.1%
E 132.3	Bed	13.7	35	Medium	77.0%	63.9%	47.6%	Minimum	77.3%	41.3%	3.3%
E 132.4	Bed	8.7	26	Medium	78.1%	66.0%	49.8%	High	87.4%	70.5%	51.8%
E 143.1	LKD	41.1	94	Minimum	55.7%	36.7%	18.0%	Minimum	67.8%	26.6%	0.0%
E 143.2	Bed	16.8	36	Medium	76.4%	62.1%	45.5%	Minimum	66.5%	9.5%	0.3%
E 143.3	Bed	11.9	29	High	79.8%	70.0%	59.9%	High	85.5%	67.5%	53.8%
E 143.4	Bed	6.7	15	High	83.2%	74.8%	66.1%	High	86.8%	72.3%	60.3%
E 144.1	LKD	41.1	101	Medium	72.5%	59.5%	47.6%	Medium	82.7%	59.5%	41.6%
E 144.2	Bed	20.2	52	High	79.9%	69.8%	55.5%	High	88.2%	73.6%	57.9%
E 144.3	Bed	13.7	35	High	79.9%	70.3%	60.0%	Medium	79.9%	54.7%	39.3%
E 144.4	Bed	8.7	26	High	83.7%	76.0%	68.7%	High	89.3%	77.0%	67.4%
E 145.1	LKD	41.4	96	Minimum	55.3%	36.1%	16.0%	Minimum	65.4%	23.6%	0.0%
E 145.2	Bed	16.8	36	Medium	76.2%	61.8%	45.0%	Minimum	73.4%	29.5%	0.7%
E 145.3	Bed	11.9	29	High	78.2%	68.4%	57.8%	High	85.8%	68.4%	54.4%
E 146.1	LKD	41.1	101	Medium	72.4%	59.0%	45.9%	Medium	83.0%	59.8%	41.6%
E 146.2	Bed	20.2	52	Medium	73.5%	57.0%	39.5%	Medium	85.0%	61.7%	39.2%
E 146.3	Bed	13.7	35	High	79.5%	69.8%	59.2%	Medium	81.3%	57.3%	41.3%
E 146.4	Bed	6.7	15	High	82.4%	73.9%	65.0%	High	88.5%	75.0%	63.8%
E 146.4	Bed	8.7	26	High	80.4%	71.3%	61.2%	High	87.5%	73.5%	62.4%

**Table 33: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood E.**

# EN17037:2018 Daylight Provision Room Compliance - Neighbourhood F

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
F 157.1	LKD	41.4	96	Fail	41.2%	15.9%	0.8%	Minimum	53.4%	2.6%	0.0%
F 157.2	Bed	16.8	36	Medium	75.2%	63.1%	48.5%	Minimum	74.6%	39.4%	17.4%
F 157.3	Bed	11.9	29	Medium	73.4%	58.7%	42.6%	Medium	79.9%	51.4%	29.3%
F 157.4	Bed	6.7	15	High	78.4%	67.6%	54.6%	Medium	85.1%	64.6%	47.0%
F 158.1	LKD	41.1	101	Medium	70.4%	53.9%	38.5%	Medium	81.2%	55.1%	34.5%
F 158.2	Bed	20.2	52	Medium	75.0%	63.1%	47.4%	Medium	85.5%	65.7%	47.6%
F 158.3	Bed	13.7	35	High	77.9%	66.4%	52.6%	Minimum	78.0%	46.8%	21.1%
F 158.4	Bed	8.7	26	High	78.7%	68.0%	55.3%	High	86.7%	70.1%	54.6%
F 159.1	LKD	41.1	94	Fail	46.2%	22.4%	0.6%	Minimum	57.8%	5.7%	0.0%
F 159.2	Bed	16.8	36	High	78.5%	67.1%	53.2%	Minimum	73.4%	32.7%	12.7%
F 159.3	Bed	11.9	29	Medium	76.7%	63.9%	48.6%	Medium	79.8%	50.7%	28.4%
F 159.4	Bed	6.7	15	High	80.4%	70.5%	57.4%	Medium	86.0%	66.8%	49.1%
F 160.1	LKD	41.1	101	Medium	72.2%	56.7%	43.5%	Medium	82.9%	57.9%	38.6%
F 160.2	Bed	20.2	52	High	80.4%	70.6%	59.0%	High	88.7%	74.2%	60.9%
F 160.3	Bed	13.7	35	High	77.2%	65.5%	51.8%	Minimum	77.8%	46.4%	20.7%
F 160.4	Bed	8.7	26	High	82.7%	74.2%	62.9%	High	89.5%	77.0%	65.4%
F 166.1	LKD	41.4	96	Fail	43.2%	15.6%	0.1%	Minimum	59.6%	9.6%	0.0%
F 166.2	Bed	16.8	36	Medium	71.4%	58.8%	45.1%	Minimum	60.0%	25.3%	9.0%
F 166.3	Bed	11.9	29	Medium	76.2%	61.8%	44.7%	Medium	85.6%	63.6%	41.1%
F 166.4	Bed	6.7	15	High	81.0%	70.8%	56.1%	High	88.7%	73.9%	56.9%
F 167.1	LKD	41.1	101	Medium	69.0%	53.8%	33.8%	Medium	79.9%	53.4%	29.1%
F 167.2	Bed	20.2	52	High	75.2%	64.2%	52.7%	High	84.7%	65.5%	50.9%
F 167.3	Bed	13.7	35	Medium	77.1%	64.1%	47.3%	Minimum	77.0%	39.8%	2.1%
F 167.4	Bed	8.7	26	High	78.4%	66.8%	50.8%	High	87.6%	71.0%	52.7%
F 168.1	LKD	41.1	94	Fail	45.2%	19.4%	0.3%	Minimum	60.0%	12.4%	0.0%
F 168.2	Bed	16.8	36	Medium	73.4%	61.8%	49.5%	Minimum	68.4%	33.9%	22.9%
F 168.3	Bed	11.9	29	Medium	77.9%	66.1%	49.5%	Medium	85.3%	63.3%	41.4%
F 168.4	Bed	6.7	15	High	81.9%	71.9%	58.5%	High	87.2%	69.9%	50.8%
F 169.1	LKD	41.1	101	Medium	71.2%	57.2%	41.7%	Medium	81.8%	57.2%	35.7%
F 169.2	Bed	20.2	52	High	80.9%	72.5%	63.0%	High	88.1%	74.7%	63.6%
F 169.3	Bed	13.7	35	Medium	76.8%	63.7%	47.3%	Minimum	78.1%	42.7%	3.0%
F 169.4	Bed	8.7	26	High	82.7%	73.2%	61.8%	High	89.0%	75.2%	61.8%
F 173.1	LKD	41.1	94	Minimum	51.0%	32.2%	11.1%	Minimum	59.8%	11.7%	0.0%
F 173.2	Bed	16.8	36	Medium	72.4%	54.9%	37.9%	Minimum	64.7%	8.9%	0.0%
F 173.3	Bed	11.9	29	High	80.3%	71.1%	60.5%	High	85.0%	65.6%	51.6%
F 173.4	Bed	6.7	15	High	82.7%	74.4%	65.5%	High	87.3%	73.2%	61.0%
F 174.1	LKD	41.1	101	Medium	71.2%	58.0%	45.3%	Medium	81.4%	57.1%	36.3%
F 174.2	Bed	20.2	52	High	78.7%	68.5%	54.6%	High	87.2%	71.6%	55.1%
F 174.3	Bed	13.7	35	High	79.3%	69.6%	59.5%	Medium	78.9%	52.7%	37.7%
F 174.4	Bed	8.7	26	High	83.0%	75.1%	67.3%	High	88.8%	76.3%	66.3%
F 175.1	LKD	41.4	96	Fail	49.9%	29.5%	9.1%	Minimum	58.8%	9.0%	0.0%
F 175.2	Bed	16.8	36	Medium	71.6%	54.0%	36.9%	Minimum	60.8%	5.3%	0.0%
F 175.3	Bed	11.9	29	High	77.0%	66.8%	56.3%	Medium	83.7%	63.1%	49.1%
F 175.4	Bed	6.7	15	High	82.2%	73.4%	64.3%	High	87.4%	73.3%	61.6%
F 176.1	LKD	41.1	101	Medium	69.6%	56.0%	42.4%	Medium	80.4%	55.2%	33.7%
F 176.2	Bed	20.2	52	Medium	72.7%	56.1%	38.2%	Medium	84.7%	60.6%	37.4%
F 176.3	Bed	13.7	35	High	79.2%	69.6%	59.0%	Medium	78.0%	51.9%	37.6%
F 176.4	Bed	8.7	26	High	81.2%	72.3%	62.2%	High	87.3%	73.2%	61.7%
F 184.1	LKD	41.4	96	Minimum	52.7%	33.1%	12.8%	Minimum	63.1%	20.5%	0.0%
F 184.2	Bed	16.8	36	Medium	74.8%	58.4%	41.2%	Minimum	67.1%	12.6%	0.2%

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood F											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
F 184.3	Bed	11.9	29	High	77.4%	67.6%	57.3%	High	85.6%	68.4%	54.4%
F 184.4	Bed	6.7	15	High	81.7%	73.1%	63.5%	High	88.8%	75.9%	64.8%
F 185.1	LKD	41.1	101	Medium	71.3%	57.8%	44.2%	Medium	82.4%	58.6%	39.0%
F 185.2	Bed	20.2	52	Medium	72.5%	56.5%	38.3%	Medium	84.7%	60.6%	37.5%
F 185.3	Bed	13.7	35	High	79.3%	69.9%	59.3%	Medium	80.0%	54.6%	39.2%
F 185.4	Bed	8.7	26	High	80.7%	71.8%	61.6%	High	87.1%	72.9%	60.6%
F 186.1	LKD	41.1	94	Minimum	52.8%	33.0%	11.9%	Minimum	63.5%	21.2%	0.0%
F 186.2	Bed	16.8	36	Medium	75.3%	59.6%	42.6%	Minimum	65.0%	5.0%	0.0%
F 186.3	Bed	11.9	29	High	80.5%	71.1%	61.4%	High	85.8%	68.7%	54.5%
F 186.4	Bed	6.7	15	High	83.4%	75.1%	66.9%	High	87.8%	74.4%	62.9%
F 187.1	LKD	41.1	101	Medium	72.6%	59.9%	47.9%	Medium	82.5%	59.3%	41.0%
F 187.2	Bed	20.2	52	High	79.4%	69.9%	55.6%	High	88.2%	73.4%	56.7%
F 187.3	Bed	13.7	35	High	80.0%	70.6%	60.3%	Medium	80.7%	56.3%	40.7%
F 187.4	Bed	8.7	26	High	83.3%	76.0%	68.2%	High	89.5%	78.0%	67.8%

**Table 34: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood F.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood G											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
G 188.1	LKD	41.1	94	Fail	47.9%	30.2%	8.1%	Minimum	62.6%	22.1%	0.0%
G 188.2	Bed	16.8	36	High	76.9%	65.7%	52.1%	Minimum	68.5%	26.3%	9.2%
G 188.3	Bed	11.9	29	Medium	76.3%	64.0%	49.8%	Medium	83.3%	60.4%	43.0%
G 188.4	Bed	6.7	15	High	80.5%	71.5%	60.7%	High	88.0%	73.4%	58.4%
G 189.1	LKD	41.1	101	Medium	71.8%	58.9%	46.2%	Medium	81.8%	58.4%	40.6%
G 189.2	Bed	8.7	26	High	83.1%	75.4%	66.7%	High	89.2%	76.8%	65.8%
G 189.2	Bed	13.7	35	High	78.2%	67.5%	55.0%	Minimum	78.3%	48.5%	25.5%
G 189.2	Bed	20.2	52	High	81.0%	72.3%	63.3%	High	88.6%	75.1%	64.3%
G 190.1	LKD	41.4	96	Fail	44.7%	23.6%	5.0%	Minimum	58.6%	15.0%	0.0%
G 190.2	Bed	16.8	36	High	77.2%	66.1%	52.8%	Minimum	70.8%	29.6%	13.6%
G 190.3	Bed	11.9	29	Medium	72.6%	59.0%	44.2%	Medium	80.0%	53.3%	34.1%
G 190.4	Bed	6.7	15	High	78.4%	67.8%	55.2%	High	86.8%	71.0%	55.5%
G 191.1	LKD	41.1	101	Medium	69.4%	52.9%	38.7%	Medium	79.5%	52.6%	34.0%
G 191.2	Bed	20.2	52	Medium	74.7%	63.1%	48.7%	Medium	84.9%	64.2%	46.0%
G 191.3	Bed	13.7	35	High	77.3%	65.9%	52.8%	Minimum	77.6%	47.6%	24.3%
G 191.4	Bed	8.7	26	High	79.1%	69.3%	57.0%	High	87.8%	73.6%	59.2%
G 195.1	LKD	41.1	94	Fail	48.4%	22.8%	0.5%	Minimum	62.1%	16.8%	0.0%
G 195.2	Bed	16.8	36	High	75.3%	64.1%	53.0%	Minimum	70.3%	37.4%	23.6%
G 195.3	Bed	11.9	29	High	78.8%	67.3%	51.2%	Medium	85.4%	63.2%	40.7%
G 195.4	Bed	6.7	15	High	82.6%	72.3%	58.9%	High	87.5%	70.4%	51.4%
G 196.1	LKD	41.1	101	Medium	71.4%	57.5%	43.3%	Medium	82.1%	57.8%	37.8%
G 196.2	Bed	20.2	52	High	80.8%	72.4%	62.5%	High	88.4%	75.5%	63.6%
G 196.3	Bed	13.7	35	Medium	76.4%	62.7%	46.0%	Minimum	78.4%	42.6%	5.7%
G 196.4	Bed	8.7	26	High	82.5%	73.2%	61.6%	High	89.1%	75.8%	62.2%
G 197.1	LKD	41.4	96	Fail	45.4%	20.8%	0.3%	Minimum	60.5%	13.8%	0.0%
G 197.2	Bed	16.8	36	High	74.7%	63.5%	53.3%	Minimum	72.6%	40.5%	25.2%
G 197.3	Bed	11.9	29	Medium	75.9%	61.6%	43.8%	Medium	85.4%	63.2%	40.3%
G 197.4	Bed	6.7	15	High	80.9%	70.8%	55.7%	High	87.9%	71.6%	53.5%



EN17037:2018 Daylight Provision Room Compliance - Neighbourhood G											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
G 198.1	LKD	41.1	101	Medium	70.3%	55.7%	37.6%	Medium	81.7%	57.2%	34.3%
G 198.2	Bed	20.2	52	High	75.9%	65.2%	54.6%	High	84.8%	65.7%	51.4%
G 198.3	Bed	13.7	35	Medium	76.9%	64.0%	47.3%	Minimum	78.0%	42.1%	2.7%
G 198.4	Bed	8.7	26	High	78.8%	67.7%	51.5%	High	87.3%	69.9%	50.9%
G 207.1	LKD	41.1	94	Fail	45.9%	25.2%	7.4%	Minimum	60.9%	13.7%	0.0%
G 207.2	Bed	16.8	36	Medium	76.0%	61.3%	45.4%	Minimum	71.1%	19.7%	0.0%
G 207.3	Bed	11.9	29	High	76.3%	65.6%	55.1%	Medium	83.1%	61.7%	46.8%
G 207.4	Bed	6.7	15	High	80.3%	71.1%	61.3%	High	87.1%	72.4%	59.7%
G 208.1	LKD	41.1	101	Medium	70.8%	57.9%	44.6%	Medium	81.6%	57.5%	36.5%
G 208.2	Bed	20.2	52	High	80.1%	69.8%	56.0%	High	88.3%	73.7%	58.4%
G 208.3	Bed	13.7	35	High	79.6%	70.0%	59.7%	Medium	80.0%	54.5%	38.1%
G 208.4	Bed	8.7	26	High	83.1%	75.0%	67.4%	High	89.5%	77.4%	67.9%
G 209.1	LKD	27.3	68	Minimum	54.1%	30.5%	0.7%	Minimum	71.2%	24.4%	0.0%
G 209.2	Bed	12.1	36	Medium	65.0%	51.0%	36.5%	Minimum	75.3%	46.0%	29.5%
G 210.1	LKD	43.6	110	Minimum	61.9%	46.4%	29.0%	Minimum	76.5%	46.6%	22.5%
G 210.1	LKD	43.6	110	Minimum	61.4%	45.2%	27.0%	Minimum	75.4%	43.4%	17.7%
G 210.1	LKD	43.6	110	Minimum	60.7%	44.1%	26.5%	Minimum	76.2%	44.5%	18.7%
G 210.2	Bed	19.3	46	Medium	72.9%	56.4%	38.5%	Medium	83.5%	56.5%	32.6%
G 210.3	Bed	15.1	43	Medium	72.0%	59.8%	47.8%	Minimum	73.1%	42.9%	28.7%
G 210.4	Bed	9.0	27	High	76.2%	65.4%	54.9%	High	85.5%	67.4%	53.3%
G 211.1	LKD	27.3	68	Minimum	57.1%	32.9%	1.2%	Minimum	72.1%	24.8%	0.0%
G 211.2	Bed	12.1	36	Minimum	61.5%	46.4%	33.4%	Minimum	72.6%	39.8%	22.9%
G 212.2	Bed	19.3	46	Medium	73.1%	56.1%	38.4%	Medium	84.5%	59.0%	35.9%
G 212.3	Bed	15.1	43	Medium	71.8%	60.0%	47.8%	Minimum	72.6%	41.1%	25.3%
G 212.4	Bed	9.0	27	High	76.8%	66.3%	55.5%	High	85.9%	68.9%	54.9%
G 213.1	LKD	27.3	68	Minimum	58.5%	34.6%	1.3%	Minimum	72.1%	25.2%	0.0%
G 213.2	Bed	12.1	36	Minimum	61.8%	45.6%	33.0%	Minimum	71.7%	38.6%	24.0%
G 214.2	Bed	19.3	46	Medium	73.2%	56.1%	38.9%	Medium	84.2%	58.6%	35.2%
G 214.3	Bed	15.1	43	Medium	70.7%	58.1%	45.5%	Minimum	72.9%	41.8%	26.5%
G 214.4	Bed	9.0	27	High	76.3%	65.7%	55.3%	High	85.6%	67.7%	53.8%
G 215.1	LKD	41.1	94	Fail	41.1%	20.7%	3.9%	Minimum	54.7%	5.6%	0.0%
G 215.2	Bed	16.8	36	Medium	74.0%	58.4%	41.4%	Minimum	61.8%	4.5%	0.0%
G 215.3	Bed	11.9	29	High	75.8%	65.3%	54.8%	Medium	80.9%	57.8%	41.8%
G 215.4	Bed	6.7	15	High	80.5%	71.1%	60.9%	High	85.9%	69.0%	54.8%
G 216.1	LKD	41.1	101	Medium	70.7%	57.1%	43.9%	Medium	80.8%	55.4%	33.3%
G 216.2	Bed	20.2	52	High	79.1%	69.2%	54.4%	High	87.7%	72.5%	56.1%
G 216.3	Bed	13.7	35	High	79.8%	70.1%	60.3%	Medium	78.4%	51.8%	36.9%
G 216.4	Bed	8.7	26	High	83.2%	75.6%	67.3%	High	89.0%	77.0%	65.9%

**Table 35: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood G.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood H											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
H 217.1	LKD	41.1	94	Minimum	50.4%	30.4%	9.8%	Minimum	63.0%	21.9%	0.1%
H 217.2	Bed	16.8	36	High	76.3%	65.4%	51.1%	Minimum	70.8%	31.1%	8.9%
H 217.3	Bed	11.9	29	High	78.3%	68.0%	56.4%	Medium	81.5%	58.5%	40.8%
H 217.4	Bed	6.7	15	High	80.3%	71.8%	61.6%	High	86.0%	69.9%	56.0%
H 218.1	LKD	41.1	101	Medium	72.6%	60.6%	48.2%	Medium	81.7%	59.8%	42.0%
H 218.2	Bed	20.2	52	High	81.1%	72.1%	62.9%	High	88.9%	75.3%	64.5%
H 218.3	Bed	13.7	35	High	77.9%	67.0%	56.1%	Minimum	76.7%	47.7%	23.8%
H 218.4	Bed	8.7	26	High	83.2%	75.9%	67.6%	High	89.0%	77.1%	66.4%
H 219.1	LKD	41.4	96	Minimum	50.3%	29.0%	6.7%	Minimum	62.3%	17.5%	0.0%
H 219.2	Bed	16.8	36	High	77.1%	65.8%	51.4%	Minimum	69.5%	34.9%	7.0%
H 219.3	Bed	11.9	29	High	75.2%	63.0%	50.0%	Medium	82.5%	59.4%	41.5%
H 219.4	Bed	6.7	15	High	79.8%	70.7%	60.2%	High	86.0%	69.0%	54.5%
H 220.1	LKD	41.1	101	Medium	70.6%	56.4%	42.5%	Medium	80.9%	56.2%	36.9%
H 220.2	Bed	20.2	52	Medium	74.9%	62.5%	46.9%	Medium	84.9%	64.2%	45.6%
H 220.3	Bed	13.7	35	High	78.4%	68.0%	56.7%	Minimum	76.1%	45.7%	23.3%
H 220.4	Bed	8.7	26	High	79.7%	70.1%	58.9%	High	86.7%	71.6%	57.8%
H 225.1	LKD	41.1	94	Minimum	58.6%	38.8%	21.3%	Minimum	70.1%	31.1%	0.8%
H 225.2	Bed	16.8	36	Medium	76.1%	62.8%	46.8%	Minimum	63.5%	11.8%	0.6%
H 225.3	Bed	11.9	29	High	80.5%	71.9%	62.0%	High	86.3%	70.6%	57.8%
H 225.4	Bed	6.7	15	High	84.6%	76.7%	68.9%	High	87.9%	73.9%	62.2%
H 226.1	LKD	41.1	101	Medium	73.1%	60.9%	48.0%	Medium	82.5%	59.9%	41.0%
H 226.2	Bed	20.2	52	High	78.6%	68.5%	54.5%	High	87.6%	72.0%	56.0%
H 226.3	Bed	13.7	35	High	80.0%	71.0%	60.6%	Medium	81.2%	58.2%	39.6%
H 226.4	Bed	8.7	26	High	84.6%	76.8%	69.0%	High	90.1%	78.4%	69.0%
H 227.1	LKD	41.4	96	Minimum	58.4%	39.2%	21.3%	Minimum	69.2%	29.3%	1.4%
H 227.2	Bed	16.8	36	Medium	76.3%	63.9%	48.9%	Minimum	70.8%	22.2%	1.1%
H 227.3	Bed	11.9	29	High	78.3%	68.9%	59.0%	High	86.2%	70.3%	57.1%
H 227.4	Bed	6.7	15	High	83.1%	74.6%	66.2%	High	89.0%	75.8%	65.2%
H 228.1	LKD	41.1	101	Medium	71.8%	59.5%	45.3%	Medium	82.6%	60.1%	41.6%
H 228.2	Bed	20.2	52	Medium	72.5%	57.2%	40.0%	Medium	84.2%	59.8%	38.4%
H 228.3	Bed	13.7	35	High	79.8%	70.9%	60.4%	Medium	80.9%	57.7%	38.9%
H 228.4	Bed	8.7	26	High	80.1%	71.6%	61.8%	High	88.1%	74.2%	62.6%
H 233.1	LKD	41.4	96	Minimum	59.0%	40.2%	21.3%	Minimum	69.1%	31.1%	1.7%
H 233.2	Bed	16.8	36	Medium	76.6%	64.2%	49.0%	Minimum	73.8%	33.2%	3.6%
H 233.3	Bed	11.9	29	High	78.7%	69.3%	59.5%	High	86.3%	70.8%	57.6%
H 233.4	Bed	6.7	15	High	82.2%	73.4%	64.7%	High	89.1%	76.3%	65.9%
H 234.1	LKD	41.1	101	Medium	72.9%	60.8%	47.7%	Medium	82.5%	60.6%	42.6%
H 234.2	Bed	20.2	52	Medium	72.9%	57.6%	40.7%	Medium	83.7%	59.5%	38.9%
H 234.3	Bed	13.7	35	High	79.9%	70.8%	60.5%	Medium	80.8%	57.7%	38.2%
H 234.4	Bed	8.7	26	High	80.4%	71.8%	62.0%	High	87.7%	73.7%	62.3%
H 235.1	LKD	41.1	94	Minimum	59.3%	40.1%	22.0%	Minimum	68.9%	30.5%	1.0%
H 235.2	Bed	16.8	36	Medium	76.1%	63.0%	47.7%	Minimum	66.6%	13.3%	1.9%
H 235.3	Bed	11.9	29	High	80.7%	71.7%	61.6%	High	86.1%	70.1%	57.1%
H 235.4	Bed	6.7	15	High	83.7%	75.5%	67.5%	High	88.0%	74.2%	62.8%
H 236.1	LKD	41.1	101	High	73.9%	62.3%	50.8%	Medium	83.2%	61.9%	45.2%
H 236.2	Bed	20.2	52	High	79.4%	69.8%	58.4%	High	88.0%	73.1%	59.2%
H 236.3	Bed	13.7	35	High	80.1%	71.3%	60.9%	Medium	81.4%	58.4%	40.1%
H 236.4	Bed	8.7	26	High	84.2%	77.0%	69.8%	High	89.6%	78.2%	68.5%

**Table 36: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood H.**

# EN17037:2018 Daylight Provision Room Compliance - Neighbourhood J

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
J 050.2	Bed	20.2	52	Medium	74.2%	61.0%	46.1%	Medium	84.5%	62.7%	44.2%
J 050.3	Bed	13.7	35	High	76.8%	65.0%	52.8%	Minimum	78.3%	49.3%	26.6%
J 050.4	Bed	8.7	26	High	78.2%	67.4%	55.7%	High	87.3%	72.6%	59.0%
J 052.2	Bed	20.2	52	High	79.9%	70.0%	56.8%	High	87.7%	73.1%	57.6%
J 052.3	Bed	13.7	35	High	78.5%	67.7%	56.1%	Medium	78.8%	50.0%	27.1%
J 052.4	Bed	8.7	26	High	82.7%	74.2%	64.2%	High	89.3%	76.6%	64.7%
J 054.2	Bed	20.2	52	High	81.1%	72.9%	63.3%	High	88.1%	75.0%	63.3%
J 054.3	Bed	13.7	35	Medium	76.9%	64.9%	49.5%	Minimum	76.9%	42.9%	8.2%
J 054.4	Bed	8.7	26	High	82.3%	73.1%	62.1%	High	88.8%	75.2%	61.8%
J 060.1	Bed	20.2	52	High	81.9%	73.4%	64.3%	High	88.2%	75.0%	64.5%
J 060.2	Bed	13.7	35	Medium	76.5%	63.9%	48.5%	Minimum	77.6%	44.7%	13.4%
J 060.3	Bed	8.7	26	High	82.4%	73.4%	62.4%	High	89.5%	76.2%	64.4%
J 062.1	Bed	20.2	52	High	80.4%	71.3%	59.1%	High	88.4%	74.3%	60.6%
J 062.2	Bed	13.7	35	High	75.4%	64.3%	50.6%	Minimum	73.1%	38.0%	12.7%
J 062.3	Bed	8.7	26	High	81.3%	72.1%	61.1%	High	88.1%	73.7%	60.5%
J 068.1	Bed	20.2	52	High	81.1%	73.1%	63.8%	High	88.3%	75.3%	63.6%
J 068.2	Bed	13.7	35	High	77.3%	67.5%	55.2%	Minimum	76.2%	46.8%	22.9%
J 068.3	Bed	8.7	26	High	83.5%	75.2%	67.8%	High	88.9%	75.8%	65.7%
J 237.1	LKD	41.1	94	Fail	47.9%	27.2%	4.7%	Minimum	62.6%	16.3%	0.0%
J 237.2	Bed	16.8	36	High	78.3%	67.1%	51.6%	Minimum	73.9%	33.5%	12.4%
J 237.2	Bed	20.2	52	High	81.3%	72.1%	62.9%	High	88.7%	74.9%	63.9%
J 237.3	Bed	11.9	29	High	74.6%	62.4%	50.0%	Medium	79.0%	53.5%	33.9%
J 237.3	Bed	13.7	35	High	77.9%	67.3%	55.6%	Minimum	76.9%	47.9%	24.8%
J 237.4	Bed	6.7	15	High	77.9%	67.8%	57.5%	Medium	83.9%	62.7%	48.9%
J 237.4	Bed	8.7	26	High	83.4%	76.1%	67.7%	High	89.1%	77.2%	66.4%
J 238.1	LKD	41.1	101	Medium	71.8%	59.7%	46.8%	Medium	82.0%	60.0%	41.3%
J 239.1	LKD	41.4	96	Fail	47.6%	26.4%	4.3%	Minimum	60.6%	12.8%	0.0%
J 239.2	Bed	16.8	36	Medium	76.7%	64.7%	49.1%	Minimum	76.1%	42.0%	17.2%
J 239.2	Bed	20.2	52	Medium	74.5%	61.3%	45.3%	Medium	85.8%	65.8%	46.8%
J 239.3	Bed	11.9	29	Medium	74.4%	61.9%	47.5%	Medium	83.2%	60.2%	42.6%
J 239.3	Bed	13.7	35	High	77.6%	66.8%	55.0%	Minimum	78.1%	49.3%	25.7%
J 239.4	Bed	6.7	15	High	77.8%	67.4%	56.2%	Medium	85.1%	64.9%	49.5%
J 239.4	Bed	8.7	26	High	79.5%	69.9%	58.3%	High	86.5%	70.8%	56.8%
J 240.1	LKD	41.1	101	Medium	70.9%	56.4%	42.3%	Medium	81.8%	57.7%	38.0%
J 249.1	LKD	41.4	96	Fail	47.9%	27.5%	6.6%	Minimum	61.3%	18.3%	0.0%
J 249.2	Bed	16.8	36	High	76.8%	65.7%	51.1%	Minimum	68.4%	27.3%	5.4%
J 249.3	Bed	11.9	29	High	75.1%	63.0%	50.2%	Medium	83.4%	61.6%	42.7%
J 249.4	Bed	6.7	15	High	80.3%	70.7%	60.1%	High	88.3%	74.3%	60.8%
J 250.1	LKD	41.1	101	Medium	69.6%	54.0%	39.7%	Medium	80.5%	54.4%	34.7%
J 251.1	LKD	41.1	94	Fail	46.8%	25.8%	7.1%	Minimum	61.8%	15.7%	0.3%
J 251.2	Bed	16.8	36	Medium	73.6%	58.7%	45.0%	Minimum	67.2%	23.3%	4.6%
J 251.3	Bed	11.9	29	High	78.0%	67.2%	54.8%	Medium	84.8%	64.9%	47.6%
J 251.4	Bed	6.7	15	High	81.2%	72.2%	61.7%	High	88.0%	72.9%	58.8%
J 252.1	LKD	41.1	101	Medium	69.8%	54.5%	39.7%	Medium	80.5%	53.9%	33.3%
J 253.1	LKD	41.1	94	Fail	44.0%	23.1%	6.6%	Minimum	58.1%	14.3%	0.0%
J 253.2	Bed	16.8	36	High	77.8%	67.5%	56.9%	Minimum	69.2%	37.5%	25.9%
J 253.3	Bed	11.9	29	Medium	74.1%	59.8%	43.8%	Medium	79.3%	50.4%	26.5%
J 253.4	Bed	6.7	15	High	78.5%	67.5%	53.3%	Medium	85.5%	63.8%	44.3%
J 254.1	LKD	41.1	101	Medium	70.4%	56.7%	42.3%	Medium	80.7%	56.5%	36.0%
J 255.1	LKD	27.3	68	Medium	68.9%	55.6%	44.3%	Minimum	76.0%	49.6%	35.0%

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood J											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
J 255.2	Bed	12.1	36	Minimum	58.3%	38.7%	13.1%	Minimum	71.2%	31.4%	2.4%
J 256.1	LKD	43.6	110	Minimum	62.6%	47.6%	31.8%	Medium	77.7%	50.7%	30.0%
J 256.2	Bed	19.3	46	High	76.9%	66.8%	55.8%	High	85.3%	66.9%	52.6%
J 256.3	Bed	15.1	43	Medium	68.6%	50.6%	31.5%	Minimum	70.8%	24.9%	0.3%
J 256.4	Bed	9.0	27	Medium	74.7%	60.6%	44.1%	Medium	84.8%	62.5%	42.2%
J 257.1	LKD	27.3	68	Medium	69.9%	57.3%	46.0%	Medium	78.8%	53.8%	39.1%
J 257.2	Bed	12.1	36	Minimum	58.2%	38.3%	12.0%	Minimum	68.3%	25.5%	1.7%
J 258.1	LKD	43.6	110	Medium	64.8%	50.1%	33.4%	Medium	78.3%	52.2%	31.3%
J 258.2	Bed	19.3	46	High	77.7%	67.8%	57.4%	High	85.7%	68.3%	54.5%
J 258.3	Bed	15.1	43	Medium	68.5%	50.2%	30.3%	Minimum	71.3%	26.5%	0.2%
J 258.4	Bed	9.0	27	Medium	74.3%	59.9%	43.7%	Medium	85.3%	64.2%	44.2%
J 259.1	LKD	41.1	94	Fail	48.8%	27.0%	8.9%	Minimum	62.1%	22.2%	0.0%
J 259.2	Bed	16.8	36	High	79.7%	70.4%	60.4%	Minimum	74.0%	46.1%	31.9%
J 259.3	Bed	11.9	29	Medium	75.0%	61.1%	45.7%	Medium	80.3%	53.3%	29.5%
J 259.4	Bed	6.7	15	High	78.3%	67.4%	53.3%	Medium	86.4%	67.7%	49.0%
J 260.1	LKD	41.1	101	Medium	72.0%	58.9%	45.3%	Medium	82.4%	59.0%	40.9%
J 261.1	LKD	41.1	94	Fail	45.8%	22.0%	2.2%	Minimum	59.2%	11.5%	0.0%
J 261.2	Bed	16.8	36	High	77.2%	66.1%	52.8%	Minimum	70.8%	31.9%	13.0%
J 261.3	Bed	11.9	29	High	75.5%	64.0%	50.6%	Medium	78.5%	51.9%	30.2%
J 261.4	Bed	6.7	15	High	77.0%	66.3%	53.4%	Medium	85.4%	66.0%	48.3%
J 262.1	LKD	41.1	101	Medium	69.1%	53.4%	38.0%	Medium	79.5%	52.4%	32.1%
J 263.1	LKD	27.3	68	Minimum	64.7%	46.9%	28.2%	Minimum	76.1%	43.7%	20.6%
J 263.2	Bed	12.1	36	Minimum	64.7%	49.1%	30.9%	Minimum	75.6%	46.1%	22.8%
J 264.1	LKD	43.6	110	Minimum	63.7%	48.0%	32.7%	Minimum	77.8%	49.9%	29.0%
J 264.2	Bed	19.3	46	Medium	76.0%	63.7%	49.5%	Medium	84.3%	63.7%	45.8%
J 264.3	Bed	15.1	43	Medium	70.8%	57.0%	40.4%	Minimum	69.4%	34.4%	8.6%
J 264.4	Bed	9.0	27	Medium	74.5%	63.1%	49.2%	Medium	83.6%	62.5%	45.5%
J 265.1	LKD	27.3	68	Minimum	66.1%	49.1%	31.0%	Minimum	76.7%	44.5%	23.1%
J 265.2	Bed	12.1	36	Minimum	63.8%	48.1%	30.7%	Minimum	73.6%	42.6%	20.7%
J 266.1	LKD	43.6	110	Minimum	64.3%	49.4%	34.8%	Medium	77.7%	50.4%	31.2%
J 266.2	Bed	19.3	46	Medium	75.3%	62.9%	48.6%	Medium	84.8%	64.9%	47.4%
J 266.3	Bed	15.1	43	Medium	69.0%	54.7%	38.7%	Minimum	69.2%	33.7%	6.1%
J 266.4	Bed	9.0	27	High	75.0%	64.3%	51.3%	High	85.9%	68.5%	53.2%
J 267.1	LKD	41.1	94	Minimum	53.3%	34.7%	11.4%	Minimum	65.5%	26.4%	0.1%
J 267.2	Bed	16.8	36	High	77.9%	66.6%	54.0%	Minimum	72.7%	34.8%	17.1%
J 267.3	Bed	11.9	29	High	75.6%	65.5%	52.3%	Medium	84.2%	64.1%	46.5%
J 267.4	Bed	6.7	15	High	79.8%	71.0%	60.8%	High	88.0%	73.1%	60.8%
J 268.1	LKD	41.1	101	Medium	72.9%	61.0%	48.7%	Medium	82.4%	61.5%	43.8%

**Table 37: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood J.**

# EN17037:2018 Daylight Provision Room Compliance - Neighbourhood L

Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
L 278.1	LKD	41.1	94	Minimum	52.2%	27.4%	4.6%	Minimum	67.7%	22.3%	0.0%
L 278.2	Bed	16.8	36	High	77.7%	68.1%	56.9%	Minimum	71.9%	39.4%	26.1%
L 278.3	Bed	11.9	29	Medium	78.0%	65.5%	49.4%	Medium	85.8%	64.4%	42.6%
L 278.4	Bed	6.7	15	High	83.0%	73.0%	60.8%	High	87.7%	71.4%	53.4%
L 279.1	LKD	41.1	101	Medium	73.1%	59.6%	45.9%	Medium	83.0%	59.9%	41.1%
L 279.2	Bed	20.2	52	High	81.5%	73.4%	63.4%	High	88.2%	75.3%	63.5%
L 279.3	Bed	13.7	35	Medium	77.5%	65.1%	49.0%	Minimum	78.6%	44.2%	5.2%
L 279.4	Bed	8.7	26	High	83.0%	74.2%	62.9%	High	89.5%	76.6%	64.1%
L 280.1	LKD	41.4	96	Fail	48.5%	24.2%	1.6%	Minimum	65.2%	17.6%	0.0%
L 280.2	Bed	16.8	36	High	76.8%	66.4%	56.1%	Minimum	74.3%	45.5%	28.6%
L 280.3	Bed	11.9	29	Medium	76.6%	62.9%	46.0%	Medium	85.8%	64.5%	42.8%
L 280.4	Bed	6.7	15	High	80.8%	70.5%	55.7%	High	88.5%	73.8%	57.0%
L 281.1	LKD	41.1	101	Medium	70.7%	56.5%	39.5%	Medium	82.0%	57.7%	35.6%
L 281.2	Bed	20.2	52	High	76.1%	65.6%	54.4%	High	85.0%	66.3%	51.9%
L 281.2	Bed	8.7	26	High	78.3%	66.5%	50.3%	High	87.1%	69.4%	50.6%
L 281.2	Bed	13.7	35	Medium	77.2%	64.0%	47.6%	Minimum	78.0%	42.2%	4.7%
L 281.2	Bed	20.2	52	High	76.2%	65.6%	54.8%	High	85.6%	68.3%	54.3%
L 281.3	Bed	13.7	35	Medium	77.3%	64.1%	47.8%	Minimum	77.4%	41.7%	4.2%
L 281.4	Bed	8.7	26	High	78.4%	66.7%	50.5%	High	87.4%	70.5%	52.0%
L 288.1	LKD	41.4	96	Minimum	50.9%	28.7%	3.4%	Minimum	66.3%	22.4%	0.0%
L 289.1	LKD	41.1	101	Medium	72.0%	57.7%	42.3%	Medium	83.2%	59.8%	40.7%
L 289.2	Bed	16.8	36	High	79.0%	69.4%	58.7%	Minimum	68.9%	37.6%	23.8%
L 289.3	Bed	11.9	29	Medium	75.8%	60.3%	43.0%	Medium	85.6%	63.9%	41.6%
L 289.4	Bed	6.7	15	High	80.5%	70.1%	55.0%	High	89.0%	74.8%	58.6%
L 290.1	LKD	41.1	94	Fail	49.2%	25.2%	1.1%	Minimum	66.0%	21.3%	0.0%
L 290.2	Bed	16.8	36	High	77.2%	67.4%	57.0%	Minimum	75.1%	48.1%	33.8%
L 290.3	Bed	11.9	29	Medium	77.2%	64.1%	47.2%	Medium	85.8%	64.5%	42.6%
L 290.4	Bed	6.7	15	High	81.1%	70.8%	56.2%	High	87.4%	70.7%	51.8%
L 291.1	LKD	41.1	101	Medium	72.6%	59.4%	46.3%	Medium	83.3%	60.6%	43.2%
L 291.2	Bed	20.2	52	High	81.4%	72.9%	63.9%	High	88.8%	76.0%	65.5%
L 291.3	Bed	13.7	35	Medium	77.6%	65.1%	48.7%	Minimum	78.4%	42.8%	5.6%
L 291.4	Bed	8.7	26	High	83.1%	73.9%	62.7%	High	89.0%	75.1%	62.3%
L 297.1	LKD	41.1	94	Minimum	57.8%	40.8%	23.2%	Minimum	68.7%	29.7%	0.5%
L 297.2	Bed	16.8	36	Medium	76.2%	62.4%	45.1%	Minimum	65.8%	6.0%	0.0%
L 297.3	Bed	11.9	29	High	80.9%	72.1%	62.0%	High	86.1%	69.7%	56.0%
L 297.4	Bed	6.7	15	High	84.1%	76.8%	68.8%	High	88.1%	74.6%	63.1%
L 298.1	LKD	41.1	101	Medium	73.7%	61.8%	49.9%	Medium	83.2%	60.9%	44.4%
L 298.2	Bed	20.2	52	High	80.2%	70.2%	57.0%	High	87.9%	73.2%	58.3%
L 298.3	Bed	13.7	35	High	79.7%	70.2%	60.0%	Medium	81.1%	57.6%	41.2%
L 298.4	Bed	8.7	26	High	84.0%	76.6%	69.3%	High	89.4%	77.2%	67.6%
L 299.1	LKD	41.4	96	Minimum	56.5%	38.8%	20.6%	Minimum	69.0%	29.2%	1.2%
L 299.2	Bed	16.8	36	Medium	77.2%	64.1%	47.2%	Minimum	70.4%	20.6%	0.0%
L 299.3	Bed	11.9	29	High	78.0%	68.0%	57.7%	High	86.1%	69.5%	55.3%
L 299.4	Bed	6.7	15	High	82.7%	74.6%	66.2%	High	88.9%	76.4%	65.6%
L 300.1	LKD	41.1	101	Medium	72.2%	58.7%	46.2%	Medium	83.3%	60.6%	43.8%
L 300.2	Bed	20.2	52	Medium	73.0%	56.5%	38.6%	Medium	84.9%	62.0%	39.8%
L 300.3	Bed	13.7	35	High	79.9%	70.6%	59.9%	Medium	79.9%	54.6%	39.5%
L 300.4	Bed	8.7	26	High	80.5%	71.6%	61.8%	High	87.6%	73.9%	62.3%
L 301.1	LKD	27.3	68	Minimum	60.1%	36.6%	5.3%	Minimum	75.0%	31.6%	0.5%
L 301.2	Bed	12.1	36	Medium	71.3%	58.8%	47.3%	Medium	80.5%	56.8%	40.9%



EN17037:2018 Daylight Provision Room Compliance - Neighbourhood L											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
L 302.1	LKD	43.6	110	Medium	68.1%	53.7%	39.6%	Medium	81.1%	55.5%	34.4%
L 303.1	LKD	27.3	68	Minimum	58.9%	34.8%	2.9%	Minimum	72.9%	27.1%	0.0%
L 303.2	Bed	12.1	36	Medium	72.9%	60.7%	49.0%	Medium	82.0%	59.3%	43.2%
L 304.1	LKD	43.6	110	Medium	68.3%	53.5%	37.8%	Medium	80.9%	55.7%	34.2%
L 305.1	LKD	41.4	96	Minimum	53.7%	34.0%	11.8%	Minimum	64.9%	22.3%	0.1%
L 305.2	Bed	16.8	36	Medium	76.5%	62.8%	46.4%	Minimum	76.0%	35.3%	0.6%
L 305.3	Bed	11.9	29	High	76.8%	66.6%	56.0%	High	85.2%	66.4%	52.3%
L 305.4	Bed	6.7	15	High	80.6%	71.8%	62.2%	High	85.9%	68.9%	55.8%
L 306.1	LKD	41.1	101	Medium	70.7%	56.7%	42.5%	Medium	82.1%	57.9%	38.3%
L 306.2	Bed	20.2	52	Medium	74.0%	57.9%	40.7%	Medium	85.1%	62.4%	40.3%
L 306.3	Bed	13.7	35	High	78.3%	68.7%	58.5%	Medium	77.3%	51.9%	36.7%
L 306.4	Bed	8.7	26	High	78.6%	69.4%	59.5%	High	86.3%	71.1%	58.3%
L 307.1	LKD	41.1	94	Minimum	52.2%	30.7%	9.1%	Minimum	63.5%	19.2%	0.0%
L 307.2	Bed	16.8	36	Medium	76.6%	63.1%	46.6%	Minimum	75.2%	33.8%	0.3%
L 307.3	Bed	11.9	29	High	76.7%	66.5%	56.0%	Medium	81.5%	58.8%	42.6%
L 307.4	Bed	6.7	15	High	80.3%	71.6%	60.9%	Medium	83.4%	62.1%	48.0%
L 308.1	LKD	41.1	101	Medium	70.7%	57.0%	42.6%	Medium	81.6%	57.3%	36.3%
L 308.2	Bed	20.2	52	High	80.2%	70.5%	55.9%	High	88.4%	73.5%	56.8%
L 308.3	Bed	13.7	35	High	76.6%	66.3%	56.3%	Minimum	75.2%	49.1%	32.8%
L 308.4	Bed	8.7	26	High	82.2%	74.5%	65.5%	High	87.0%	73.5%	61.6%

**Table 38: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood L.**

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood M											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
M 302.2	Bed	19.3	46	Medium	74.2%	57.8%	40.5%	Medium	85.0%	61.7%	38.4%
M 302.3	Bed	15.1	43	High	74.0%	62.1%	50.5%	Minimum	75.5%	47.8%	32.5%
M 302.4	Bed	9.0	27	High	78.2%	68.7%	58.7%	High	86.6%	71.7%	59.5%
M 304.2	Bed	19.3	46	Medium	74.6%	58.7%	41.2%	Medium	84.5%	59.0%	36.5%
M 304.3	Bed	15.1	43	High	74.4%	63.3%	51.7%	Minimum	77.1%	49.7%	35.1%
M 304.4	Bed	9.0	27	High	77.2%	67.3%	57.2%	High	86.0%	69.5%	55.9%
M 309.1	LKD	41.1	94	Minimum	56.5%	38.5%	13.6%	Minimum	68.9%	28.9%	0.0%
M 309.2	Bed	16.8	36	High	81.4%	71.7%	61.7%	Minimum	75.0%	41.2%	21.2%
M 309.2	Bed	6.7	15	High	81.9%	72.7%	60.3%	High	88.9%	75.0%	61.1%
M 309.2	Bed	11.9	29	Medium	76.6%	63.5%	48.9%	Medium	85.5%	65.1%	45.6%
M 309.2	Bed	16.8	36	Medium	75.0%	63.0%	48.3%	Minimum	74.7%	40.4%	17.0%
M 309.3	Bed	11.9	29	High	76.9%	65.3%	51.3%	Medium	82.8%	60.0%	39.9%
M 309.4	Bed	6.7	15	High	81.0%	71.7%	59.9%	High	86.3%	68.9%	51.4%
M 310.1	LKD	41.1	101	High	74.5%	64.2%	51.3%	Medium	83.8%	64.4%	47.9%
M 310.2	Bed	20.2	52	High	82.1%	73.4%	64.9%	High	89.1%	76.1%	65.7%
M 310.3	Bed	13.7	35	High	78.5%	68.2%	55.2%	Medium	79.8%	51.2%	27.5%
M 310.4	Bed	8.7	26	High	83.0%	75.0%	66.1%	High	89.5%	77.7%	67.2%
M 311.1	LKD	41.4	96	Minimum	57.2%	38.7%	13.1%	Minimum	70.6%	32.3%	0.2%
M 311.2	Bed	16.8	36	High	80.9%	71.2%	61.2%	Medium	79.5%	51.8%	28.7%
M 311.3	Bed	11.9	29	Medium	75.5%	62.6%	47.7%	Medium	83.9%	62.0%	41.9%
M 311.4	Bed	6.7	15	High	80.1%	70.2%	57.8%	High	87.7%	72.3%	57.9%
M 312.1	LKD	41.1	101	Medium	73.4%	60.7%	46.4%	Medium	83.7%	62.8%	44.8%

EN17037:2018 Daylight Provision Room Compliance - Neighbourhood M											
Space ID	Description	Area [m²]	Sensor Count	Target Compliance	300lux_50	500lux_50	750lux_50	Minimum Compliance	100lux_95	300lux_95	500lux_95
M 312.2	Bed	20.2	52	High	76.1%	65.2%	51.7%	High	86.1%	68.0%	51.1%
M 312.3	Bed	13.7	35	High	77.8%	66.7%	53.7%	Minimum	79.0%	49.3%	25.1%
M 312.4	Bed	8.7	26	High	79.0%	68.9%	56.7%	High	87.9%	73.5%	58.6%
M 319.1	LKD	41.4	96	Fail	46.4%	24.7%	4.0%	Minimum	62.4%	15.2%	0.0%
M 320.1	LKD	41.1	101	Medium	72.3%	57.0%	43.0%	Medium	83.0%	58.6%	39.8%
M 320.2	Bed	20.2	52	Medium	75.0%	63.3%	47.5%	Medium	85.6%	66.0%	48.1%
M 320.3	Bed	13.7	35	High	77.8%	66.2%	52.5%	Minimum	78.2%	47.4%	22.3%
M 320.4	Bed	8.7	26	High	80.0%	69.8%	56.6%	High	87.6%	71.7%	55.9%
M 321.1	LKD	41.1	94	Minimum	52.6%	31.3%	5.2%	Minimum	67.4%	22.1%	0.0%
M 321.2	Bed	16.8	36	High	78.0%	66.4%	52.7%	Minimum	72.8%	32.4%	12.1%
M 321.3	Bed	11.9	29	High	79.3%	68.8%	55.3%	Medium	85.9%	66.3%	47.8%
M 321.4	Bed	6.7	15	High	82.0%	73.1%	61.5%	High	88.3%	74.2%	59.6%
M 322.1	LKD	41.1	101	Medium	73.6%	59.3%	45.5%	Medium	83.8%	60.9%	42.6%
M 322.2	Bed	20.2	52	High	80.4%	70.6%	59.0%	High	88.1%	73.4%	59.7%
M 322.3	Bed	13.7	35	High	78.4%	67.4%	54.5%	Minimum	78.7%	48.3%	24.2%
M 322.4	Bed	8.7	26	High	82.6%	74.1%	62.7%	High	89.7%	77.2%	65.4%
M 329.1	LKD	41.4	96	Minimum	58.9%	39.4%	14.8%	Minimum	72.8%	35.3%	1.4%
M 329.2	Bed	16.8	36	High	82.1%	73.8%	64.9%	Medium	80.7%	56.8%	41.0%
M 329.3	Bed	11.9	29	Medium	76.2%	62.3%	44.9%	Medium	85.3%	63.1%	41.1%
M 329.4	Bed	6.7	15	High	80.7%	70.6%	55.7%	High	88.7%	73.7%	57.0%
M 330.1	LKD	41.1	101	Medium	72.6%	59.3%	45.5%	Medium	84.0%	61.7%	45.0%
M 330.2	Bed	20.2	52	High	77.5%	67.3%	57.1%	High	86.1%	69.7%	56.2%
M 330.3	Bed	13.7	35	Medium	76.4%	62.9%	45.8%	Minimum	77.4%	41.2%	1.7%
M 330.4	Bed	8.7	26	High	78.3%	66.0%	50.0%	High	87.5%	70.8%	52.6%
M 331.1	LKD	41.1	94	Minimum	59.3%	40.0%	16.4%	Minimum	72.1%	33.4%	1.4%
M 331.2	Bed	16.8	36	High	82.4%	73.8%	64.7%	Medium	77.2%	51.3%	38.4%
M 331.3	Bed	11.9	29	High	79.5%	68.3%	52.1%	Medium	85.5%	63.9%	41.7%
M 331.4	Bed	6.7	15	High	83.0%	73.4%	60.8%	High	87.4%	70.5%	51.7%
M 332.1	LKD	41.1	101	Medium	73.8%	61.5%	48.9%	Medium	84.1%	62.7%	46.3%
M 332.2	Bed	20.2	52	High	82.6%	74.4%	65.8%	High	89.0%	76.5%	66.3%
M 332.3	Bed	13.7	35	Medium	77.8%	65.9%	49.9%	Minimum	78.4%	43.4%	5.4%
M 332.4	Bed	8.7	26	High	83.6%	74.6%	64.2%	High	89.5%	76.1%	63.4%

**Table 39: EN17037:2018 Daylight Provision individual room compliance values - Neighbourhood M.**

## Appendix C - Annual Probable Sunlight Hours

Block A : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
A 01	Yes	46.1%	13.4%	Y	Y
A 02	Yes	75.6%	29.8%	Y	Y
A 03	Yes	77.2%	30.0%	Y	Y
A 04	Yes	30.9%	5.6%	Y	Y
A 05	No	38.1%	9.7%	Y	Y
A 06	Yes	44.8%	11.6%	Y	Y
A 07	Yes	51.1%	14.9%	Y	Y
A 08	Yes	77.0%	30.0%	Y	Y
A 09	Yes	74.2%	29.5%	Y	Y
A 10	Yes	39.0%	7.0%	Y	Y
A 11	No	36.0%	8.8%	Y	Y
A 12	Yes	52.3%	15.9%	Y	Y
A 13	Yes	54.3%	17.2%	Y	Y
A 14	Yes	75.6%	29.8%	Y	Y
A 15	Yes	77.2%	30.0%	Y	Y
A 16	Yes	40.6%	6.0%	Y	Y
A 17	No	38.1%	9.7%	Y	Y
A 18	Yes	55.4%	18.3%	Y	Y
A 19	Yes	58.1%	19.3%	Y	Y
A 20	Yes	77.0%	30.0%	Y	Y
A 21	Yes	74.2%	29.5%	Y	Y
A 22	Yes	54.2%	11.8%	Y	Y
A 23	No	36.0%	8.8%	Y	Y
A 24	Yes	58.6%	19.8%	Y	Y
A 25	Yes	57.9%	19.8%	Y	Y
A 26	Yes	75.6%	29.8%	Y	Y
A 27	Yes	77.2%	30.0%	Y	Y
A 28	Yes	69.5%	24.8%	Y	Y
A 29	No	38.1%	9.7%	Y	Y
A 30	Yes	58.0%	19.8%	Y	Y

Table 40: Block A - Annual Probable Sunlight Hours

Block C : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
C 01	Yes	21.7%	0.2%	N	N
C 02	No	36.3%	10.1%	Y	Y
C 03	Yes	75.2%	30.3%	Y	Y
C 04	Yes	77.7%	30.7%	Y	Y
C 05	Yes	77.7%	30.7%	Y	Y
C 06	Yes	47.1%	16.2%	Y	Y
C 07	Yes	25.7%	0.4%	Y	N
C 08	No	36.6%	10.1%	Y	Y
C 09	Yes	75.2%	30.3%	Y	Y
C 10	Yes	75.2%	30.3%	Y	Y
C 11	Yes	51.3%	18.6%	Y	Y
C 12	Yes	48.0%	16.0%	Y	Y
C 13	Yes	33.9%	2.5%	Y	N
C 14	No	38.1%	10.1%	Y	Y
C 15	Yes	75.2%	30.3%	Y	Y
C 16	Yes	77.7%	30.7%	Y	Y
C 17	Yes	77.7%	30.7%	Y	Y
C 18	Yes	53.8%	17.9%	Y	Y
C 19	Yes	40.6%	6.7%	Y	Y
C 20	No	38.8%	10.1%	Y	Y
C 21	Yes	75.2%	30.3%	Y	Y
C 22	Yes	75.2%	30.3%	Y	Y
C 23	Yes	55.8%	19.1%	Y	Y
C 24	Yes	53.5%	17.9%	Y	Y
C 25	Yes	52.9%	16.4%	Y	Y
C 26	No	38.9%	10.1%	Y	Y
C 27	Yes	75.2%	30.3%	Y	Y
C 28	Yes	77.7%	30.7%	Y	Y
C 29	Yes	77.7%	30.7%	Y	Y
C 30	Yes	56.2%	19.1%	Y	Y

Table 41: Block C - Annual Probable Sunlight Hours

Block H : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
H 01	No	5.3%	0.0%	N	N
H 02	Yes	51.6%	15.0%	Y	Y
H 03	Yes	48.8%	12.0%	Y	Y
H 04	Yes	64.4%	20.8%	Y	Y
H 05	Yes	65.2%	22.2%	Y	Y
H 06	Yes	29.7%	6.7%	Y	Y
H 07	No	7.9%	0.0%	N	N
H 08	Yes	53.3%	16.3%	Y	Y
H 09	Yes	69.7%	24.3%	Y	Y
H 10	Yes	32.8%	13.9%	Y	Y
H 11	Yes	67.8%	24.9%	Y	Y
H 12	Yes	31.6%	7.3%	Y	Y
H 13	No	15.7%	0.0%	N	N
H 14	Yes	55.2%	17.9%	Y	Y
H 15	Yes	55.5%	17.3%	Y	Y
H 16	Yes	74.4%	27.9%	Y	Y
H 17	Yes	74.0%	27.7%	Y	Y
H 18	Yes	37.2%	9.5%	Y	Y
H 19	No	21.9%	1.3%	N	N
H 20	Yes	56.3%	18.8%	Y	Y
H 21	Yes	76.7%	29.7%	Y	Y
H 22	Yes	41.6%	15.1%	Y	Y
H 23	Yes	73.6%	29.0%	Y	Y
H 24	Yes	36.9%	9.4%	Y	Y
H 25	No	33.0%	6.4%	Y	Y
H 26	Yes	56.7%	19.1%	Y	Y
H 27	Yes	57.6%	19.0%	Y	Y
H 28	Yes	77.0%	30.0%	Y	Y
H 29	Yes	77.0%	30.0%	Y	Y
H 30	Yes	39.2%	10.4%	Y	Y

Block K : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
K 01	No	1.0%	0.0%	N	N
K 02	Yes	49.8%	18.4%	Y	Y
K 03	Yes	55.9%	21.1%	Y	Y
K 04	Yes	74.1%	28.3%	Y	Y
K 05	Yes	74.1%	28.3%	Y	Y
K 06	Yes	28.6%	7.3%	Y	Y
K 07	No	3.3%	0.0%	N	N
K 08	Yes	53.0%	19.0%	Y	Y
K 09	Yes	74.1%	28.3%	Y	Y
K 10	Yes	34.2%	16.2%	Y	Y
K 11	Yes	70.7%	27.4%	Y	Y
K 12	Yes	28.0%	6.4%	Y	Y
K 13	No	9.1%	0.0%	N	N
K 14	Yes	58.2%	20.4%	Y	Y
K 15	Yes	59.8%	21.8%	Y	Y
K 16	Yes	74.1%	28.3%	Y	Y
K 17	Yes	74.1%	28.3%	Y	Y
K 18	Yes	30.3%	7.3%	Y	Y
K 19	No	14.6%	0.4%	N	N
K 20	Yes	60.7%	21.5%	Y	Y
K 21	Yes	74.1%	28.3%	Y	Y
K 22	Yes	44.3%	16.5%	Y	Y
K 23	Yes	70.7%	27.4%	Y	Y
K 24	Yes	30.2%	6.4%	Y	Y
K 25	No	24.4%	3.9%	N	N
K 26	Yes	61.2%	21.7%	Y	Y
K 27	Yes	63.0%	22.5%	Y	Y
K 28	Yes	74.1%	28.3%	Y	Y
K 29	Yes	74.1%	28.3%	Y	Y
K 30	Yes	31.5%	7.3%	Y	Y

**Table 42: Block H - Annual Probable Sunlight Hours** **Table 43: Block K - Annual Probable Sunlight Hours**

Maisonettes : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
005	Yes	39.0%	15.7%	Y	Y
006	Yes	50.8%	17.4%	Y	Y
007	Yes	40.3%	17.6%	Y	Y
008	No	77.9%	31.1%	Y	Y
009	No	48.1%	19.4%	Y	Y
010	Yes	56.2%	20.9%	Y	Y
011	Yes	44.5%	18.4%	Y	Y
012	Yes	55.8%	20.1%	Y	Y
020	Yes	48.6%	8.4%	Y	Y
021	No	73.8%	26.7%	Y	Y
022	No	45.6%	7.2%	Y	Y
023	Yes	71.2%	24.8%	Y	Y
032	Yes	43.2%	8.5%	Y	Y
033	Yes	68.3%	22.4%	Y	Y
034	Yes	40.7%	5.2%	Y	Y
035	Yes	71.5%	25.2%	Y	Y
039	No	48.4%	16.1%	Y	Y
040	No	56.3%	19.1%	Y	Y
041	Yes	48.6%	17.2%	Y	Y
042	Yes	57.0%	19.7%	Y	Y
048	Yes	76.1%	31.5%	Y	Y
049	Yes	78.3%	31.5%	Y	Y
050	Yes	76.1%	31.5%	Y	Y
051	No	78.3%	31.5%	Y	Y
052	No	41.8%	18.1%	Y	Y
053	Yes	76.1%	30.6%	Y	Y
054	Yes	38.7%	15.7%	Y	Y
055	Yes	49.8%	17.1%	Y	Y
062	Yes	32.1%	9.6%	Y	Y
063	Yes	47.2%	15.8%	Y	Y
064	Yes	34.5%	8.5%	Y	Y
065	Yes	46.5%	13.8%	Y	Y
072	Yes	19.8%	4.8%	N	N
073	Yes	52.1%	15.6%	Y	Y
074	Yes	31.2%	8.8%	Y	Y
075	Yes	51.6%	17.3%	Y	Y
076	Yes	37.2%	10.9%	Y	Y
077	Yes	43.3%	12.6%	Y	Y
078	Yes	37.9%	8.3%	Y	Y
079	Yes	42.0%	10.2%	Y	Y
080	Yes	36.2%	6.9%	Y	Y
081	Yes	44.5%	10.5%	Y	Y
082	Yes	30.5%	3.6%	Y	N
083	Yes	40.4%	6.3%	Y	Y
084	Yes	35.9%	9.7%	Y	Y
085	Yes	53.5%	17.6%	Y	Y
086	Yes	38.3%	11.0%	Y	Y
087	Yes	53.0%	16.5%	Y	Y
095	Yes	38.9%	8.2%	Y	Y
096	Yes	39.1%	6.0%	Y	Y

Maisonettes : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
097	Yes	55.5%	17.3%	Y	Y
098	Yes	55.4%	17.3%	Y	Y
106	Yes	51.1%	14.0%	Y	Y
107	Yes	69.1%	23.2%	Y	Y
108	Yes	48.3%	12.5%	Y	Y
109	Yes	69.0%	23.1%	Y	Y
110	Yes	47.8%	11.1%	Y	Y
111	Yes	65.2%	21.2%	Y	Y
112	Yes	6.1%	0.0%	N	N
113	Yes	56.9%	15.2%	Y	Y
114	Yes	6.0%	0.0%	N	N
115	Yes	57.0%	15.7%	Y	Y
116	Yes	4.2%	0.0%	N	N
117	Yes	55.8%	14.3%	Y	Y
118	Yes	4.2%	0.0%	N	N
119	Yes	55.0%	13.8%	Y	Y
120	Yes	45.9%	9.4%	Y	Y
121	Yes	66.2%	21.6%	Y	Y
122	Yes	44.0%	13.2%	Y	Y
123	Yes	76.8%	29.9%	Y	Y
124	Yes	44.0%	13.2%	Y	Y
125	Yes	46.0%	13.5%	Y	Y
129	Yes	55.6%	14.6%	Y	Y
130	Yes	78.0%	30.2%	Y	Y
131	Yes	54.0%	13.3%	Y	Y
132	Yes	78.1%	30.3%	Y	Y
143	Yes	64.2%	23.9%	Y	Y
144	Yes	71.4%	26.2%	Y	Y
145	Yes	66.5%	25.1%	Y	Y
146	Yes	73.5%	27.6%	Y	Y
157	Yes	24.8%	4.3%	N	N
158	Yes	44.0%	11.0%	Y	Y
159	Yes	32.0%	2.9%	Y	N
160	Yes	44.8%	11.4%	Y	Y
166	Yes	41.4%	7.3%	Y	Y
167	Yes	64.0%	18.7%	Y	Y
168	Yes	38.6%	6.1%	Y	Y
169	Yes	64.0%	19.3%	Y	Y
173	Yes	67.0%	24.3%	Y	Y
174	Yes	74.6%	28.4%	Y	Y
175	Yes	68.1%	25.2%	Y	Y
176	Yes	74.5%	28.4%	Y	Y
184	Yes	69.7%	26.4%	Y	Y
185	Yes	75.8%	29.4%	Y	Y
186	Yes	70.2%	26.9%	Y	Y
187	Yes	75.9%	29.6%	Y	Y
188	Yes	28.0%	7.4%	Y	Y
189	Yes	37.4%	11.6%	Y	Y
190	Yes	28.4%	8.0%	Y	Y
191	Yes	38.5%	11.6%	Y	Y



Maisonettes : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
195	Yes	47.9%	9.6%	Y	Y
196	Yes	67.4%	21.8%	Y	Y
197	Yes	47.1%	7.9%	Y	Y
198	Yes	68.0%	22.0%	Y	Y
207	Yes	54.1%	13.9%	Y	Y
208	Yes	67.6%	23.1%	Y	Y
209	Yes	1.9%	0.0%	N	N
210	Yes	61.6%	18.1%	Y	Y
211	Yes	0.8%	0.0%	N	N
212	Yes	60.8%	17.4%	Y	Y
213	Yes	0.8%	0.0%	N	N
214	Yes	61.2%	17.9%	Y	Y
215	Yes	53.1%	13.0%	Y	Y
216	Yes	68.1%	23.8%	Y	Y
217	Yes	42.8%	13.8%	Y	Y
218	Yes	74.2%	28.6%	Y	Y
219	Yes	41.3%	12.8%	Y	Y
220	Yes	46.4%	14.0%	Y	Y
225	Yes	72.1%	28.0%	Y	Y
226	Yes	73.7%	28.6%	Y	Y
227	Yes	72.1%	28.0%	Y	Y
228	Yes	73.7%	28.6%	Y	Y
233	Yes	72.4%	28.1%	Y	Y
234	Yes	73.7%	28.6%	Y	Y
235	Yes	72.1%	28.0%	Y	Y
236	Yes	73.7%	28.6%	Y	Y
237	Yes	32.5%	10.4%	Y	Y
238	Yes	73.2%	27.2%	Y	Y
239	Yes	35.9%	7.8%	Y	Y
240	Yes	42.0%	11.6%	Y	Y
249	Yes	46.0%	10.7%	Y	Y
250	Yes	48.9%	12.8%	Y	Y
251	Yes	44.0%	9.8%	Y	Y
252	Yes	48.8%	13.1%	Y	Y
253	Yes	46.5%	12.6%	Y	Y
254	Yes	70.4%	25.4%	Y	Y
255	Yes	51.3%	14.2%	Y	Y
256	Yes	67.9%	23.8%	Y	Y
257	Yes	57.0%	17.3%	Y	Y
258	Yes	68.8%	24.3%	Y	Y
259	Yes	60.4%	19.4%	Y	Y
260	Yes	73.1%	26.8%	Y	Y
261	Yes	32.2%	12.6%	Y	Y
262	Yes	37.7%	13.7%	Y	Y
263	Yes	30.8%	9.2%	Y	Y
264	Yes	36.9%	14.8%	Y	Y
265	Yes	32.8%	8.4%	Y	Y
266	Yes	38.5%	15.3%	Y	Y
267	Yes	39.0%	14.4%	Y	Y
268	Yes	76.8%	29.8%	Y	Y
278	Yes	53.7%	13.3%	Y	Y
279	Yes	73.2%	26.3%	Y	Y

Maisonettes : Annual Probable Sunlight Hours					
ID	Within 90° South	% of APSH	% of PSH Sept 21 - Mar 21	Meets Criteria	
				APSH	PSH
280	Yes	50.1%	10.4%	Y	Y
281	Yes	73.1%	26.2%	Y	Y
288	Yes	53.7%	13.2%	Y	Y
289	Yes	74.4%	27.3%	Y	Y
290	Yes	52.0%	12.2%	Y	Y
291	Yes	73.4%	26.4%	Y	Y
297	Yes	70.7%	27.0%	Y	Y
298	Yes	74.5%	28.5%	Y	Y
299	Yes	69.5%	26.0%	Y	Y
300	Yes	73.2%	27.4%	Y	Y
301	Yes	4.2%	0.0%	N	N
302	Yes	69.4%	24.5%	Y	Y
303	Yes	1.8%	0.0%	N	N
304	Yes	68.5%	24.0%	Y	Y
305	Yes	61.0%	19.8%	Y	Y
306	Yes	68.3%	23.2%	Y	Y
307	Yes	59.3%	18.1%	Y	Y
308	Yes	65.7%	21.1%	Y	Y
309	Yes	47.1%	15.5%	Y	Y
310	Yes	50.5%	16.4%	Y	Y
311	Yes	46.6%	14.9%	Y	Y
312	Yes	49.2%	16.4%	Y	Y
319	Yes	23.5%	5.2%	N	Y
320	Yes	47.5%	14.9%	Y	Y
321	Yes	29.8%	3.3%	Y	N
322	Yes	46.0%	12.5%	Y	Y
329	Yes	64.0%	21.4%	Y	Y
330	Yes	78.1%	30.4%	Y	Y
331	Yes	63.2%	21.2%	Y	Y
332	Yes	78.5%	30.7%	Y	Y

**Table 44: Maisonettes - Annual Probable Sunlight Hours**

## Appendix D - Annual Probable Sunlight Hours for Apartment Blocks

Sunlight on the Ground - Private Amenity		
Plot No.	Proposed: % Area receiving 2 hours sunlight on 21st March	Meets Criteria
001	68.0	Y
002	66.6	Y
003	66.6	Y
004	62.1	Y
005	64.0	Y
006	10.5	N
007	66.2	Y
008	50.0	Y
009	80.9	Y
010	58.3	Y
011	80.9	Y
012	66.6	Y
013	78.7	Y
014	66.6	Y
015	63.6	Y
016	71.2	Y
017	78.7	Y
018	78.7	Y
019	78.7	Y
020	76.1	Y
021	83.3	Y
022	54.7	Y
023	91.6	Y
024	72.9	Y
025	87.5	Y
026	87.5	Y
027	87.5	Y
028	87.5	Y
029	87.5	Y
030	87.5	Y
031	87.5	Y
032	57.1	Y
033	75.0	Y
034	52.3	Y
035	66.6	Y
036	72.7	Y
037	74.2	Y
038	78.7	Y
039	71.4	Y
040	74.9	Y
041	78.5	Y
042	74.9	Y
043	0.0	N
044	0.0	N
045	0.0	N
046	0.0	N
047	0.0	N

Sunlight on the Ground - Private Amenity		
048	0.0	N
049	0.0	N
050	0.0	N
051	66.6	Y
052	0.0	N
053	6.9	N
054	0.0	N
055	60.6	Y
056	57.5	Y
057	57.5	Y
058	65.1	Y
059	65.1	Y
060	65.6	Y
061	61.6	Y
062	0.0	N
063	57.1	Y
064	0.0	N
065	83.1	Y
066	84.8	Y
067	84.8	Y
068	84.6	Y
069	85.0	Y
070	84.2	Y
071	59.7	Y
072	41.0	N
073	74.3	Y
074	76.8	Y
075	75.9	Y
076	74.7	Y
077	74.6	Y
078	74.7	Y
079	67.6	Y
080	74.7	Y
081	58.2	Y
082	77.8	Y
083	77.8	Y
084	75.9	Y
085	66.3	Y
086	72.2	Y
087	50.2	Y
088	67.7	Y
089	66.9	Y
090	74.0	Y
091	74.6	Y
092	79.5	Y
093	79.5	Y
094	79.5	Y
095	71.1	Y

Sunlight on the Ground - Private Amenity		
096	70.5	Y
097	67.4	Y
098	68.4	Y
099	89.4	Y
100	89.2	Y
101	88.8	Y
102	88.6	Y
103	88.4	Y
104	88.6	Y
105	87.8	Y
106	85.4	Y
107	81.0	Y
108	85.4	Y
109	81.0	Y
110	0.0	N
111	0.0	N
112	0.0	N
113	0.0	N
114	0.0	N
115	0.0	N
116	0.0	N
117	0.0	N
118	0.0	N
119	0.0	N
120	20.0	N
121	0.0	N
122	67.1	Y
123	55.7	Y
124	64.2	Y
125	55.7	Y
126	67.8	Y
127	67.1	Y
128	67.8	Y
129	81.7	Y
130	74.7	Y
131	81.4	Y
132	74.7	Y
133	81.6	Y
134	81.8	Y
135	81.8	Y
136	81.8	Y
137	81.8	Y
138	68.3	Y
139	68.3	Y
140	68.3	Y
141	68.3	Y
142	72.2	Y
143	0.0	N
144	0.0	N
145	0.0	N
146	0.0	N

Sunlight on the Ground - Private Amenity		
147	0.0	N
148	0.0	N
149	8.4	N
150	17.5	N
151	43.9	N
152	69.8	Y
153	70.0	Y
154	70.0	Y
155	70.0	Y
156	70.0	Y
157	61.9	Y
158	18.9	N
159	63.4	Y
160	55.7	Y
161	87.6	Y
162	87.6	Y
163	87.6	Y
164	87.2	Y
165	83.4	Y
166	64.5	Y
167	74.7	Y
168	75.1	Y
169	74.7	Y
170	67.2	Y
171	70.0	Y
172	71.2	Y
173	0.0	N
174	0.0	N
175	0.0	N
176	0.0	N
177	3.7	N
178	6.3	N
179	7.8	N
180	13.0	N
181	9.6	N
182	26.5	N
183	10.7	N
184	0.0	N
185	0.0	N
186	0.0	N
187	0.0	N
188	67.9	Y
189	54.7	Y
190	65.3	Y
191	0.0	N
192	55.8	Y
193	67.2	Y
194	67.2	Y
195	81.7	Y
196	75.7	Y
197	78.3	Y

Sunlight on the Ground - Private Amenity		
198	74.7	Y
199	87.8	Y
200	87.8	Y
201	87.8	Y
202	87.8	Y
203	87.8	Y
204	67.2	Y
205	70.0	Y
206	70.2	Y
207	0.0	N
208	0.0	N
209	0.0	N
210	0.0	N
211	0.0	N
212	0.0	N
213	0.0	N
214	0.0	N
215	0.0	N
216	0.0	N
217	67.4	Y
218	0.0	N
219	58.7	Y
220	0.0	N
221	58.1	Y
222	60.9	Y
223	64.0	Y
224	66.2	Y
225	14.0	N
226	0.0	N
227	10.8	N
228	0.0	N
229	7.2	N
230	0.0	N
231	0.0	N
232	0.0	N
233	0.0	N
234	0.0	N
235	5.8	N
236	0.0	N
237	67.4	Y
238	0.0	N
239	58.9	Y
240	0.0	N
241	46.8	N
242	54.2	Y
243	58.4	Y
244	62.8	Y
245	62.8	Y
246	62.8	Y
247	62.8	Y
248	62.9	Y

Sunlight on the Ground - Private Amenity		
249	62.9	Y
250	0.0	N
251	58.9	Y
252	0.0	N
253	83.0	Y
254	74.7	Y
255	83.0	Y
256	74.7	Y
257	83.0	Y
258	74.7	Y
259	83.0	Y
260	74.7	Y
261	63.4	Y
262	3.1	N
263	63.4	Y
264	63.1	Y
265	64.0	Y
266	58.9	Y
267	68.7	Y
268	65.2	Y
269	40.4	N
270	33.3	N
271	25.1	N
272	14.6	N
273	73.8	Y
274	73.8	Y
275	70.9	Y
276	71.0	Y
277	80.4	Y
278	73.6	Y
279	80.1	Y
280	73.6	Y
281	78.0	Y
282	81.9	Y
283	82.2	Y
284	81.6	Y
285	81.6	Y
286	81.6	Y
287	81.4	Y
288	81.4	Y
289	73.6	Y
290	82.5	Y
291	73.6	Y
292	69.8	Y
293	69.8	Y
294	69.8	Y
295	69.6	Y
296	71.6	Y
297	0.0	N
298	0.0	N
299	0.0	N

Sunlight on the Ground - Private Amenity		
300	0.0	N
301	0.0	N
302	0.0	N
303	0.0	N
304	0.0	N
305	0.0	N
306	0.0	N
307	0.0	N
308	0.0	N
309	70.8	Y
310	57.8	Y
311	68.2	Y
312	56.8	Y
313	67.0	Y
314	71.0	Y
315	70.9	Y
316	71.0	Y
317	71.0	Y
318	71.0	Y
319	64.2	Y
320	41.0	N
321	62.9	Y
322	56.8	Y
323	81.9	Y
324	81.6	Y
325	81.6	Y
326	81.6	Y
327	81.6	Y
328	81.6	Y
329	82.8	Y
330	74.7	Y
331	82.8	Y
332	74.7	Y

**Table 45: Calculation of Sun on the Ground to private amenity spaces within the development**