


ART DATA CENTRES

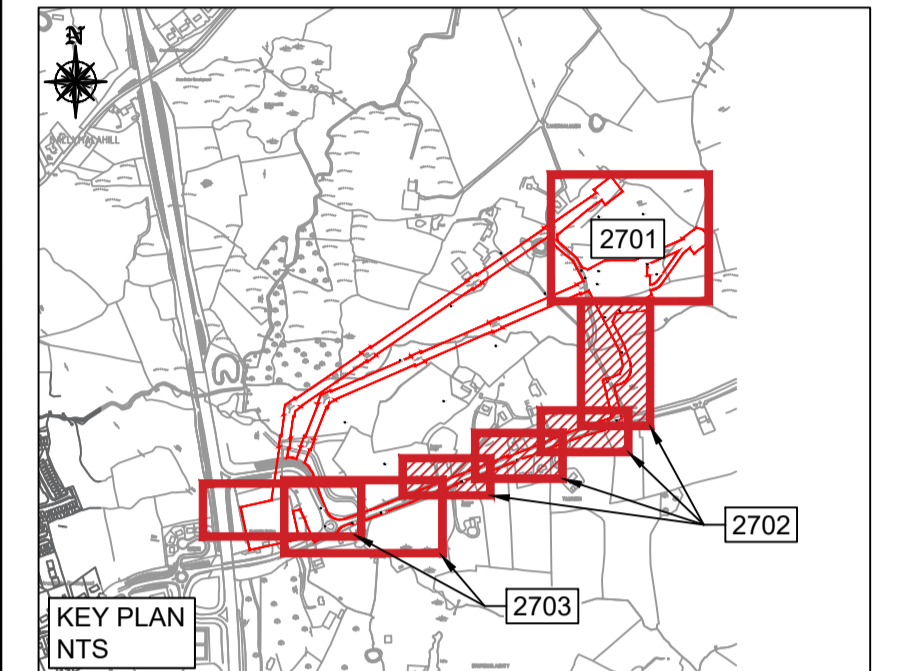

LEGEND:

- SITE BOUNDARY —
- EXISTING OH LINES TO BE REMOVED —
- PROPOSED 110kV, 2x125mm \varnothing SDR17.6 AND 3x160mm \varnothing SDR21 HDPE DOUBLE CIRCUIT —
- PROPOSED JOINT BAY LOCATION ▭
- PROPOSED TELECOM DUCT —
- PROPOSED LINK BOX ▭
- PROPOSED TELECOM CHAMBER ▭
- EXISTING HP GASMAIN —

Rev	Description	PS	RG	03/06/22
P01	FOR PLANNING			

Clifton Scannell Emerson Associates Limited
 Consulting Engineers,
 3rd Floor, The Highrise,
 Bakers Point, Pottery Road,
 Dun Laoghaire, Co. Dublin,
 Ireland, A96 KW29

T: +353 1 288 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

Client: ART DATA CENTRES
 ART DATA CENTRES ENNIS
 Project: CAMPUS - 110KV GIS SUBSTATION
 Dwg. Title: PROPOSED 110 KV GRID CONNECTION SHEET 02 OF 03

Drawn By: PS Checked By: RG Date: JUN 2022

Project Code: Originator: Zonal/Phase: Level: Type: Role: Dwg. No.
20_110A - CSE - GEN - XX - DR - C - 2702

S2 PLANNING
 Status Code: Suitability Description: Scale @ A1: 1:500

P01 PLANNING
 Revision: Project Status: **20_110A**
 CSEA Job No.

