




North

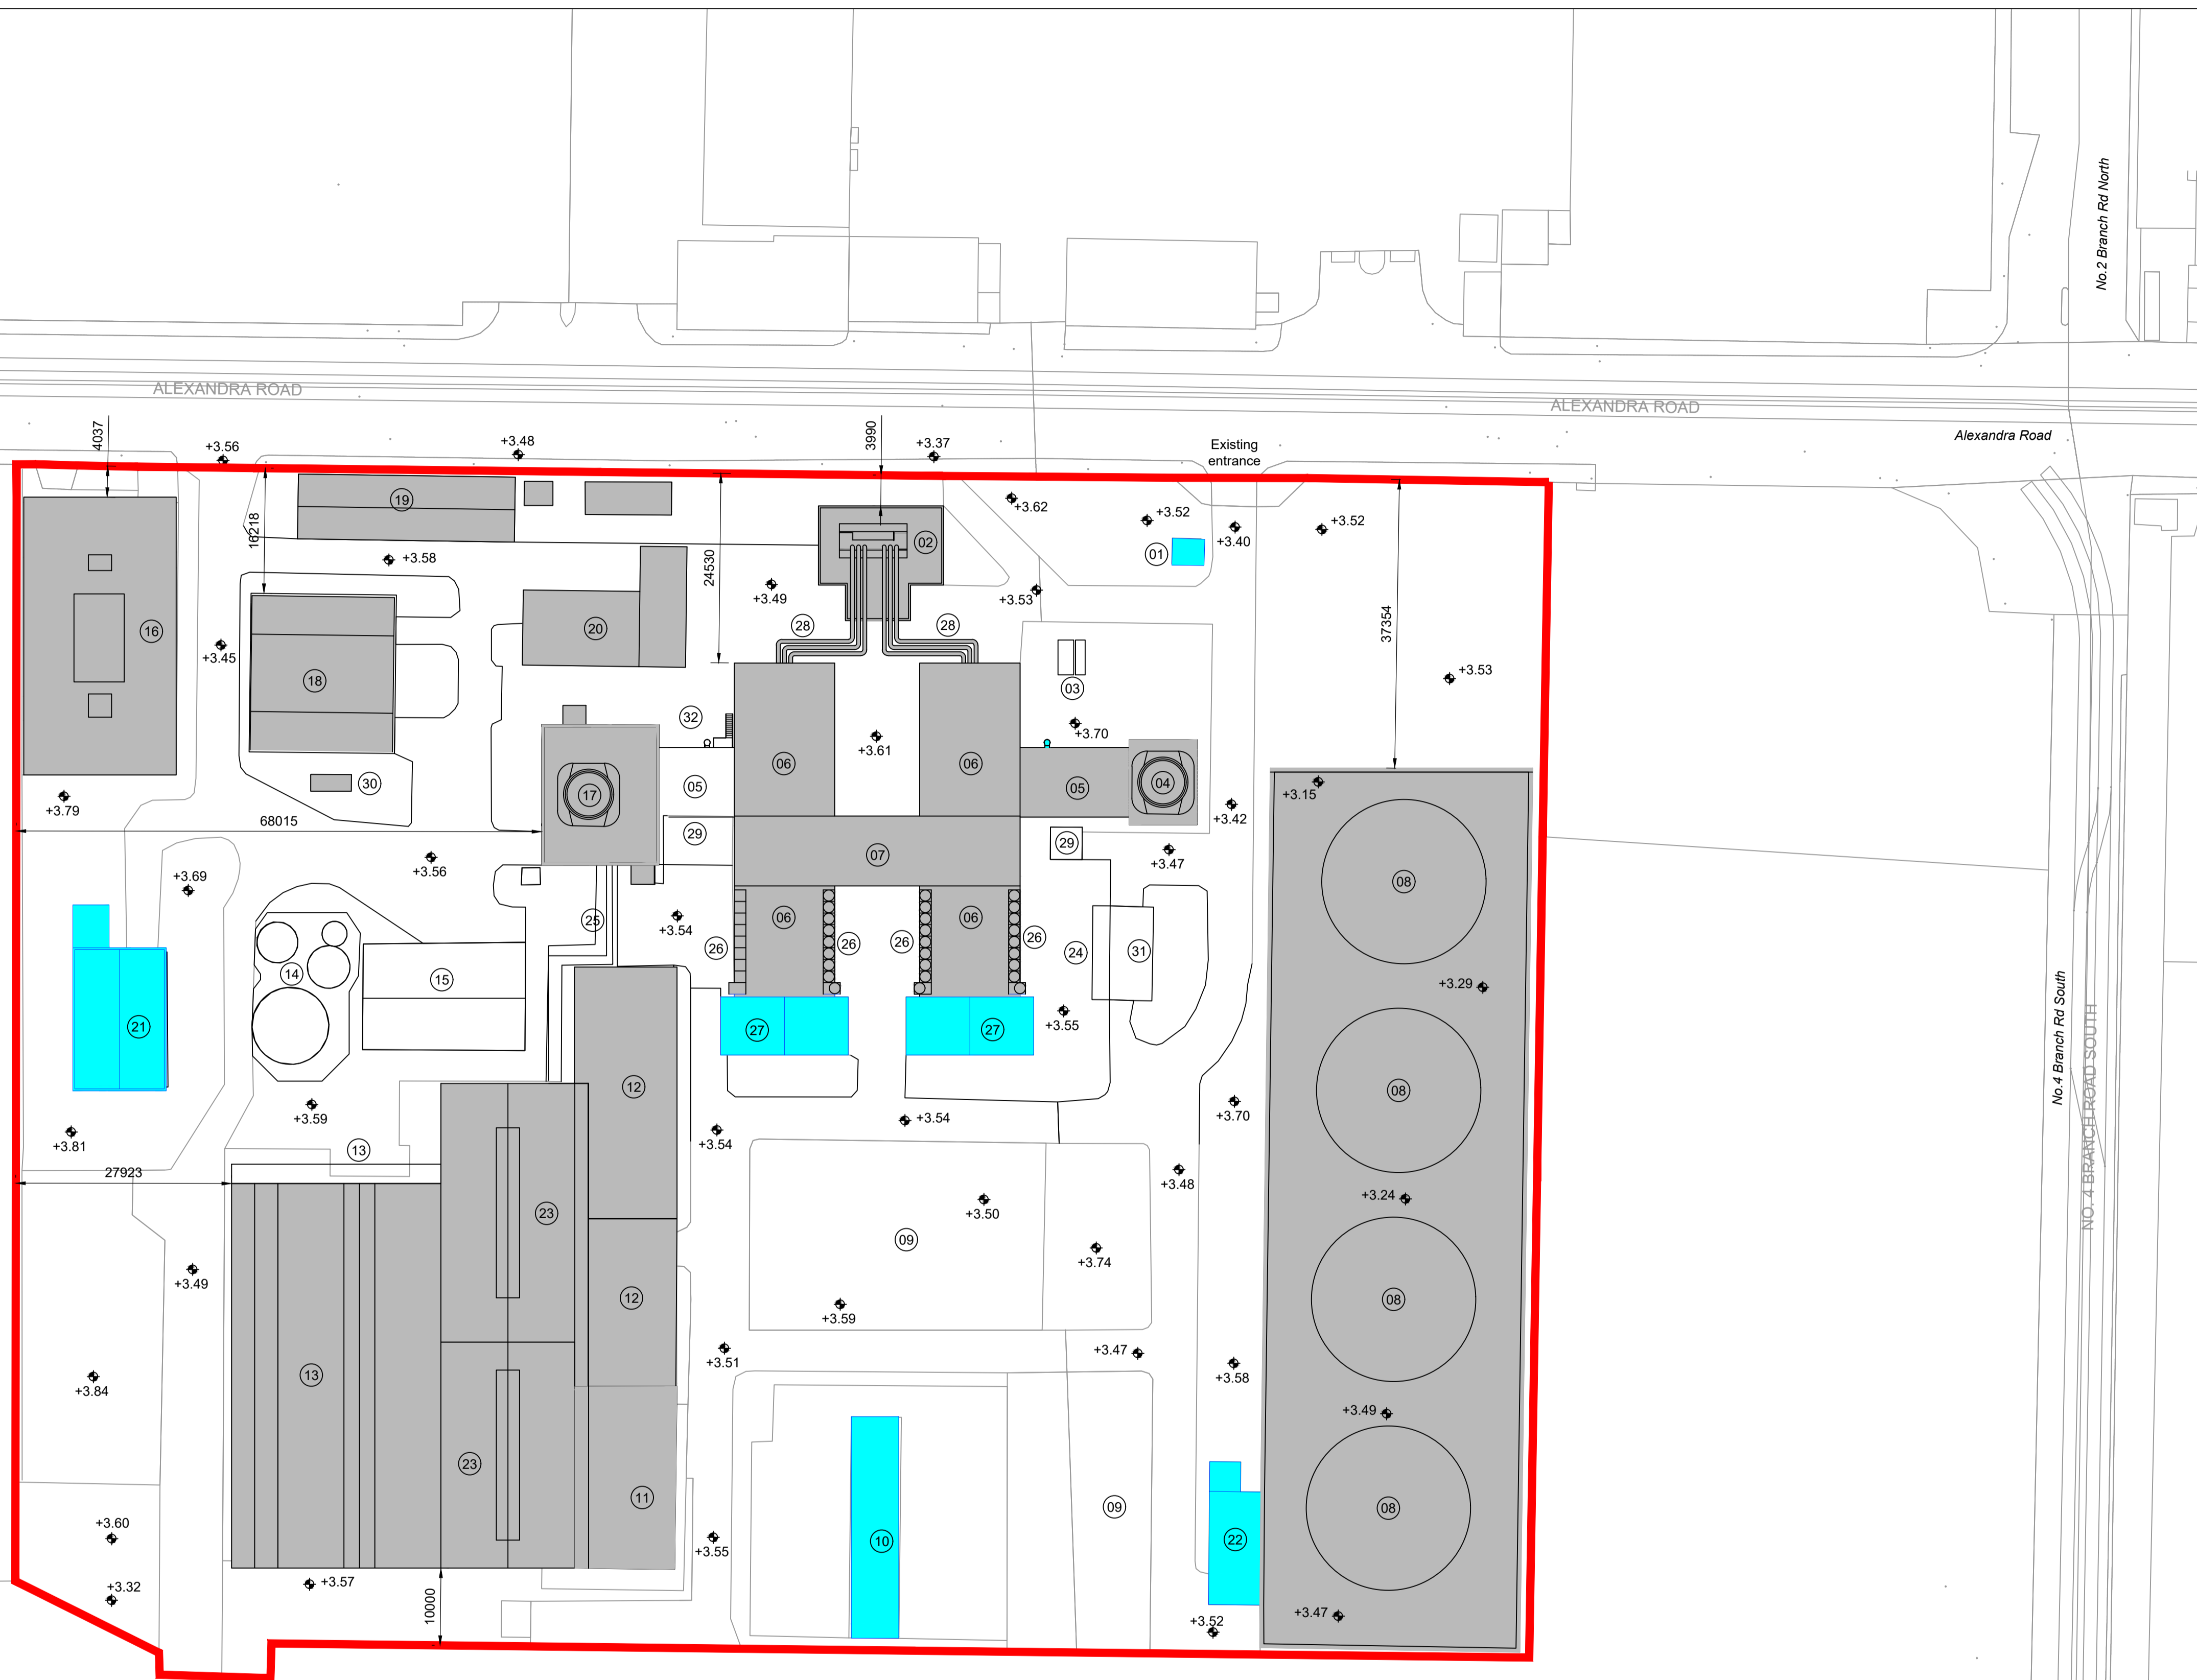

- Notes
1. For planning purposes only.
 2. All dimensions are in millimetres unless otherwise noted.
 3. All levels are in metres above Malin Head datum.

Key to symbols

	Application Site Boundary
	Existing Equipment to be Retained
	Existing Equipment to be Dismantled/Demolished

Equipment Schedule - Existing			
Item	Description	Item	Description
01	Gate House	17	HRSG & Exhaust Stack - CT4
02	220kV Transformer & Bund	18	Canteen
03	N2 Deluge Tanks	19	Stores
04	Exhaust Stack - CT5	20	220kV GIS Substation Building
05	Exhaust Gas Transition Ducts	21	Gas Compressor Building
06	Turbine Hall	22	Fuel Oil Pump House
07	Unloading Bay	23	Steam Turbine Hall
08	Diesel Storage Tanks and Bund	24	Hydrogen Bottle Storage Bay
09	Car Park	25	Pipe Bridge
10	38kV Substation Building	26	Gas Turbine Fin Fan Coolers
11	Control Building	27	Air Filter
12	Administration & Stores	28	Gas Insulated Busbar
13	Old Boiler House	29	House Transformers
14	Towns Water & Demin Water Tanks	30	Oil Interceptor (underground)
15	Water Treatment Building	31	Hydrogen Unloading Area
16	Natural Gas AGI	32	CEMS Package for CT4

Reference drawings

229101053-MMD-00-XX-DR-C-0002 Overall Site Location Plan
 229101053-MMD-00-XX-DR-C-0011 Proposed Site Layout Plan

PL2	20/06/2022	SHY	Issued for Planning	ESB	DH
PL1	27/05/2022	SHY	Issued for Planning	ESB	DH
Rev	Date	Drawn	Description	Ch'k'd	App'd

MOTT MACDONALD

South Block
 Rockfield
 Dundrum
 Dublin 16
 Ireland
 T +353 (0)1 291 6700
 F
 W www.mottmac.com

Client **Electricity Supply Board**

Title **North Wall Emergency Generation Plant**
Existing Site Layout Plan

Designed	ESB	Eng check	ESB
Drawn	S. Healy	Coordination	D. Hassett
Dwg check	L. Gough	Approved	D. Hassett
Scale at A1	Status	Rev	Security
1:500	APR	PL2	STD
Drawing Number			
229101053-MMD-00-XX-DR-C-0010			

