

All dimensions are in millimetres, unless noted otherwise.

Figured dimensions only to be used, drawings not to be scaled. If in doubt ask.

For illustration purposes only
appearance of unit

Finished Surface capped with clause 804 material.

Yellow Marker Warning tape across full width of trench

Clause 804 material to be used and compacted in accordance with NRA guidelines in layers not more than 300mm.

ESBN red cable marker strips

125mm Comm Ducts

160mm Dia Power Ducts, Complete with 12mm Diameter draw ropes.

Competent Stratum

300mm max

450mm min


FRL

CBGMB Clause 822 material

A393 Steel mesh for width of trench

Existing culvert / water pipe

SCALE 1:50

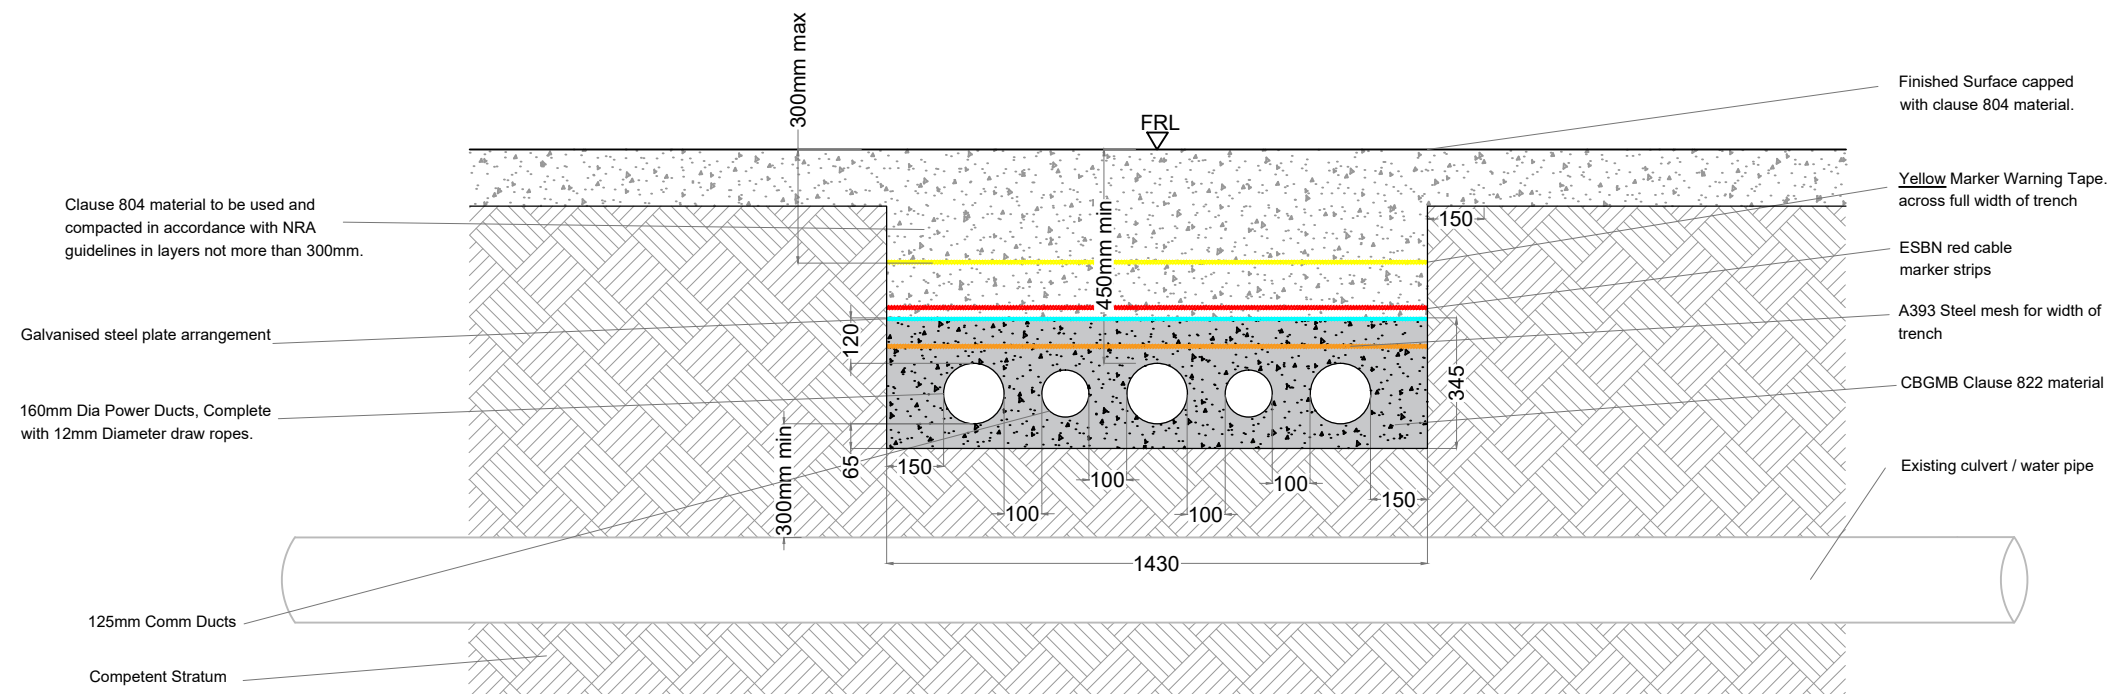

SCALE 1:20

DRAWING TITLE: Option C - Flat Bed Over Existing Pipe - 110kV	
PROJECT TITLE: Knocknamork Grid Connection Infrastructure, An Bord Pleanála	
DRAWING BY: Joseph O'Brien	CHECKED BY: Meabhann Crowe
PROJECT No.: 210732	DRAWING No.: 210732 - 22
SCALE: As Shown @ A3	DATE: 26.07.2022
 <div style="float: right; text-align: right;"> MKO Planning and Environmental Consultants Tuam Road, Galway Ireland, H91 WJ84 +353 (0) 91 735611 email: info@www.mkoireland.ie Website: www.mkoireland.ie </div>	