

Finished Surface capped with
clause 804 material.

Yellow Marker Warning Tape.
across full width of trench

Clause 804 material to be used and
compacted in accordance with NRA
guidelines in layers not more than
300mm.


ESBN red cable marker strips

CBGMB Clause 822 material

125mm Comm Ducts

160mm Dia Power Ducts, Complete
with 12mm Diameter draw ropes.

PVC Corrugated Pipe sized
appropriately

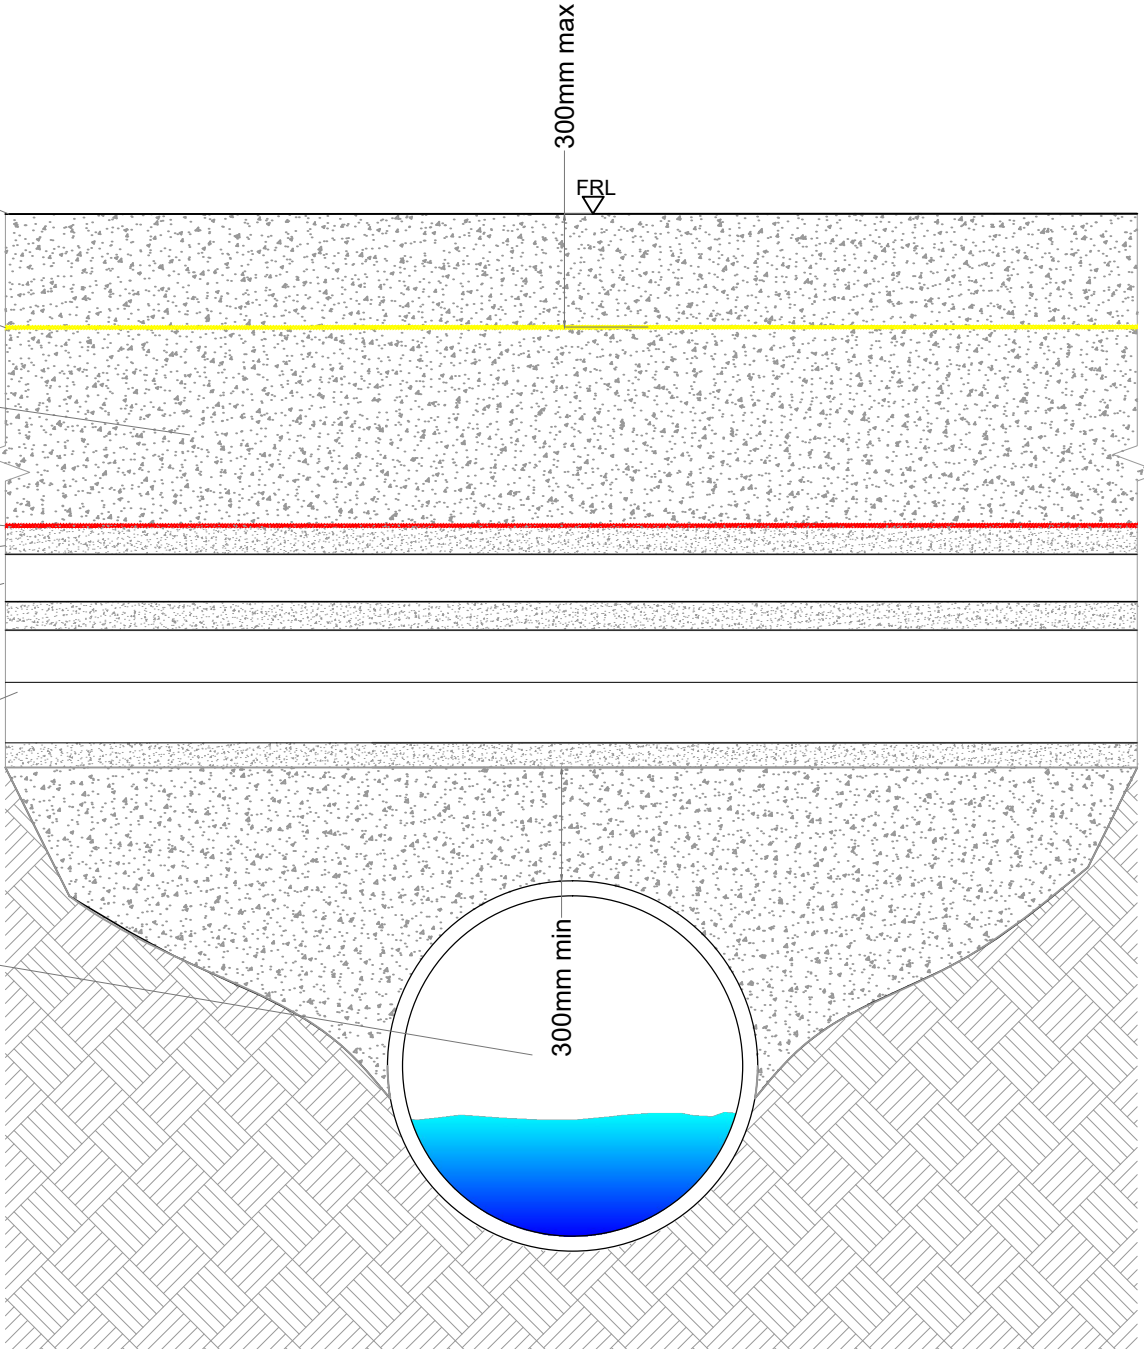

Option F - Pipe crossing - 110kV

SCALE 1:20

Note:

All dimensions are in millimetres, unless noted otherwise.

All dimensions to be checked on site and any discrepancy to be reported to the engineer.

Figured dimensions only to be used, drawings not to be scaled. If in doubt ask.

For illustration purposes only. Exact size and appearance of unit subject to manufacturer selection.

DRAWING TITLE: Option F - Pipe Crossing - 110kV	
PROJECT TITLE: Knocknamork Grid Connection Infrastructure, An Bord Pleanala	
DRAWING BY: Joseph O'Brien	CHECKED BY: Meabhann Crowe
PROJECT No.: 210732	DRAWING No.: 210732 - 26
SCALE: 1:20 @ A3	DATE: 26.07.2022
<div><div></div><div><p>MKO Planning and Environmental Consultants Tuam Road, Galway Ireland, H91 VW84 +353 (0) 91 735611 email: info@www.mkoireland.ie Website: www.mkoireland.ie</p></div></div>	