


FOR DROP DOWN CABLE DETAILS REFER TO DRAWING No. 22\_131-CSE-GEN-XX-DR-C-1530

PROPOSED DROP DOWN MAST

EXISTING 110KV OVERHEAD LINE TO BE REMOVED

PROPOSED DROP DOWN MAST

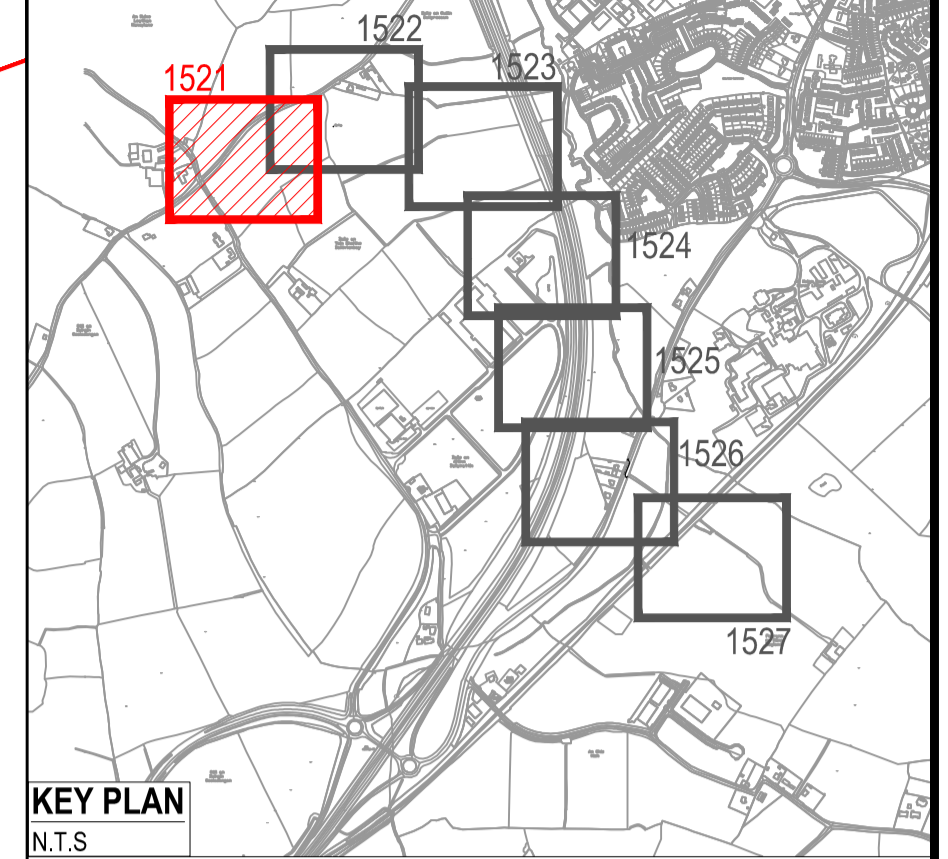

KEY PLAN  
N.T.S

LEGEND:

- PROPOSED CIRCUIT 'A' ROUTE
- PROPOSED CIRCUIT 'B' ROUTE
- PROPOSED JOINT BAY
- EXISTING 110KV OVERHEAD LINE / MAST
- EXISTING GROUND LEVEL
- SITE BOUNDARY

P02	GENERAL AMENDMENTS	KT	DRL	25/10/22
P01	ISSUE FOR PLANNING	KT	DRL	21/10/22
Rev	Description	Drawn	Checked	Date

**Clifton Scannell Emerson Associates Limited**  
 Consulting Engineers,  
 3rd Floor, The Highline,  
 Bakers Point, Pottery Road,  
 Dun Laoghaire, Co. Dublin,  
 Ireland, A96 KW29

T. +353 1 288 5006  
 F. +353 1 283 3466  
 E. info@csea.ie  
 W. www.csea.ie

Client	CRAG WICKLOW LIMITED			
Project	DUB 30 GRID CONNECTION CIRCUIT 'B' ROUTE SHEET 1 OF 7			
Dwg. Title	KT	Date	SEP. 2022	22_131
Drawn By	DRL	Scale	1:500 @ A1	CSEA Job No.
Checked By				
Project Code	Originator	Zone/Phase	Level	Type
22_131 - CSE - GEN - XX - DR - C - 1521				
S2	SUITABLE FOR INFORMATION			
P02	PLANNING			

