

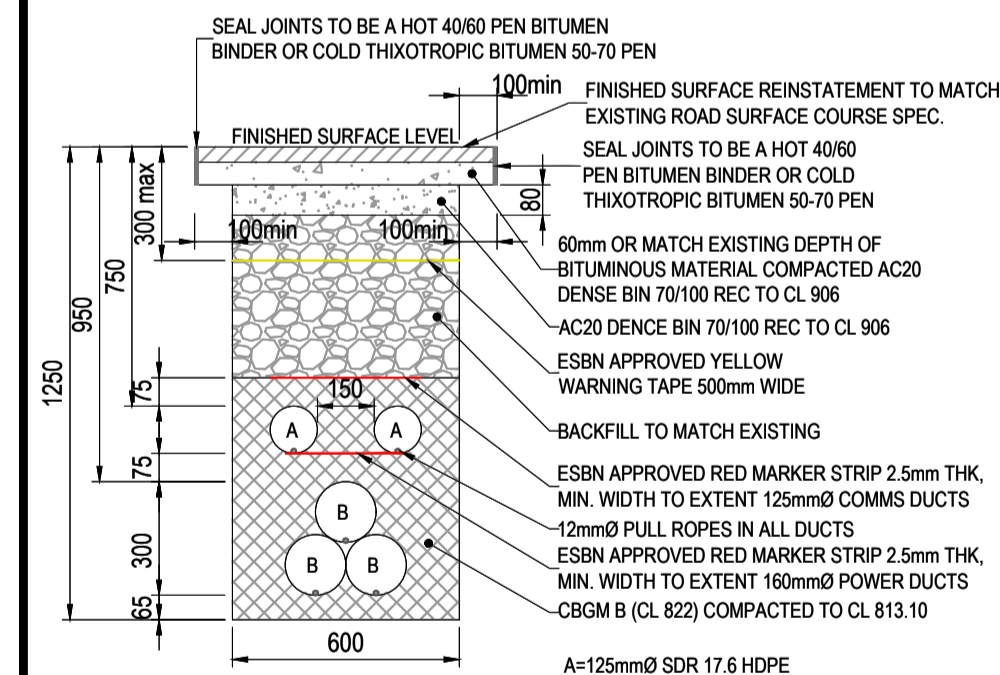


LEGEND:

- PROPOSED CIRCUIT 'A' ROUTE —
- PROPOSED CIRCUIT 'B' ROUTE —
- PROPOSED JOINT BAY ▾
- EXISTING 110kV OVERHEAD LINE / MAST —
- EXISTING GROUND LEVEL + 99.99
- SITE BOUNDARY —

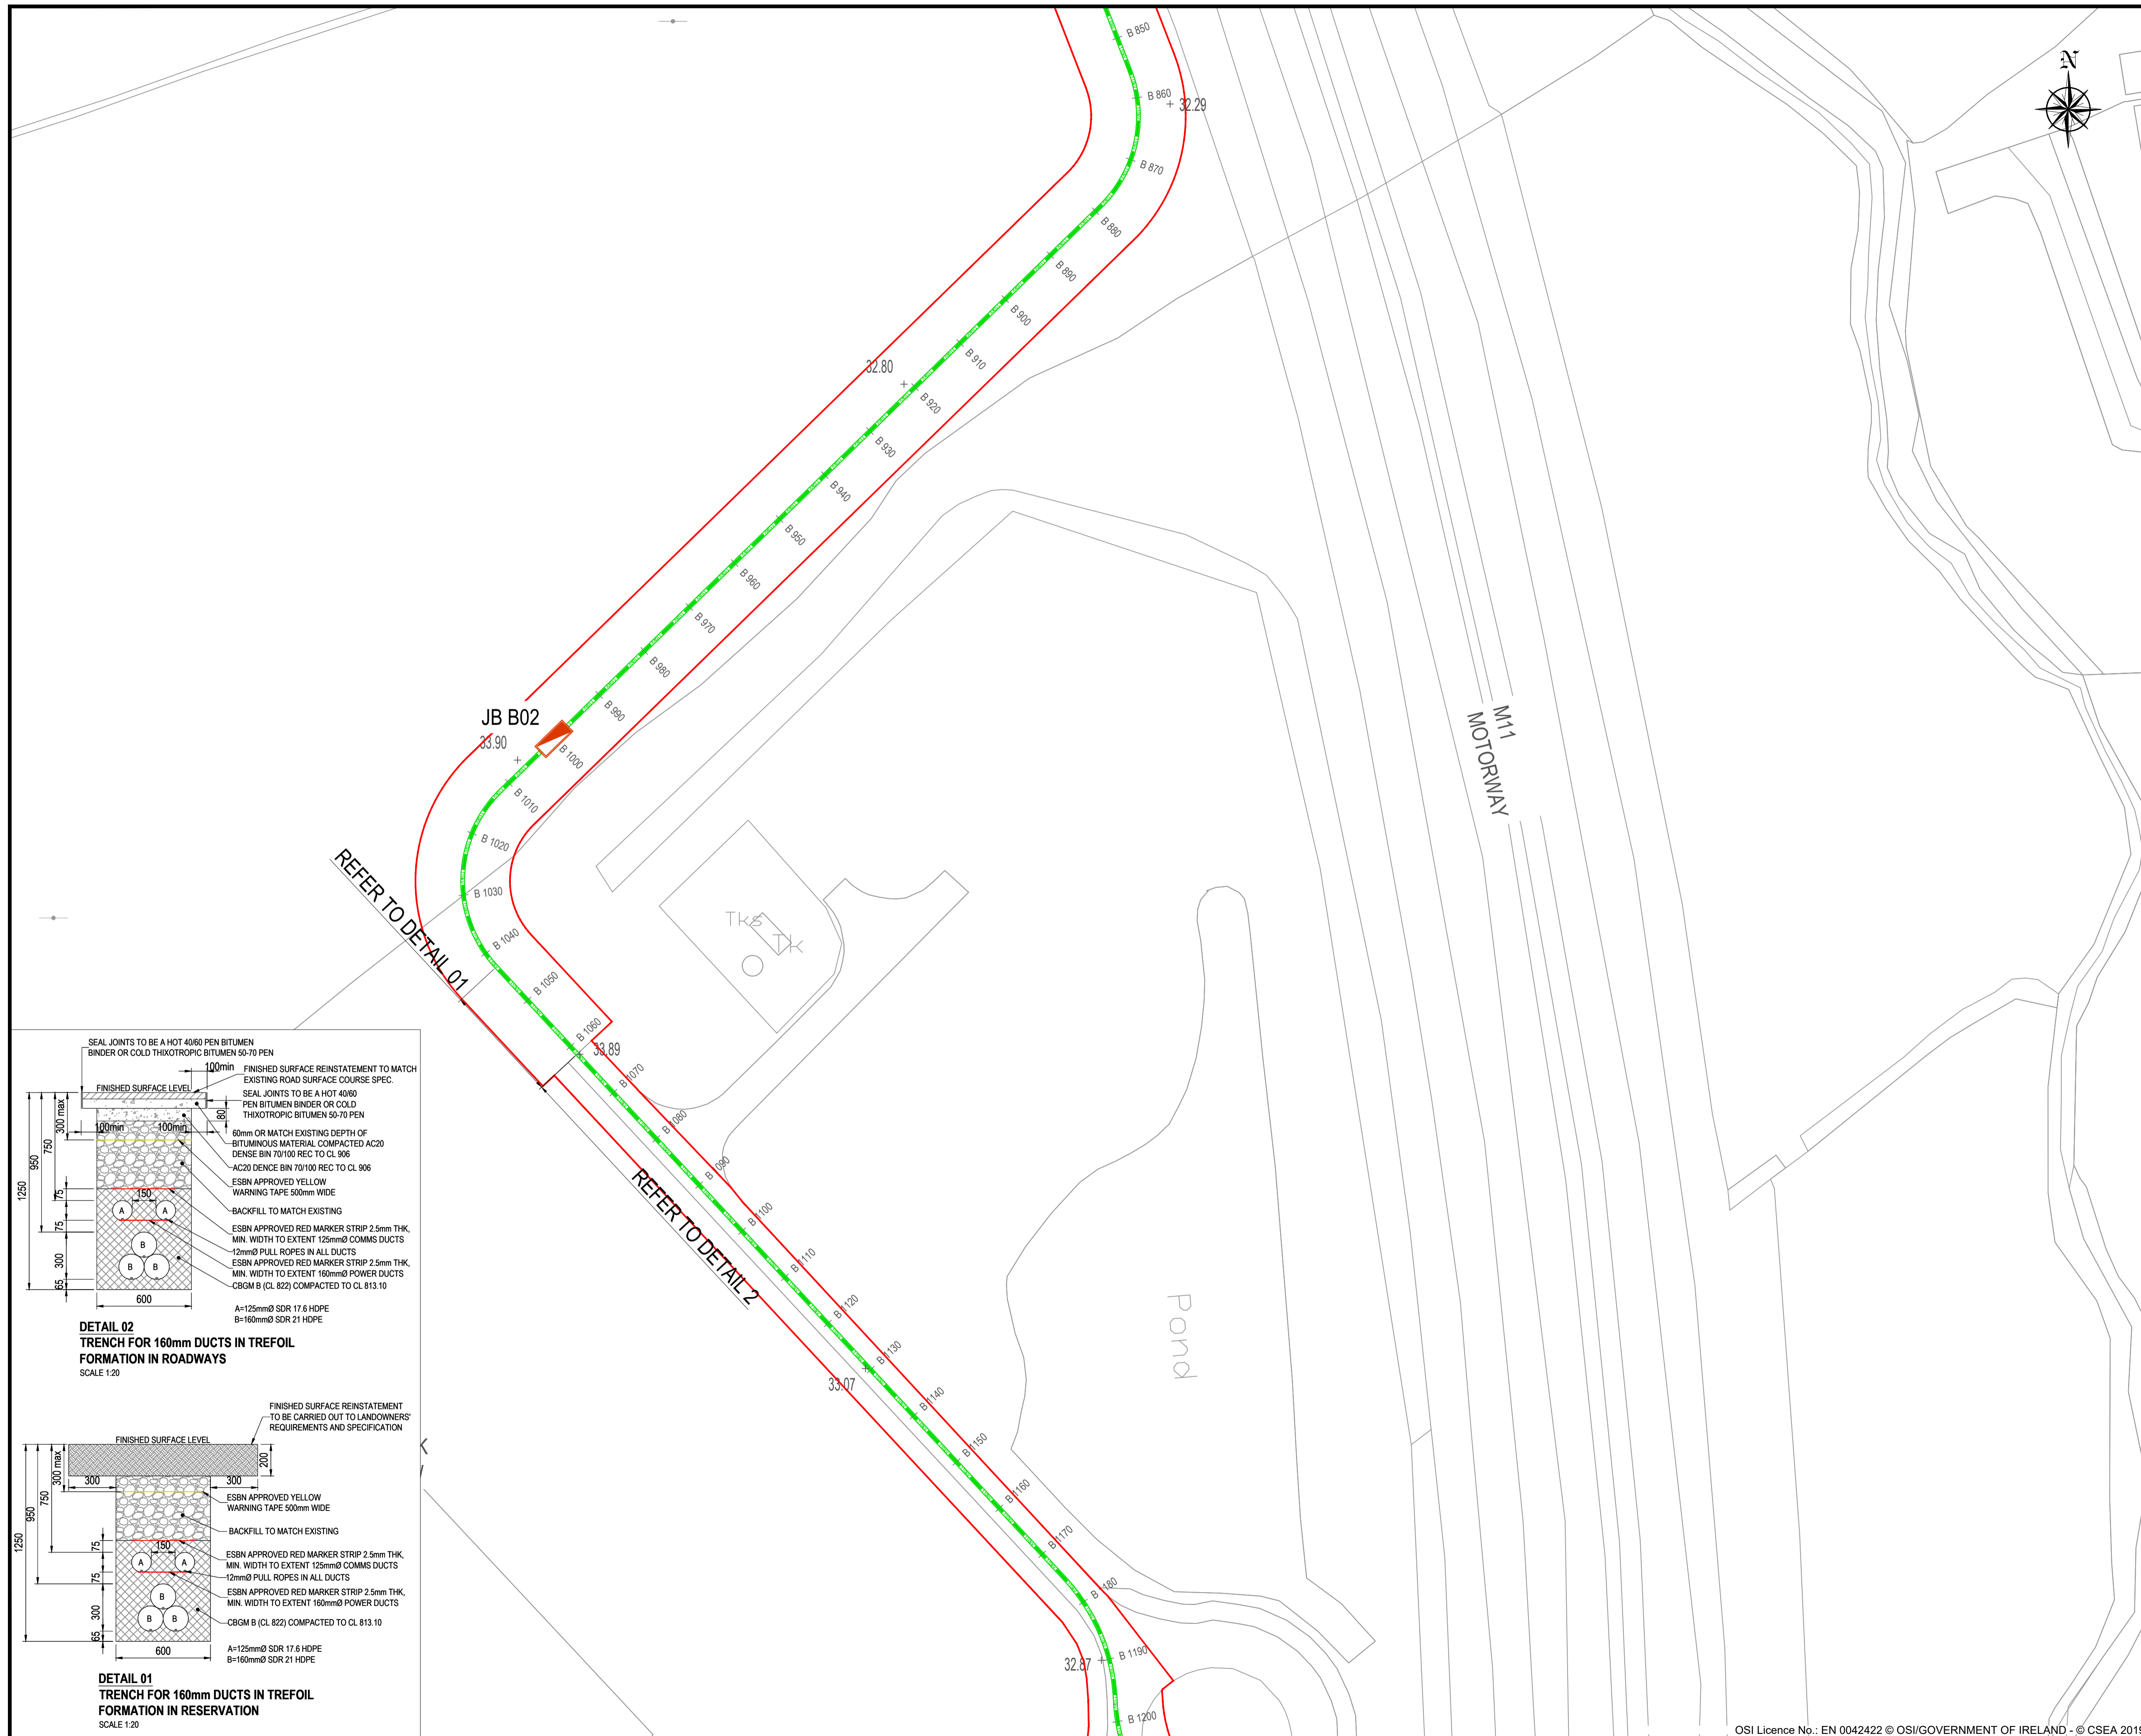

DETAIL 02
TRENCH FOR 160mm DUCTS IN TREFOIL FORMATION IN ROADWAYS
SCALE 1:20

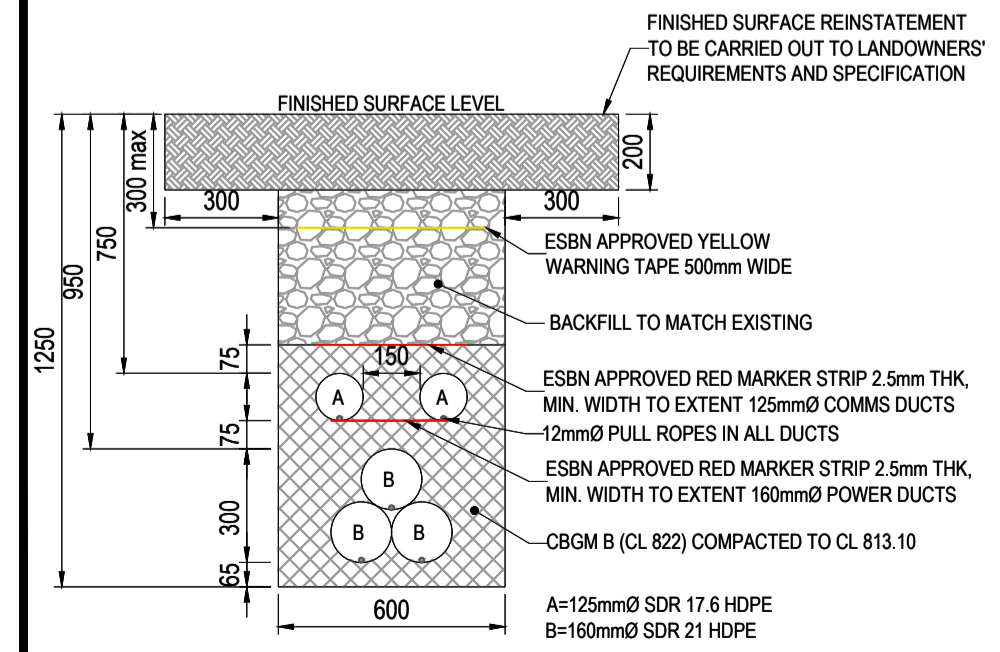

DETAIL 01
TRENCH FOR 160mm DUCTS IN TREFOIL FORMATION IN RESERVATION
SCALE 1:20

| | | | | |
|-----|--------------------|-------|---------|----------|
| P01 | ISSUE FOR PLANNING | KT | DRL | 21/10/22 |
| Rev | Description | Drawn | Checked | Date |

Clifton Scannell Emerson Associates Limited
Consulting Engineers,
3rd Floor The Highline,
Bakers Point, Pottery Road,
Dun Laoghaire, Co. Dublin,
Ireland, A96 KW29

T: +353 1 288 5006
F: +353 1 283 3466
E: info@csea.ie
W: www.csea.ie

| | | | | |
|---|--|------------|------------|--------------|
| Client | CRAG WICKLOW LIMITED | | | |
| Project | DUB 30 GRID CONNECTION CIRCUIT 'B' ROUTE SHEET 4 OF 7 | | | |
| Dwg. Title | CIRCUIT 'B' ROUTE SHEET 4 OF 7 | | | |
| Drawn By | KT | Date | SEP. 2022 | 22_131 |
| Checked By | DRL | Scale | 1:500 @ A1 | CSEA Job No. |
| Project Code | Originator | Zone/Phase | Level | Type |
| 22_131 - CSE - GEN - XX - DR - C - 1524 | | | | |
| Status Code | S2 SUITABLE FOR INFORMATION | | | |
| P01 | PLANNING | | | |
| Revision | Project Status | | | |