


PROFILE
SCALE 1:20

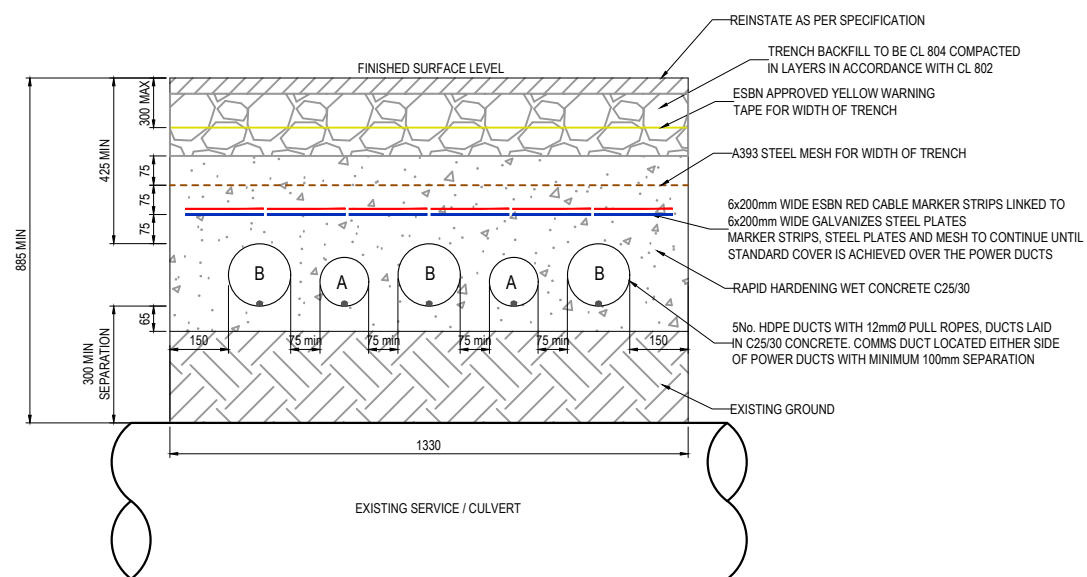

SECTION
SCALE 1:10

NOTES:

- A = COMMS DUCTING 125 mm SDR 17.6 HDPE
B = 110KV DUCTING 160 mm SDR 21 HDPE
- ALL PRODUCTS AND MATERIALS TO BE UTILISED DURING CONSTRUCTION TO COMPLY WITH EIRGRID FUNCTIONAL SPECIFICATION, EBN STANDARDS, TII SPECIFICATION FOR ROAD WORKS AND ALL RELEVANT IRISH (EUROPEAN) AND BRITISH STANDARDS
- 300mm MINIMUM VERTICAL AND HORIZONTAL CLEARANCES TO BE OBSERVED BETWEEN CABLE DUCTS AND 3rd PARTY SERVICES. HIGH RISK 3rd PARTY SERVICES CROSSING TO BE CONSULTED WITH EIRGRID AND SERVICE OWNER
- STEEL PLATES MUST COVER DUCTS. NO OVERLAP IS REQUIRED HOWEVER STANDARD DIMENSIONS MAY RESULT IN AN OVERLAP. SPACING OF 10mm TO BE MAINTAINED BETWEEN STEEL PLATES TO PREVENT THE TRANSFER OF STRAY CURRENT
- THE MINIMUM CLEARANCE BETWEEN ALL HV AND COMMUNICATION DUCTS IS 75mm
- WOODEN TEMPLATES ARE TO BE USED AT 5m INTERVALS DURING DUCT INSTALLATION. PRE-MADE 75mm WIDE CONCRETE SPACERS TO BE USED DURING DUCT INSTALLATION IN WET CONCRETE
- MINIMUM BURIAL DEPTH IS 425mm AS PER REQUIREMENTS OF HSA - CODE OF PRACTICE FOR AVOIDING DANGER FROM UNDERGROUND SERVICES

Rev	Description	Drawn	Checked	Date
P01	ISSUE FOR PLANNING	KT	DRL	21/10/22

Clifton Scannell Emerson Associates Limited
Consulting Engineers
3rd Floor The Highline,
Bakers Point, Pottery Road,
Dun Laoghaire, Co. Dublin,
Ireland, A96 KW29
T. +353 1 288 5006
F. +353 1 283 3466
E. info@csea.ie
W. www.csea.ie

Client	CRAG WICKLOW LIMITED					
Project	DUB 30 GRID CONNECTION TYPICAL TRENCH CROSS. OVER 3RD PARTY - FLAT FORMATION					
Drawn By	KT	Date	SEP. 2022	22_131		
Checked By	DRL	Scale	AS INDICATED @ A1			
Project Code	Originator	Zone/ Phase	Level	Type	Role	Dwg. No.
22_131	CSE	GEN	XX	DR	C	1540
Status Code	S2 SUITABLE FOR INFORMATION					
Revision	P01 PLANNING					