

- NOTES:**
- This drawing is to be used for EirGrid design approval only and is not to be used for construction.
 - For further information reference the latest versions of EirGrid Dr. No. **XDC-CBL-STND-H-007** & Functional Specifications in addition to all other relevant documentation.
 - Dimensions are in millimeters, unless noted otherwise.
 - Drawings are not to be scaled, use figured dimensions only.
 - Road-markings to be agreed with the county council and reinstated.
 - Road surfacing build-up and tie in with non floating road sections to be agreed with the county council.

LEGEND:

SECUGRID 40/40 GEOGRID	
TENSAR Tx160 GEOGRID	
GEOTEXTILE	
BASE WEARING COURSE	
PEAT COMPOSITION	
EXISTING MATERIAL	
NEW ROAD BUILD UP MATERIAL	

PROJECT

Clogherchor Wind Farm 110kV Grid Connection

CLIENT

FuturaEnergy Ireland

Orsted

CONSULTANTS

TOBIN
 CONSULTING ENGINEERS


NOTES: -

Path of cable route and location of associated Joint Bays, Link Boxes and Comms Chambers may vary depending on site conditions.

Other services may be encountered along the route.

This drawing is to be used only for the purpose of the planning application and is subject to detailed design.

LEGEND: -

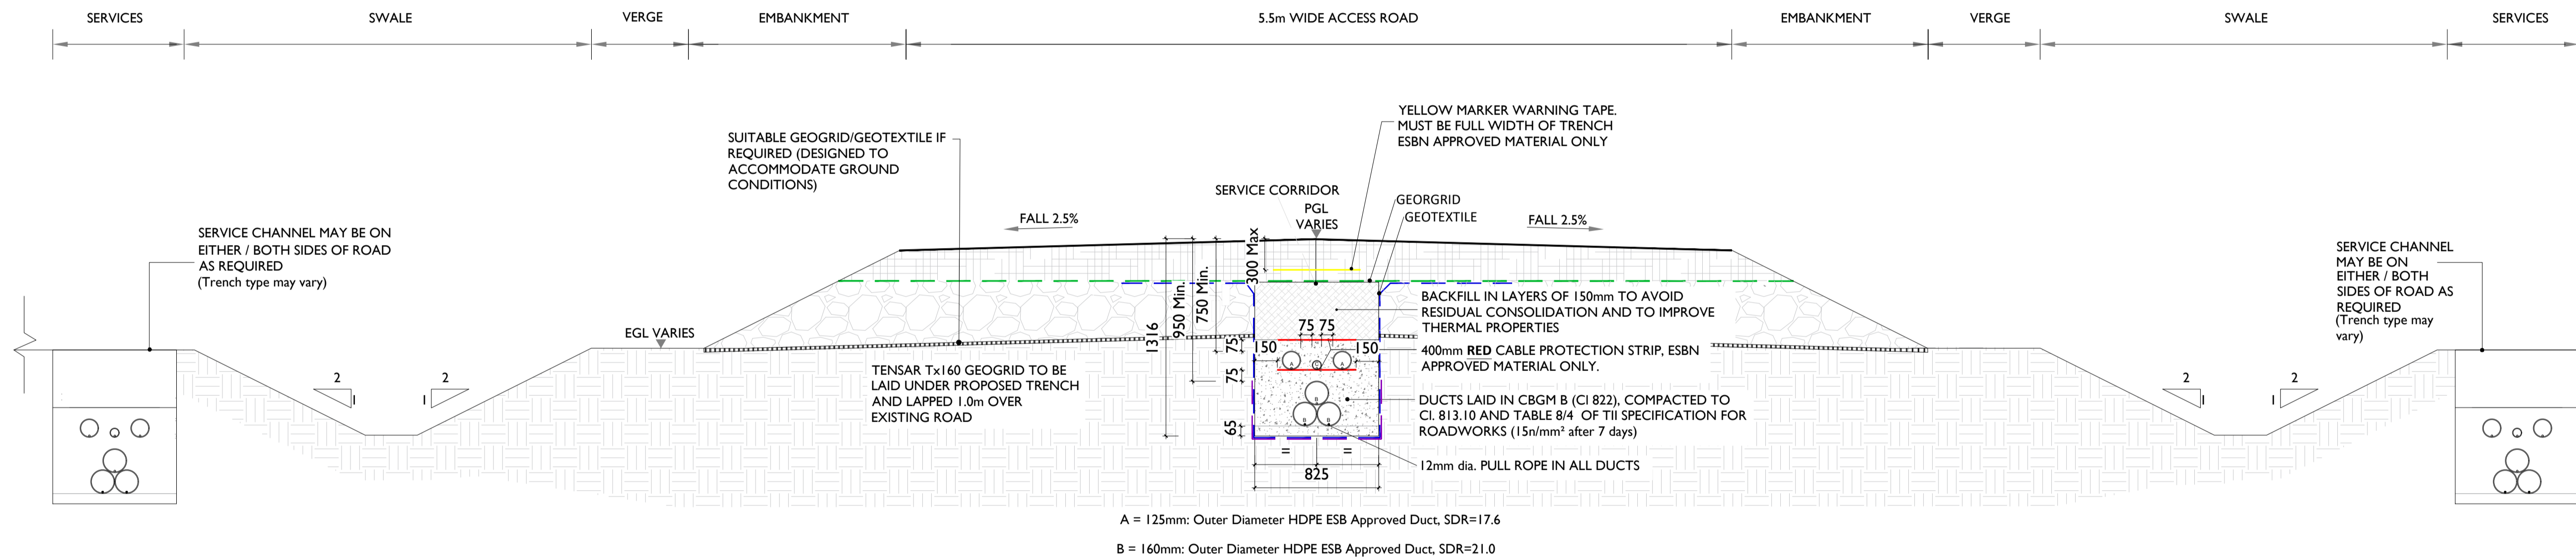

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P02	17.02.23	Issued for Information
P01	11.01.23	Issued for Information
P00	03.10.22	Issued for Information

PROJECT NUMBER
 05-725

SHEET TITLE
 Typical 110kV Ducting through Existing Floating Road in Peat

SHEET NUMBER
 05725-DR-121