



ISO A1 594mm x 841mm
Project Management Initials: Designer: JC
Checked: DB
Approved: RG

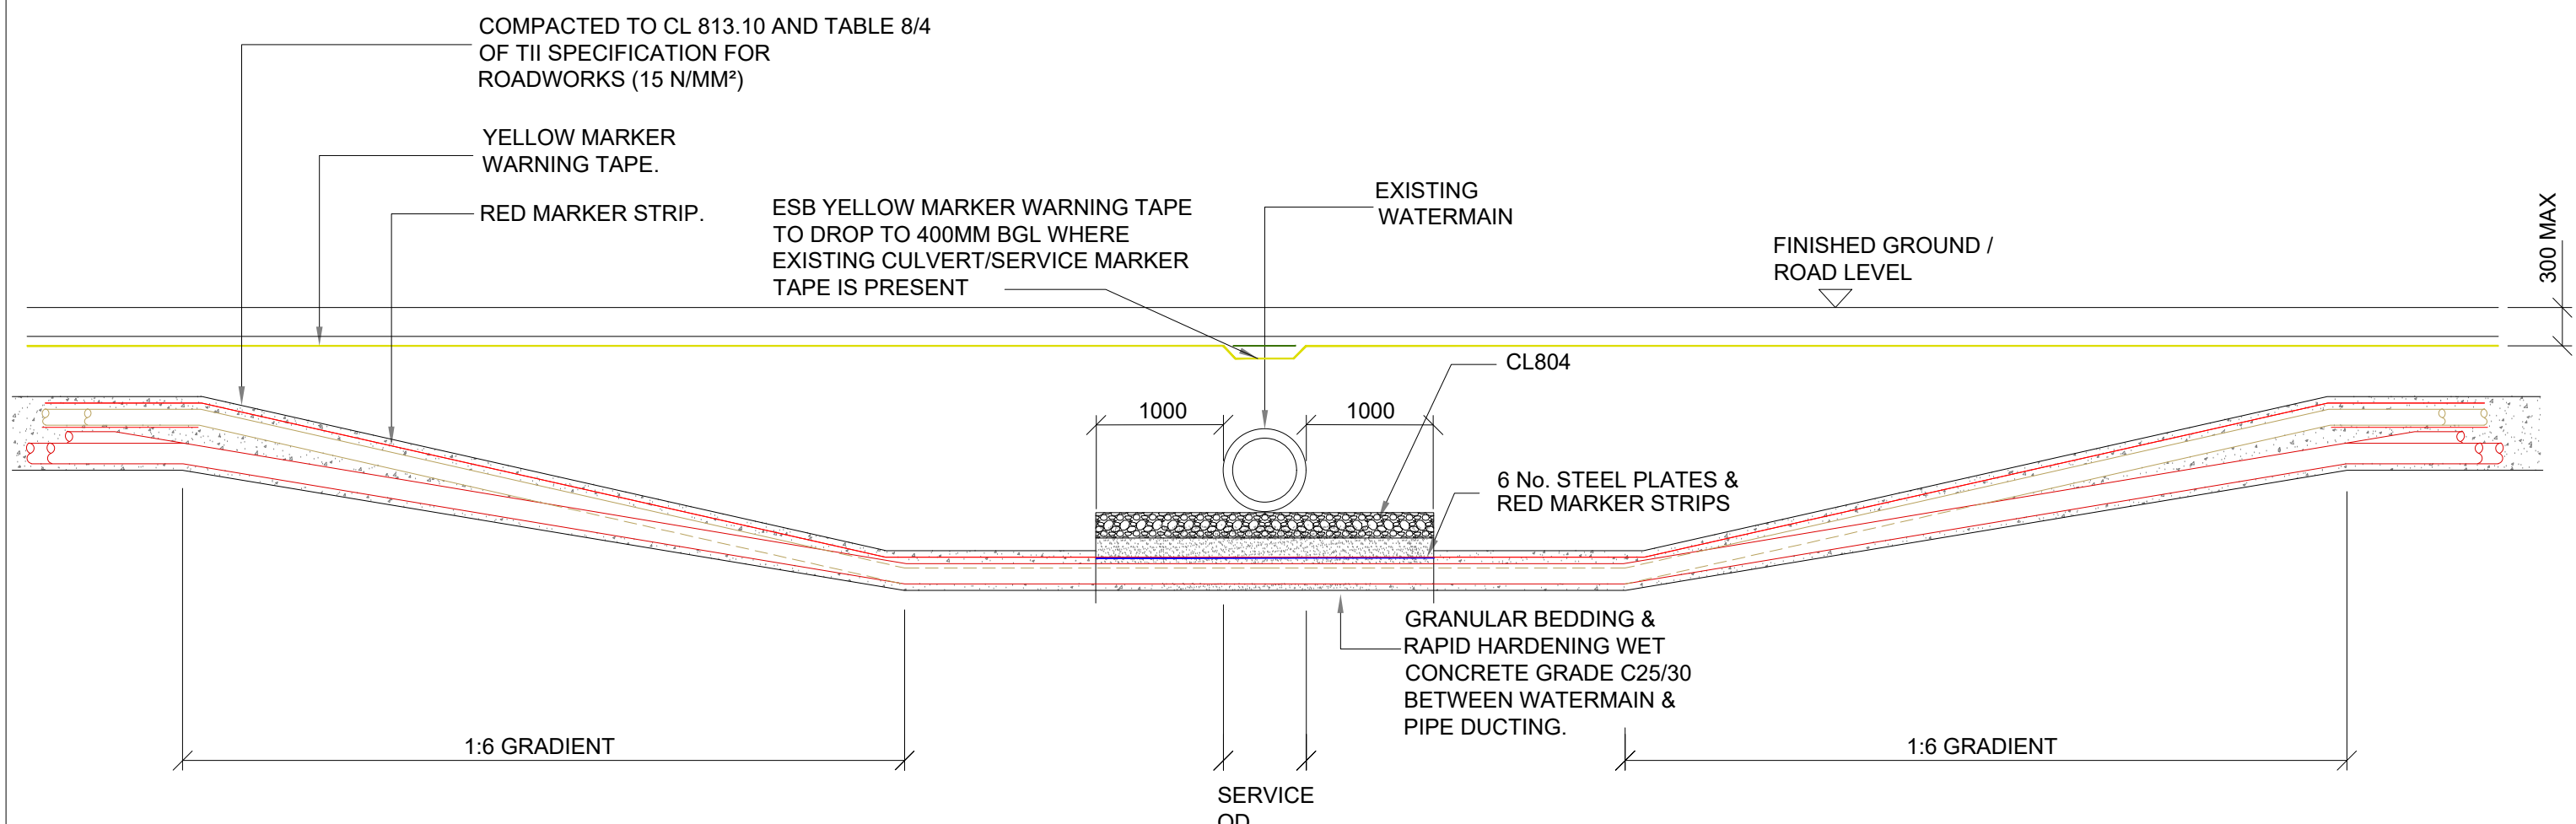


SECTION B-B
SCALE 1:50

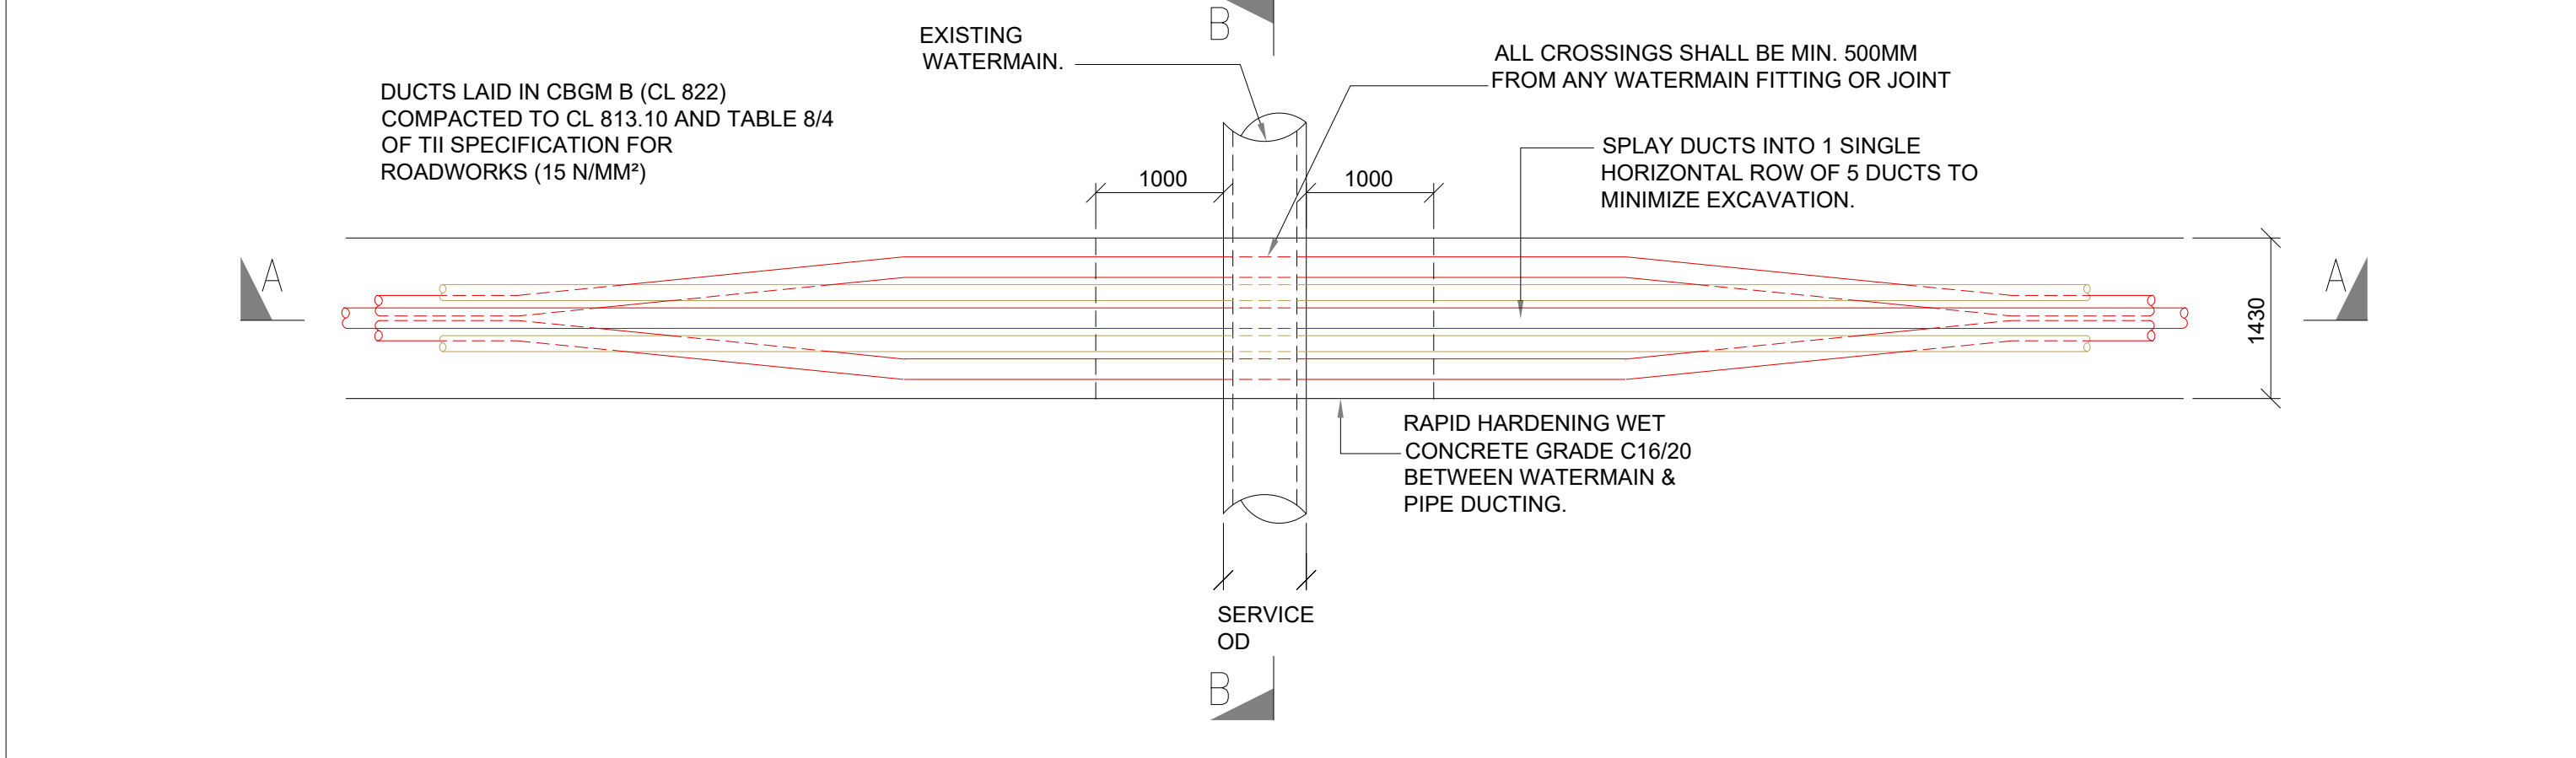


PLAN VIEW
SCALE 1:50

WATERMAIN UNDERCROSSING

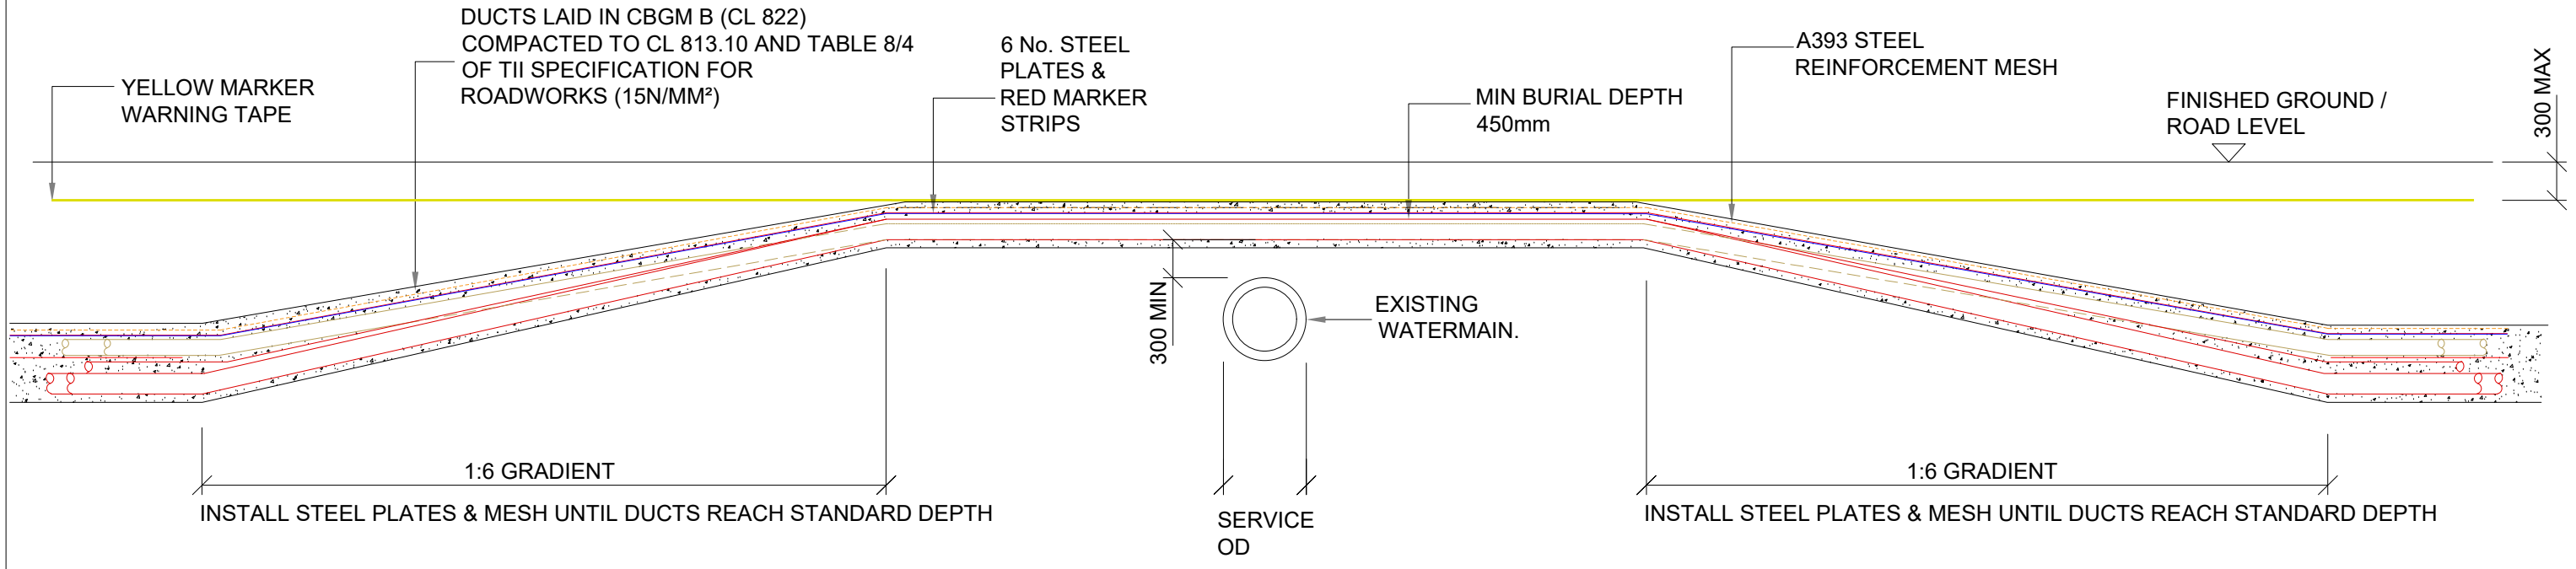

SECTION D-D
SCALE 1:50

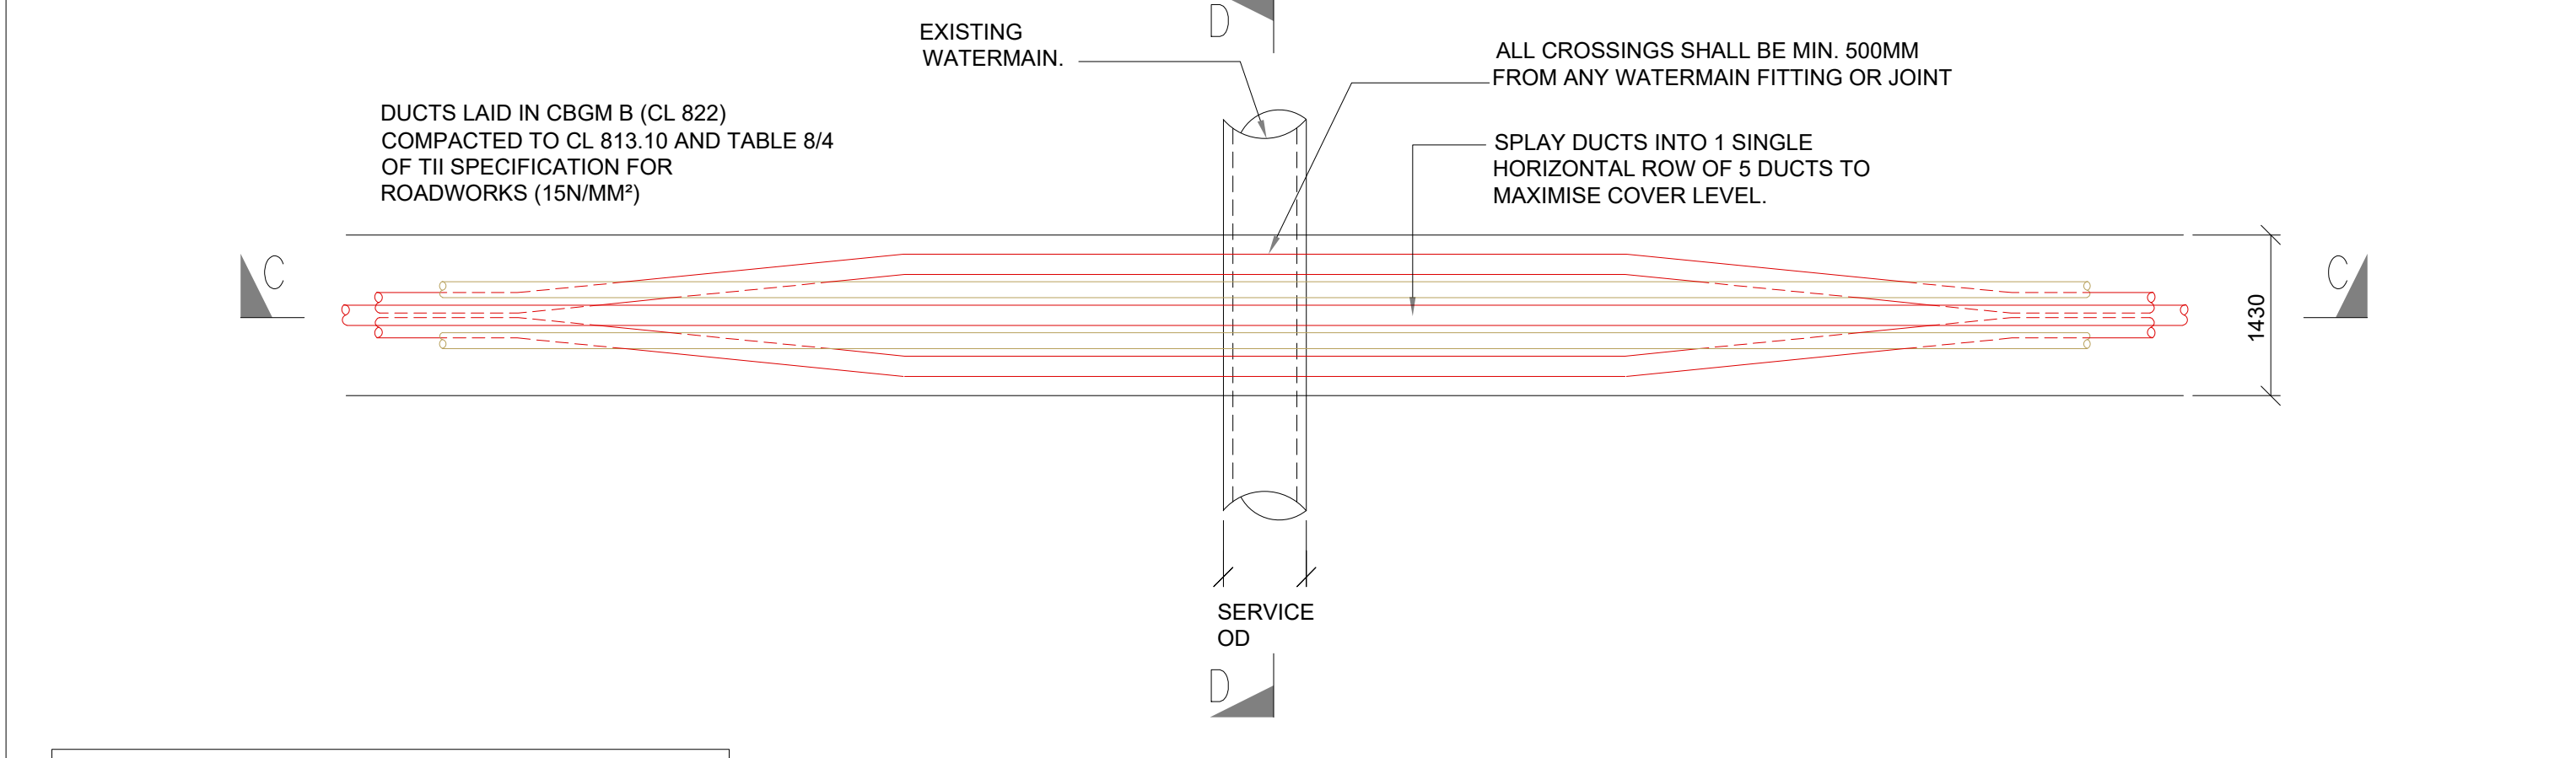


PLAN VIEW
SCALE 1:50



WATERMAIN OVERCROSSING

GENERAL NOTES

- This drawing is to be read in conjunction with all other relevant documentation.
- Do not scale from this drawing use only printed dimensions.
- All dimensions are in millimetres, all chainages, levels and co-ordinates are in metres unless defined otherwise.
- This drawing is to be read in conjunction with the project Health & Safety file for any identified potential risks.
- No excavation shall commence until the contractor has consulted up to date services drawings and carried out an Electromagnetic Locator (EML) Scan.
- Hand dig only within 500mm of existing services.
- If compacting CBGM B could cause damage to the culvert / service below, use rapid hardening cement grade C25/30 following engineers prior approval.
- For standard trench cross section drawings and minimum horizontal separation to existing services, see 05725-220 (TREFOIL) and 05725-223 (FLAT).
- Where depths exceed 3000mm to the top of duct the contractor shall consult the cable system design engineer for phase spacing requirements.
- All works shall be in accordance with Irish Water code of practice for infrastructure.
- Backfill as per guidelines for the opening, backfilling and reinstatement of openings in public roads (2015)
- As per WIS 4-08-02 & IGN 4-08-01 granular material shall be 14mm to 5mm graded aggregate or 10mm single sized aggregate
- All Products and materials to be utilised during construction to comply with Eirgrid functional specification for road works and all relevant Irish (European) and British standards
- 300mm minimum vertical and horizontal clearances to be observed between cable ducts and third party services (e.g. gas pipes, water mains, culverts etc.) In the case of high risk 3rd party services, greater clearances may be required. Designer to consult Eirgrid and 3rd party service owners for guidance
- Steel plates must cover ducts. No overlap is required however standard dimensions may result in an overlap. Spacing of 10mm to be maintained between steel plates to prevent the transfer of stray current.
- Templates are to be used at 5m intervals during duct installation in CBGM. Pre-made 75mm wide concrete spacers to be used during duct installation in wet concrete
- If existing service marker tape is not present, the ESBN yellow marker tape should be installed at maximum 300mm below finished surface level

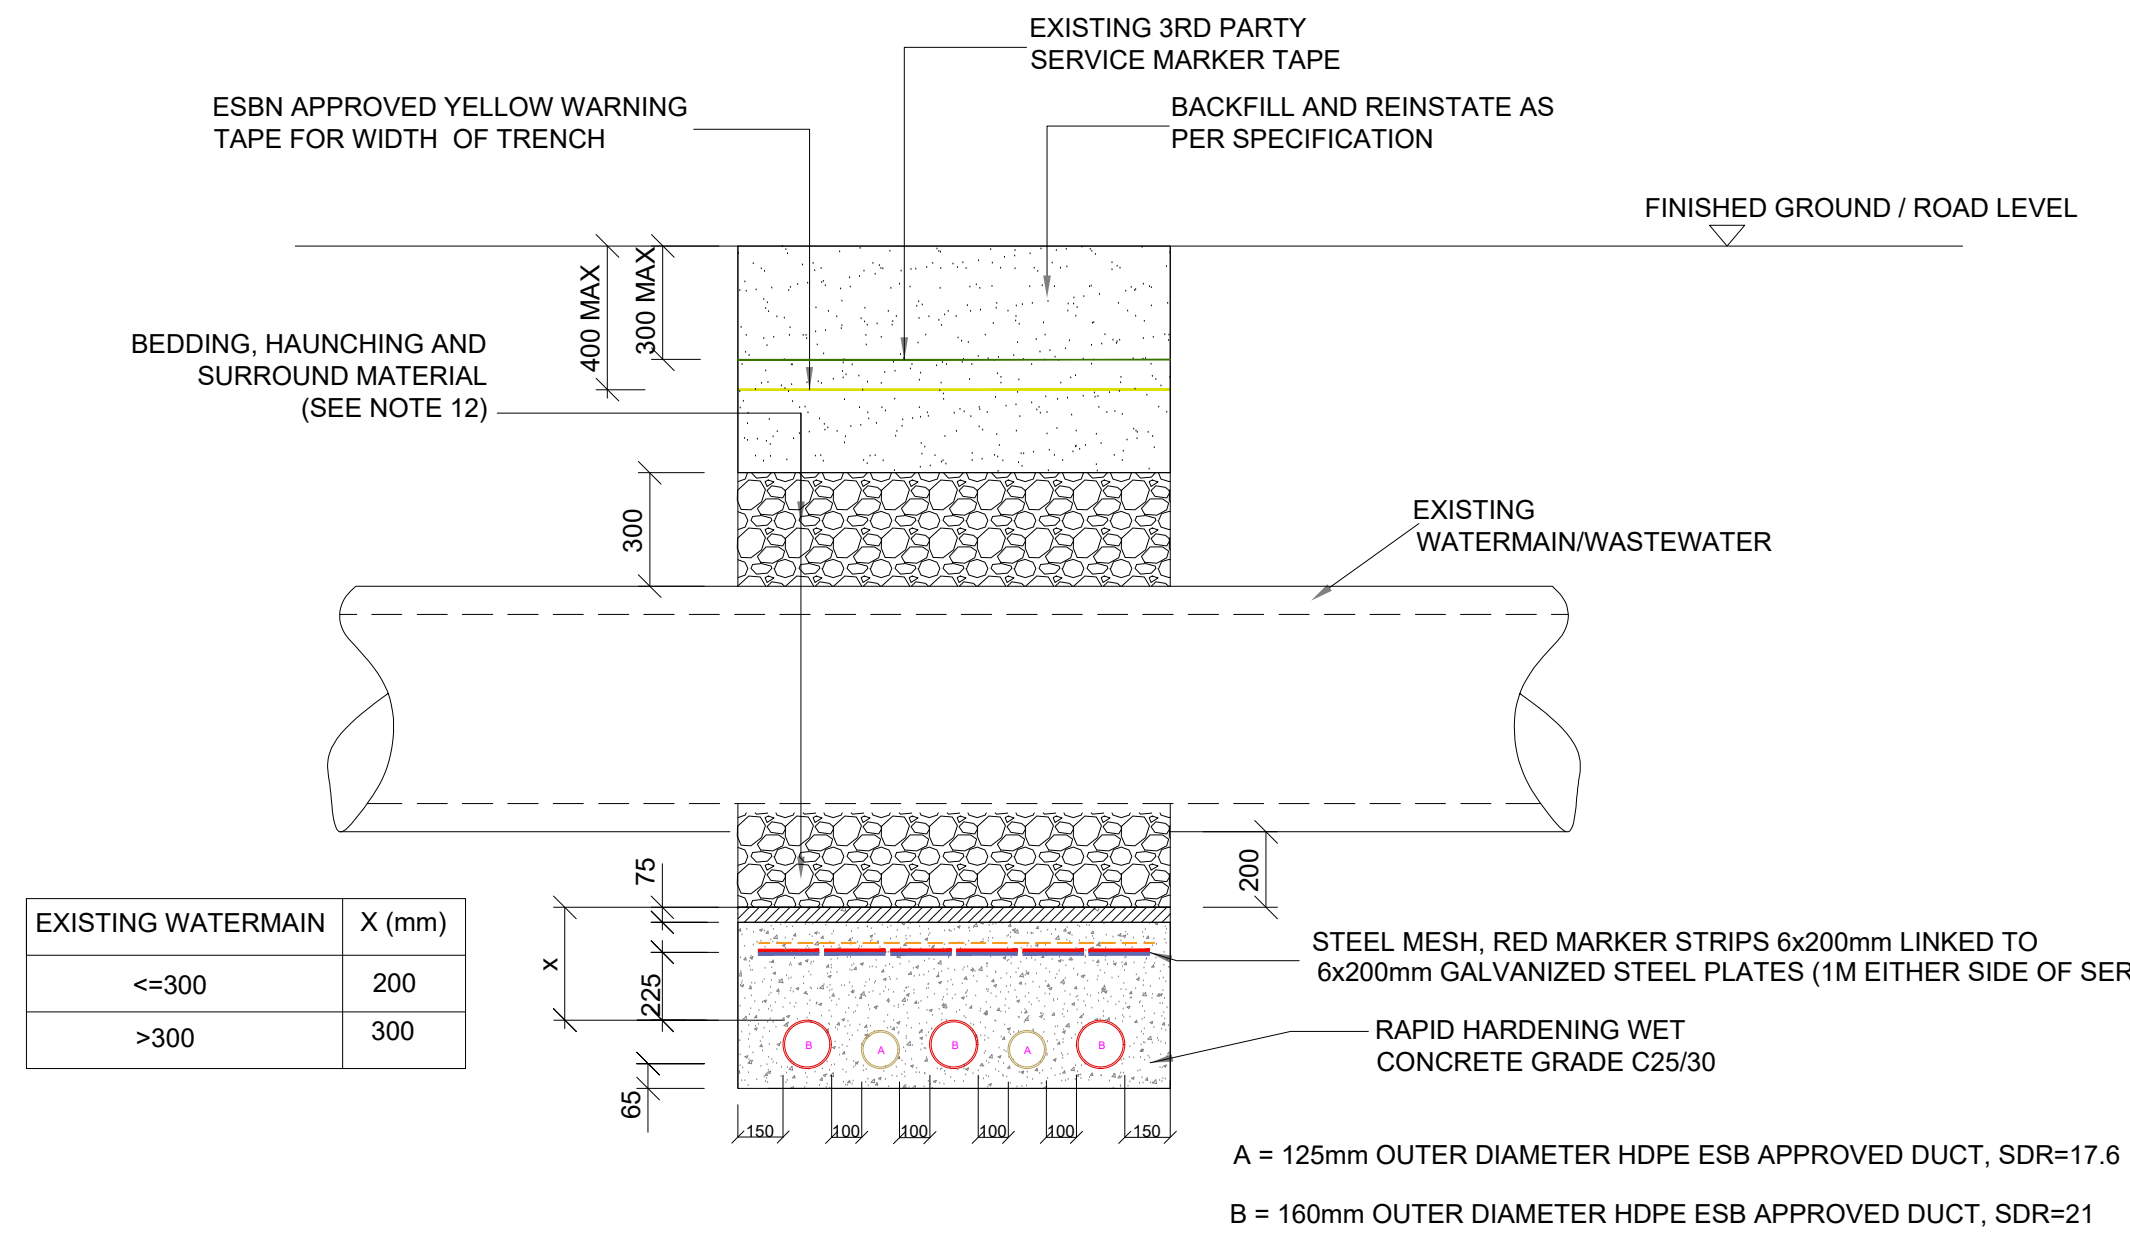

SECTION A-A
SCALE: NTS

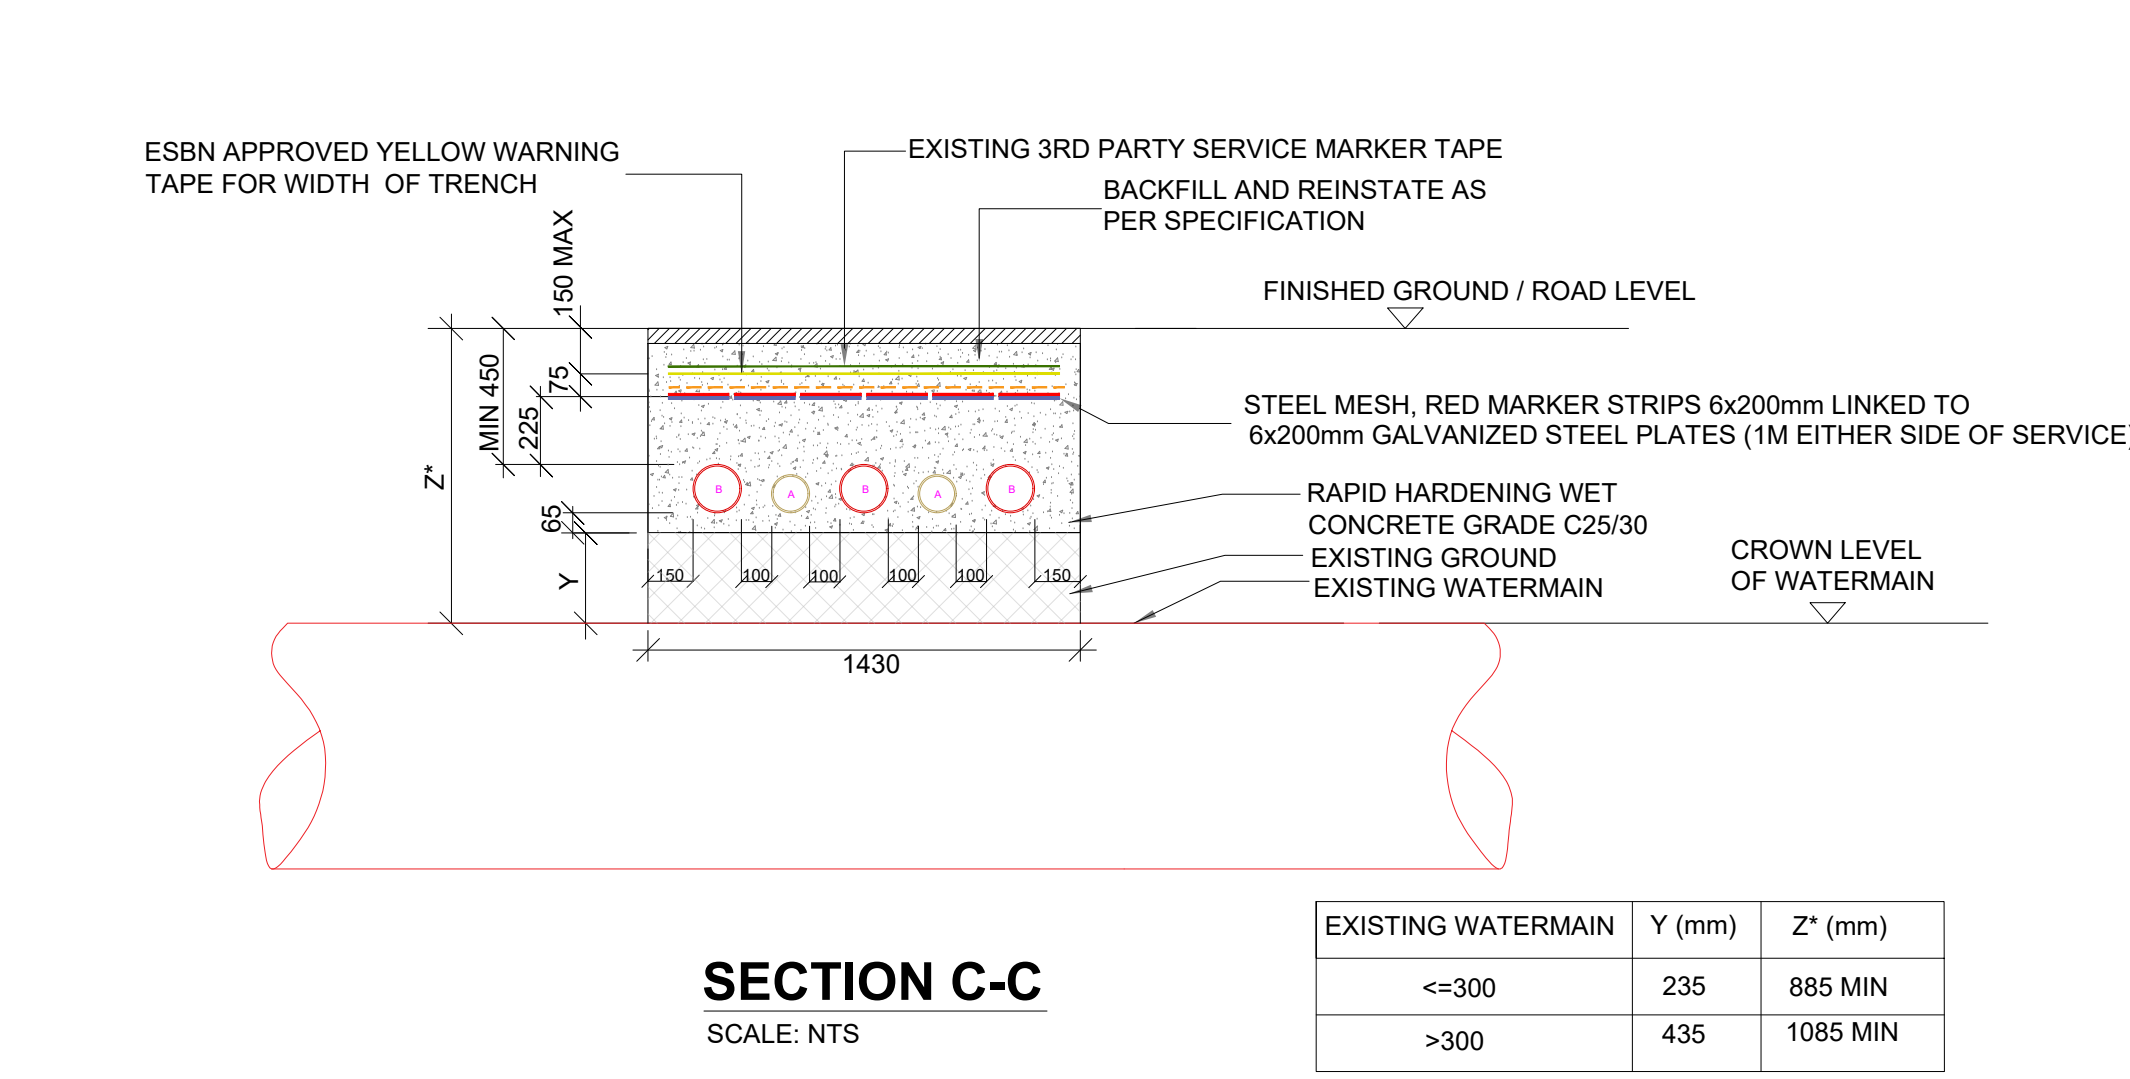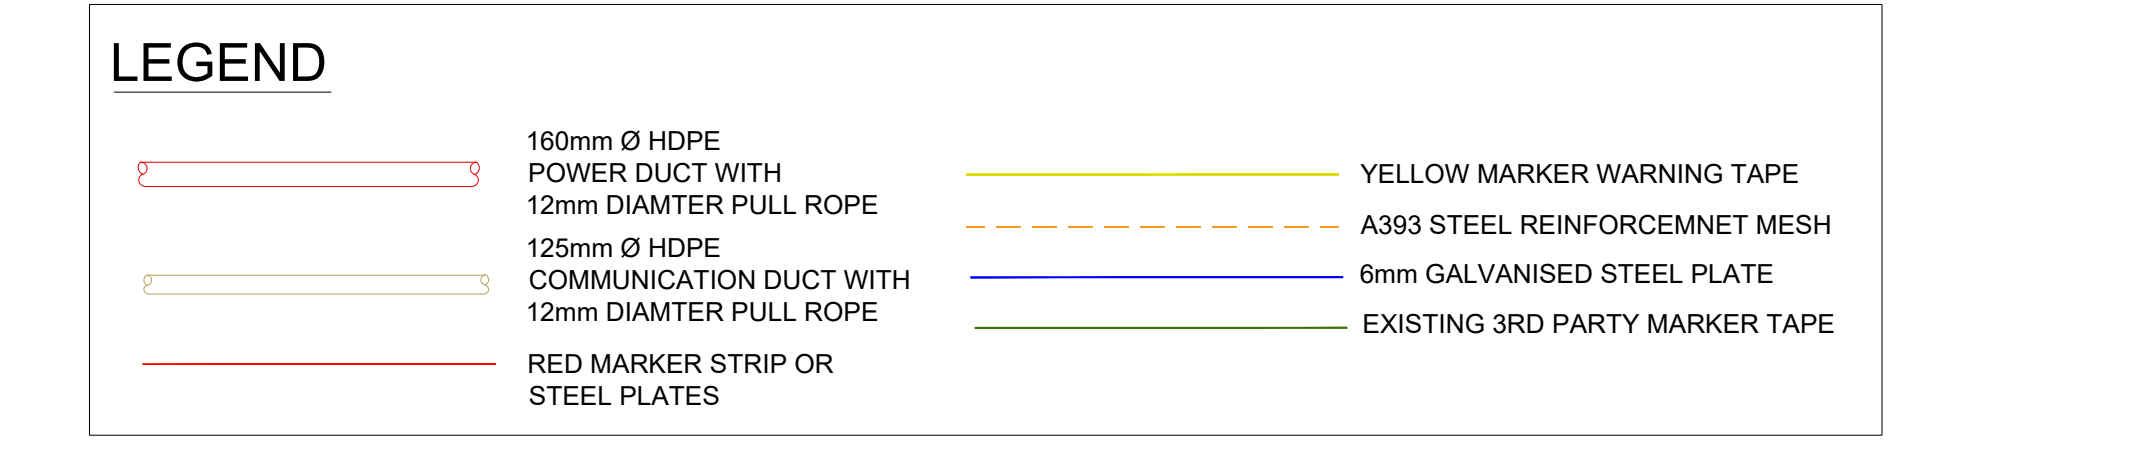

SECTION C-C
SCALE: NTS

EXISTING WATERMAIN	Y (mm)	Z* (mm)
<=300	235	885 MIN
>300	435	1085 MIN

* ALL EXISTING SERVICES WITH COVER LESS THAN MIN. DIMENSIONS ABOVE SHALL BE CROSSED BY UNDERCROSSING METHOD

tli GROUP

Head Office
Beenrigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT
**Clogherchor Wind Farm
110kV Grid Connection**

CLIENT
FuturaEnergy Ireland

Orsted

CONSULTANTS
TOBIN
CONSULTING ENGINEERS

NOTES: -
See General Notes

LEGEND: -

ISSUE/REVISION

NO	DATE	DESCRIPTION
P02	11.01.23	Issued for Application
P01	03.10.22	Issued for Application
P00	20.09.22	Issued for Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER
05-725

SHEET TITLE
Typical Trench Sections for
Crossing Watermain/Wastewater

SHEET NUMBER
05725-DR-130