


Appendix 9A: Noise and Vibration

CadnaA Output Drawings

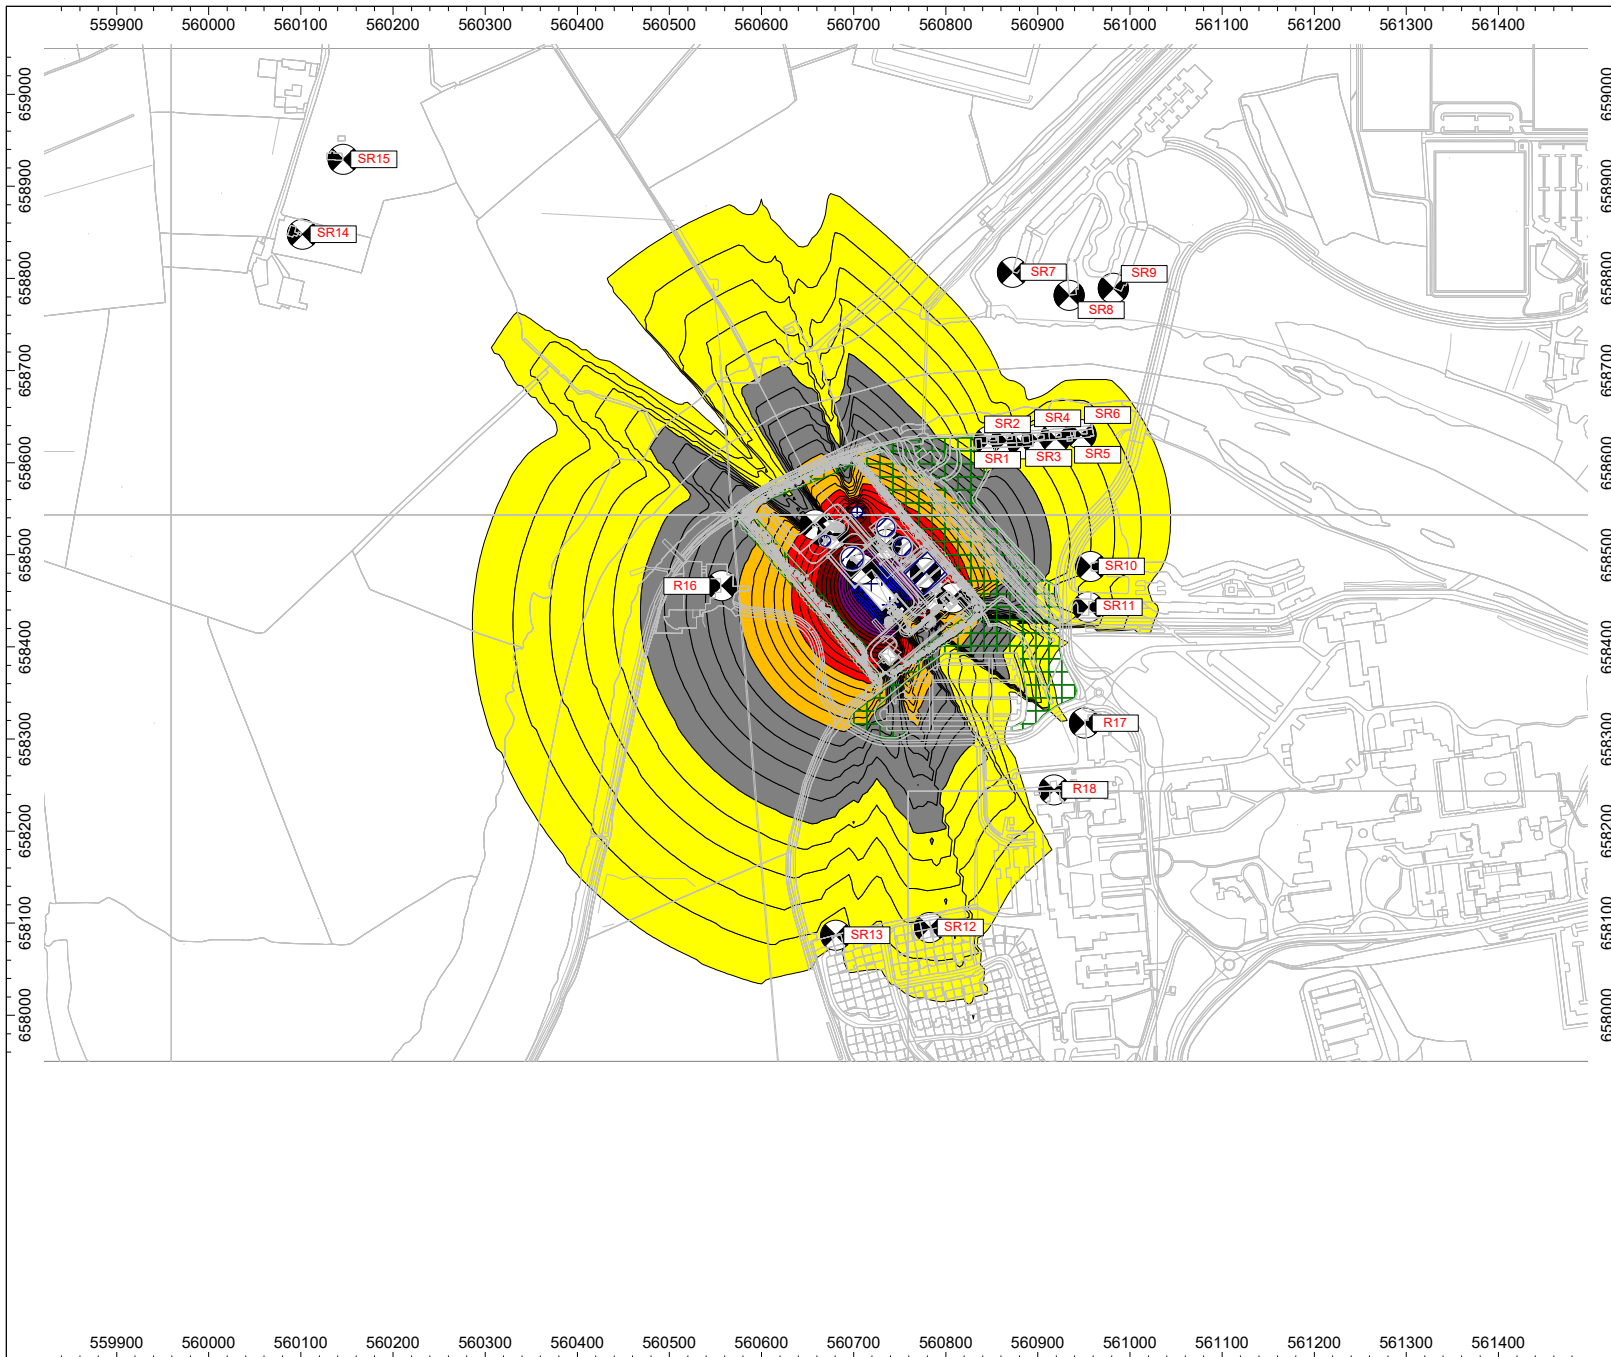

Client:
Irish Water


Project:
Castletroy Wastewater
Treatment Plant Upgrade

Prepared by:
AONA Environmental
Consulting Ltd.
www.aonaenvironmental.ie


Project Number:
ENV-6050

Drawing Title / Scenario:
Predicted construction
phase noise levels.

Drawing Number:
Figure 9.3



31.05.22

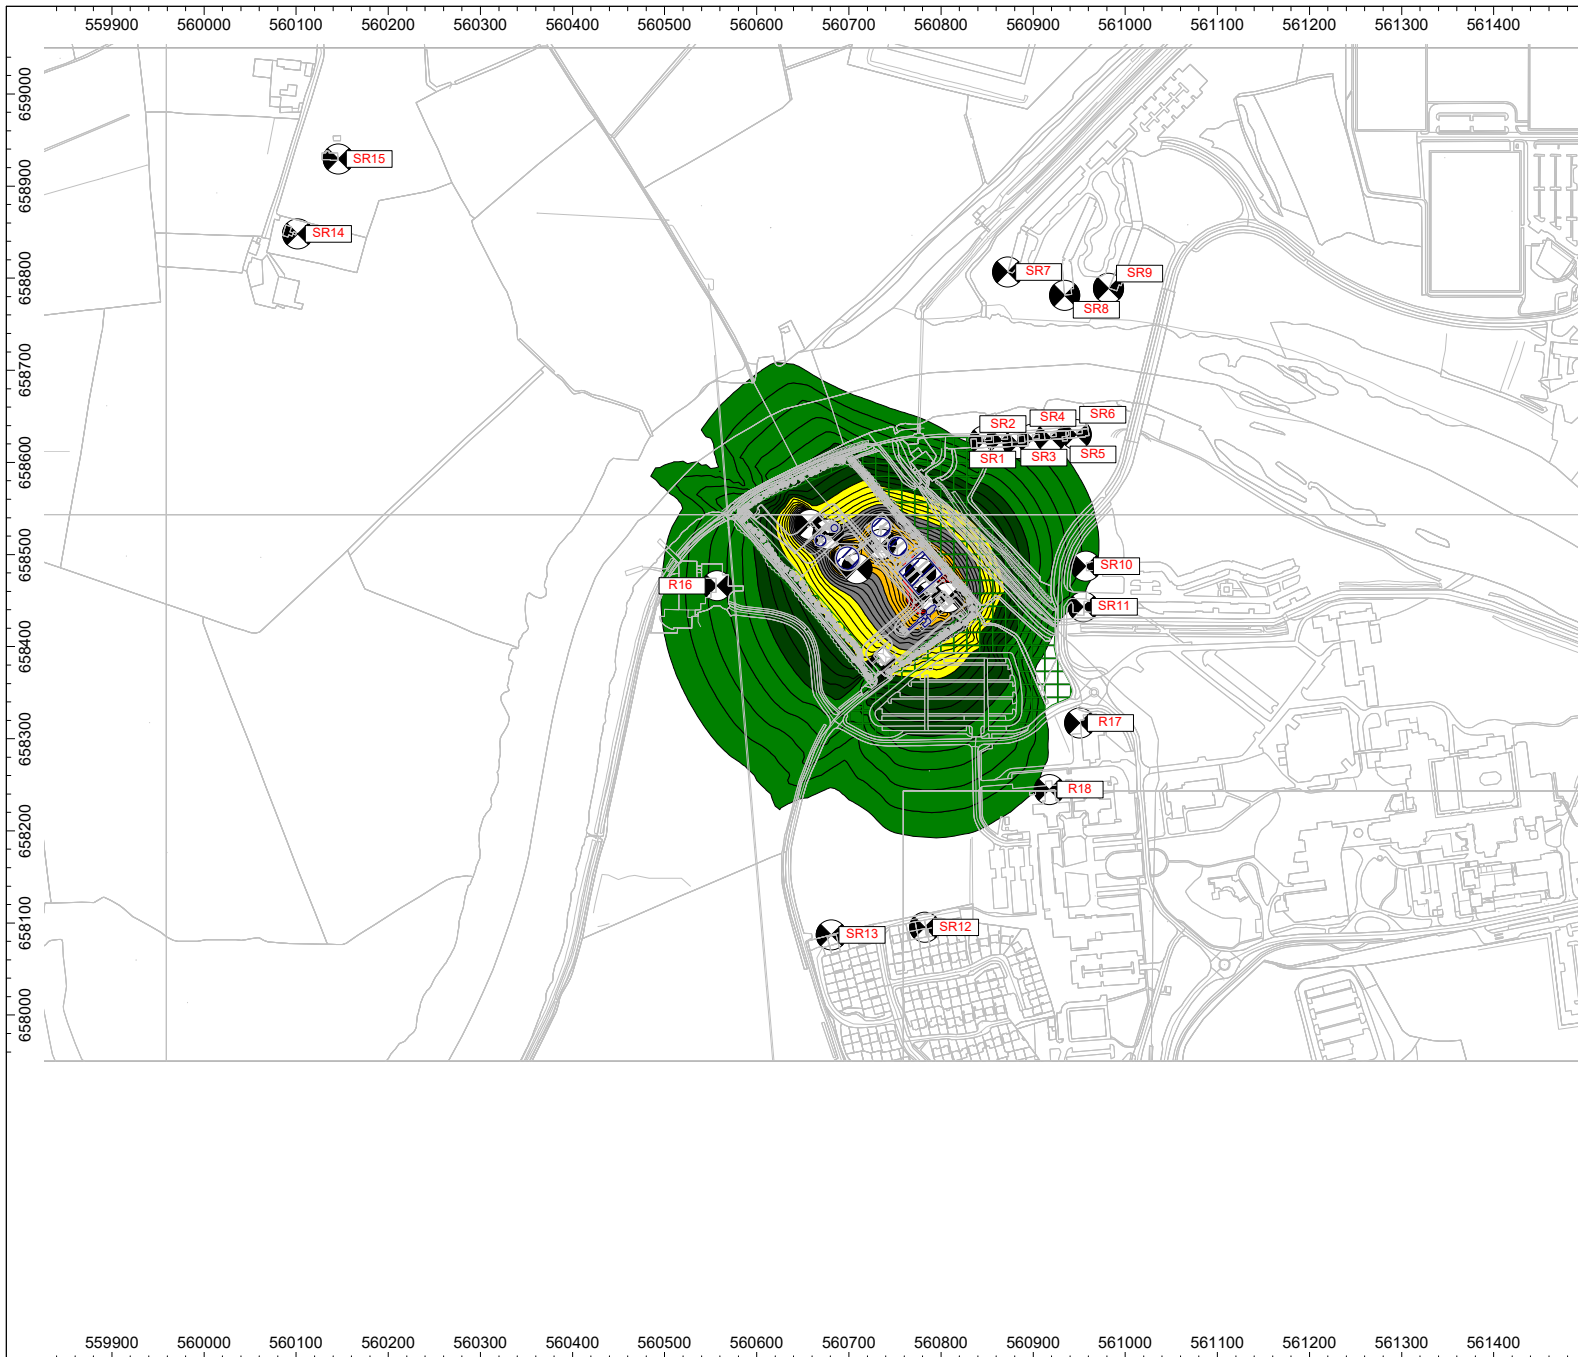

Client:
Irish Water


Project:
Castletroy Wastewater
Treatment Plant Upgrade

Prepared by:
AONA Environmental
Consulting Ltd.
www.aonaenvironmental.ie


Project Number:
ENV-6050

Drawing Title / Scenario:
Predicted existing
operational noise levels.

Drawing Number:
Figure 9.6

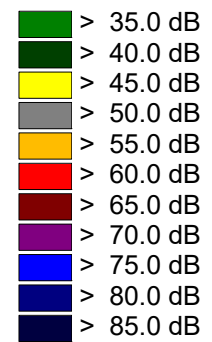

31.05.22

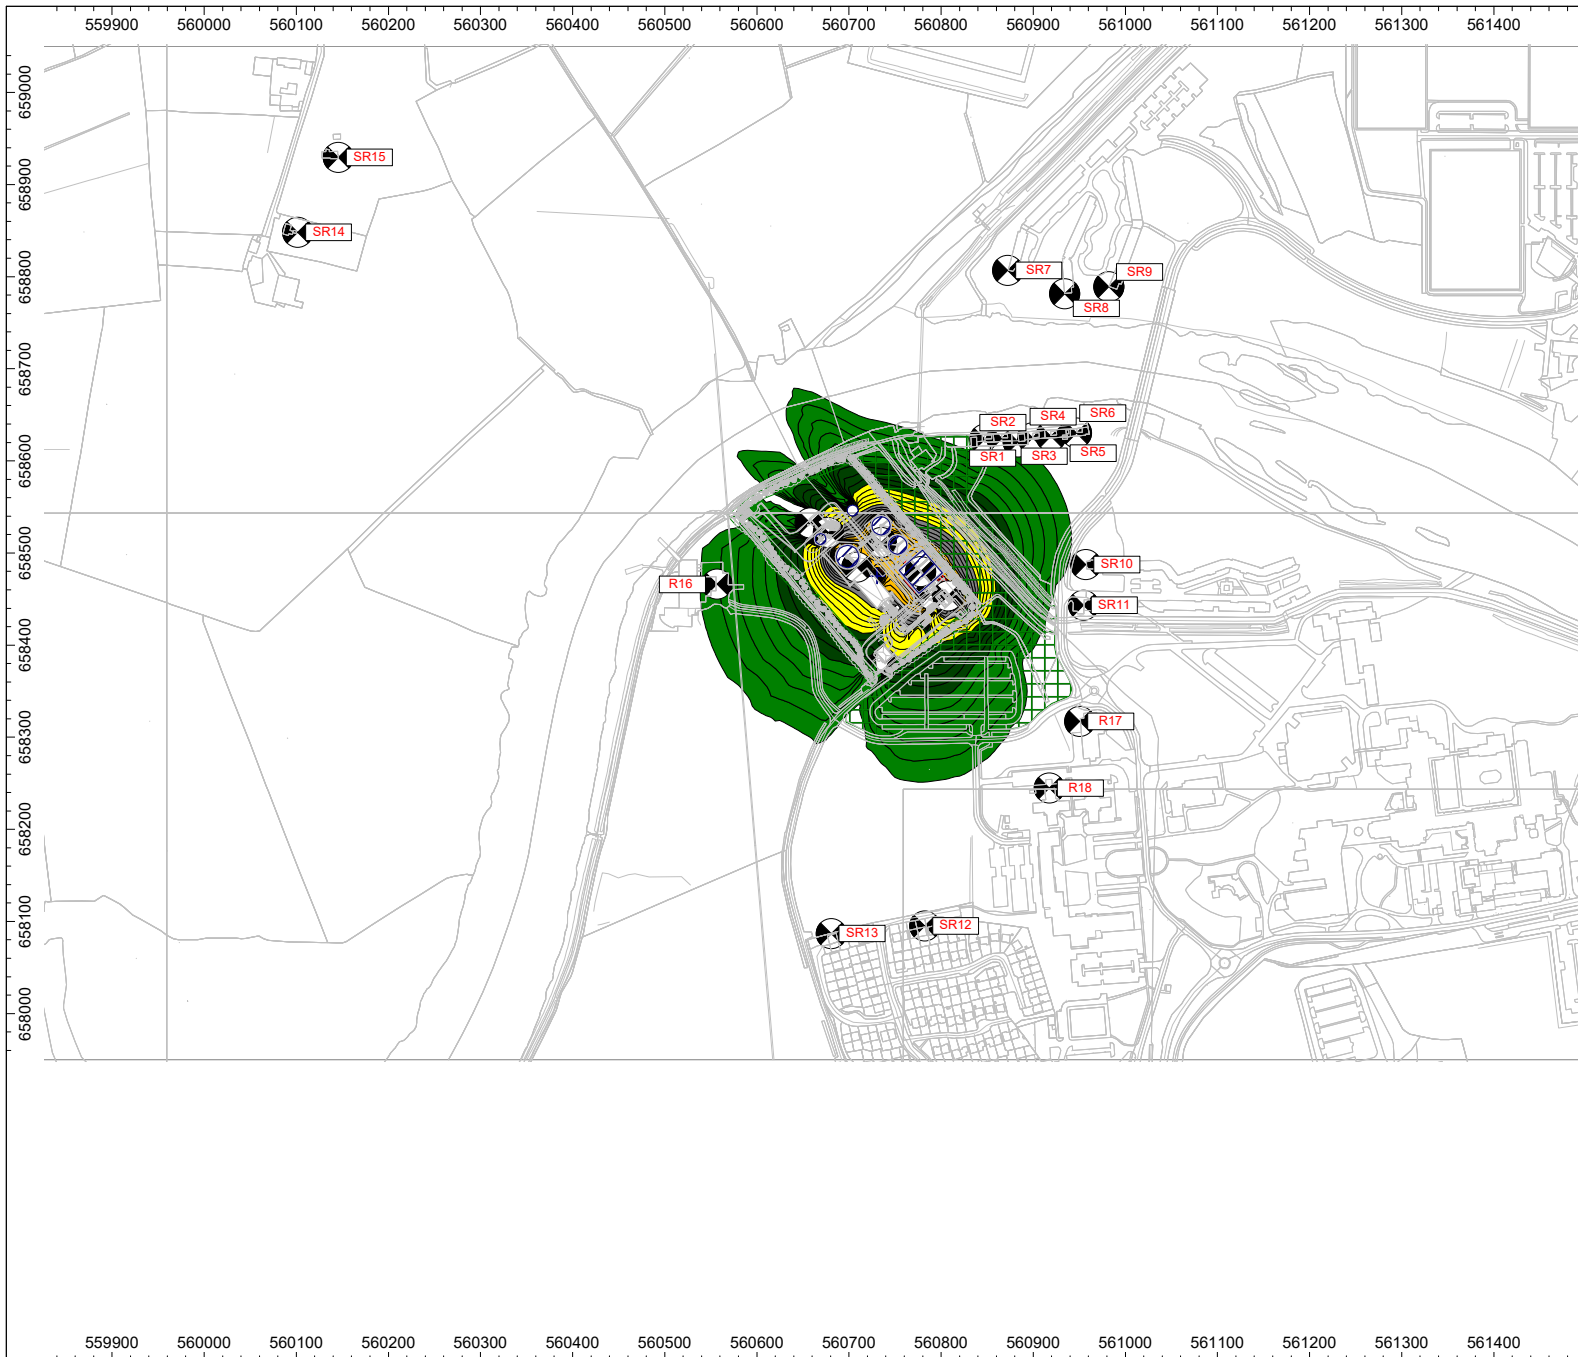

Client:
Irish Water


Project:
Castletroy Wastewater
Treatment Plant Upgrade

Prepared by:
AONA Environmental
Consulting Ltd.
www.aonaenvironmental.ie

Project Number:
ENV-6050

Drawing Title / Scenario:
Predicted Proposed
Upgrade operational noise
levels.

Drawing Number:
Figure 9.7

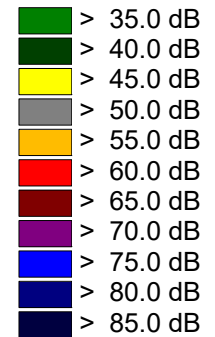

31.05.22