



Baldonnell 110kV Substation

LVIA Photomontages

May 2023

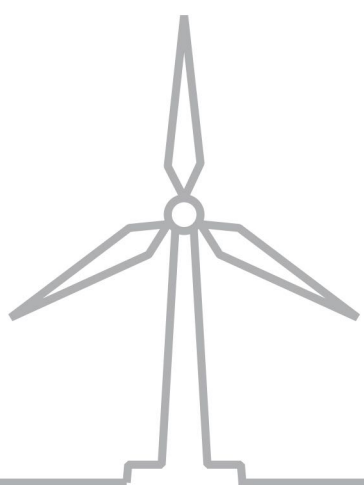

INDEX

Viewpoint 1 - Imminent baseline with Outline view

Viewpoint 4 - Imminent baseline with Outline view
Imminent baseline with Montage view

Viewpoint 7 - Imminent baseline with Outline view
Imminent baseline with Montage view

Viewpoint 2 - Imminent baseline with Outline view
Imminent baseline with Montage view


Viewpoint 5 - Imminent baseline with Outline view

Viewpoint 8 - Imminent baseline with Outline view

Viewpoint 3 - Imminent baseline with Outline view

Viewpoint 6 - Imminent baseline with Outline view

L VIA viewpoint locations for Baldonnell 110kv Substation project

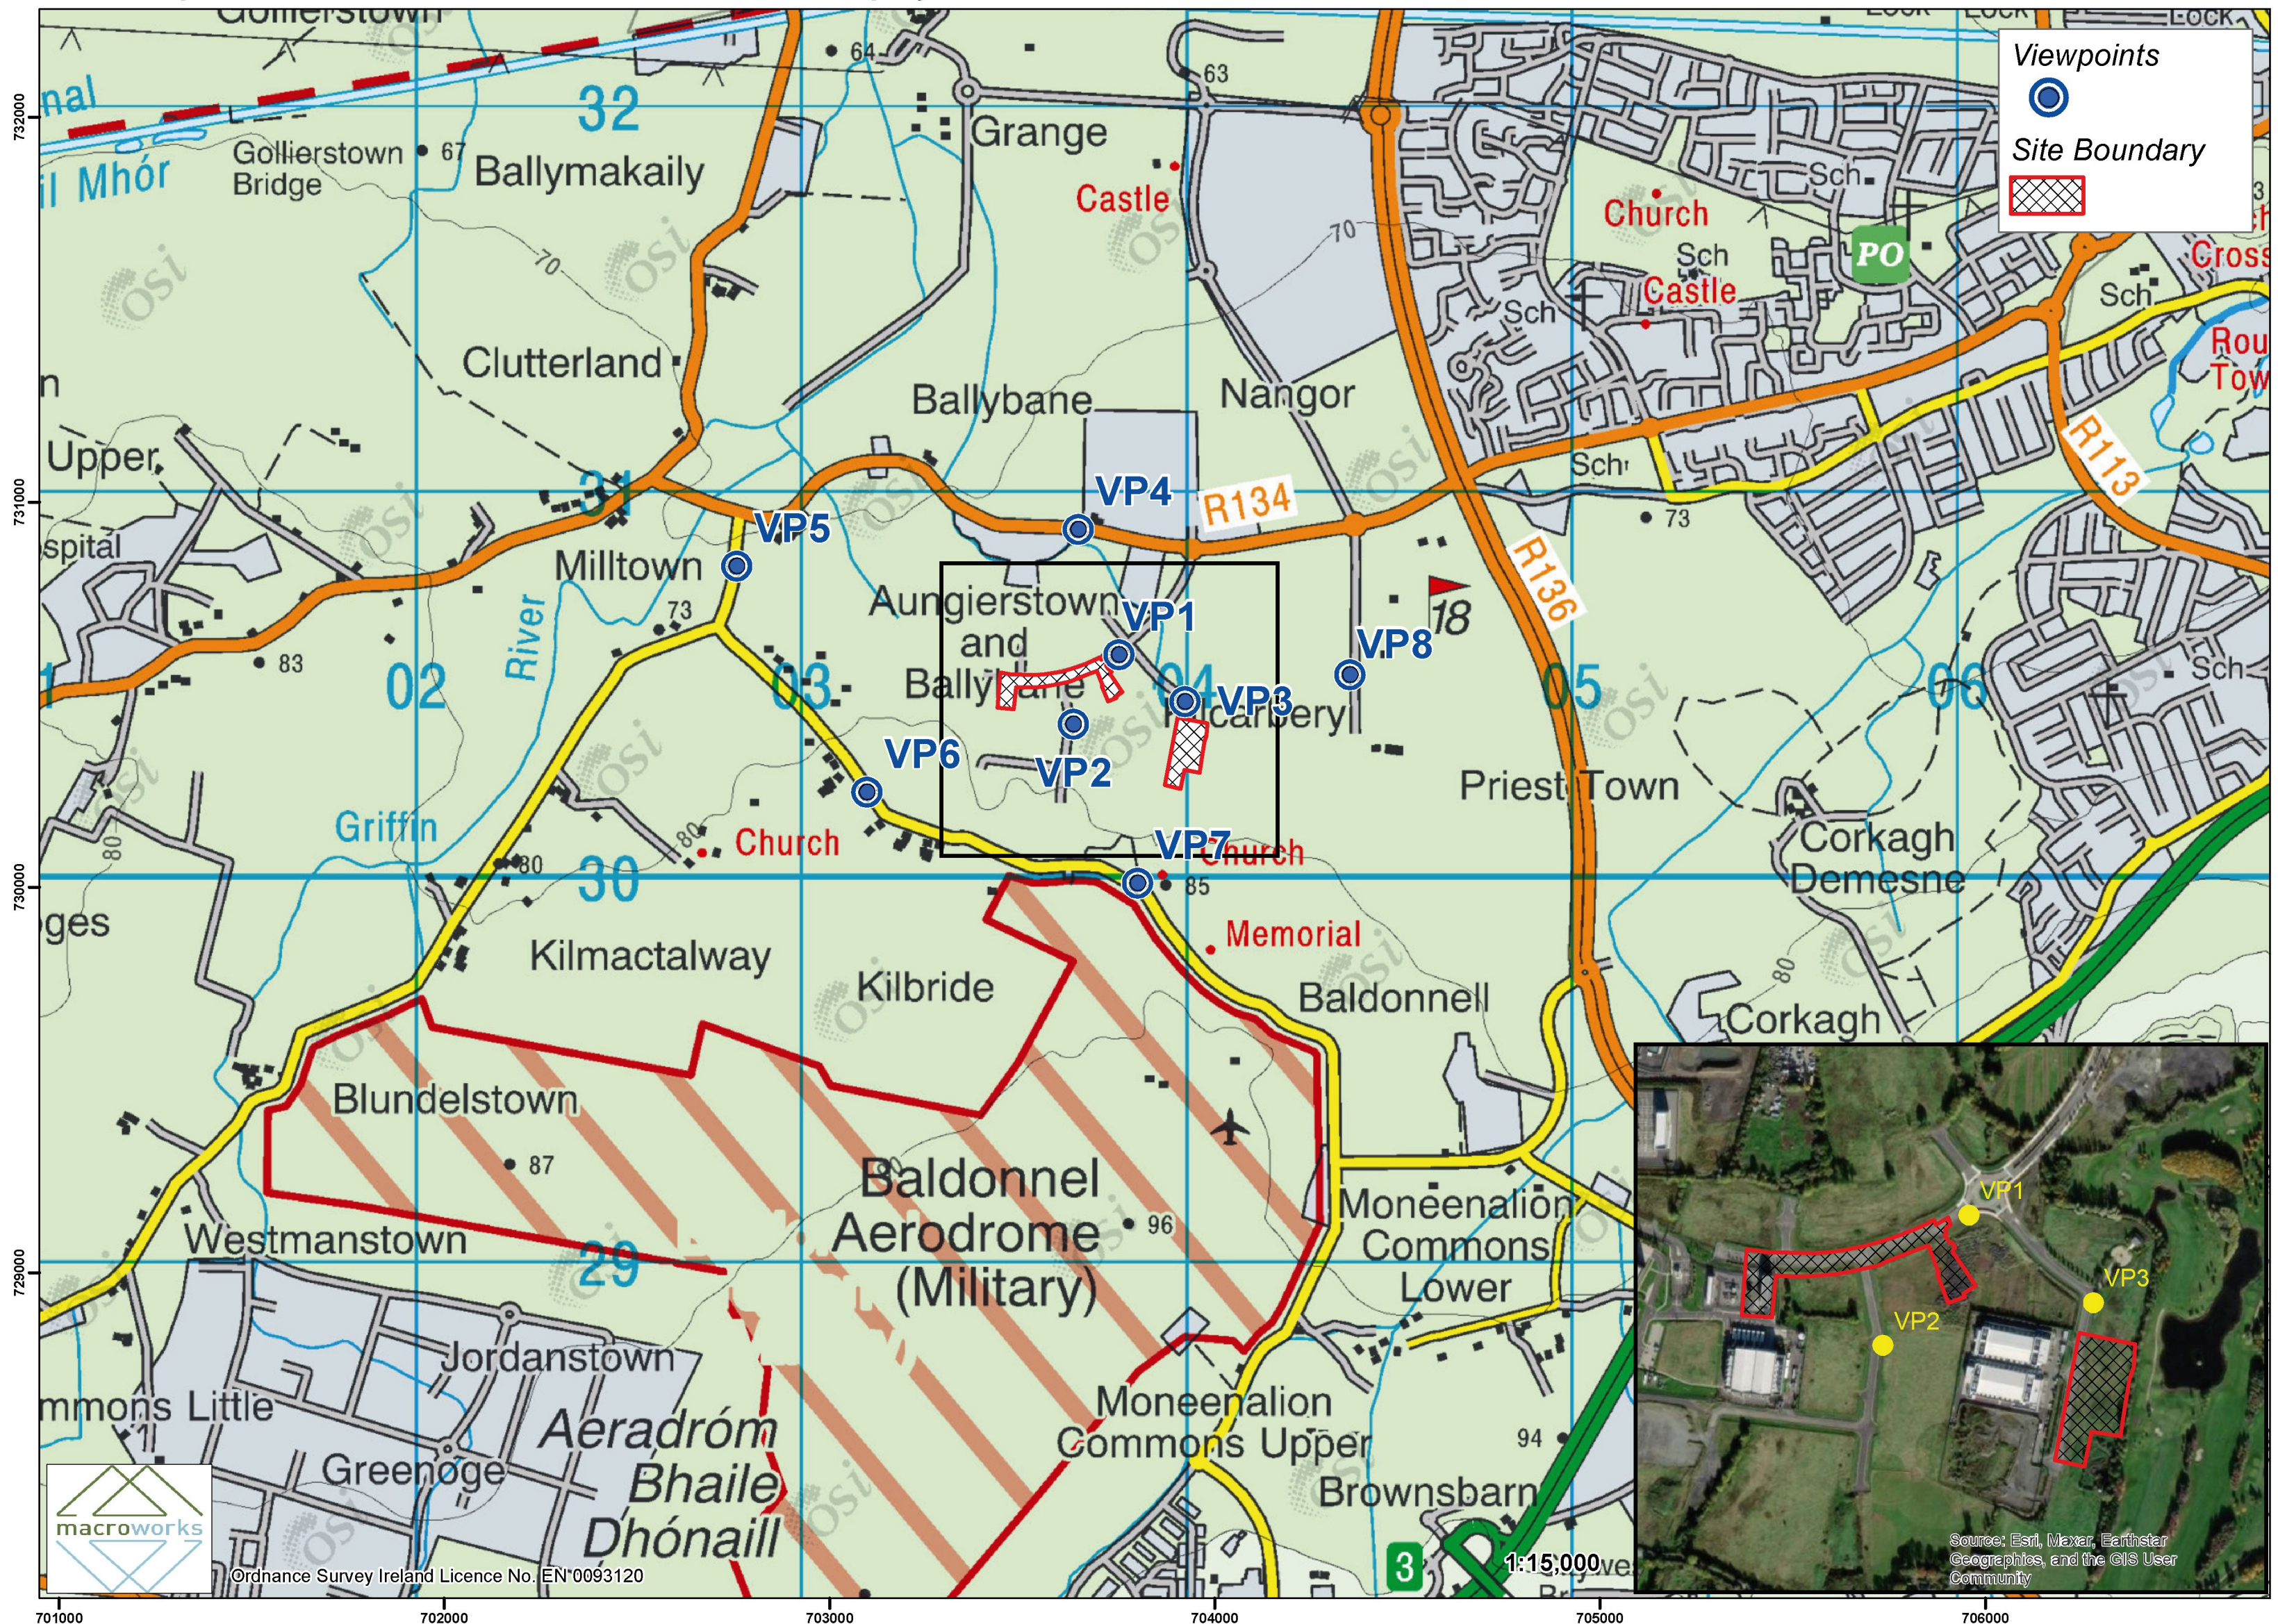

701000

702000

703000

704000

705000

706000



Ordnance Survey Ireland Licence No. EN'0093120

Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community



Please note: The proposed substation is not visible in this view therefore the montage view is not included

These are 160° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 25cm. To see this entire panoramic scene in reality would necessitate turning one's head through 120°.

Easting (ITM):	703751	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730605	Camera:	Canon 1-D Mark II digital SLR	Time:	10:25
Direction of View	172° E of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	160°				



Imminent baseline + Outline view



Baldonnell 110 kV Substation (Proposed)

Imminent baseline + Montage view



These are 80° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 40°.

Easting (ITM):	703632	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730424	Camera:	Canon 1-D Mark II digital SLR	Time:	10:42
Direction of View:	60° E of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	80°				



Imminent baseline + Outline view



Please note: The proposed substation is not visible in this view therefore the montage view is not included

These are 100° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 60°.

Easting (ITM):	703923	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730483	Camera:	Canon 1-D Mark II digital SLR	Time:	12:56
Direction of View:	92° W of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	100°				



Imminent baseline + Outline view



Baldonnell 110 kV Substation (Proposed)

Imminent baseline + Montage view



These are 80° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 40°.

Easting (ITM):	703645	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730930	Camera:	Canon 1-D Mark II digital SLR	Time:	11:29
Direction of View	162° E of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	80°				





Please note: The proposed substation is not visible in this view therefore the montage view is not included

These are 80° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 40°.

Easting (ITM):	702759	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730835	Camera:	Canon 1-D Mark II digital SLR	Time:	13:36
Direction of View	108° E of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	80°				





Please note: The proposed substation is not visible in this view therefore the montage view is not included

These are 80° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 40°.

Easting (ITM):	703097	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730247	Camera:	Canon 1-D Mark II digital SLR	Time:	11:44
Direction of View:	69° E of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	80°				



Imminent baseline + Outline view



Baldonnell 110 kV Substation (Proposed)

Imminent baseline + Montage view



These are 80° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 40°.

Easting (ITM):	703799	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730011	Camera:	Canon 1-D Mark II digital SLR	Time:	11:59
Direction of View:	3° E of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	80°				





Please note: The proposed substation is not visible in this view therefore the montage view is not included

These are 80° panoramic montages captured and presented in accordance with the guidance set by the British Landscape Institute 2011 - Advice Note 01/11.

To view these panoramas on a flat surface one must move from left to right along its length whilst maintaining a perpendicular viewing direction and the specified correct viewing distance of 30cm. To see this entire panoramic scene in reality would necessitate turning one's head through 40°.

Easting (ITM):	704351	Lens:	50mm / Full Frame Sensor	Date:	25/02/2021
Northing (ITM):	730552	Camera:	Canon 1-D Mark II digital SLR	Time:	12:35
Direction of View:	94° W of Grid North	Camera Height:	1.7m Above Ground Level		
Angle of View:	80°				

