



- Notes:**
1. Configuration of substation equipment and infrastructure is subject to ESB and Eirgrid design approval.
  2. The proposed substation layout should be used for planning purposes only.
  3. This drawing is to be read in conjunction with relevant drawings, specifications and reports.
  4. Dimensions are in millimetres, unless noted otherwise.
  5. Drawings are not to be scaled. Use figured dimensions only.
  6. All levels are shown in metres above Ordnance datum.
- Legend:**

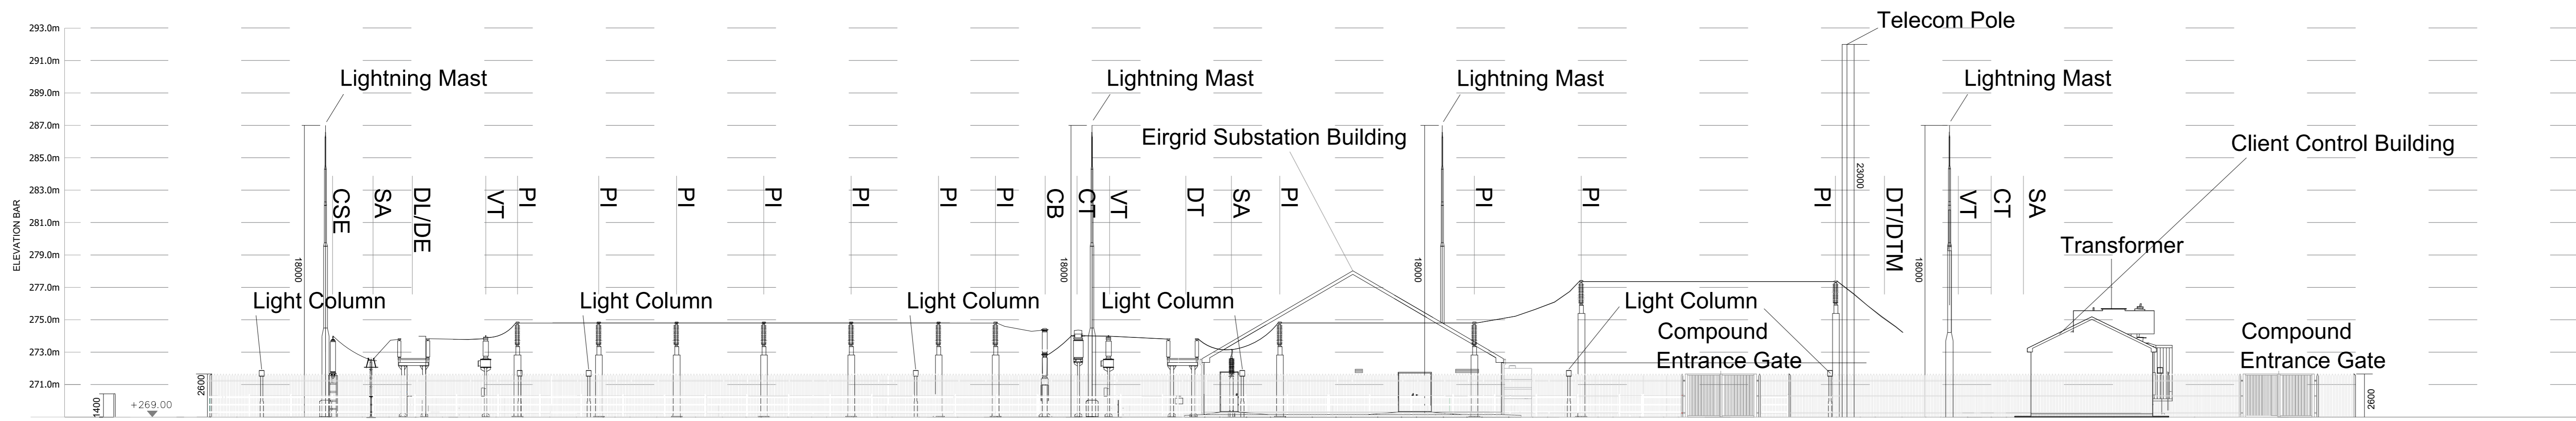


**Section A-A Elevation**

SCALE 1:200

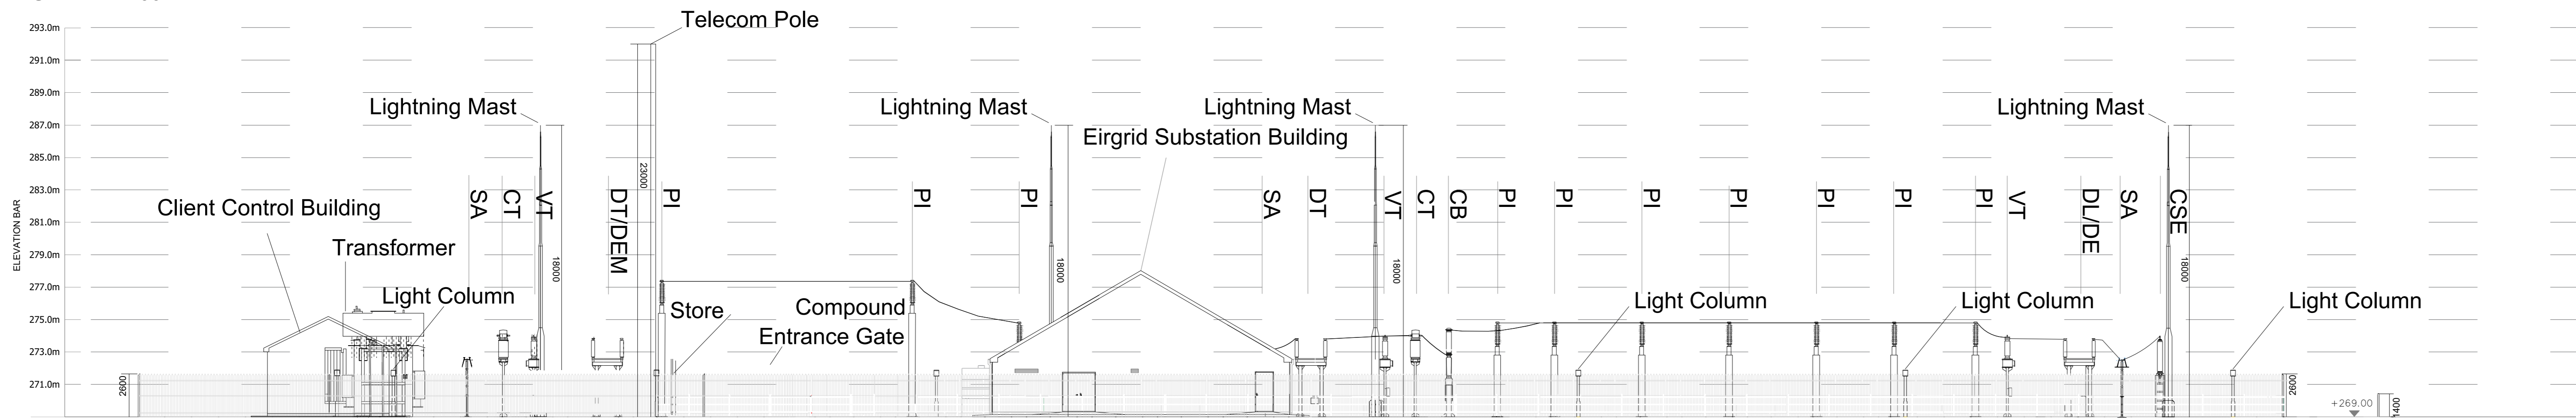


**Section B-B Elevation**

SCALE 1:200

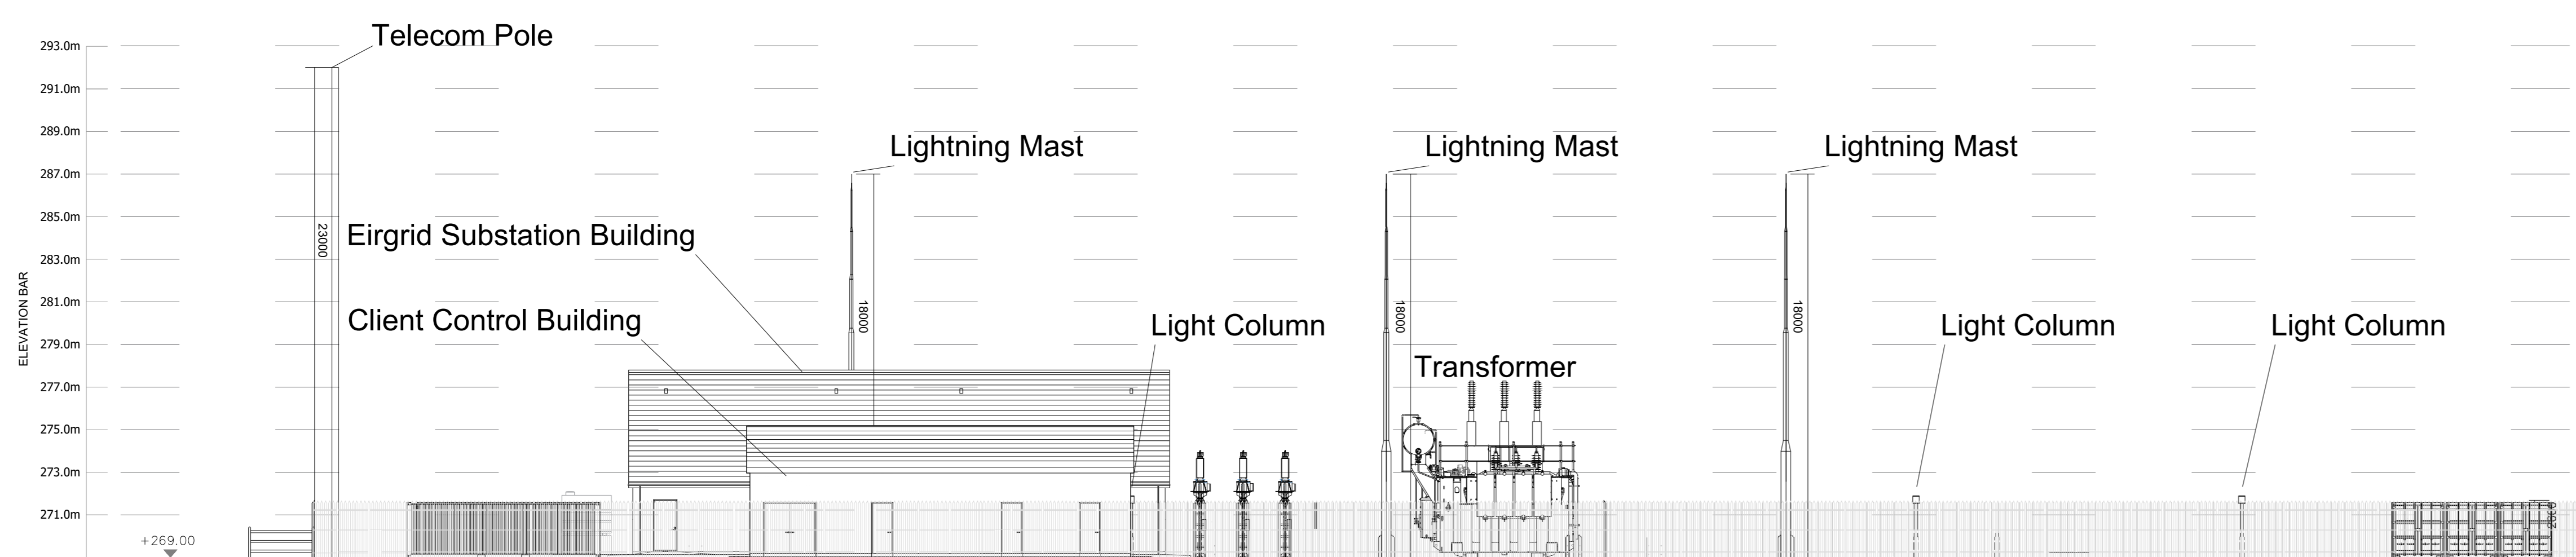

**Section C-C Elevation**

SCALE 1:200

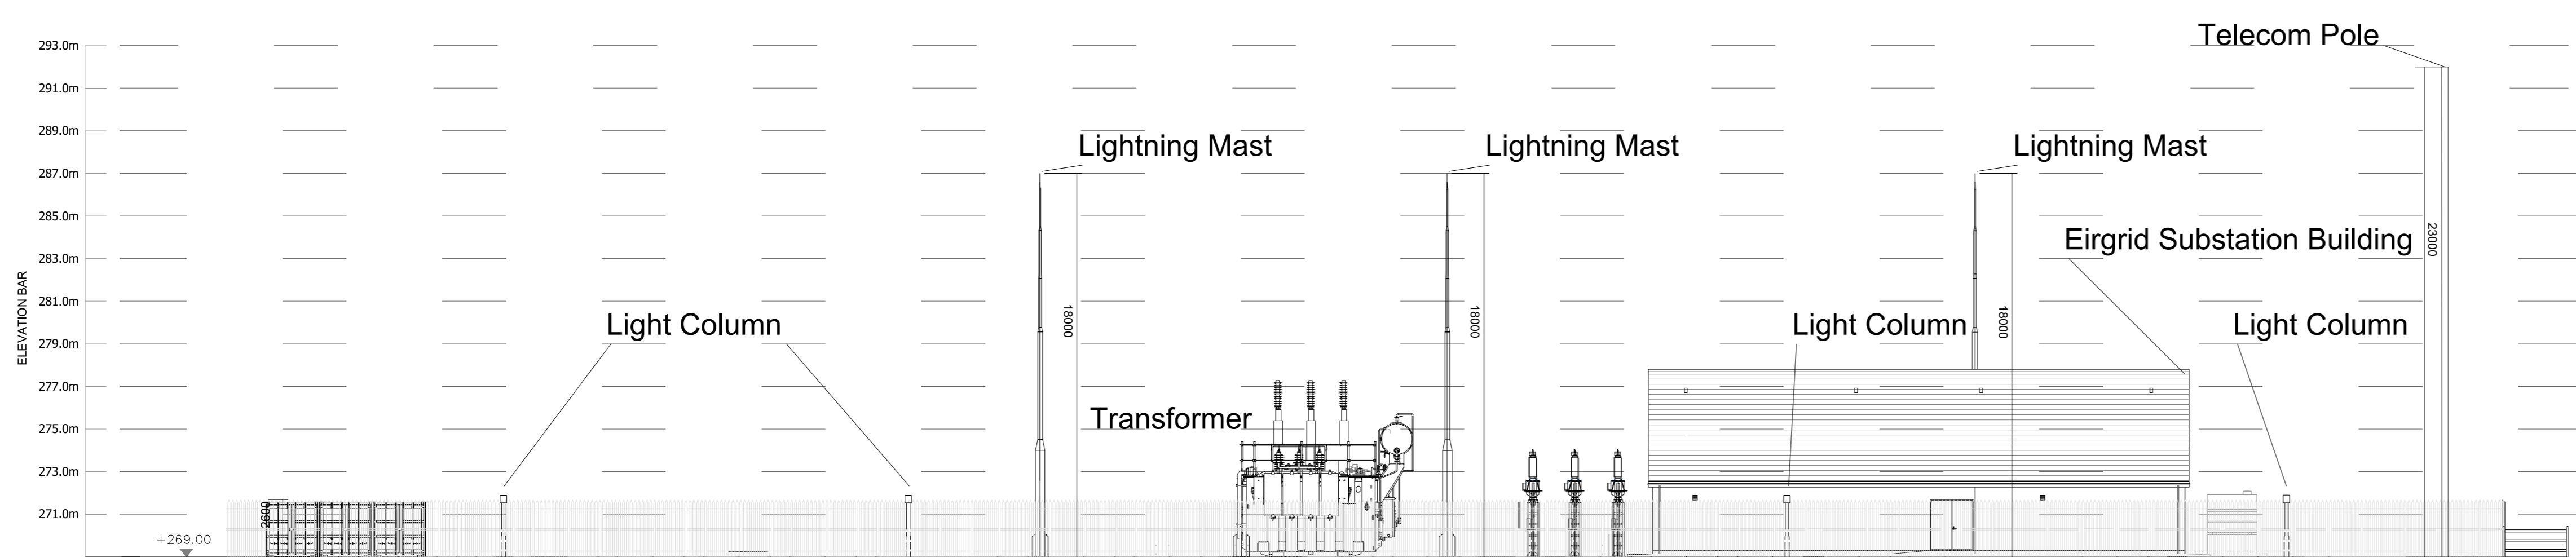

**Section D-D Elevation**

SCALE 1:200

	Description
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
DT	Disconnect.
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
PI	Post Insulator.
LM	Lighting Mast.
LS	Lamp Standard
CSE	Cable Sealing End

1	GENERAL UPDATES	07/23	LB	CO	SM
0	PLANNING APPLICATION	06/23	IG	MM	CL
Rev	Amendments	Date	By	CHK	Auth



Client: COOLGLASS WIND FARM LIMITED

Project: COOLGLASS WIND FARM

Drawing Title: PERMANENT SUBSTATION ELEVATIONS

Scale: 1:200	@ A0	SLR Project No: 428.02036.00787
Designed: CL	Checked: IG	Reviewed: MM
Date: 06/23	Date: 06/23	Date: 06/23
Client Reference: ABP-428.02036.00787.034	Sheet: 1	Total: 1

