









LEGEND:

SECUGRID 40/40 GEOGRID	
TENSAR Tx160 GEOGRID	
GEOTEXTILE	
BASE WEARING COURSE	
PEAT COMPOSITION	
EXISTING MATERIAL	
NEW ROAD BUILD UP MATERIAL	



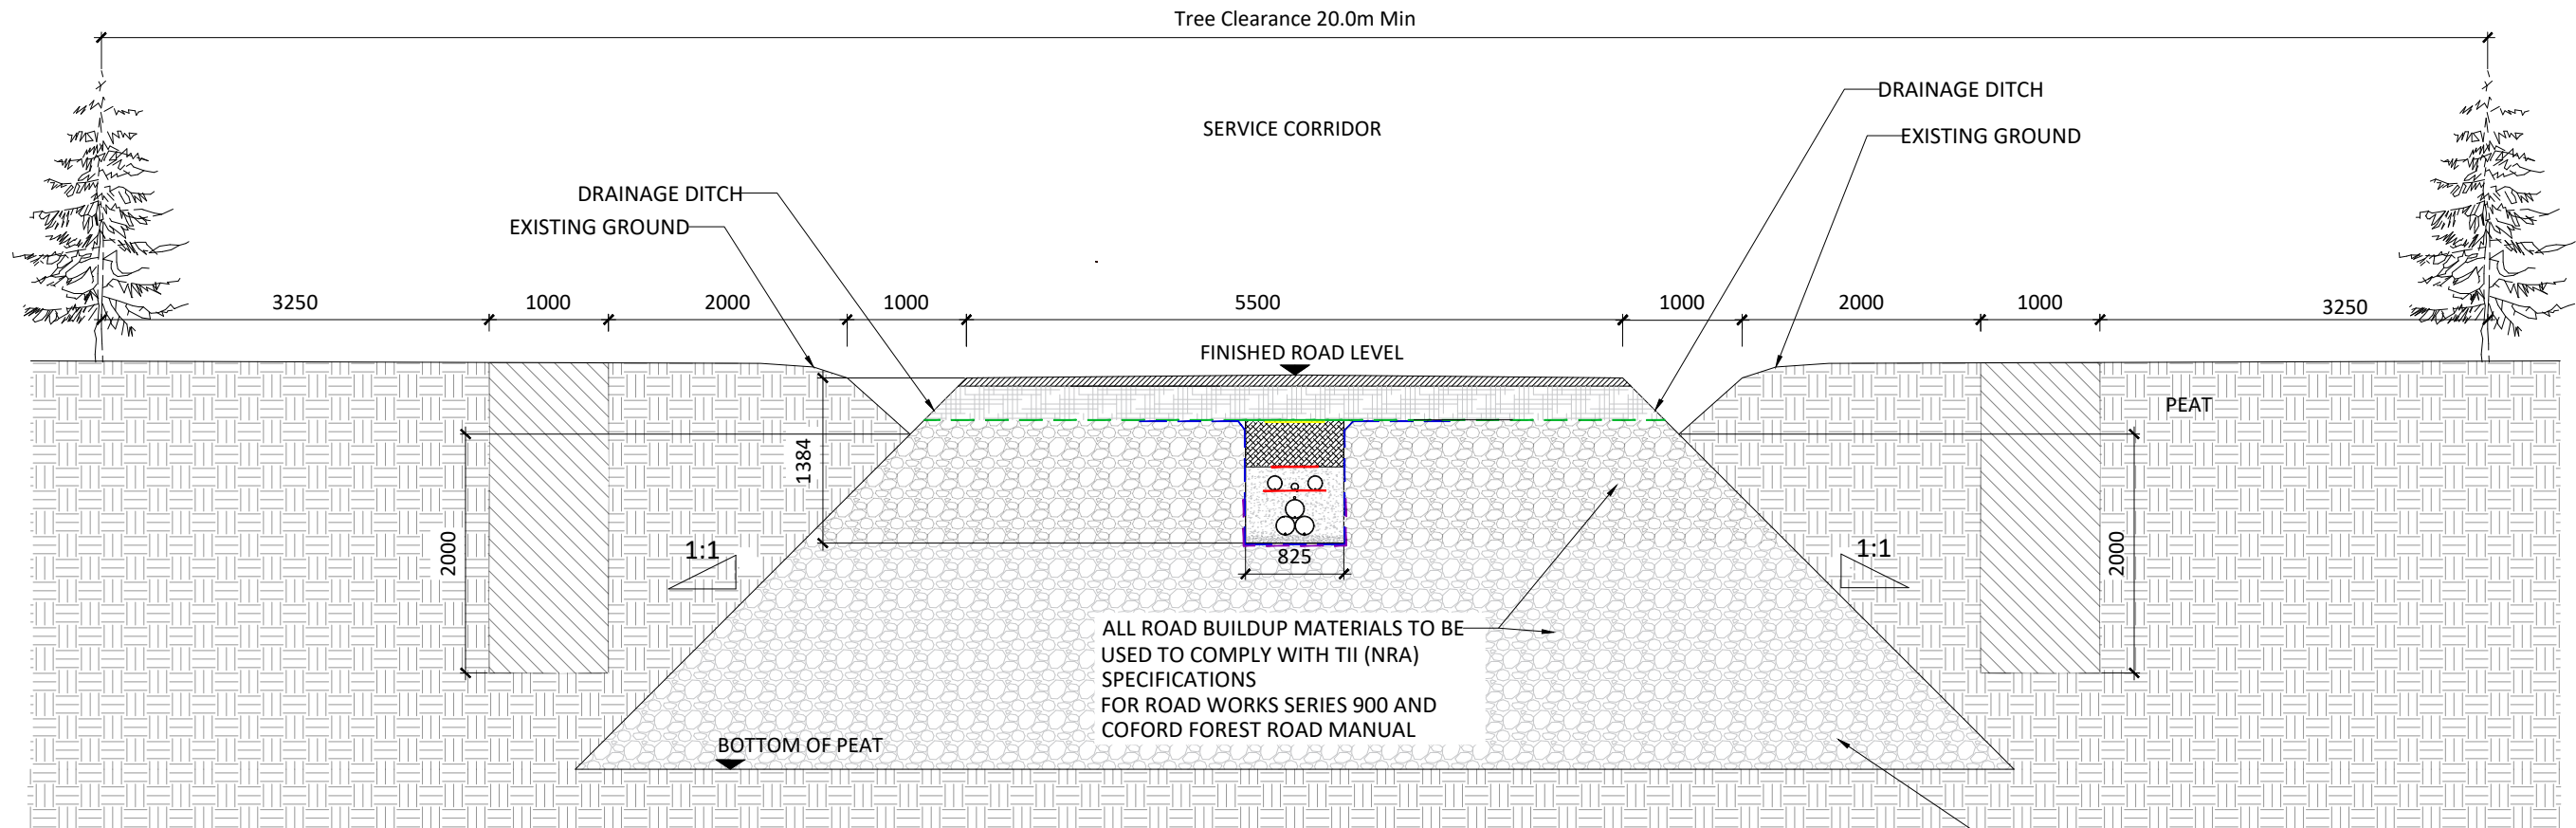

NOTE: THIS DRAWING IS FOR PEAT DEPTHS BELOW 2.5m
 CABLE LOCATION SHOWN ARE INDICATIVE AND SUBJECT TO CHANGE DURING DETAIL DESIGN

Forestry Fire-Break Road Section

Scale : 1:30

Note:

1. This drawing is subject to planning approval and should not be used for construction.
2. This drawing is to be read in conjunction with relevant drawings, specifications and reports.
3. Dimensions are in millimeters, unless noted otherwise.
4. Drawings are not to be scaled use figured dimensions only.
5. Underground cable circuit spacing to be determined during detailed design, road layout may change during detailed design with site investigation results.

	CLIENT Head Office Beenreigh, Abbeydorney, Tralee, Co. Kerry Ireland Tel: 00353 66 7135710	PROJECT Coumragappul Wind Farm 110kV Grid Connection	SHEET TITLE Forestry Access Road with Service Corridor through existing Fire Break	ISSUE/REVISION										
		PROJECT NUMBER 05-828	SHEET NUMBER 05828-DR-188	DRAWING STATUS For Planning	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 5%;"></td> <td style="width: 20%;"></td> <td style="width: 75%;"></td> </tr> <tr> <td>P1</td> <td>31.01.23</td> <td>Issued for Planning</td> </tr> <tr> <td>I/R</td> <td>DATE</td> <td>DESCRIPTION</td> </tr> </table>				P1	31.01.23	Issued for Planning	I/R	DATE	DESCRIPTION
P1	31.01.23	Issued for Planning												
I/R	DATE	DESCRIPTION												