



NOTES:


1. ALL DIMENSION IN MILLIMETERS UNLESS OTHERWISE STATED
2. REINSTATEMENTS TO COMPLY WITH REQUIREMENTS OF THE RELEVANT LOCAL AUTHORITY/ASSET OWNER
3. ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH NRA/T.I.I. SPECIFICATION FOR ROADWORKS, MAY 2005 & SUBSEQUENT REVISIONS
4. REINFORCED CONCRETE TO BE MINIMUM GRADE C32 / 40, SULPHATE RESISTING CEMENT TO BE USED WHERE AGGRESSIVE SOIL CONDITIONS APPLY, REFER TO TABLE 6.1 OF THE BRITISH STANDARD 8110.
5. CARRAIGEWAY COVERS AND FRAMES TO BE TO B.S EN 124.
6. ALL COVERS SHALL HAVE "ESB" LOGO INCORPORATED IN THEM TO THE APPROVAL OF EIRGRID
7. FURTHER DETAILS WILL BE PROVIDED BY ESB/EIRGRID.
8. FINAL POSITION OF EARTH LINK CHAMBERS SHALL BE AGREED WITH ESB/EIRGRID

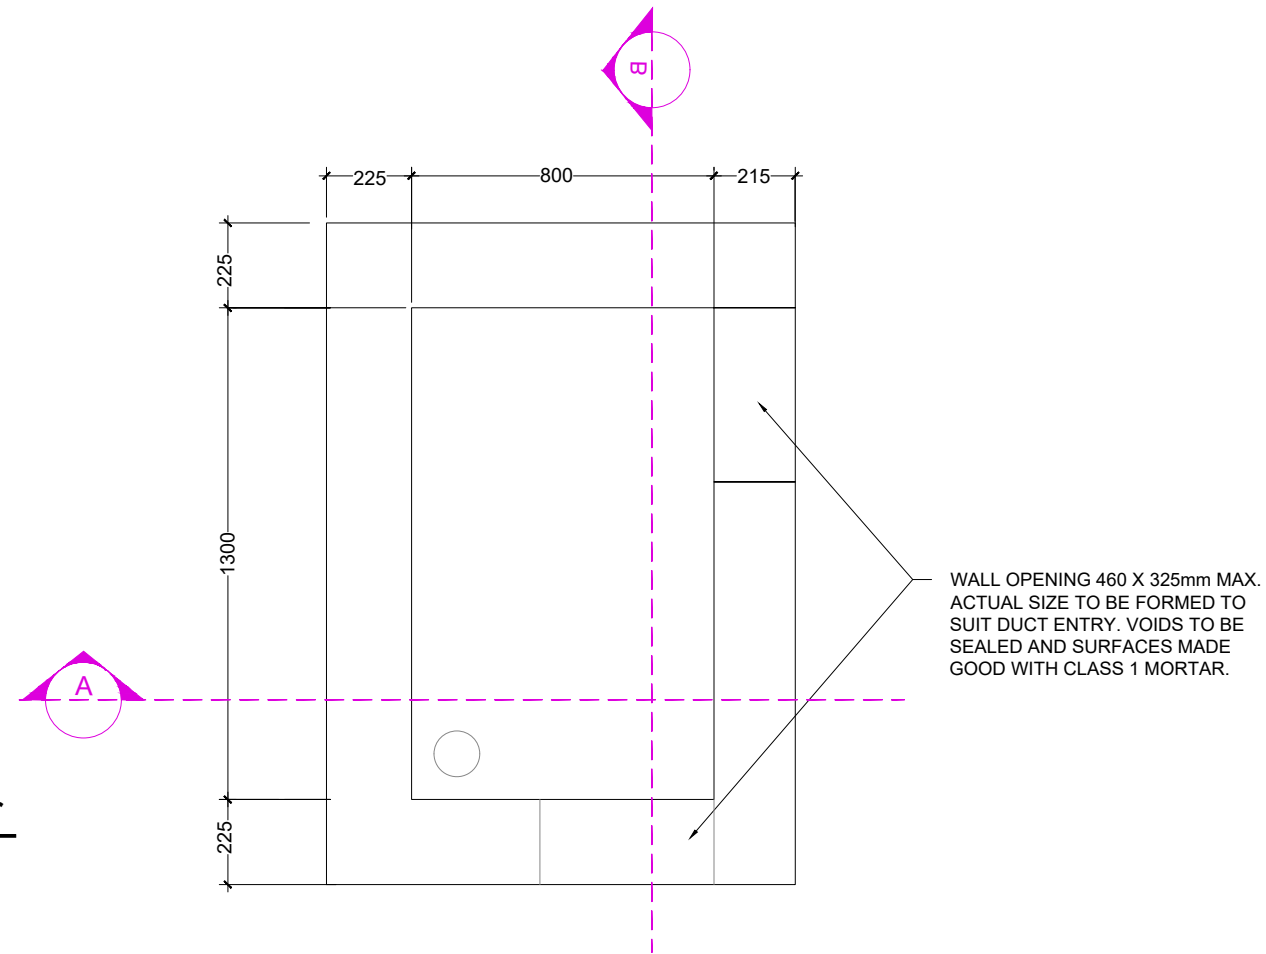

Plan of Earth Link Chamber
SCALE 1:20

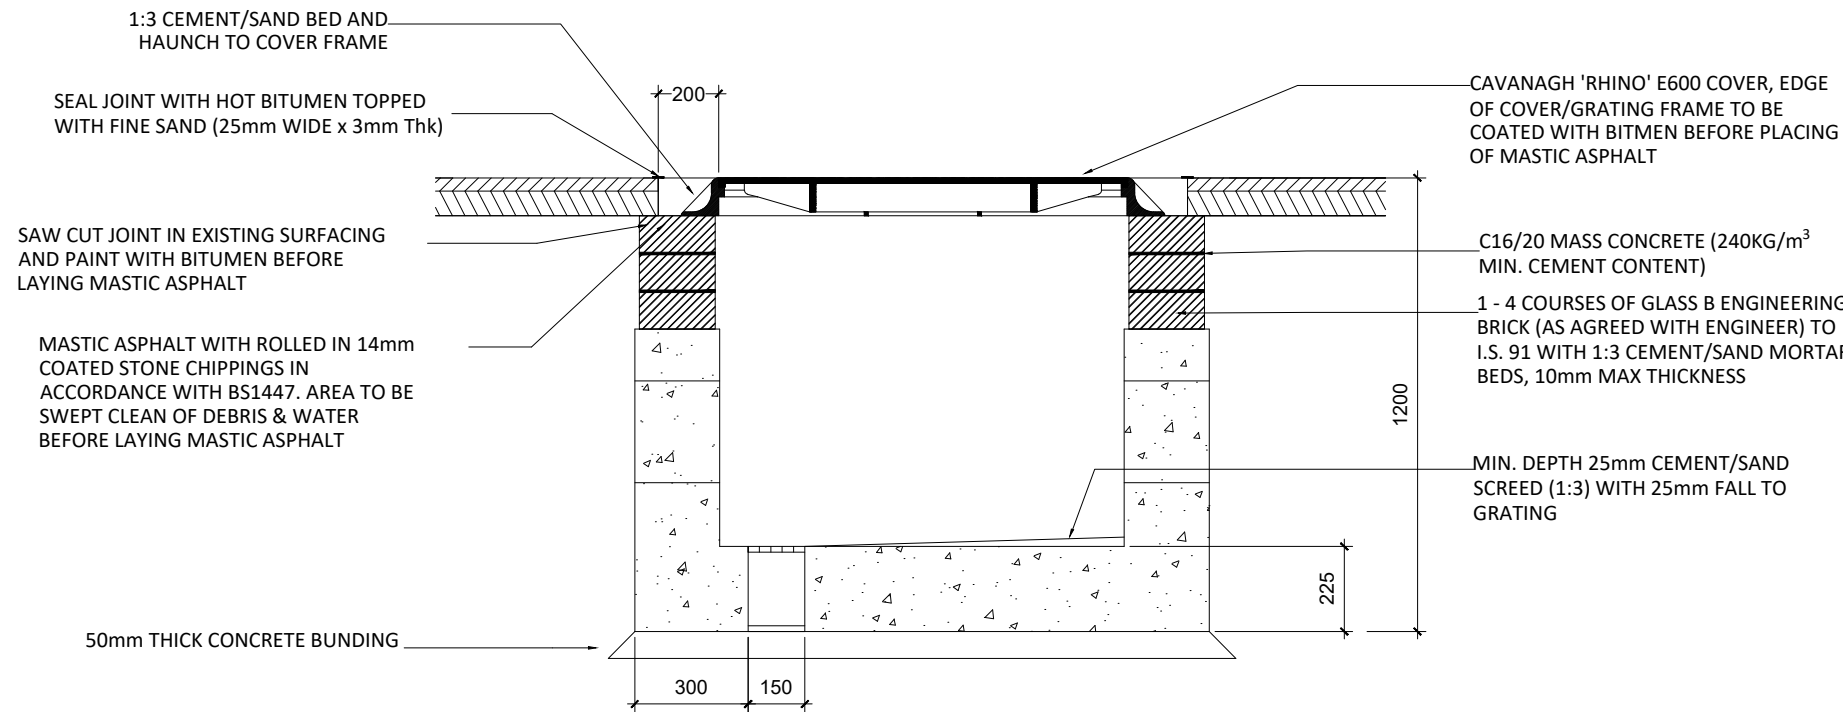

Earth Link Chamber - Section A
SCALE 1:20

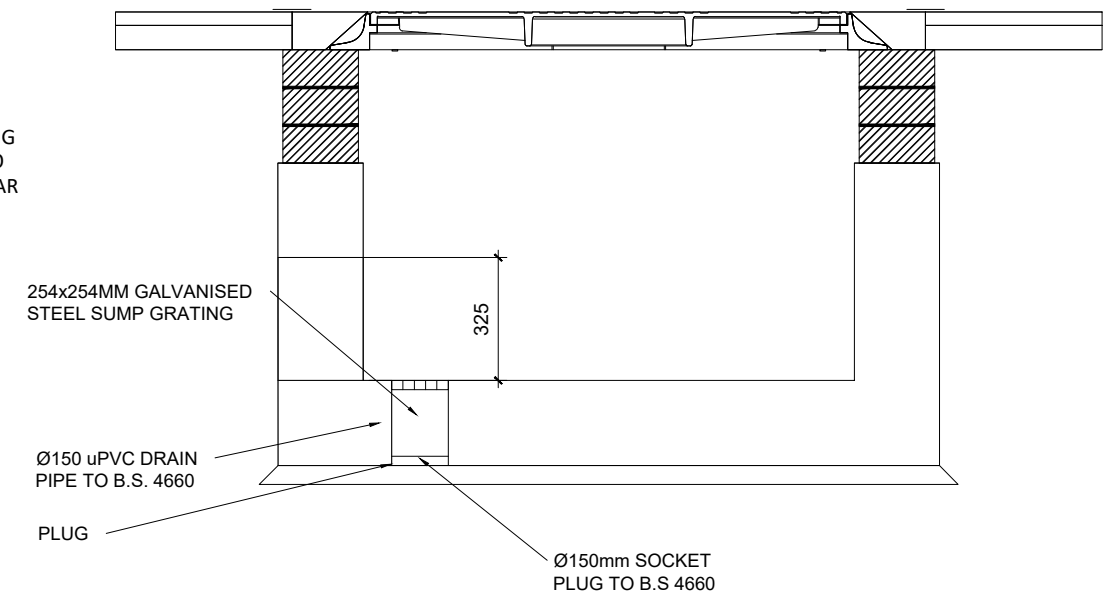

Earth Link Chamber - Section B
SCALE 1:20



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710



CLIENT
PROJECT
Carrownagowan Wind Farm
110kV Grid Connection

PROJECT NUMBER
05-641

SHEET NUMBER
05641-DR-244

SHEET TITLE
Earth Link
Chamber Details

DRAWING STATUS
For Planning

ISSUE/REVISION		
I/R	DATE	DESCRIPTION
P5	09.11.23	Issued for Planning
P4	01.06.23	Issued for Planning
P3	02.12.22	Issued for Planning
P2	19.05.20	Issued for Planning