


Figure 11.9

**Legend**

- - - Proposed Cable Route
- ▭ Planning Application Boundary (PAB)
- ▨ HDD Compound
- ▨ Temporary Construction Compound
- ▭ Substation Footprint
- - - Study Area (250m Buffer)
- LI - Moderately productive aquifer (local zones)
- Lm - Moderately productive aquifer (generally)
- PI - Poor Aquifer
- Bedrock Aquifer Faults

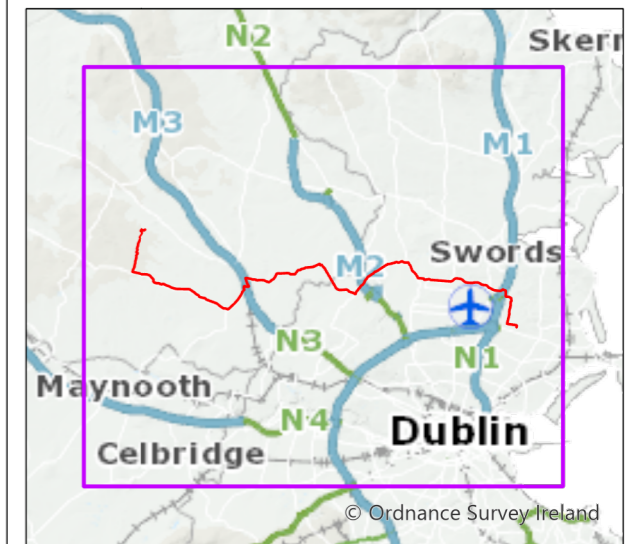

0	Feb 2024	Final	BP	PB	PB	GS
Rev.	Date	Purpose of revision	Drawn	Check'd	Rev'd	Appr'd

**Jacobs**



Client  
**East Meath - North Dublin Grid Upgrade**

Project  
**Figure 11.9 - Groundwater Aquifers (Sheet 1 of 1)**

Drawing Status: Final


Scale @ A3: 1:100,000 DO NOT SCALE

OSI Sheet No.

Jacobs No. B321084AJ

Drawing No. 321084AJ-JAC-ZZ-XX-DR-G-0443

© Copyright 2024 Jacobs U.K. Limited. The concepts and information contained in this document are the property of Jacobs. Use or copying of this document in whole or in part without the written permission of Jacobs constitutes an infringement of copyright. Limitation: This drawing has been prepared on behalf of, and for the exclusive use of Jacobs' Client, and is subject to, and issued in accordance with, the provisions of the contract between Jacobs and the Client. Jacobs accepts no liability or responsibility whatsoever for, or in respect of, any use of, or reliance upon, this drawing by any third party.

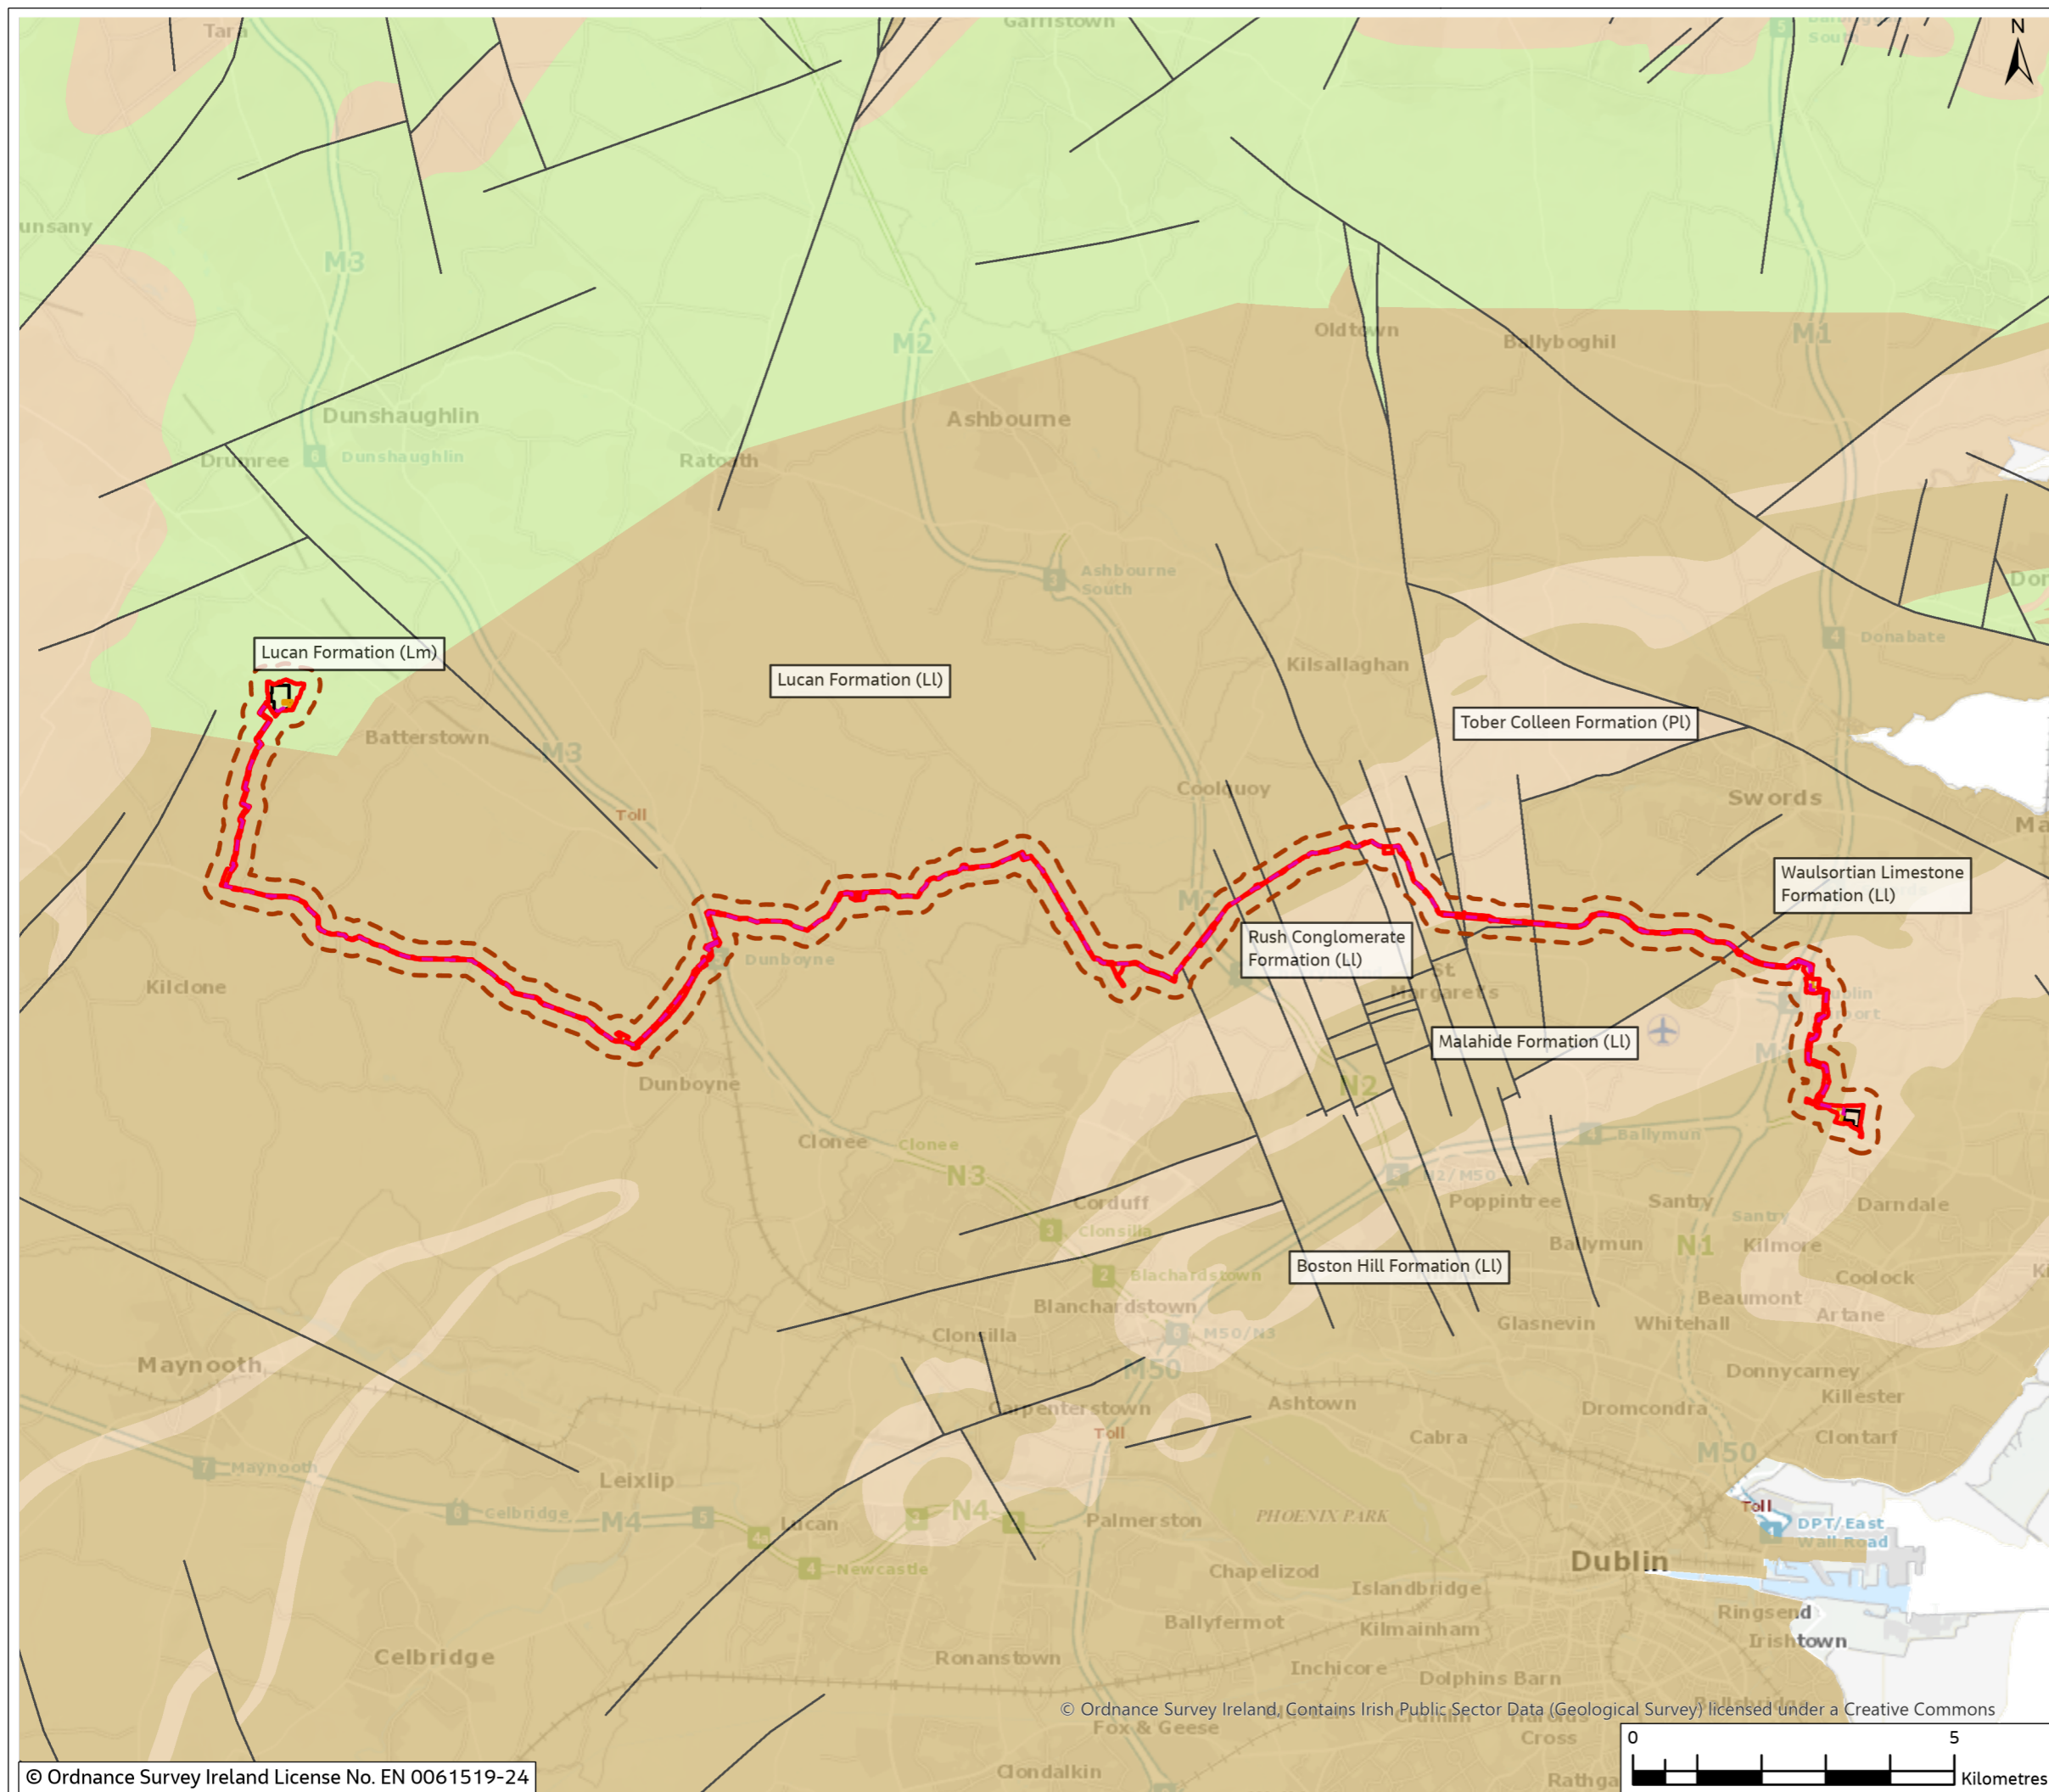

© Ordnance Survey Ireland, Contains Irish Public Sector Data (Geological Survey) licensed under a Creative Commons



© Ordnance Survey Ireland License No. EN 0061519-24