


33kV CABLE TRENCH DETAIL WITH EXISTING/PROPOSED ACCESS TRACK
SCALE 1:10

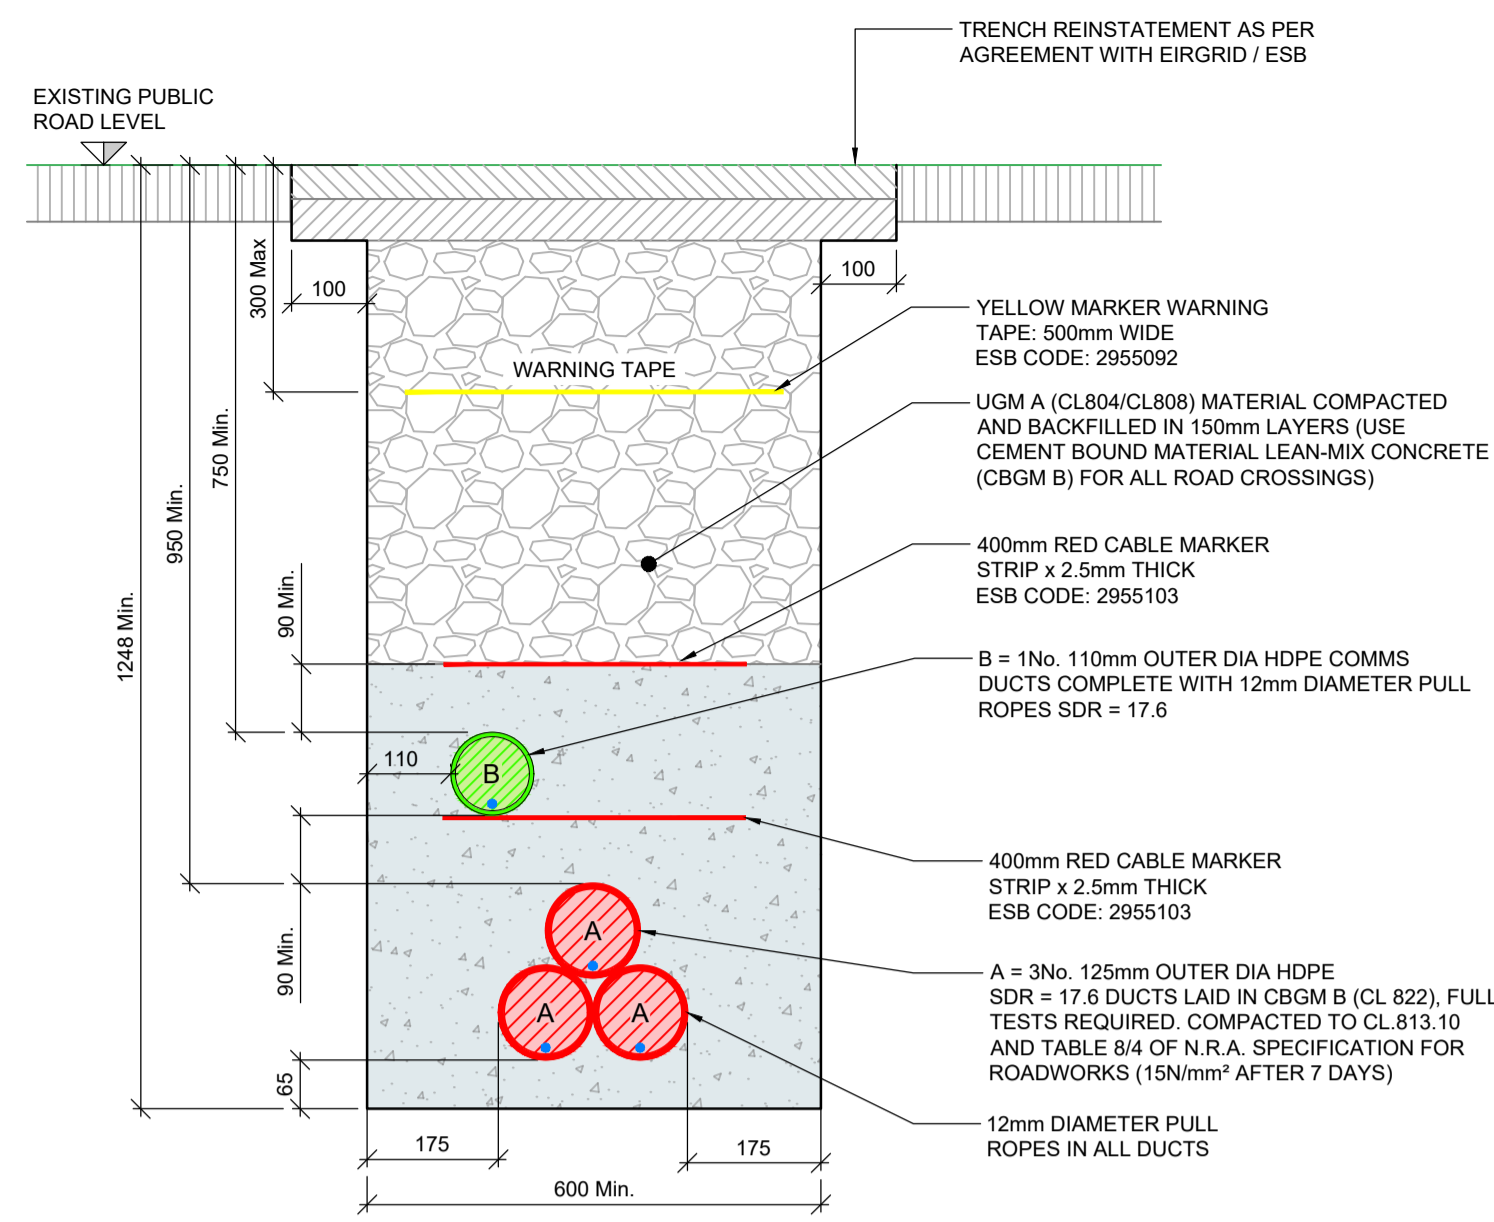


33kV CABLE TRENCH DETAIL WITHIN THE PUBLIC ROAD
SCALE 1:10


- NOTES:
1. MARKER POSTS AS PER ESB NETWORKS SPECIFICATIONS.
 2. TEMPLATES ARE TO BE USED TO MAINTAIN THE TREFOIL ARRANGEMENT WHEN LAYING THE DUCTS.

DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS IN ALL CASES. VERIFY DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE DESIGNERS IMMEDIATELY.
THIS DRAWING TO BE READ IN CONJUNCTION WITH THE DESIGNERS SPECIFICATION.
© THIS DRAWING IS COPYRIGHT AND MAY ONLY BE REPRODUCED WITH THE DESIGNERS PERMISSION.


- NOTES:
1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS, ARCHITECTS AND ESB NETWORKS DRAWINGS & SPECIFICATIONS.
 2. ALL DIMENSIONS ARE IN **MILLIMETRES**, UNLESS NOTED OTHERWISE.
 3. DRAWINGS ARE NOT TO BE SCALED.
 4. THE CONTRACTOR SHALL CHECK ALL DIMENSIONS PRIOR TO CONSTRUCTION. ANY DISCREPANCIES TO BE NOTIFIED TO THIS OFFICE IN WRITING IMMEDIATELY. ANY DISCREPANCIES BETWEEN THESE DOCUMENTS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
 5. SAND SHALL BE NATURAL UNWASHED SAND IN ACCORDANCE WITH BS 882:1992 (BS EN 12620) COMPLYING WITH GRADING LIMIT C IN TABLE 4 WITH A MAXIMUM THERMAL RESISTIVITY OF 1.0 K.m/WATT AT 0% MOISTURE CONTENT.
 6. ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH THE NRA SPECIFICATION FOR ROADWORKS.

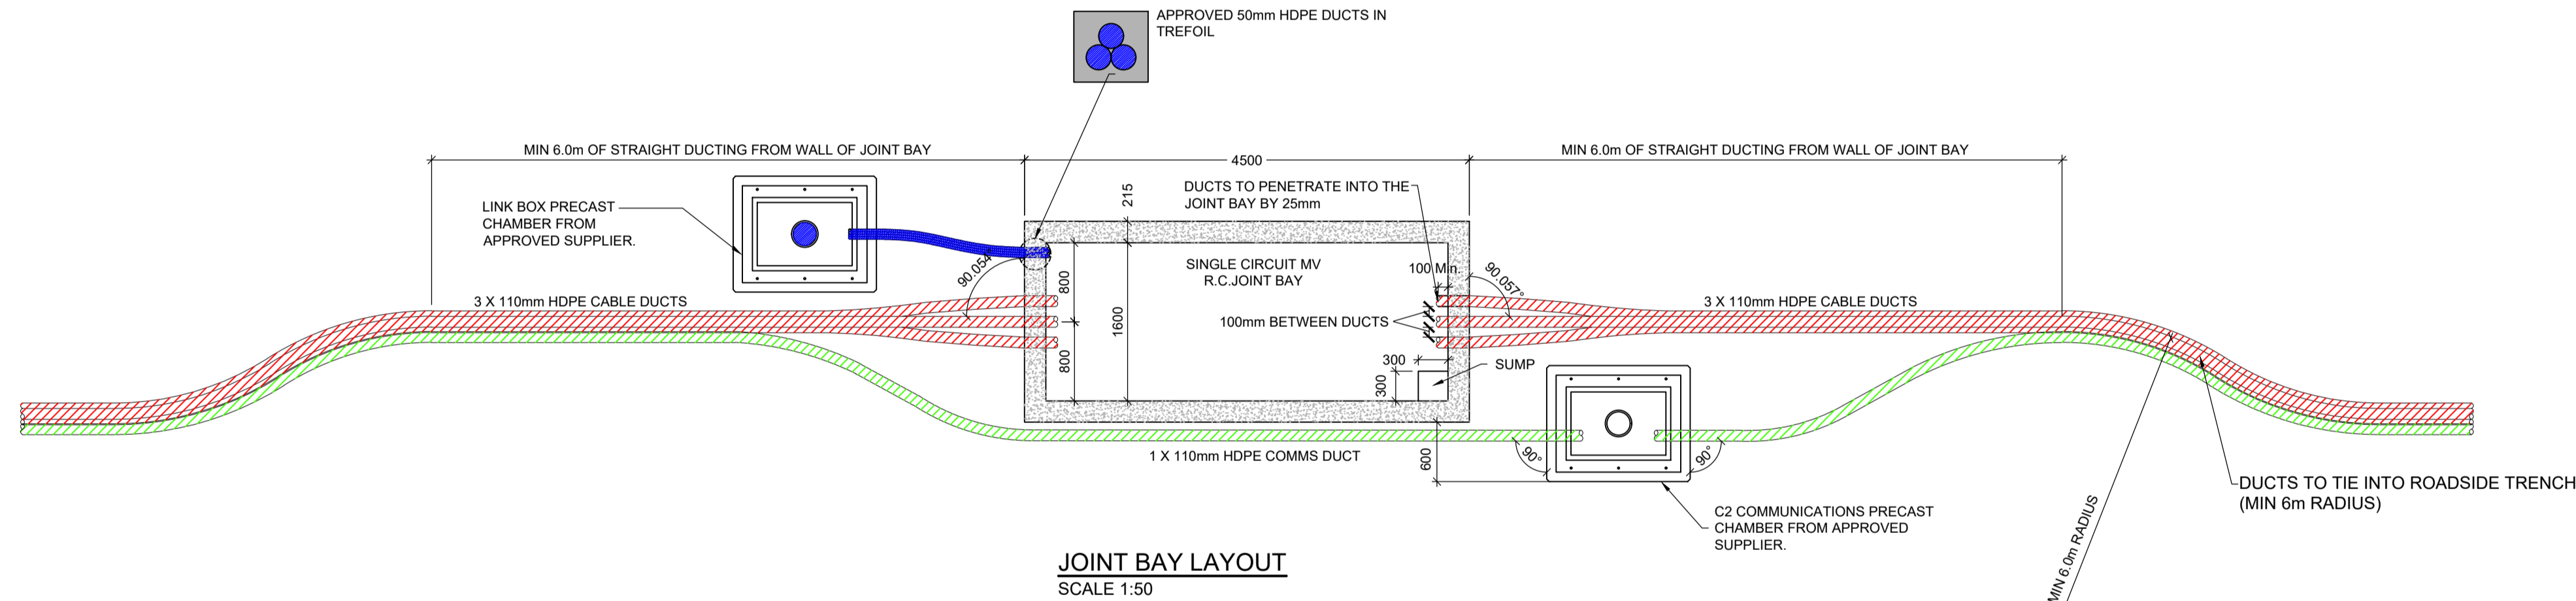

JOINT BAY LAYOUT
SCALE 1:50

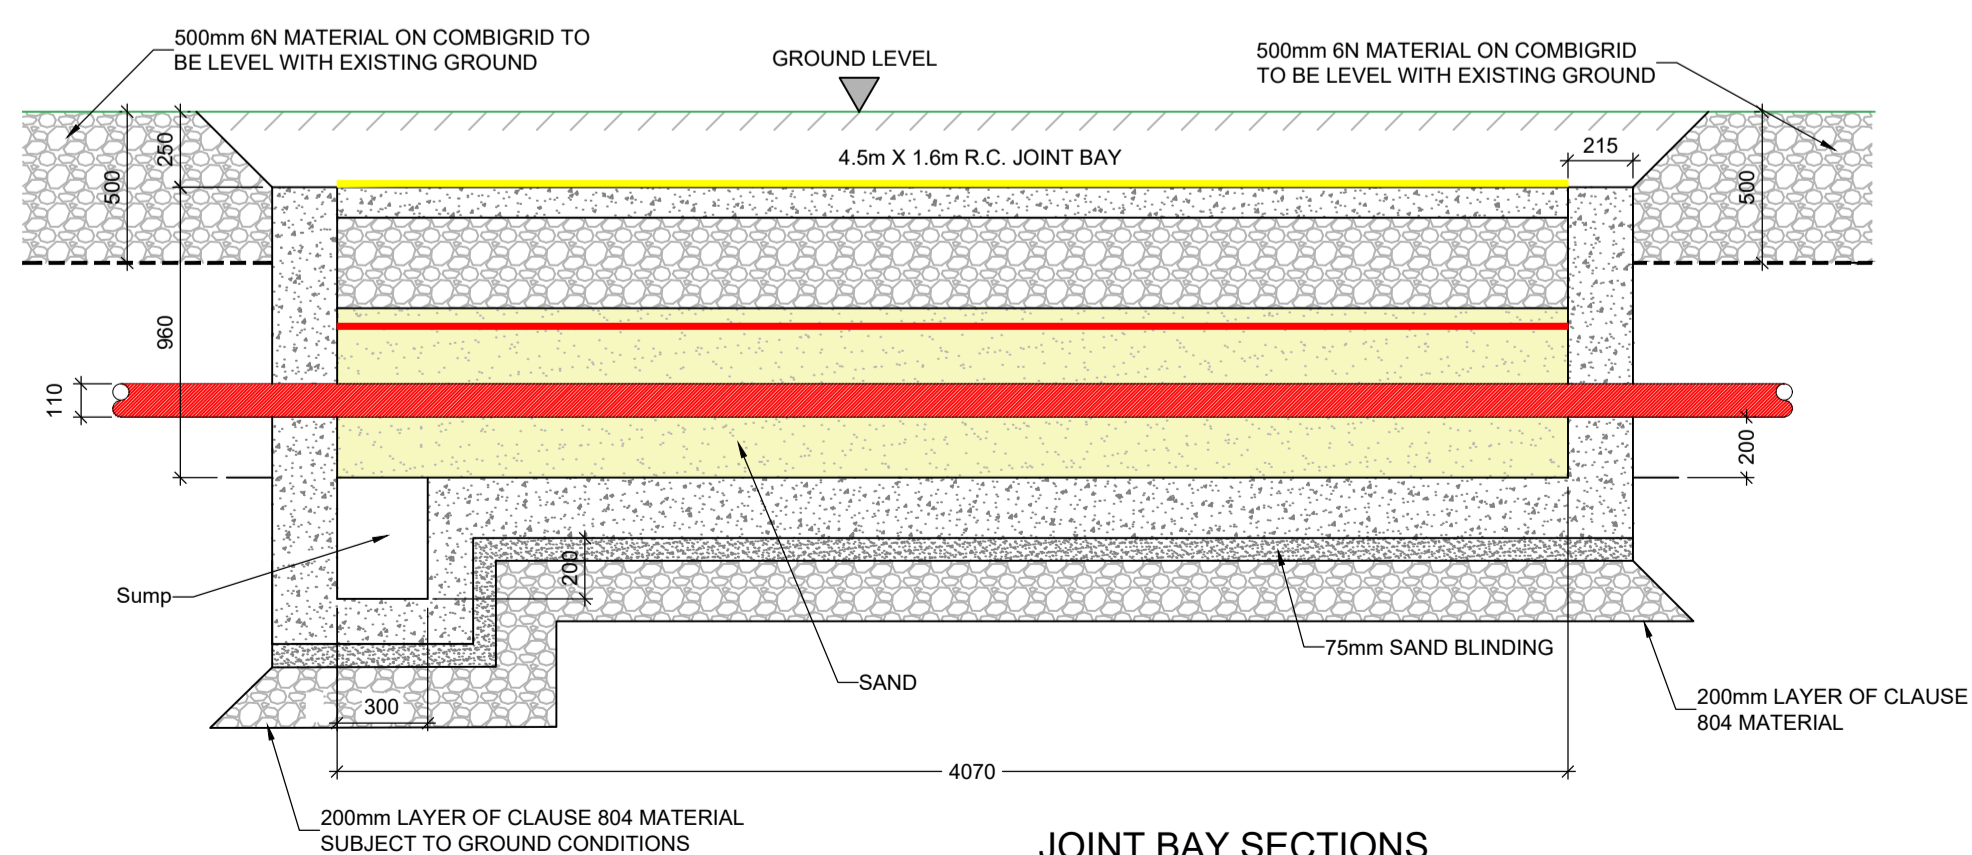

JOINT BAY SECTIONS
SCALE 1:25

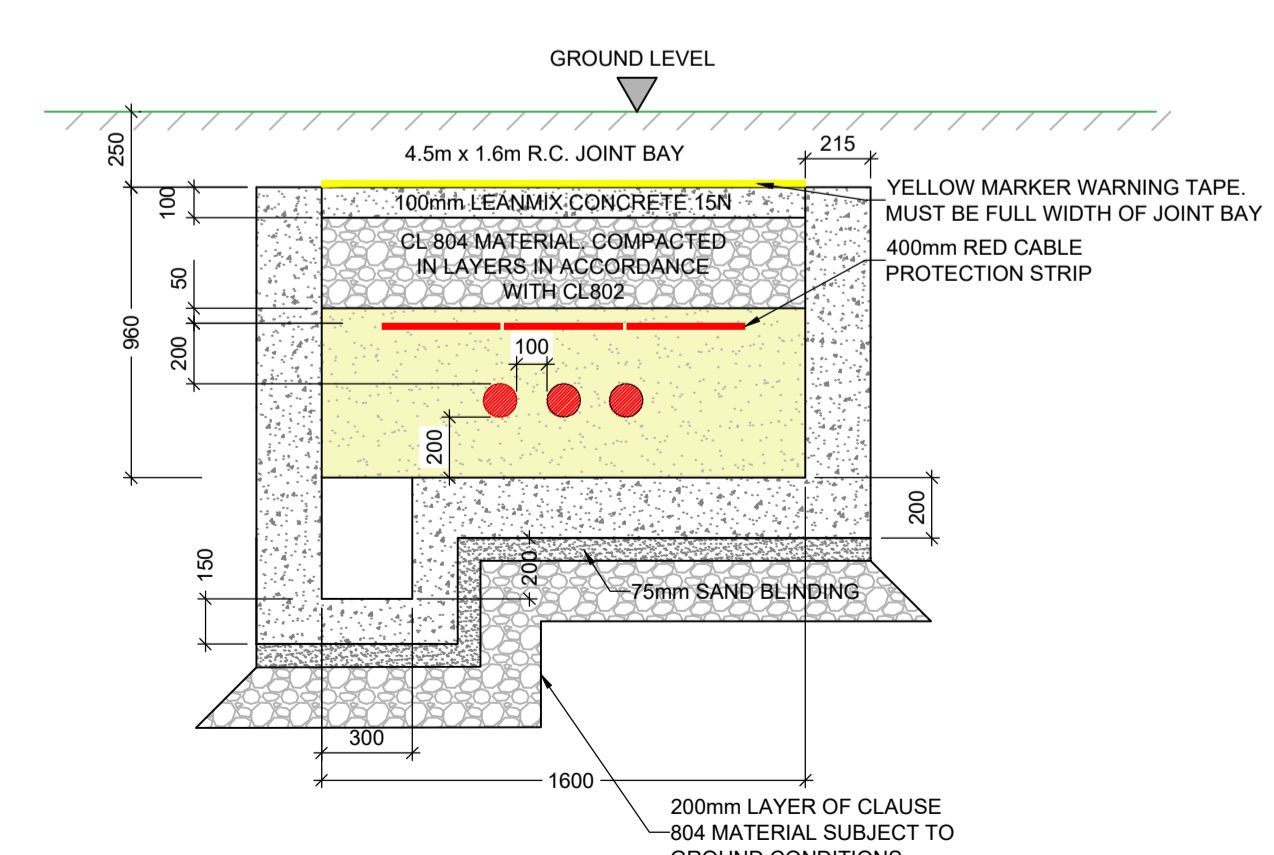

REV	DATE	DESCRIPTION	BY	APP
P04	12/02/24	FOR INFORMATION	SS	DC
P03	16/11/23	FOR APPROVAL	BK	IB
P02	06/11/23	FOR APPROVAL	BK	IB
P01	19/07/23	FOR APPROVAL	BK	IB

PROJECT: KNOCKANARRAGH WIND FARM

TITLE: CABLE TRENCH AND JOINT BAY DETAILS AND SECTIONS

CLIENT: KNOCKANARRAGH WIND FARM LTD.



DRAWN: S.M.	CHECKED: B.K.	APPROVED: I.B.
PROJECT NUMBER: 314271	DATE: JULY '23	SCALE @ A1: AS SHOWN
STATUS DESCRIPTION: FOR INFORMATION		STATUS: S2
DRAWING NUMBER: ABP-314271-22-MWP-013		REV: P04