
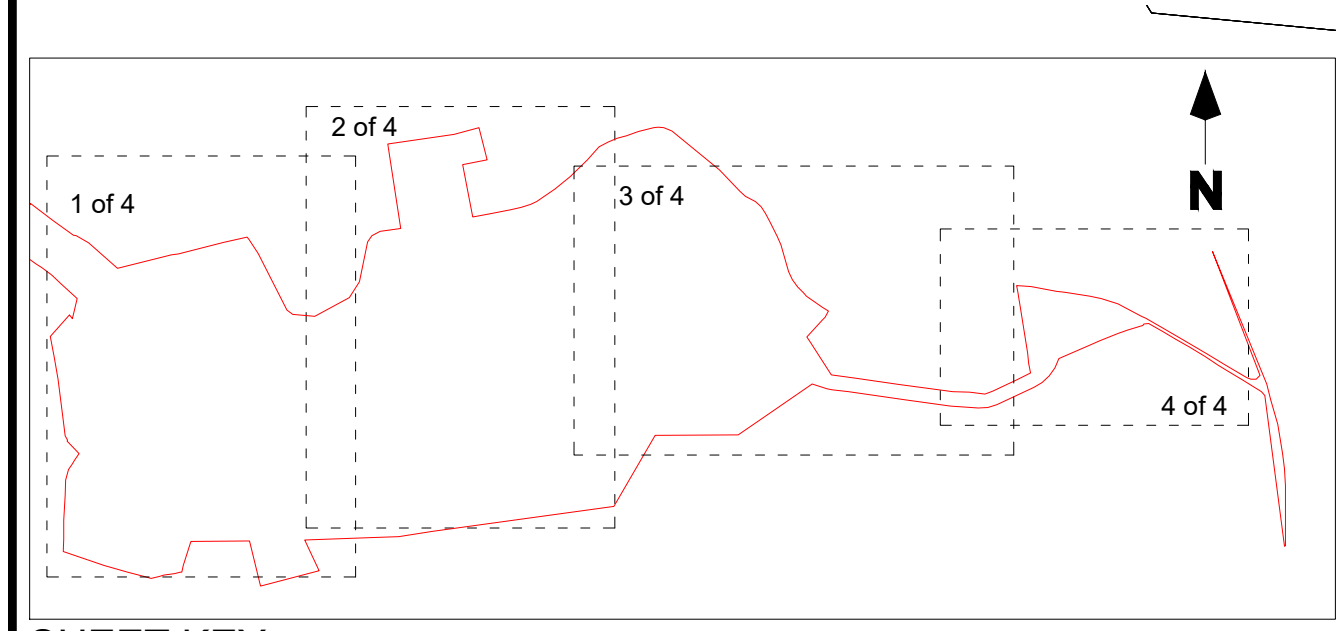


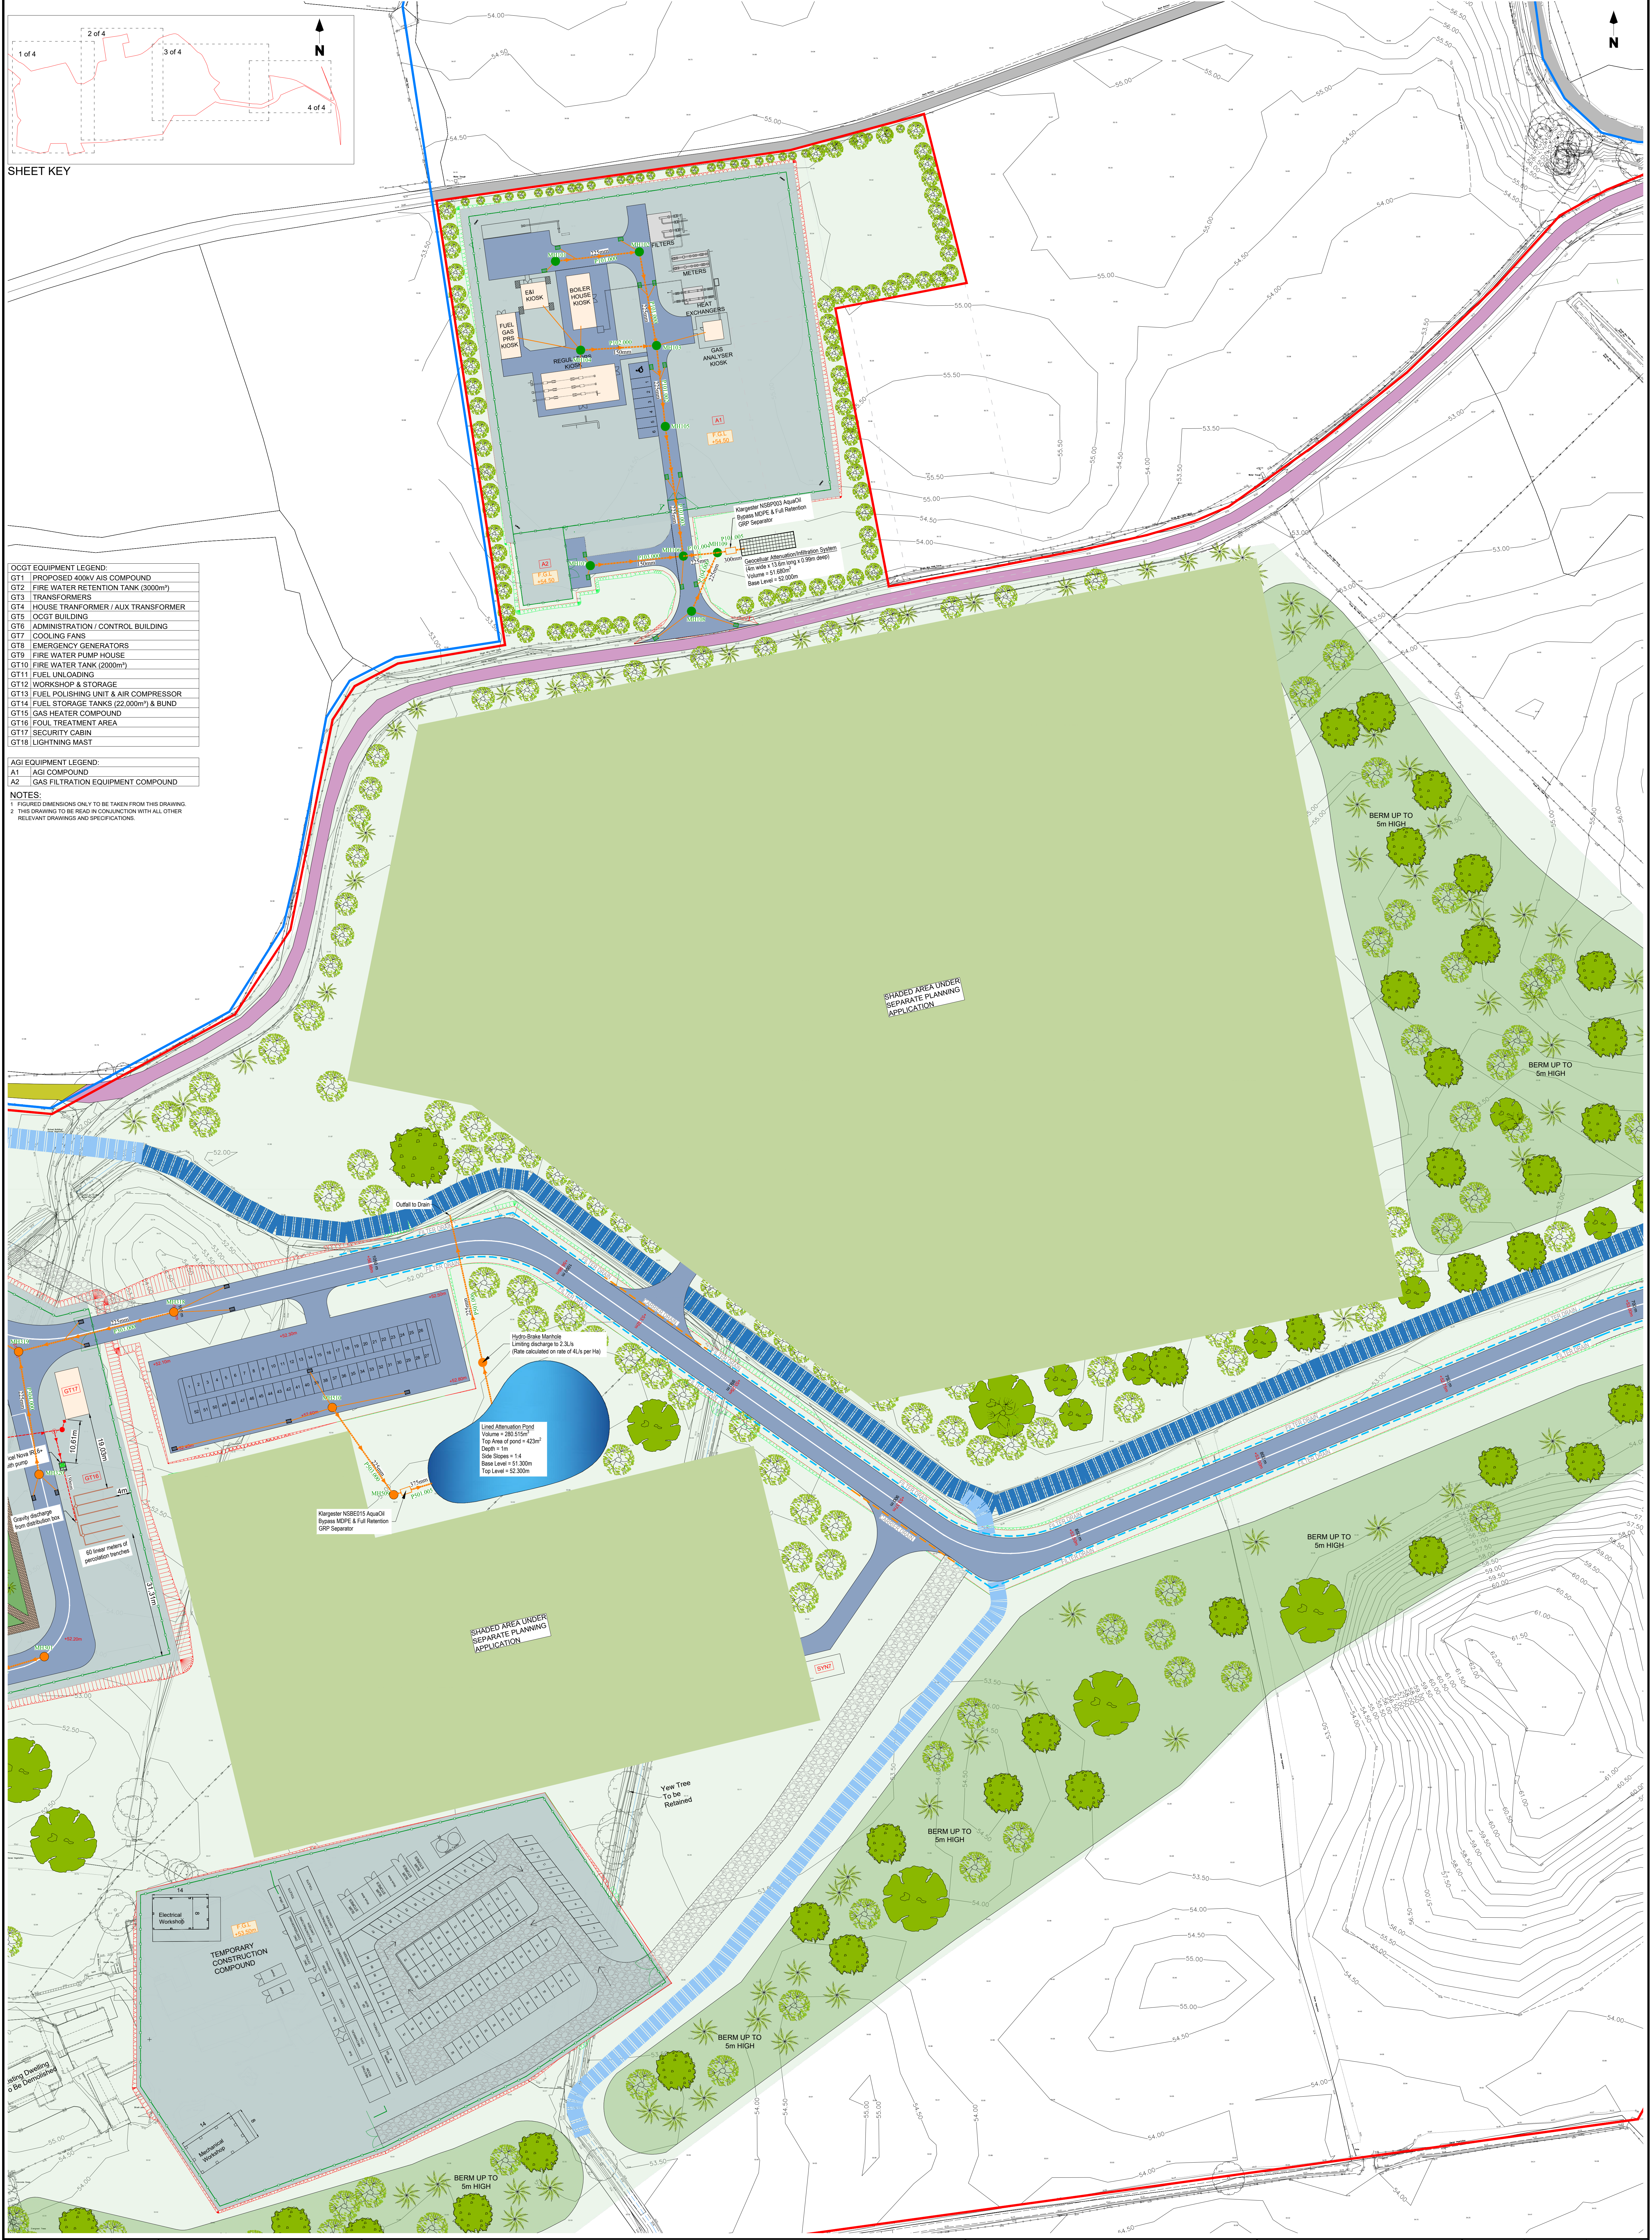


- OCGT EQUIPMENT LEGEND:
- GT1 PROPOSED 400KV AIS COMPOUND
 - GT2 FIRE WATER RETENTION TANK (3000m³)
 - GT3 TRANSFORMERS
 - GT4 HOUSE TRANSFORMER / AUX TRANSFORMER
 - GT5 OCGT BUILDING
 - GT6 ADMINISTRATION / CONTROL BUILDING
 - GT7 COOLING FANS
 - GT8 EMERGENCY GENERATORS
 - GT9 FIRE WATER PUMP HOUSE
 - GT10 FIRE WATER TANK (2000m³)
 - GT11 FUEL UNLOADING
 - GT12 WORKSHOP & STORAGE
 - GT13 FUEL POLISHING UNIT & AIR COMPRESSOR
 - GT14 FUEL STORAGE TANKS (22,000m³) & BUND
 - GT15 GAS HEATER COMPOUND
 - GT16 FOUL TREATMENT AREA
 - GT17 SECURITY CABIN
 - GT18 LIGHTNING MAST
- AGI EQUIPMENT LEGEND:
- A1 AGI COMPOUND
 - A2 GAS FILTRATION EQUIPMENT COMPOUND

NOTES:

1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING

2 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS

Rev.	Modifications	By	Date
P01	PRE SID	SK	26.03.24
P01	PLANNING	SK	07.06.24

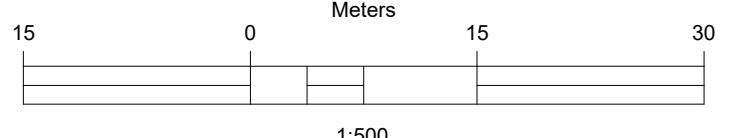

- LEGEND:
- OWNERSHIP BOUNDARY (POST AND RAIL STOCK FENCE. EXISTING TREES / HEDGES TO BE RETAINED)
- PLANNING BOUNDARY
- NEW ROAD HOT ROLLED ASPHALT TO DOE SPECIFICATION FOR ROAD WORKS
- EXISTING PUBLIC ROAD

- EXISTING ROAD (APPLICANT)
- EXISTING ROAD (ESB)
- 50mm CLEAN STONE AREA
- GRASS AREA / UNDISTURBED
- GRAVEL CONSTRUCTION ROAD
- PROPOSED BUILDINGS

- STREAM DIVERSION
- EXISTING STREAM
- PROPOSED HV LINE / CABLE ROUTES
- UNDERGROUND GAS PIPE
- FILL AREA
- CUT AREA

- GAS

© COPYRIGHT OF

HALSTON

Email: info@halston.ie
Tel: 094 9010111

**IHUB BUILDING
WESTPORT ROAD
CASTLEBAR
CO. MAYO,
F23 K162**

Client	COOLPOWRA FLEXGEN LIMITED
Project	COOLPOWRA (OCGT)
Title	PROPOSED SITE STORM WATER LAYOUT
Stage	PLANNING

Drawn	SK	Checked	WD	Approved	CS
Date	Mar 2024				
Scales	1:500				
Sheet	2 of 4				A0
Job No.	SEP-0398			Status	
Dwg. No.	CPA-HAL-OC-XX-DR-PL-1020B			Rev	P01