


Seskin Wind Farm Co. Carlow - EIAR EIAR Appendices - F - 2024.05.03 - 220246


PECENED. 7305 PO28



# **APPENDIX 4-1**


SITE LAYOUT PLANNING DRAWINGS

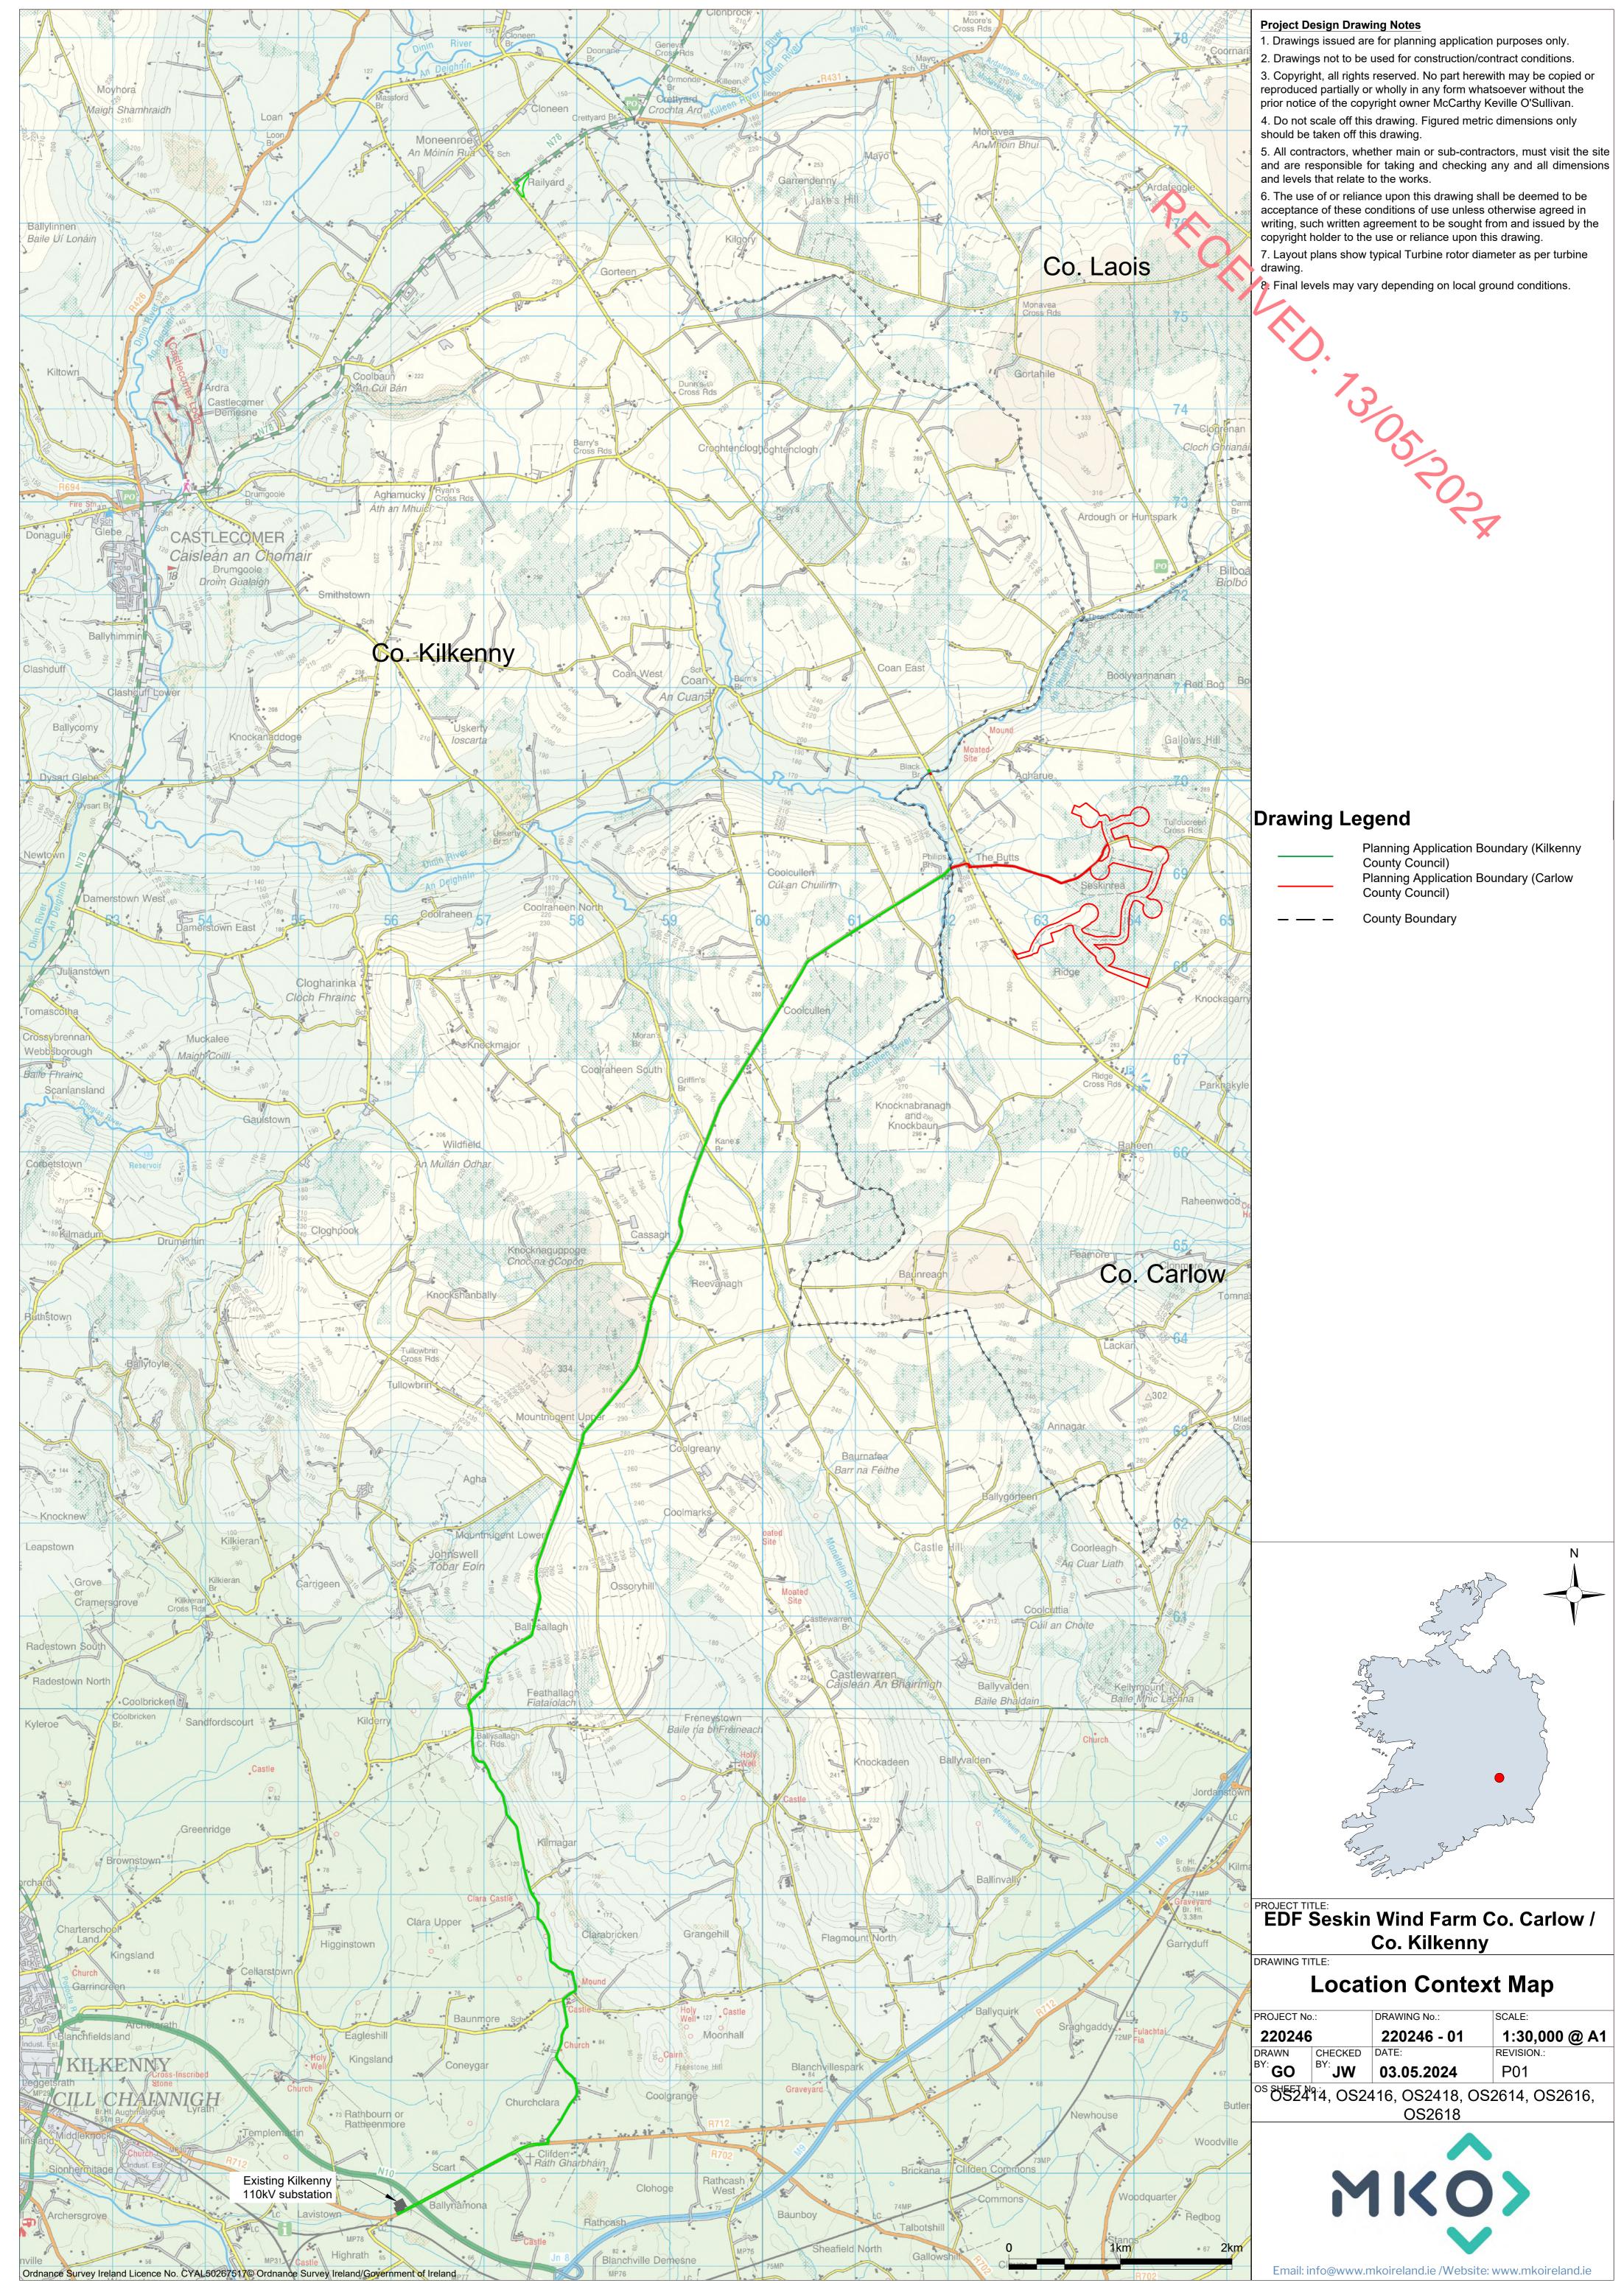

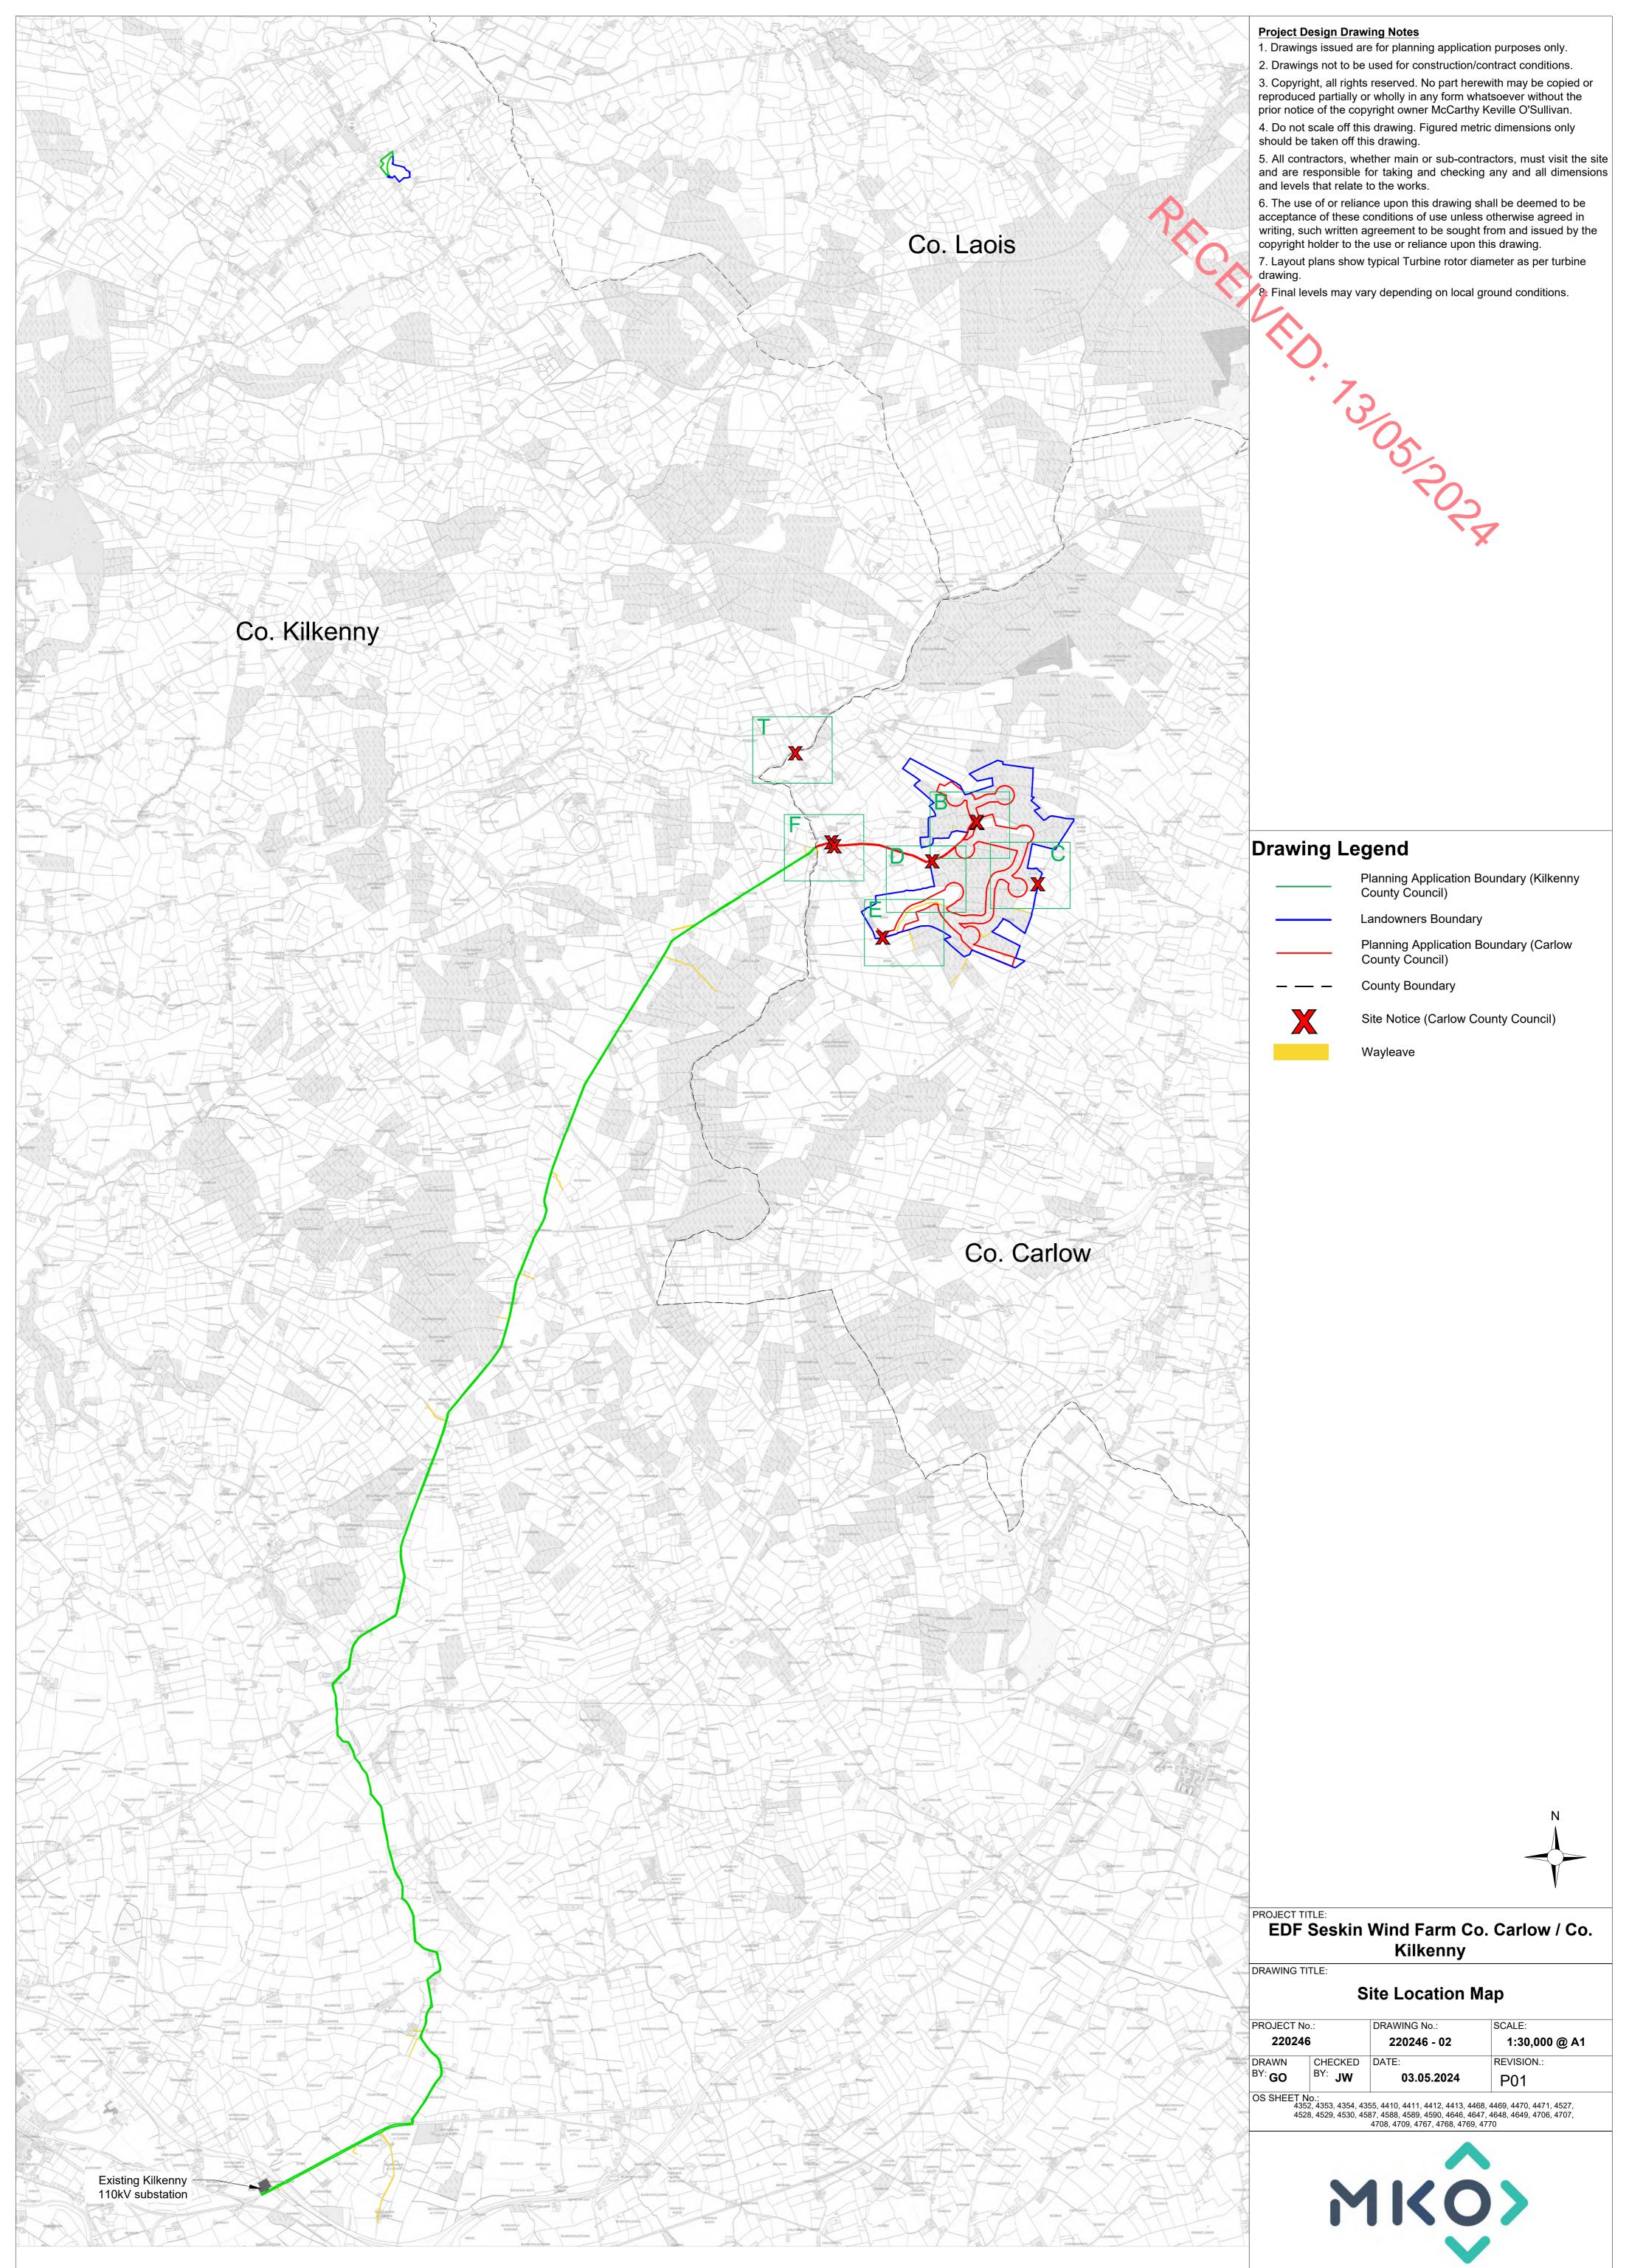



Ordnance Survey Ireland Licence No. CYAL50267517© Ordnance Survey Ireland/Government of Ireland


Email: info@www.mkoireland.ie /Website: www.mkoireland.ie

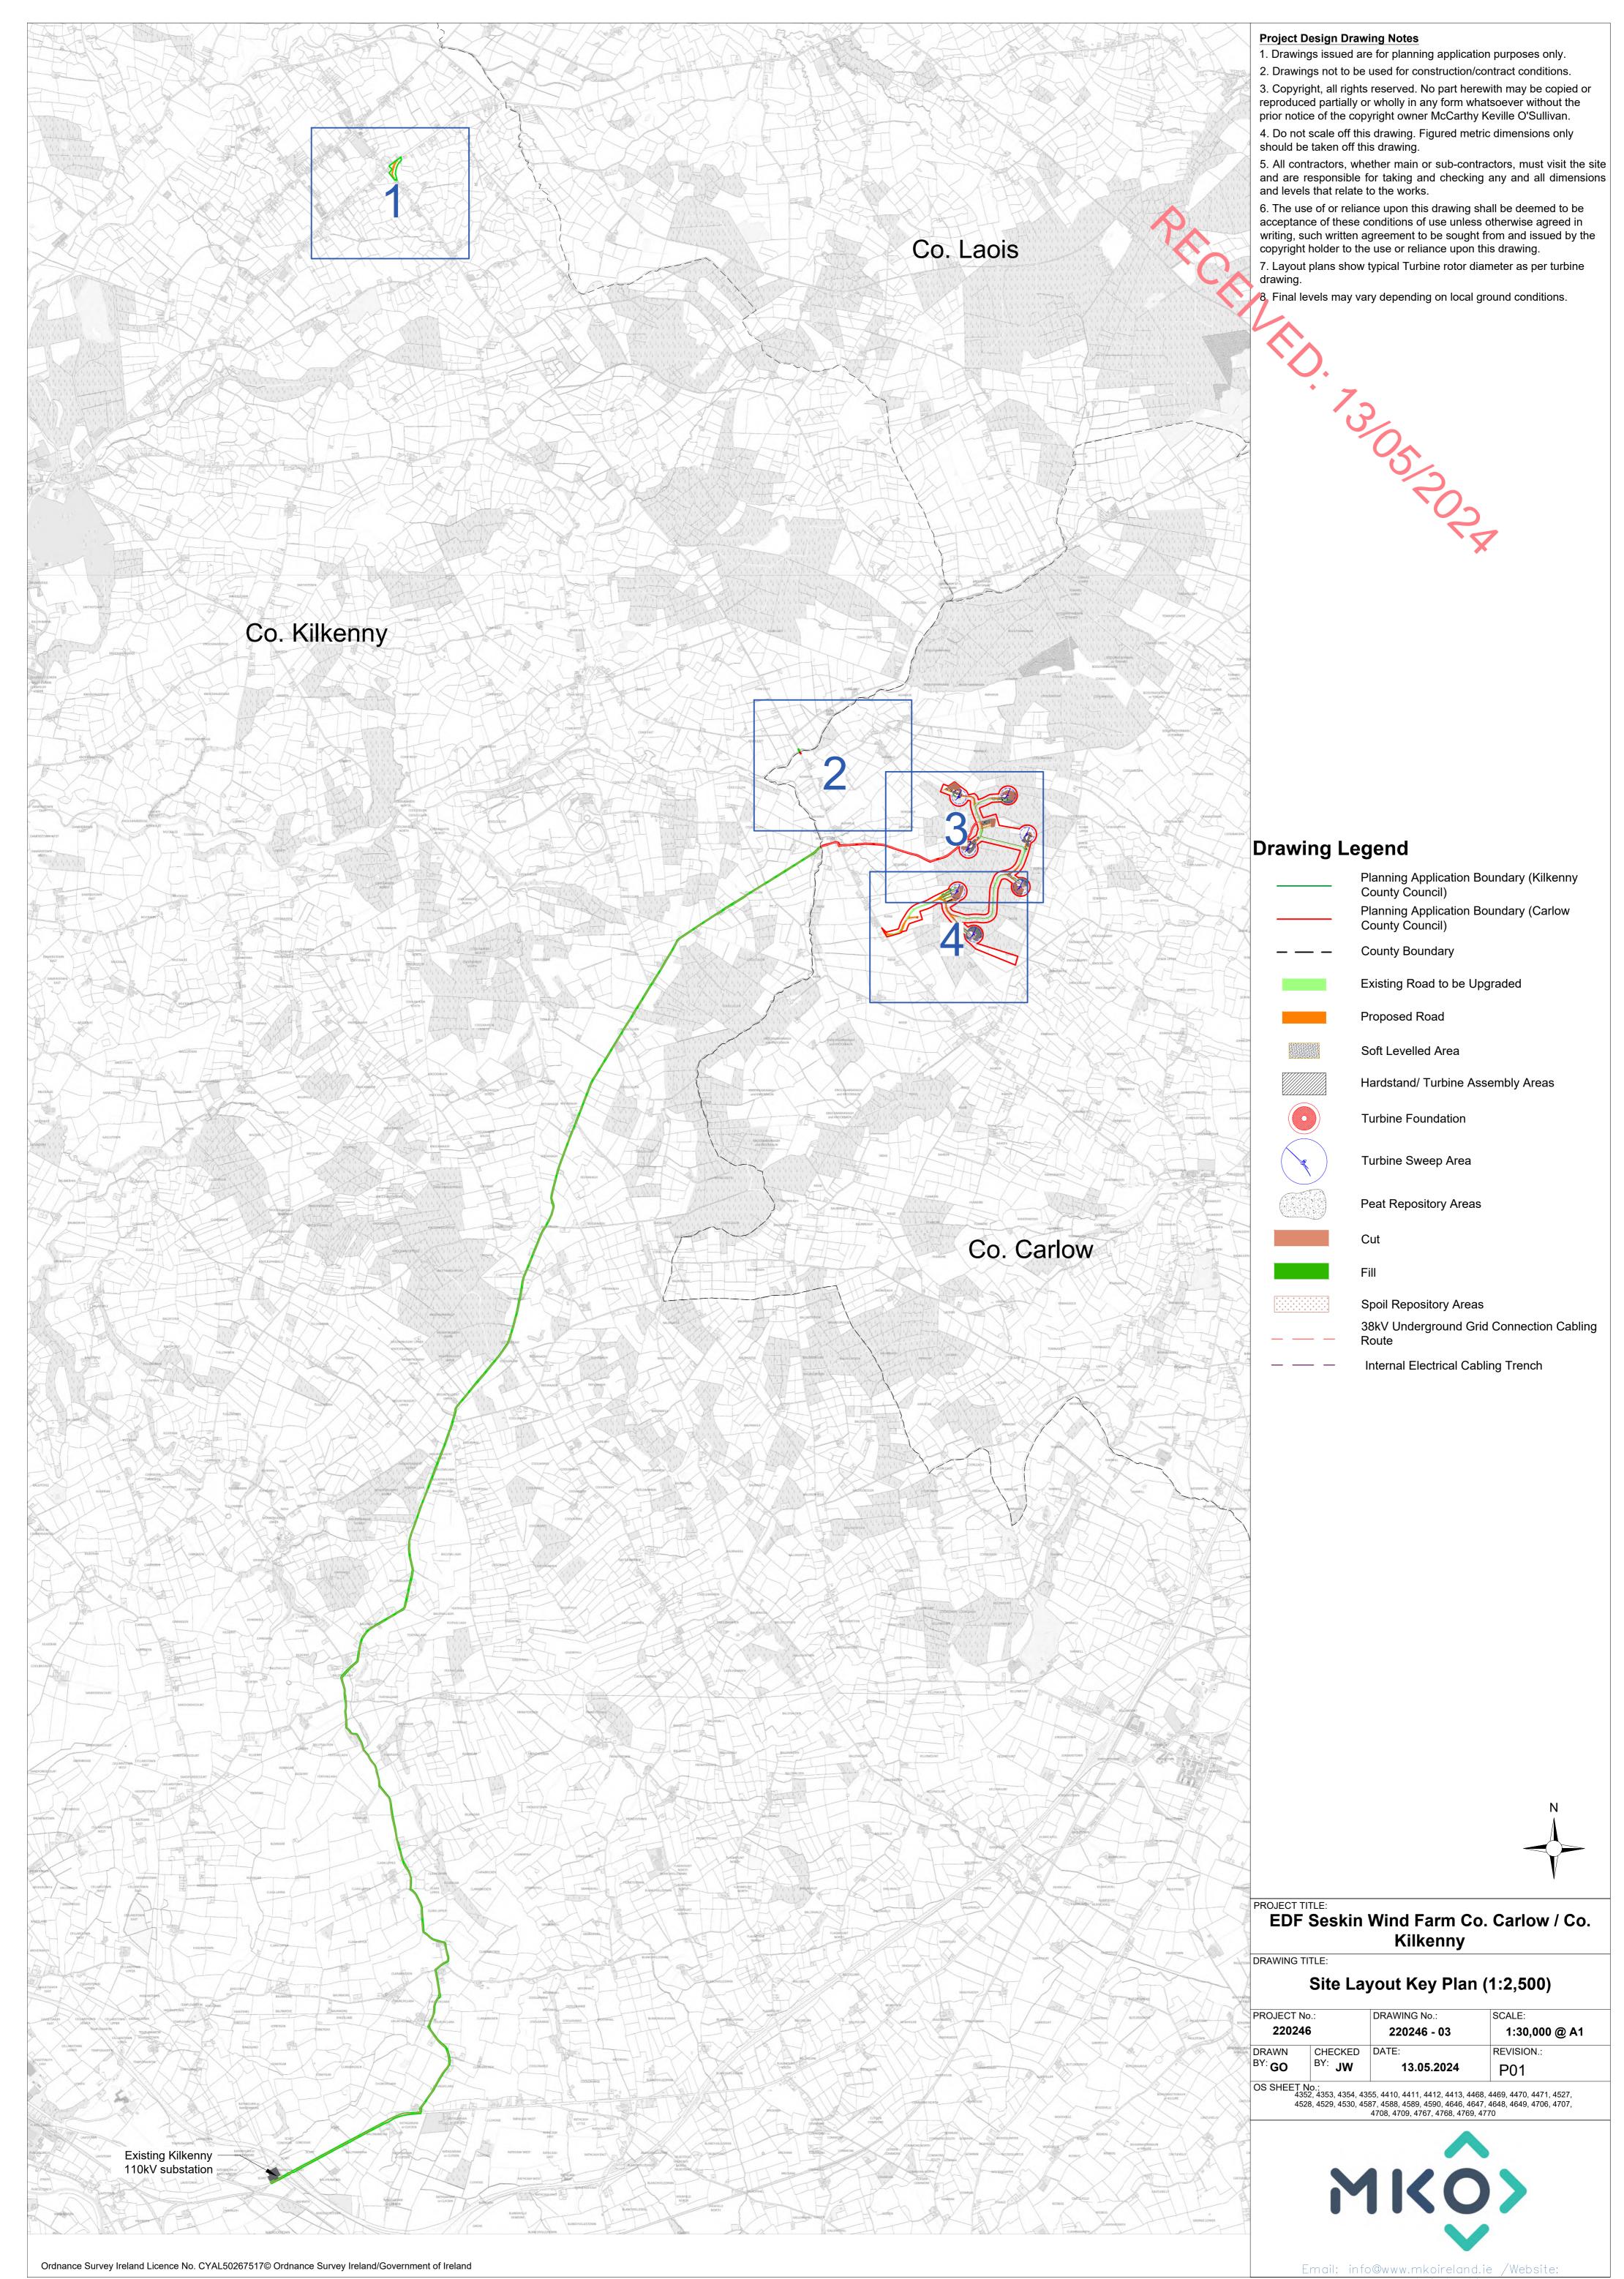

www.mkoireland.ie

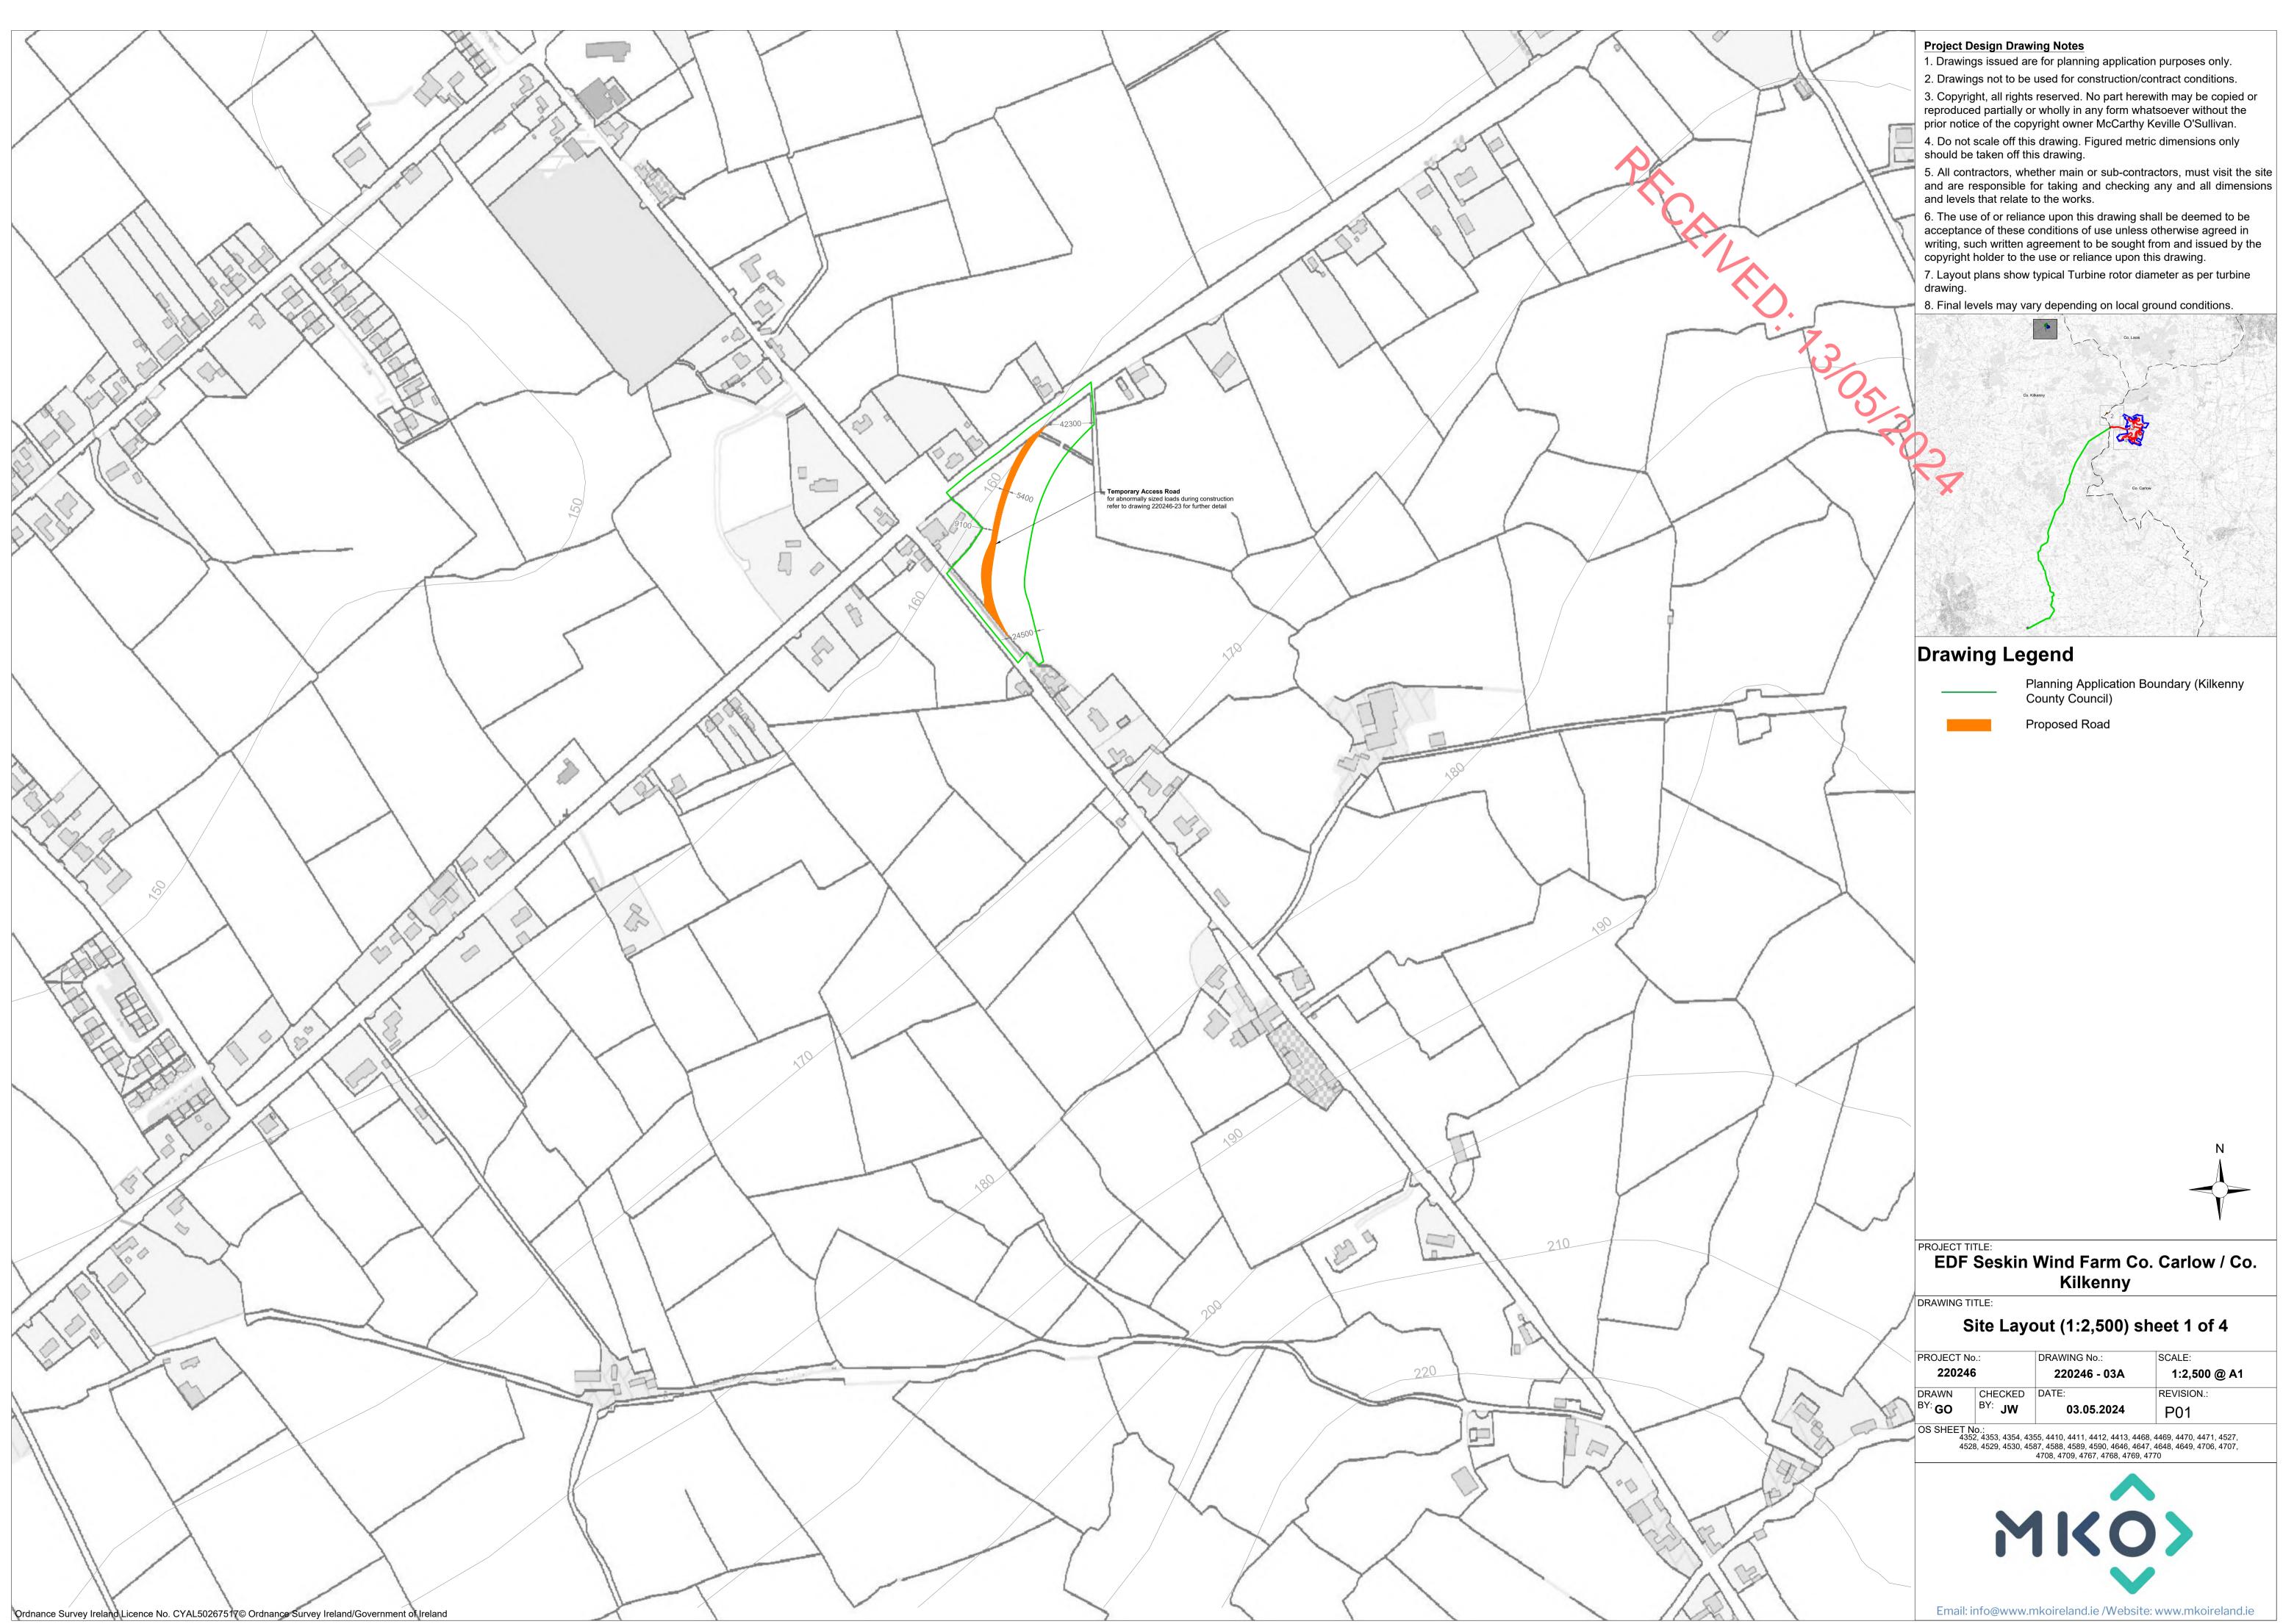

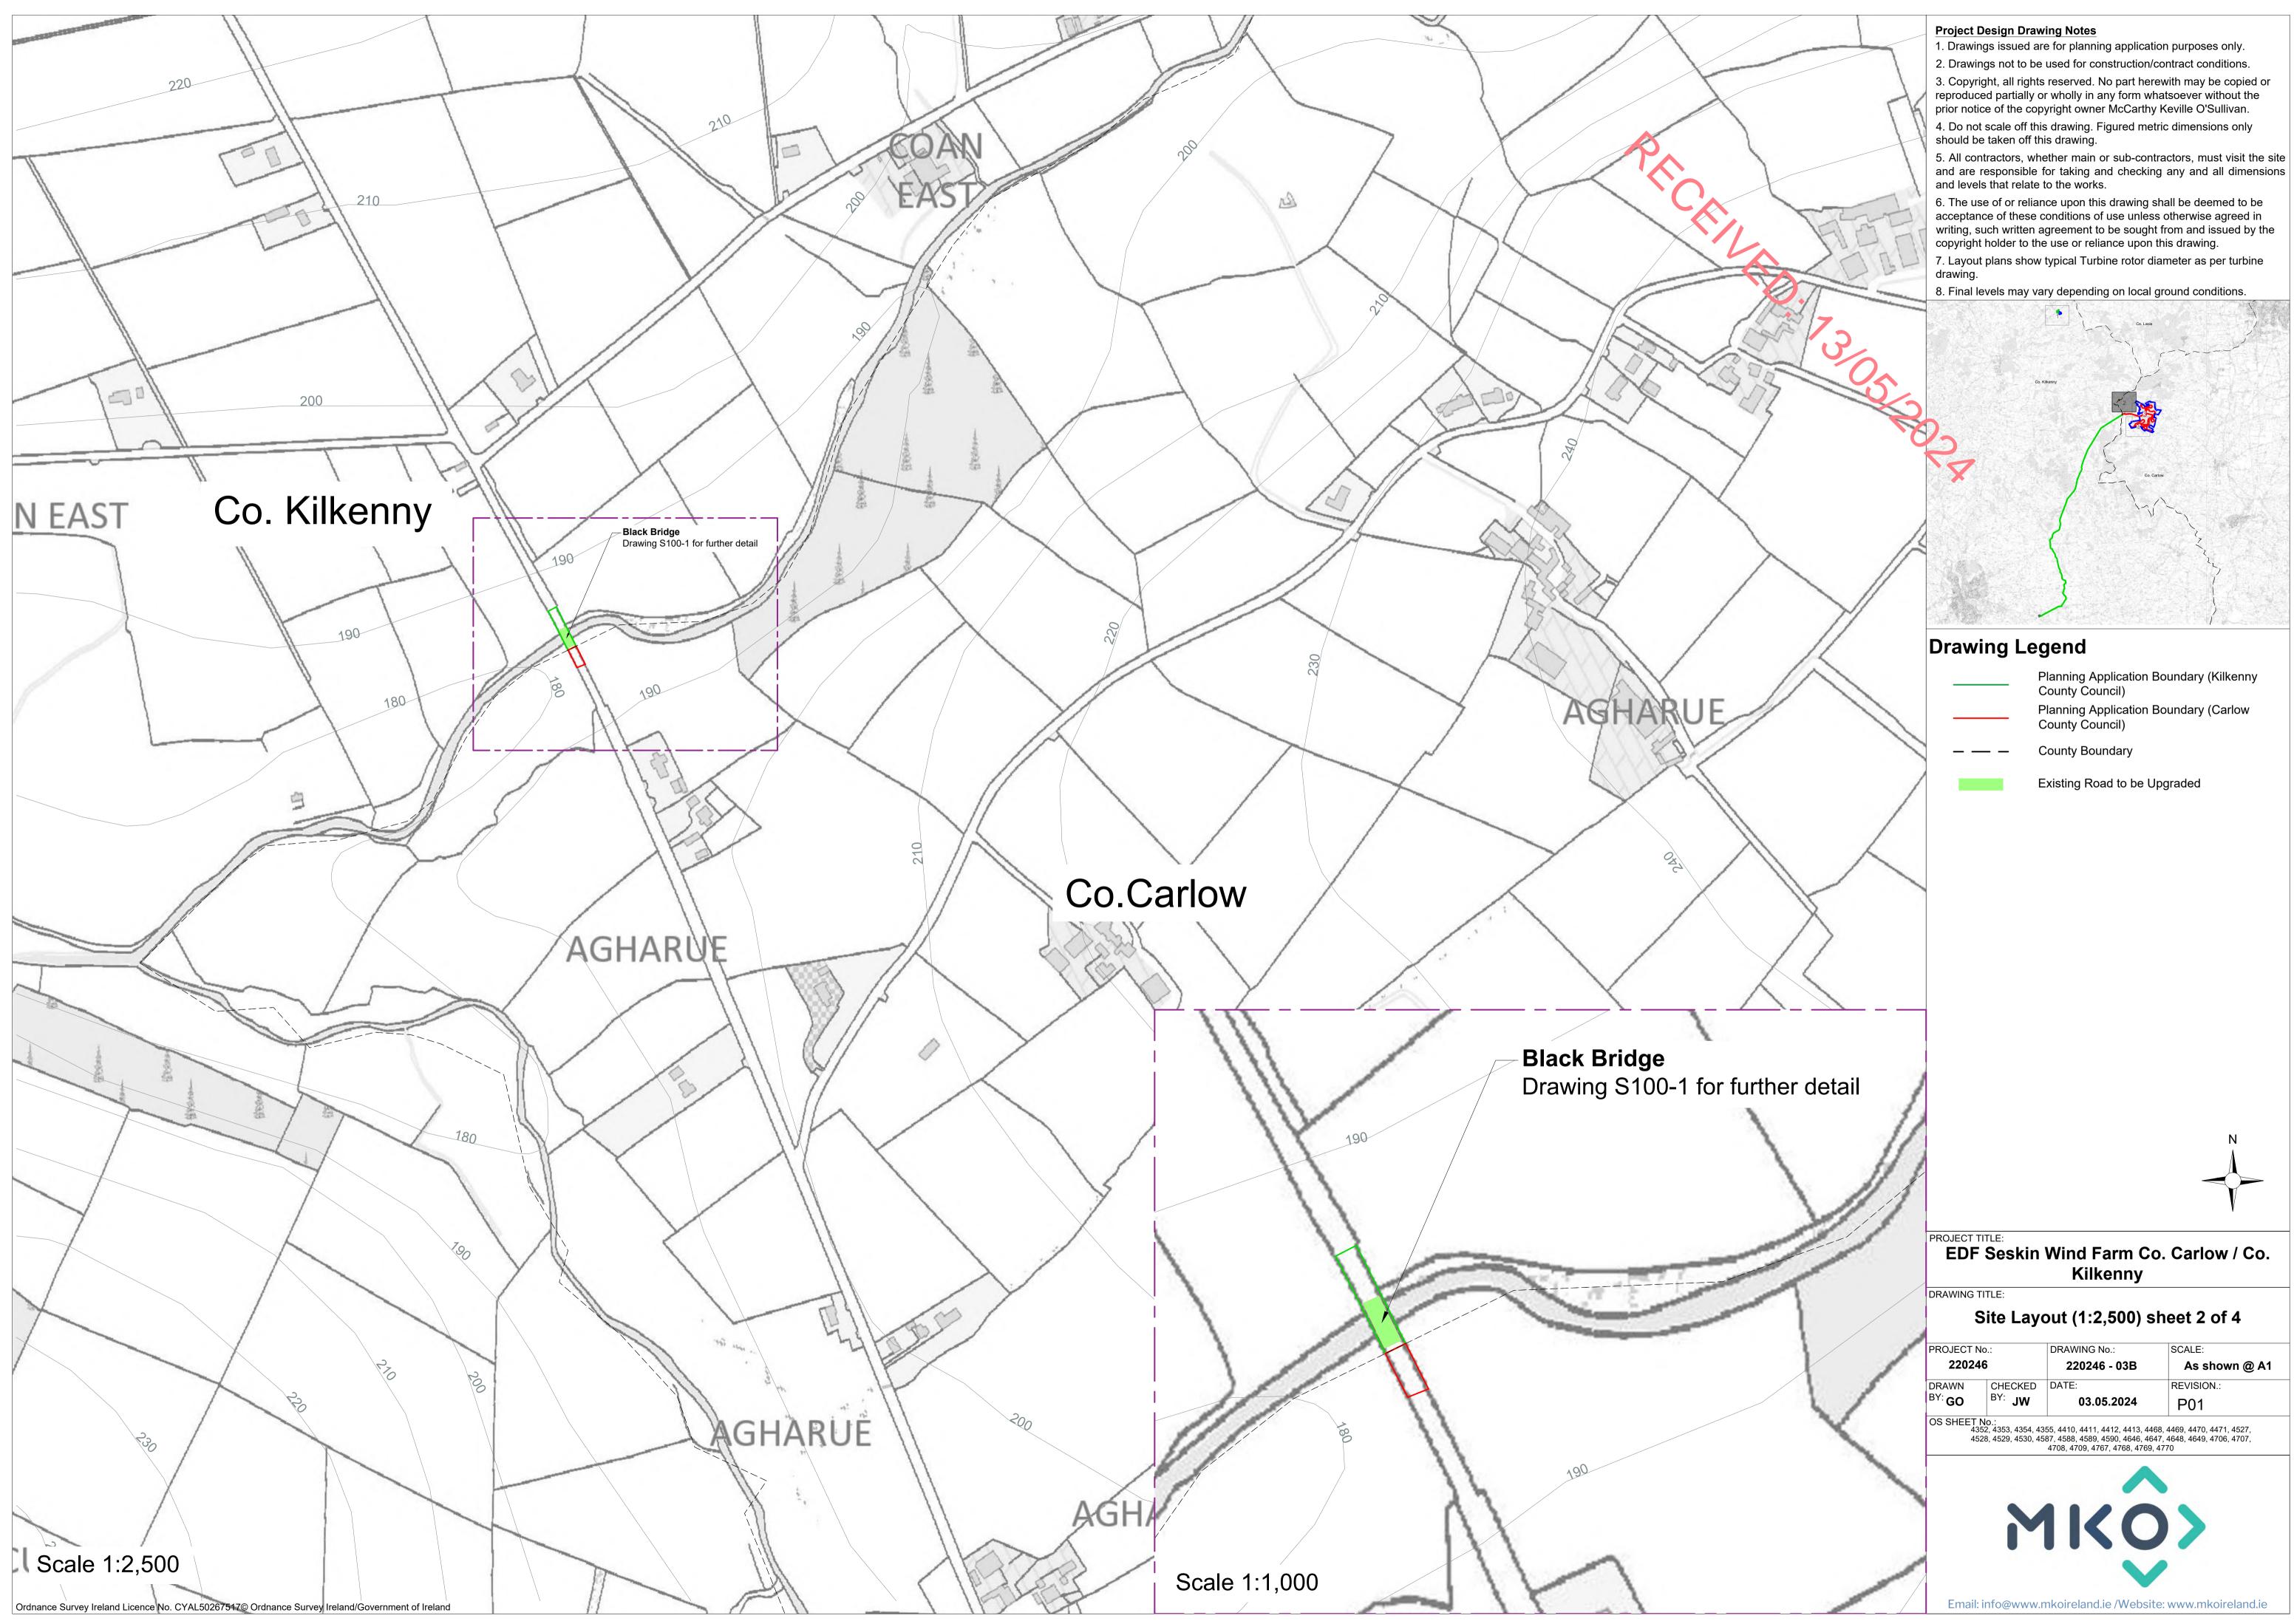

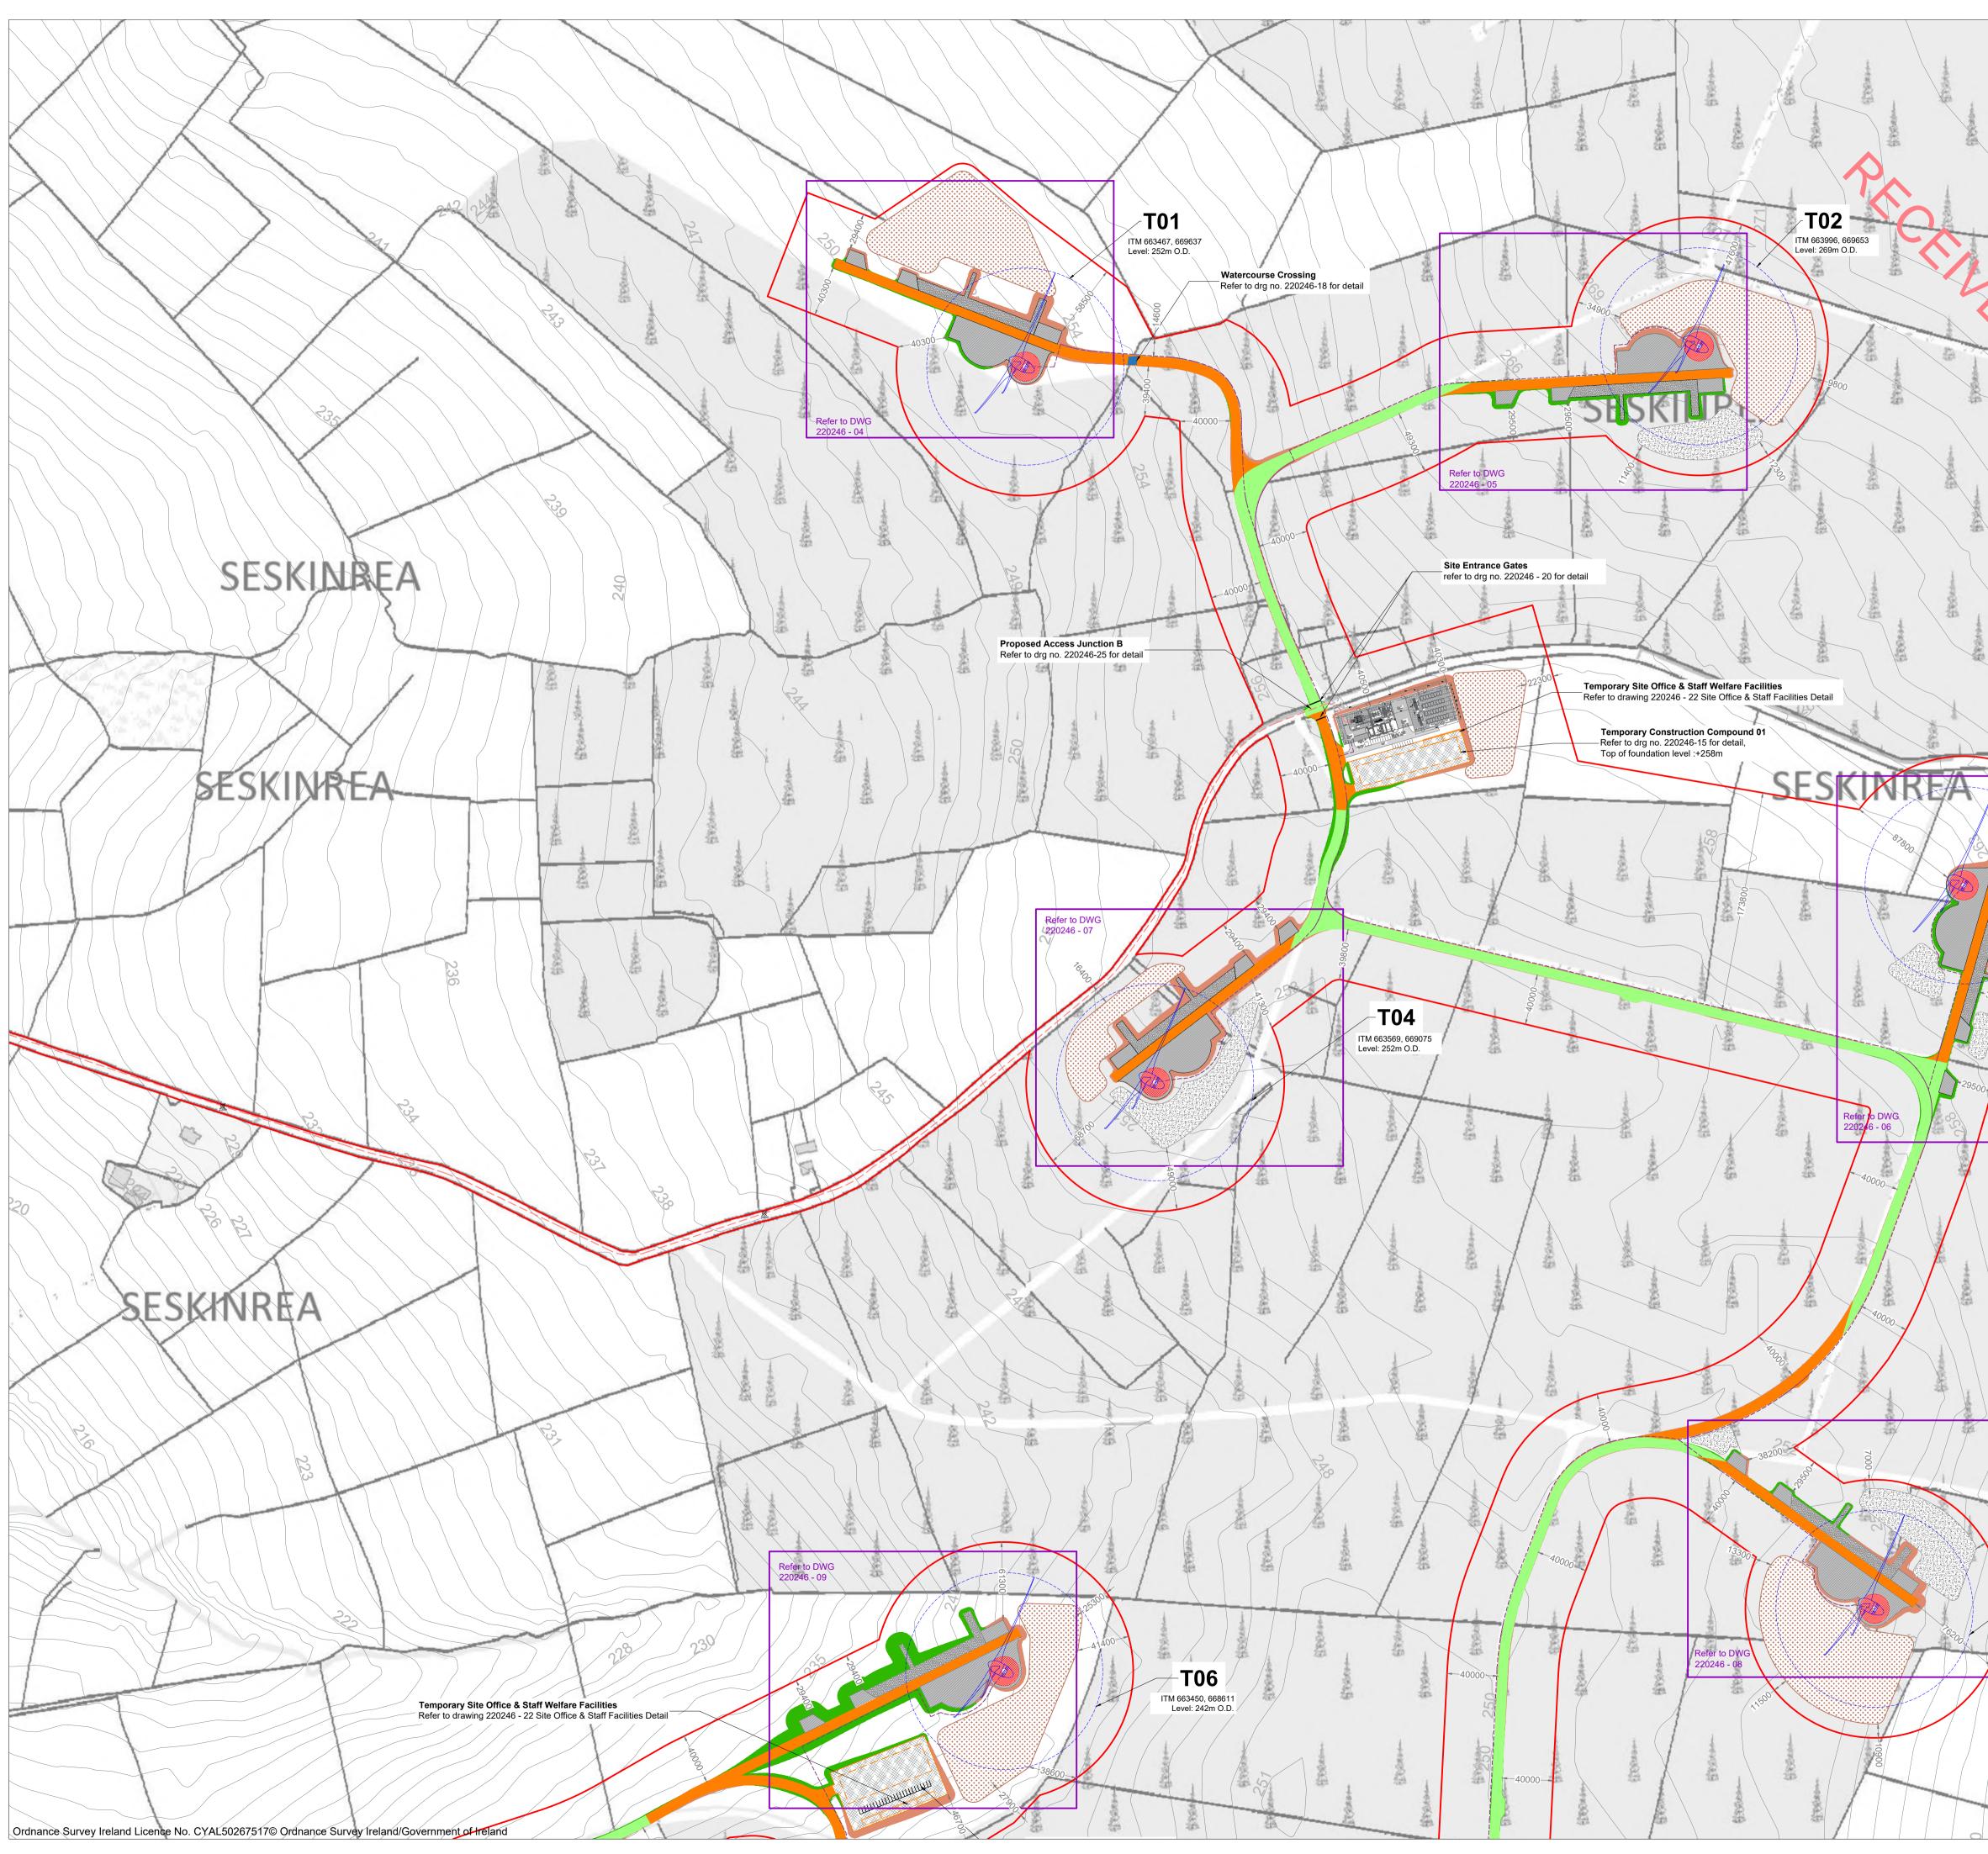

# Project Design Drawing Notes

1. Drawings issued are for planning application purposes only.

2. Drawings not to be used for construction/contract conditions.


 Copyright, all rights reserved. No part herewith may be copied or reproduced partially or wholly in any form whatsoever without the prior notice of the copyright owner McCarthy Keville O'Sullivan.
 Do not scale off this drawing. Figured metric dimensions only

should be taken off this drawing.5. All contractors, whether main or sub-contractors, must visit the site

and are responsible for taking and checking any and all dimensionsand levels that relate to the works.6. The use of or reliance upon this drawing shall be deemed to be

acceptance of these conditions of use unless otherwise agreed in writing, such written agreement to be sought from and issued by the copyright holder to the use or reliance upon this drawing.
7. Layout plans show typical Turbine rotor diameter as per turbine

drawing.8. Final levels may vary depending on local ground conditions.

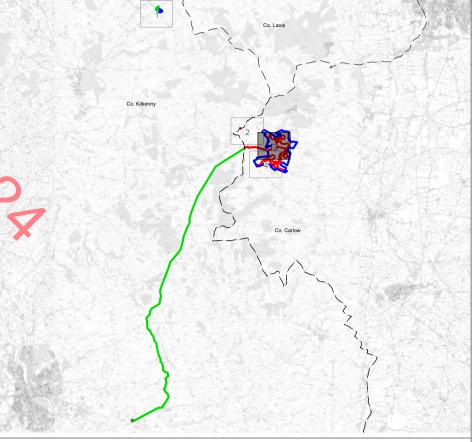

	2	1.8-32
	A //	Drav
	-T03	
	ITM 664205, 669229 Level: 261m O.D.	
7540		
	1-1-	
	AT *	
47000-		
31500		
12600		
		(a)
1		
1		
2		
14	FETNAL	
	ESKHN	
		PROJECT
		ED
		DRAWING
1 Carto		
8800	Y	PROJECT 2202
	MP	DRAWN
<b>T05</b>		<sup>BY:</sup> GO
ITM 664134, 668 Level: 254m (	0.D.	OS SHEE
	411	
	Ab	
261		

Drawing Legend

Planning Application Boundary (Carlow County Council) Existing Road to be Upgraded Proposed Road Soft Levelled Area Hardstand/ Turbine Assembly Areas Turbine Foundation Turbine Sweep Area Peat Repository Areas Cut Fill Spoil Repository Areas Internal Electrical Cabling Trench \_ \_\_ \_ 38kV Underground Grid Connection Cabling Route Watercourse Crossing Ν ROJECT TITLE: EDF Seskin Wind Farm Co. Carlow / Co. Kilkenny RAWING TITLE: Site Layout (1:2,500) sheet 3 of 4 OJECT No.: DRAWING No.: SCALE: 220246 1:2,500 @ A1 220246 - 03C REVISION. CHECKED DATE: <sup>BY:</sup> JW P01 13.05.2024 ASS SHEET NO.: 4352, 4353, 4354, 4355, 4410, 4411, 4412, 4413, 4468, 4469, 4470, 4471, 4527, 4528, 4529, 4530, 4587, 4588, 4589, 4590, 4646, 4647, 4648, 4649, 4706, 4707, 4708, 4709, 4767, 4768, 4769, 4770



Email: info@www.mkoireland.ie /Website: www.mkoireland.ie



		lanning Application Bo ounty Council)	undary (Carlow	
	E	Existing Road to be Upgraded		
	P	Proposed Road		
	S	Soft Levelled Area		
	Н	Hardstand/ Turbine Assembly Areas		
	т	Turbine Foundation		
	т	Turbine Sweep Area		
	P	Peat Repository Areas		
	C	ut		
	F	ill		
	S	Spoil Repository Areas		
	V	Watercourse Crossing		
	· — I	nternal Electrical Cabli	ng Trench	
JECT TIT	1E:		N	
EDF Seskin Wind Farm Co. Carlow / Co. Kilkenny				
WING TIT Si		out (1:2,500) sh	eet 4 of 4	
JECT No. <b>220246</b>		DRAWING No.: 220246 - 03D	SCALE: 1:2,500 @ A1	
WN	CHECKED	DATE:	REVISION.:	
GO	<sup>BY:</sup> JW	03.05.2024	P01	
SHEET No.: 4352, 4353, 4354, 4355, 4410, 4411, 4412, 4413, 4468, 4469, 4470, 4471, 4527, 4528, 4529, 4530, 4587, 4588, 4589, 4590, 4646, 4647, 4648, 4649, 4706, 4707, 4708, 4709, 4767, 4768, 4769, 4770				
		~		