


STANDARD ATTENUATION SYSTEM SECTION

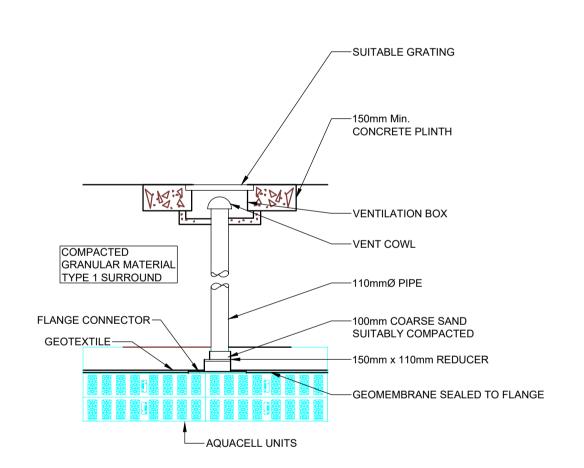

IT IS RECOMMENDED THAT ONE 110mmØ
VENT PIPE IS PROVIDED PER 7500m²
IMPERMEABLE CATCHMENT AREA ON SITE

DETAIL A

DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS IN ALL CASES. VERIFY DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE DESIGNERS IMMEDIATELY.

THIS DRAWING TO BE READ IN CONJUNCTION WITH THE DESIGNERS

SPECIFICATION.

THIS DRAWING IS COPYRIGHT AND MAY ONLY BE REPRODUCED WITH THE

DESIGNERS PERMISSION.

NOTES:

1. ALL CONSTRUCTION PRODUCTS COVERED BY A
HARMONIZED EUROPEAN PRODUCT STANDARD SHALL HAVE
DECLARATION OF PERFORMANCE AND A CE MARK IN
COMPLIANCE WITH THE CONSTRUCTION PRODUCT REGULATION (EU) NO. 395/2011 CPR. ALL EXTERNAL STEELWORK GALVANISED TO IS EN ISO 1461. ALL COVERS, GRATINGS & FRAMES IN HARDSTANDING

AREAS ARE TO BE A MINIMUM OF CLASS D400 DUCTILE IRON IN ACCORDANCE WITH BS EN 124 ALL WORK TO BE IN ACCORDANCE WITH EIRGRID FUNCTIONAL SPEC DOCUMENT: - XDS-GFS-13-001-R2

01 04.12.24 REV DATE ISSUED FOR PLANNING

SECIRE ROCKS OFFSHORE WIND FARM

ATTENUATION TANK DETAILS







DRAWN:	CHECKED:	APPROVED:
EP	NT	IB
PROJECT NUMBER:	DATE:	SCALE @ A1:
24204	NOV' 2024	AS SHOWN
STATUS DESCRIPTION	•	STATUS:
FOR PLANNING		S4

IRE1-HMV-ONS-EL-PD-0001 01