


VENT STACK DETAIL

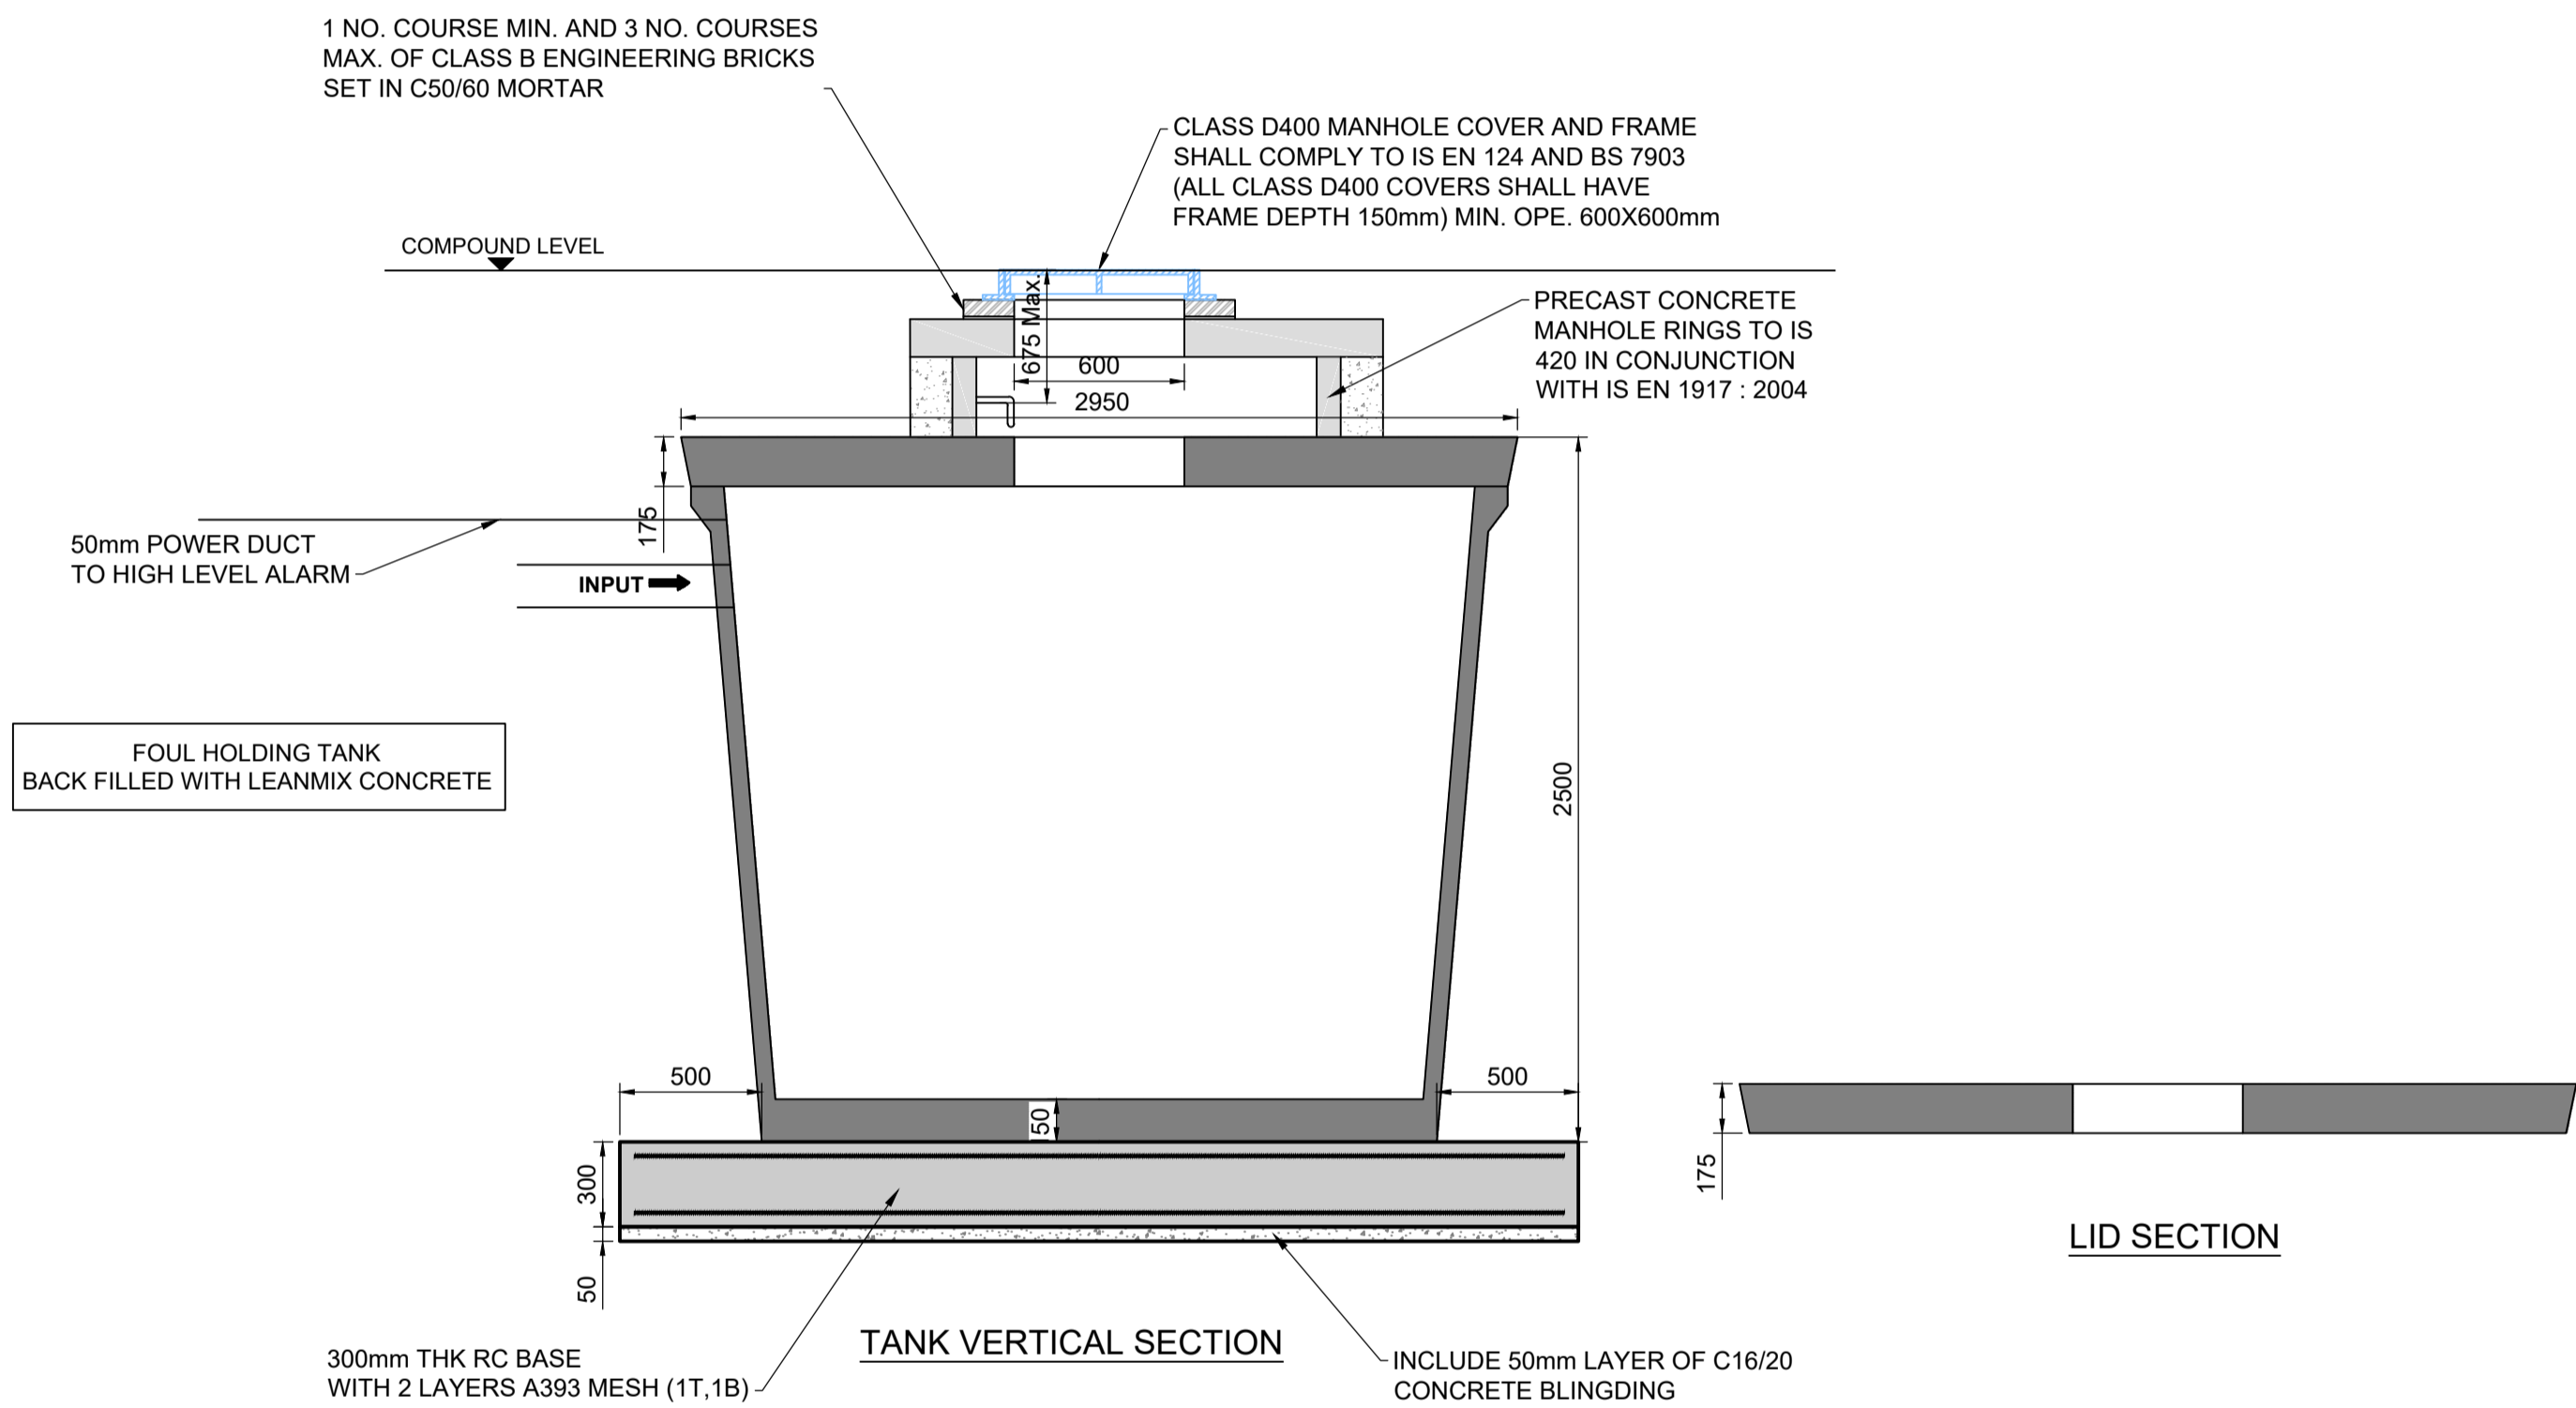

TANK TOP PLAN

LID TOP PLAN

FOUL SEWER HOLDING TANK
(VOLUME 5m³)
SCALE: 1:25

DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS IN ALL CASES. VERIFY DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE DESIGNERS IMMEDIATELY.
THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE DESIGNERS SPECIFICATION.
© THIS DRAWING IS COPYRIGHT AND MAY ONLY BE REPRODUCED WITH THE DESIGNERS PERMISSION.

- NOTES:
- ALL CONSTRUCTION PRODUCTS COVERED BY A HARMONIZED EUROPEAN PRODUCT STANDARD SHALL HAVE DECLARATION OF PERFORMANCE AND A CE MARK IN COMPLIANCE WITH THE CONSTRUCTION PRODUCT REGULATION (EU) NO. 395/2011 CPR.
 - ALL EXTERNAL STEELWORK GALVANISED TO IS EN ISO 1461.
 - ALL COVERS, GRATINGS & FRAMES IN HARDSTANDING AREAS ARE TO BE A MINIMUM OF CLASS D400 DUCTILE IRON IN ACCORDANCE WITH BS EN 124.
 - ALL WORK TO BE IN ACCORDANCE WITH EIRGRID FUNCTIONAL SPEC DOCUMENT - XDS-GFS-13-001-R2

03	04.12.24	ISSUED FOR PLANNING	EP	IB
02	28.11.24	ISSUED FOR PLANNING	EP	IB
01	18.11.24	ISSUED FOR PLANNING	EP	IB
REV	DATE	DESCRIPTION	BY	APP

PROJECT:

SCEIRDE ROCKS OFFSHORE WIND FARM

TITLE:

FOUL HOLDING TANK DETAILS

CLIENT:



DRAWN:	EP	CHECKED:	NT	APPROVED:	IB
PROJECT NUMBER:	24204	DATE:	NOV 2024	SCALE @ A1:	AS SHOWN
STATUS DESCRIPTION					STATUS:
FOR PLANNING					S4
DRAWING NUMBER:					REV:
IRE1-HMV-ONS-EL-PD-4007					03