




- NOTES
- For planning purposes only. Not for construction.
 - All dimensions are in metres unless otherwise noted.
 - Where levels are shown, all levels are in metres above Malin Head datum.
 - The identified location of the underground cable infrastructure, compound and work areas and associated infrastructure development, including joint bays and underground chambers are indicative for the purpose of the application for Approval. The final extent and location of such will be identified in detailed design.
 - The existing 3 metre wide pedestrian path is to be upgraded and widened to a 4 metre wide Temporary Construction Compound (TCC) access road. This will be retained as a 4m wide pedestrian path following demobilisation of the TCC. The four passing bays will be removed and reinstated as agreed with the Local Authority.

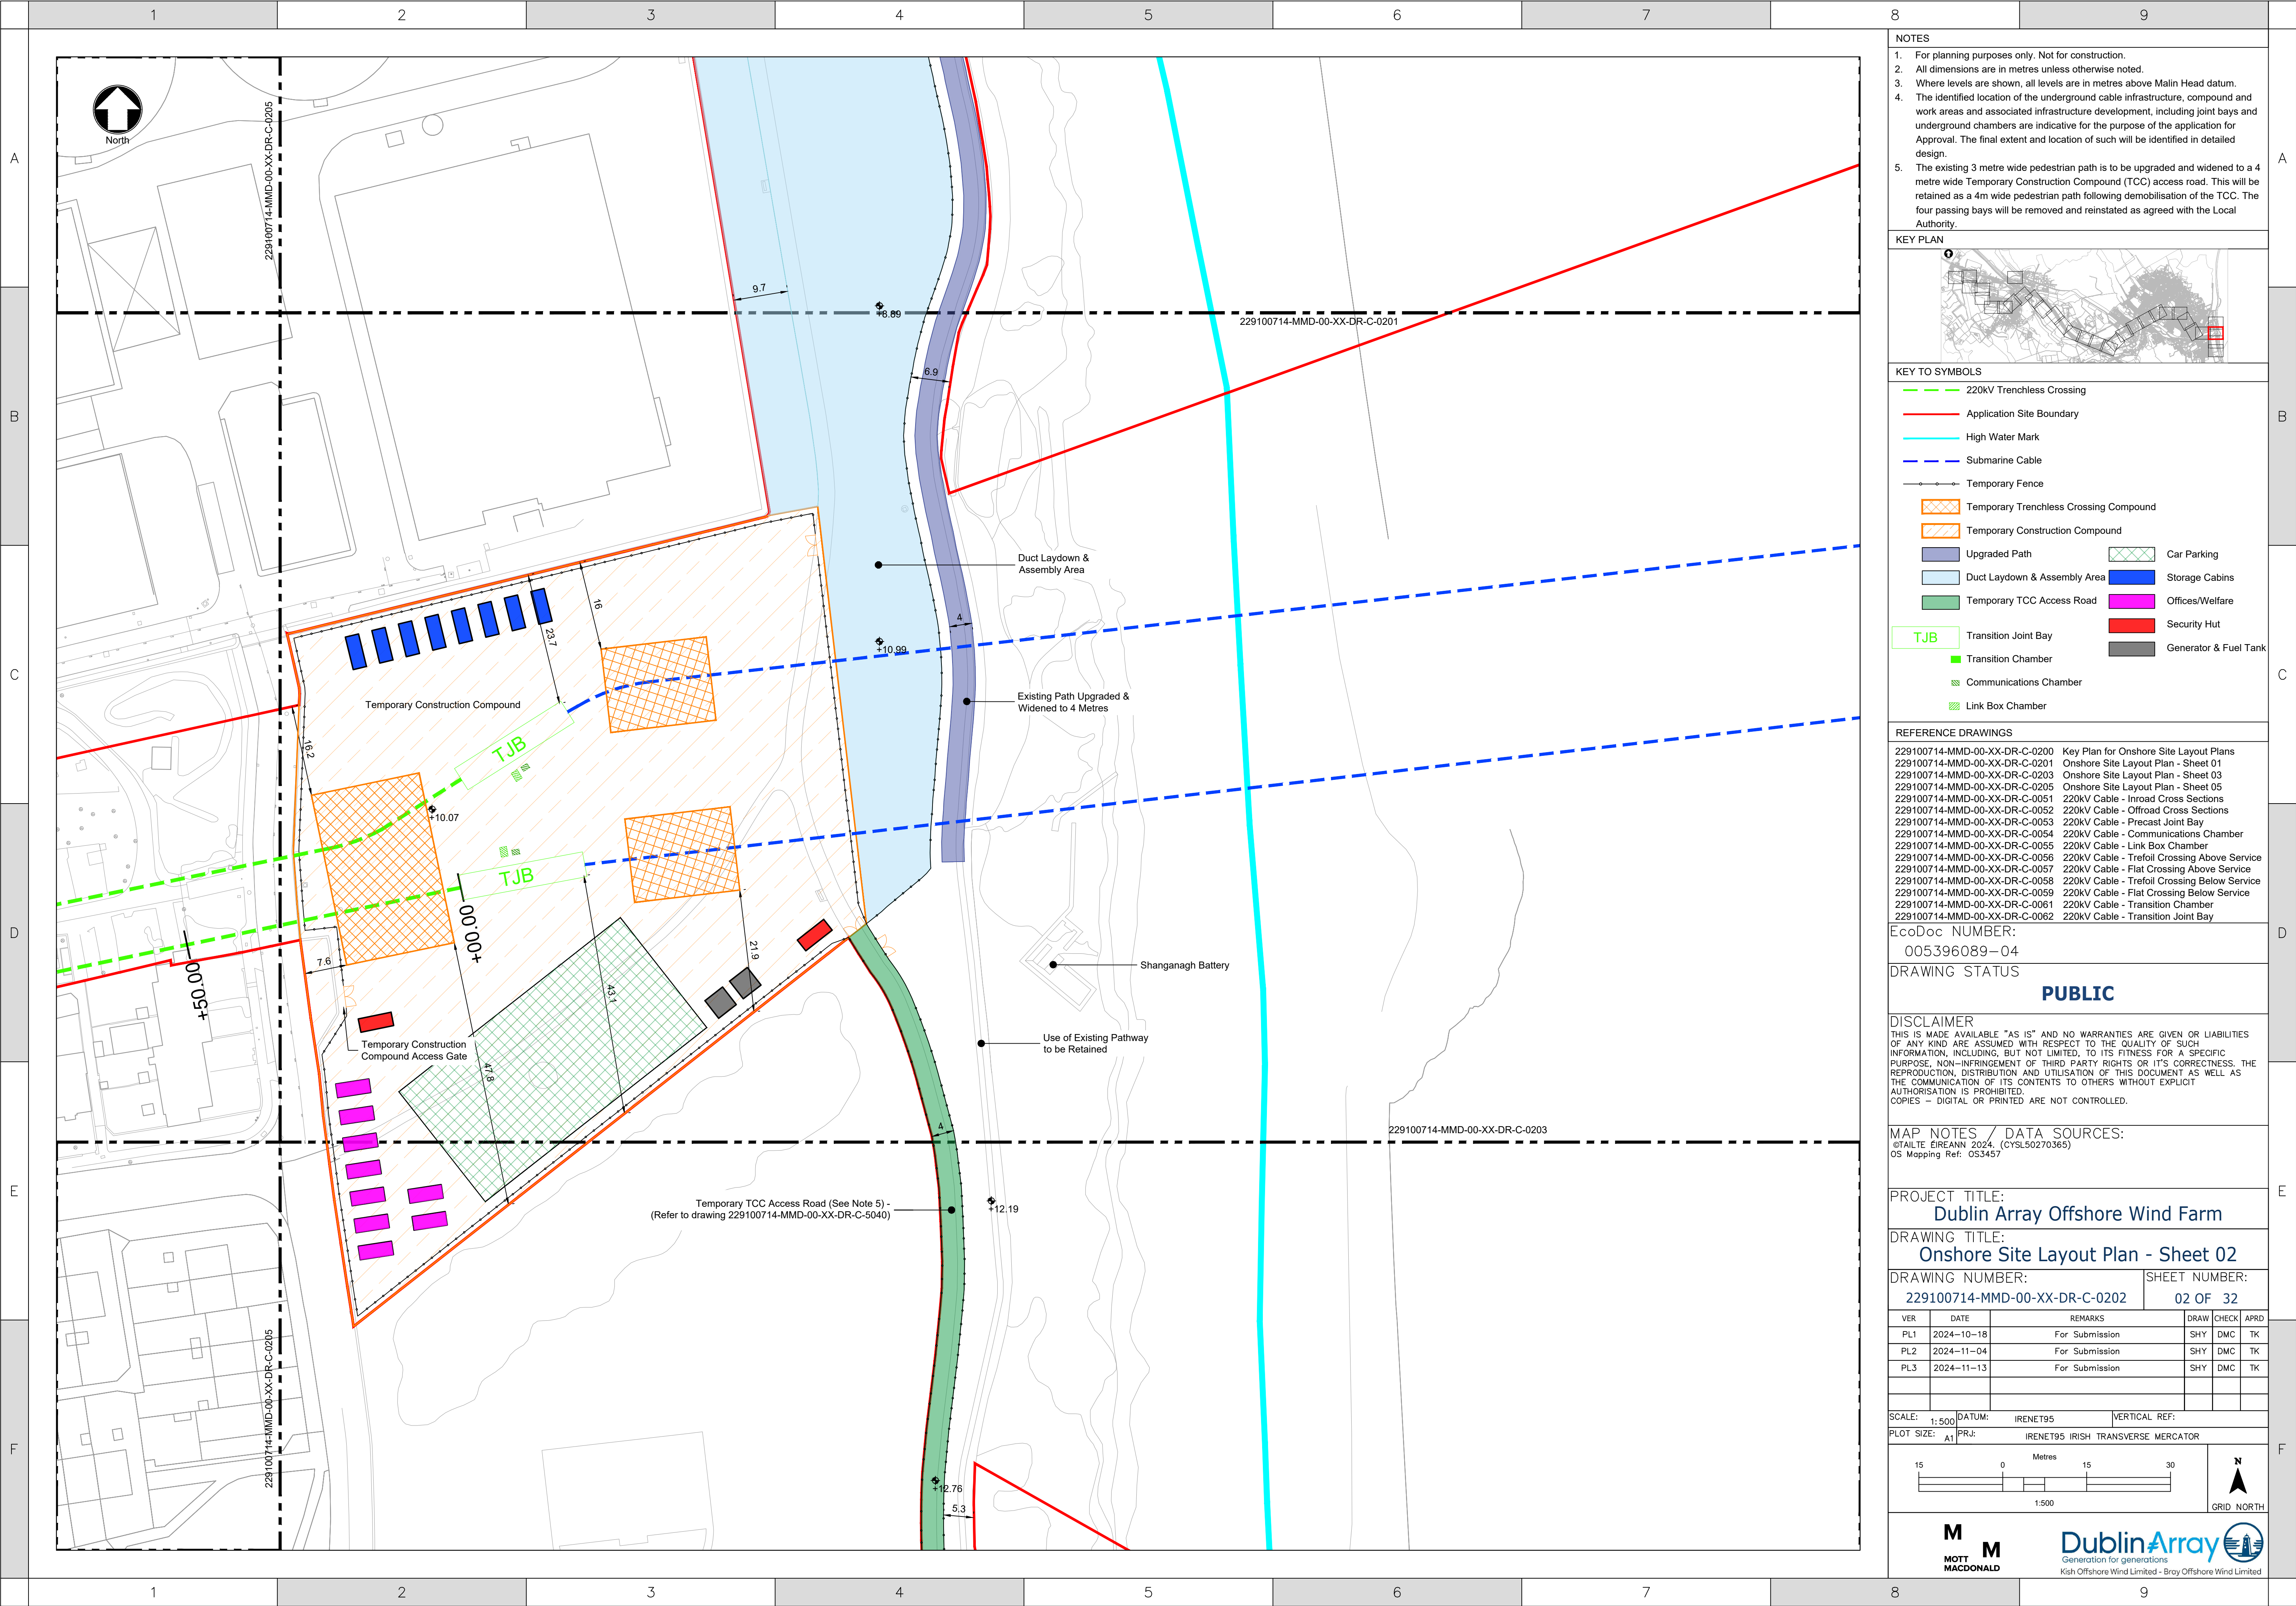

- KEY TO SYMBOLS
- 220kV Trenchless Crossing
 - Application Site Boundary
 - High Water Mark
 - Submarine Cable
 - Temporary Fence
 - Temporary Trenchless Crossing Compound
 - Temporary Construction Compound
 - Upgraded Path
 - Duct Laydown & Assembly Area
 - Temporary TCC Access Road
 - TJB
 - Transition Joint Bay
 - Transition Chamber
 - Communications Chamber
 - Link Box Chamber
 - Car Parking
 - Storage Cabins
 - Offices/Welfare
 - Security Hut
 - Generator & Fuel Tank

- REFERENCE DRAWINGS
- 229100714-MMD-00-XX-DR-C-0200 Key Plan for Onshore Site Layout Plans
 - 229100714-MMD-00-XX-DR-C-0201 Onshore Site Layout Plan - Sheet 01
 - 229100714-MMD-00-XX-DR-C-0203 Onshore Site Layout Plan - Sheet 03
 - 229100714-MMD-00-XX-DR-C-0205 Onshore Site Layout Plan - Sheet 05
 - 229100714-MMD-00-XX-DR-C-0051 220kV Cable - Inroad Cross Sections
 - 229100714-MMD-00-XX-DR-C-0052 220kV Cable - Offroad Cross Sections
 - 229100714-MMD-00-XX-DR-C-0053 220kV Cable - Precast Joint Bay
 - 229100714-MMD-00-XX-DR-C-0054 220kV Cable - Communications Chamber
 - 229100714-MMD-00-XX-DR-C-0055 220kV Cable - Link Box Chamber
 - 229100714-MMD-00-XX-DR-C-0056 220kV Cable - Trefoil Crossing Above Service
 - 229100714-MMD-00-XX-DR-C-0057 220kV Cable - Flat Crossing Above Service
 - 229100714-MMD-00-XX-DR-C-0058 220kV Cable - Trefoil Crossing Below Service
 - 229100714-MMD-00-XX-DR-C-0059 220kV Cable - Flat Crossing Below Service
 - 229100714-MMD-00-XX-DR-C-0061 220kV Cable - Transition Chamber
 - 229100714-MMD-00-XX-DR-C-0062 220kV Cable - Transition Joint Bay

EcoDoc NUMBER:
005396089-04

DRAWING STATUS
PUBLIC

DISCLAIMER
THIS IS MADE AVAILABLE "AS IS" AND NO WARRANTIES ARE GIVEN OR LIABILITIES OF ANY KIND ARE ASSUMED WITH RESPECT TO THE QUALITY OF SUCH INFORMATION, INCLUDING, BUT NOT LIMITED, TO ITS FITNESS FOR A SPECIFIC PURPOSE, NON-INFRINGEMENT OF THIRD PARTY RIGHTS OR ITS CORRECTNESS. THE REPRODUCTION, DISTRIBUTION AND UTILISATION OF THIS DOCUMENT AS WELL AS THE COMMUNICATION OF ITS CONTENTS TO OTHERS WITHOUT EXPLICIT AUTHORISATION IS PROHIBITED.
COPIES - DIGITAL OR PRINTED ARE NOT CONTROLLED.

MAP NOTES / DATA SOURCES:
©TAILE EIREANN 2024, (CYSL50270365)
OS Mapping Ref. OS3457

PROJECT TITLE:
Dublin Array Offshore Wind Farm

DRAWING TITLE:
Onshore Site Layout Plan - Sheet 02

DRAWING NUMBER: 229100714-MMD-00-XX-DR-C-0202 SHEET NUMBER: 02 OF 32

VER	DATE	REMARKS	DRAW	CHECK	APRD
PL1	2024-10-18	For Submission	SHY	DMC	TK
PL2	2024-11-04	For Submission	SHY	DMC	TK
PL3	2024-11-13	For Submission	SHY	DMC	TK

SCALE: 1:500 DATUM: IREN95 VERTICAL REF: A1
PLOT SIZE: A1 PRJ: IREN95 IRISH TRANSVERSE MERCATOR

15 0 15 30 Metres
1:500
GRID NORTH