



TYPICAL CROSS SECTION UNDER EXISTING UNDERGROUND SERVICE

Existing Service	X
Water main diameter <=300mm	300mm
Water main diameter >300mm	500mm
Telecom cable (Eir Network)	300mm

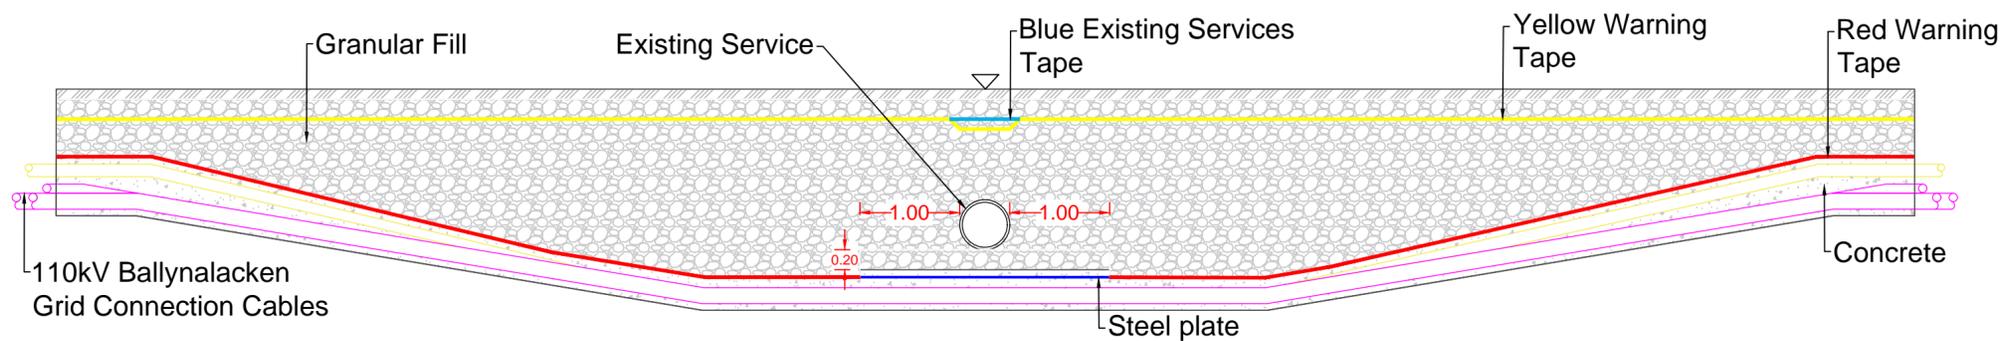

TYPICAL CROSS SECTION UNDER EXISTING UNDERGROUND SERVICE - SECTION A-A

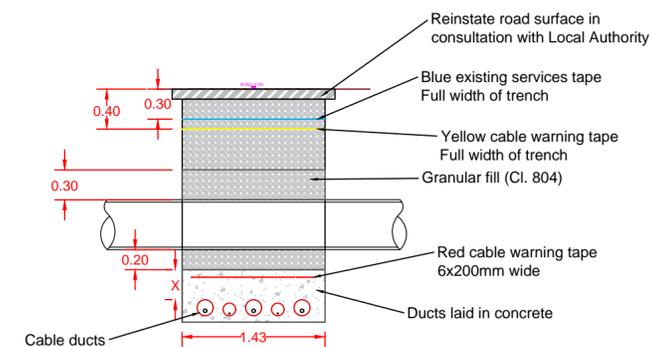

TYPICAL CROSS SECTION UNDER EXISTING UNDERGROUND SERVICE - SECTION B-B

Dimensions shown in meters

Project: Ballynalacken Windfarm

Drawing Title: Details of Grid Connection in proximity to an existing underground service

Drawing Number: BWF-24

Sheet Size: A2 Scale: 1 : 50

Drawn by: Conor Brett Date produced: 24 February 2025



Conor Brett  
Ecopower Limited  
Zetec House, Purcellsinch IDA Business Park  
Dublin Road, Kilkenny - R95 WV80

Landline - 056-7750140 (Ext 204)  
Mobile - +353 (0)87-6531458

**ECOPOWER**