
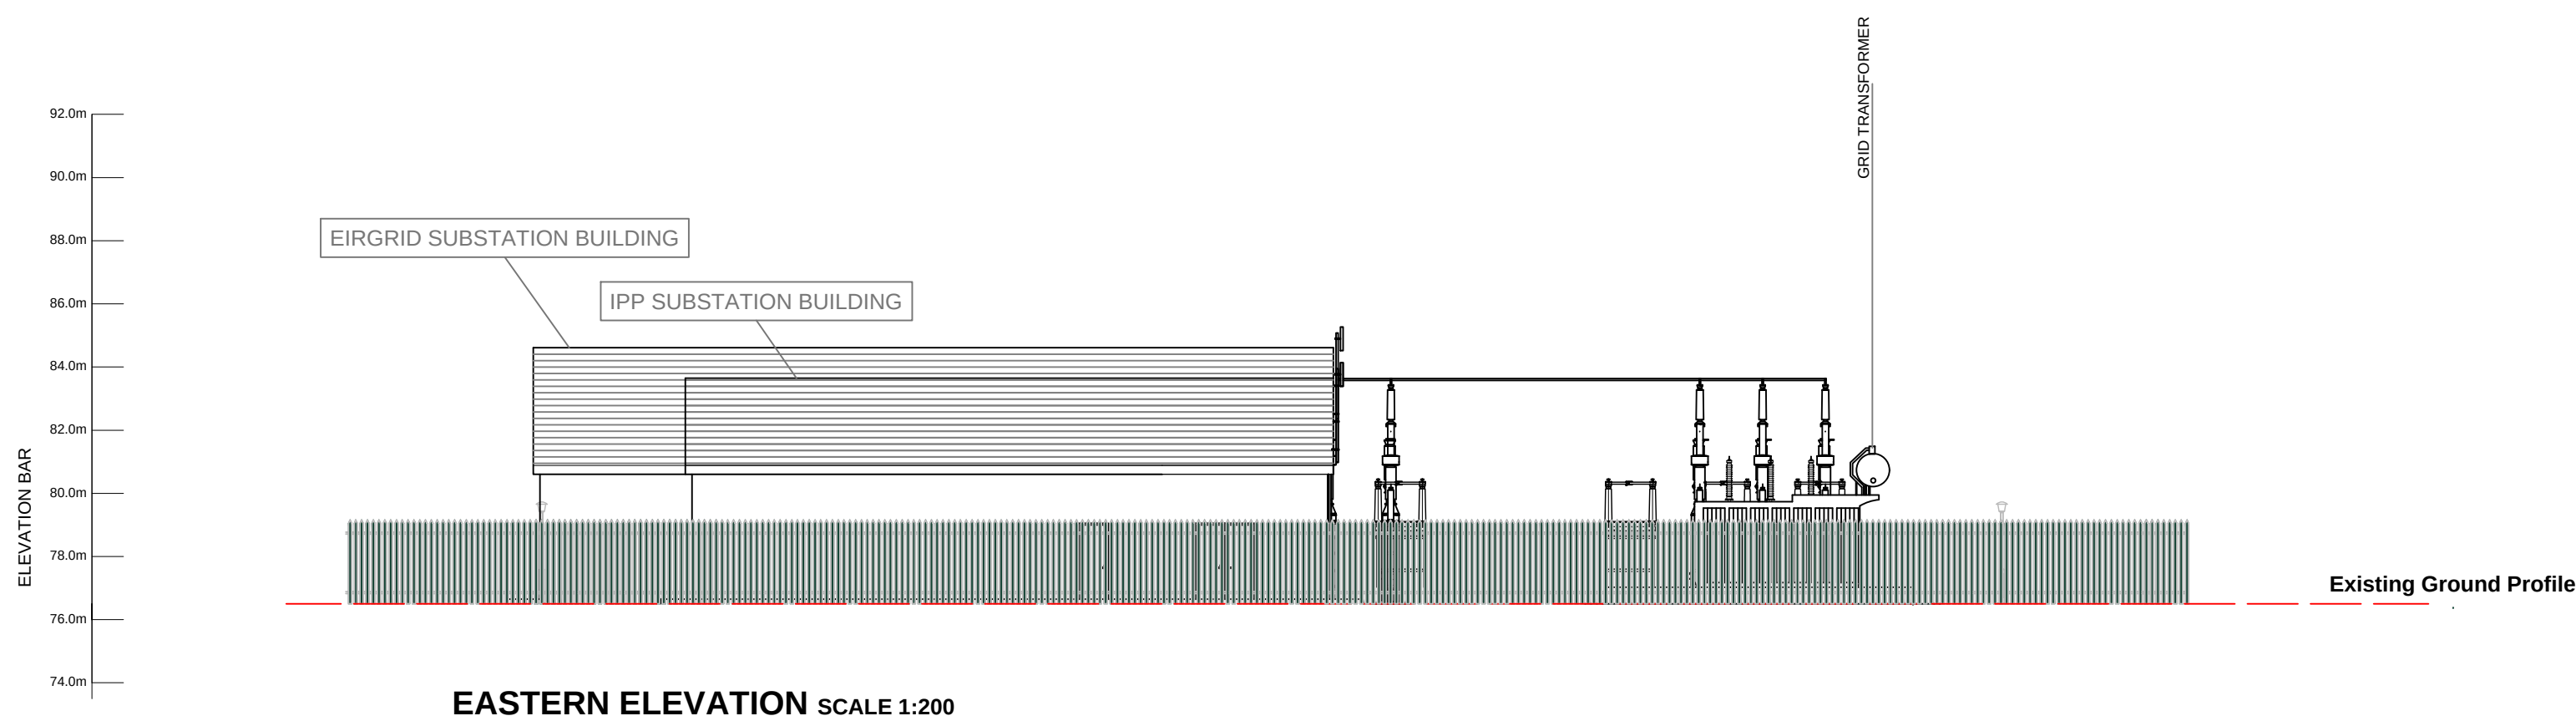
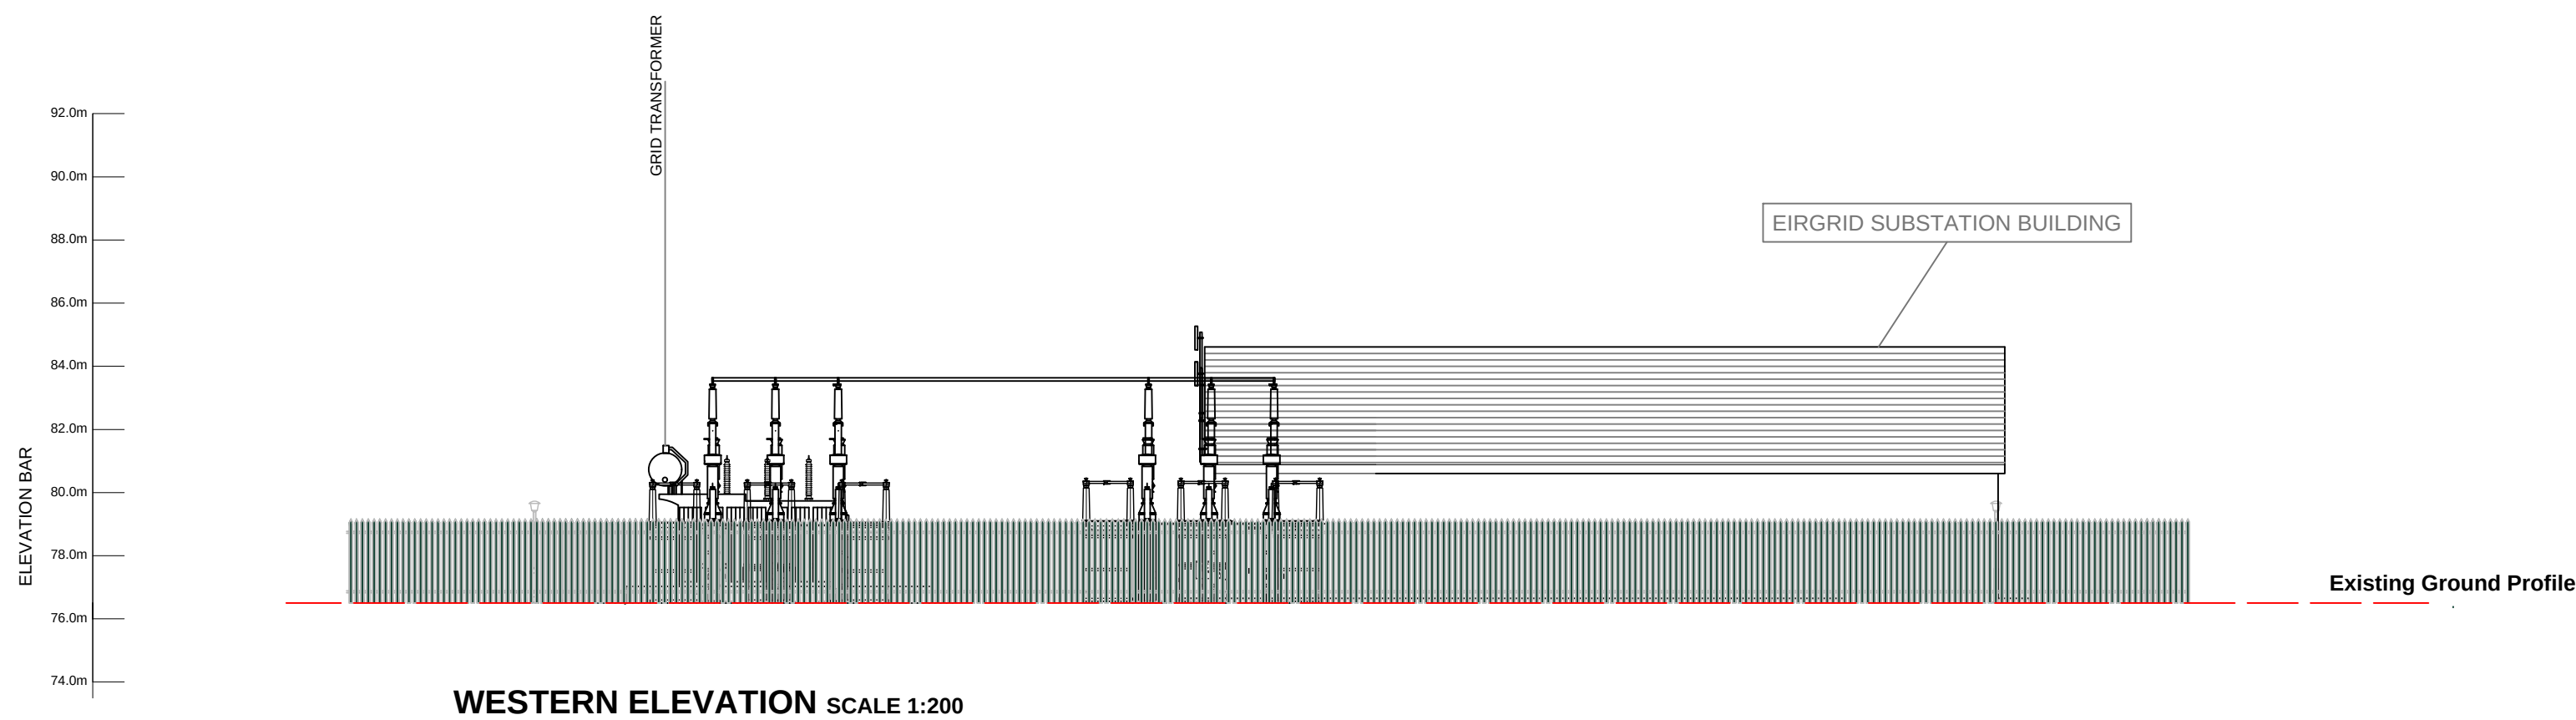
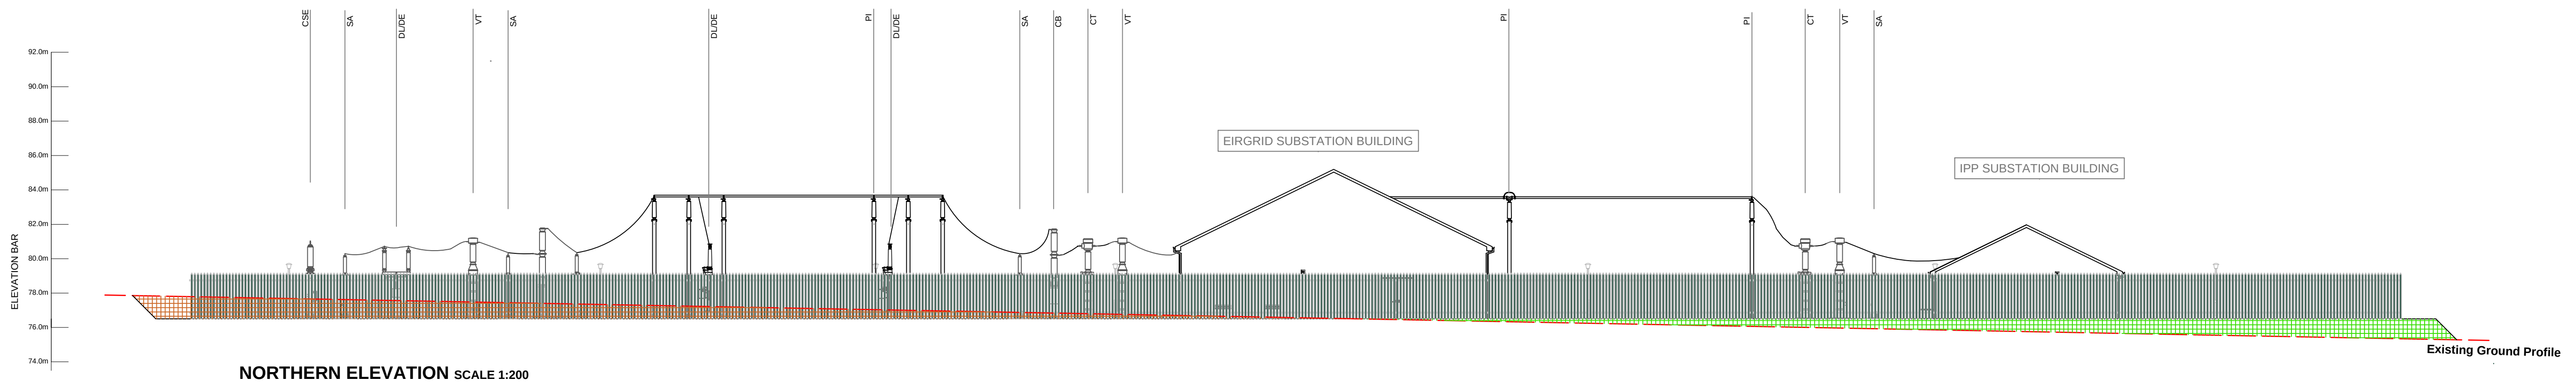


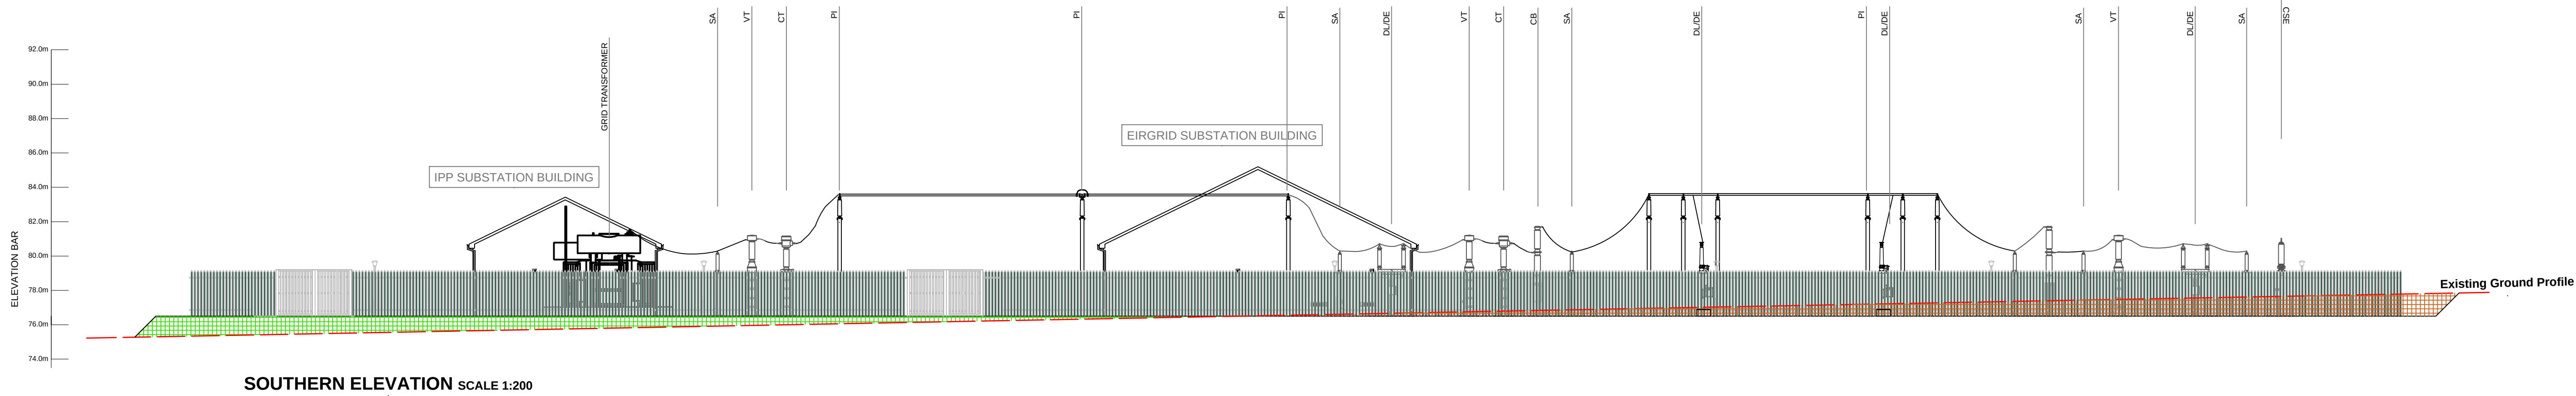

- Notes:
1. Layout and arrangements of substation buildings and electrical equipment are as per current Eirgrid specifications at the time of submission. Final specifications and siting of buildings and electrical equipment within the compound will be as per latest Eirgrid and ESB specification at the time of construction.
 2. Dimensions shown are in meters. Dimensions may vary at time of construction to reflect any revisions to Eirgrid Specifications.
 3. The Elevation of the Compound will be depicted by localized Topography such that Cut/Fill Earthworks associated with the construction of the Compound are balanced.

Code	Description
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
PI	Post Insulator.
LM	Lighting Mast.
CSE	Cable Chair
LS	Lamp

Project: Ballynalacken Windfarm

Drawing Title: Tinnalintan Substation Elevations


Drawing Number: BWF-SS2

Sheet Size: A1

Scale: 1 : 200

Drawn by: Conor Brett

Date produced: 24 February 2025

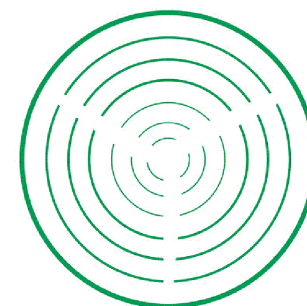

Conor Brett
Ecopower Limited
Zetec House, Purcellstown IDA Business Park
Dublin Road, Kilkenny - R95 WV80

Landline - 056-7750140 (Ext 204)
Mobile - +353 (0)87-6531458

ECOPOWER