


Tower No. 237 marks the termination of the MSA section and the commencement of the CMSA section of the line route. (Refer to Planning Drawing Reference: MT-004-031 for continuation of line)

0 50m 100m 150m 200m

LEGEND

Road		Proposed 400 kV Angle Tower Location
Land Parcel		Proposed 400 kV Intermediate Tower Location
Building		Outer Conductor
Stream / River		Centreline of Proposed Line Route
Townland Boundary		Outer Conductor
Existing Electricity Lines		Forestry
Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
Guarding Location - Temporary Works		Geo - Directory Point
		Marsh

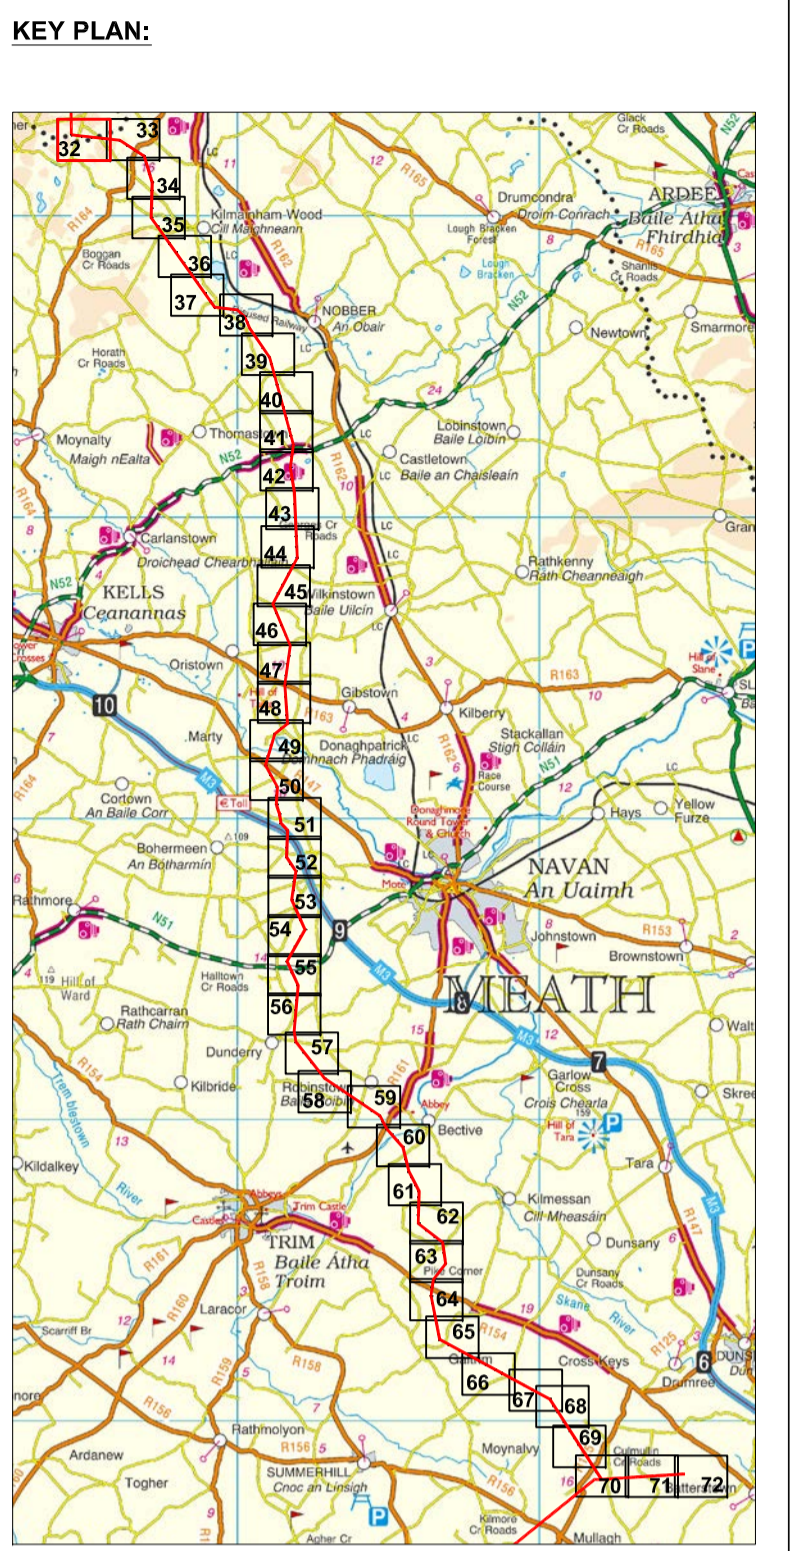

- NOTES:**
1. Transmission lines and towers not to be scaled.
 2. For details of proposed structures see structure description schedule.
 3. Figured dimensions only to be taken from this drawing.
 4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 1945, 2004

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title:

**MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 32 of 72 -**

Scale @ A1: **1:2,500**

Prepared by:	Checked:	Date:
M. Nolan	D. Grehan	December 2014
Project Director:	D. Grehan	
Planning Dwg Ref:	MT-004-032	

TOBIN
Patrick J. Tobin & Co. Ltd.

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

Drawing No.: **6244-2011**

Revision: **B**