


0 50m 100m 150m 200m

LEGEND

Road		Proposed 400 kV Angle Tower Location
Land Parcel		Proposed 400 kV Intermediate Tower Location
Building		Outer Conductor
Stream / River		Centreline of Proposed Line Route
Townland Boundary		Outer Conductor
Existing Electricity Lines		Forestry
Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
Guarding Location - Temporary Works		Geo - Directory Point
		Marsh

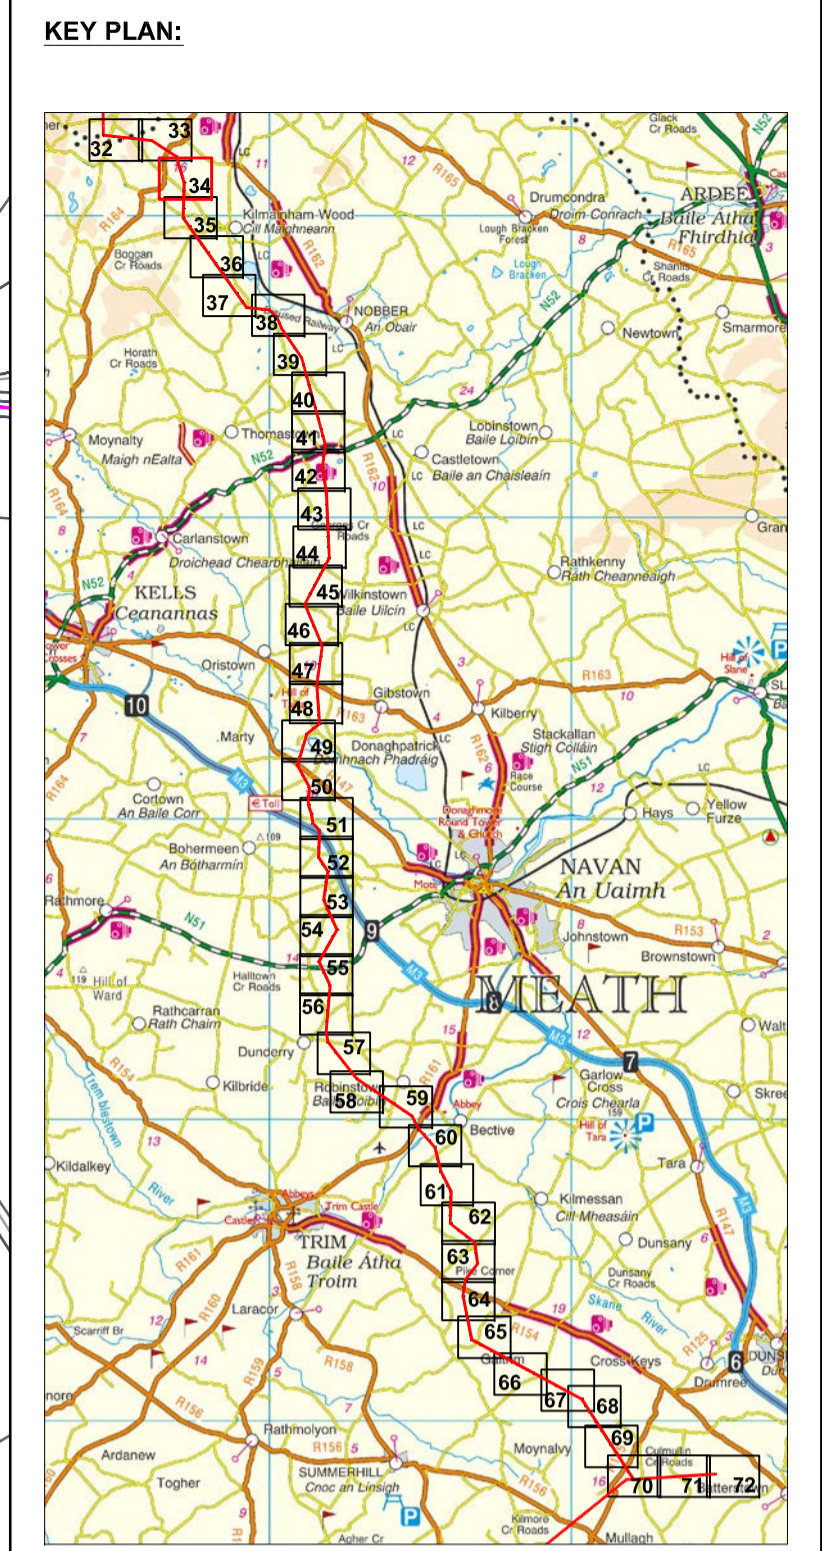

- NOTES:**
- Transmission lines and towers not to be scaled.
 - For details of proposed structures see structure description schedule.
 - Figured dimensions only to be taken from this drawing.
 - Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2005

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project: NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title: MEATH STUDY AREA (MSA) 1:2,500 LINE ROUTE MAP - Sheet 34 of 72 -

Scale @ A1: 1:2,500

Prepared by: M. Nolan	Checked: D. Grehan	Date: December 2014
Project Director: D. Grehan		
Planning Dwg Ref: MT-004-034		

Patrick J. Tobin & Co. Ltd.

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and approved. Except where otherwise stated, all rights are reserved. This document is the property of TOBIN Consulting Engineers and its contents may be reproduced or transmitted in any form and by any means electronic or mechanical, including photocopying and recording, or by any information storage and retrieval system, without permission in writing from TOBIN Consulting Engineers.

Drawing No.: 6244-2013	Revision: B
------------------------	-------------