


0 50m 100m 150m 200m

LEGEND

Road		Proposed 400 kV Angle Tower Location
Land Parcel		Proposed 400 kV Intermediate Tower Location
Building		Outer Conductor
Stream / River		Centreline of Proposed Line Route
Townland Boundary		Outer Conductor
Existing Electricity Lines		Forestry
Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
Guarding Location - Temporary Works		Geo - Directory Point
		Marsh

KEY PLAN:

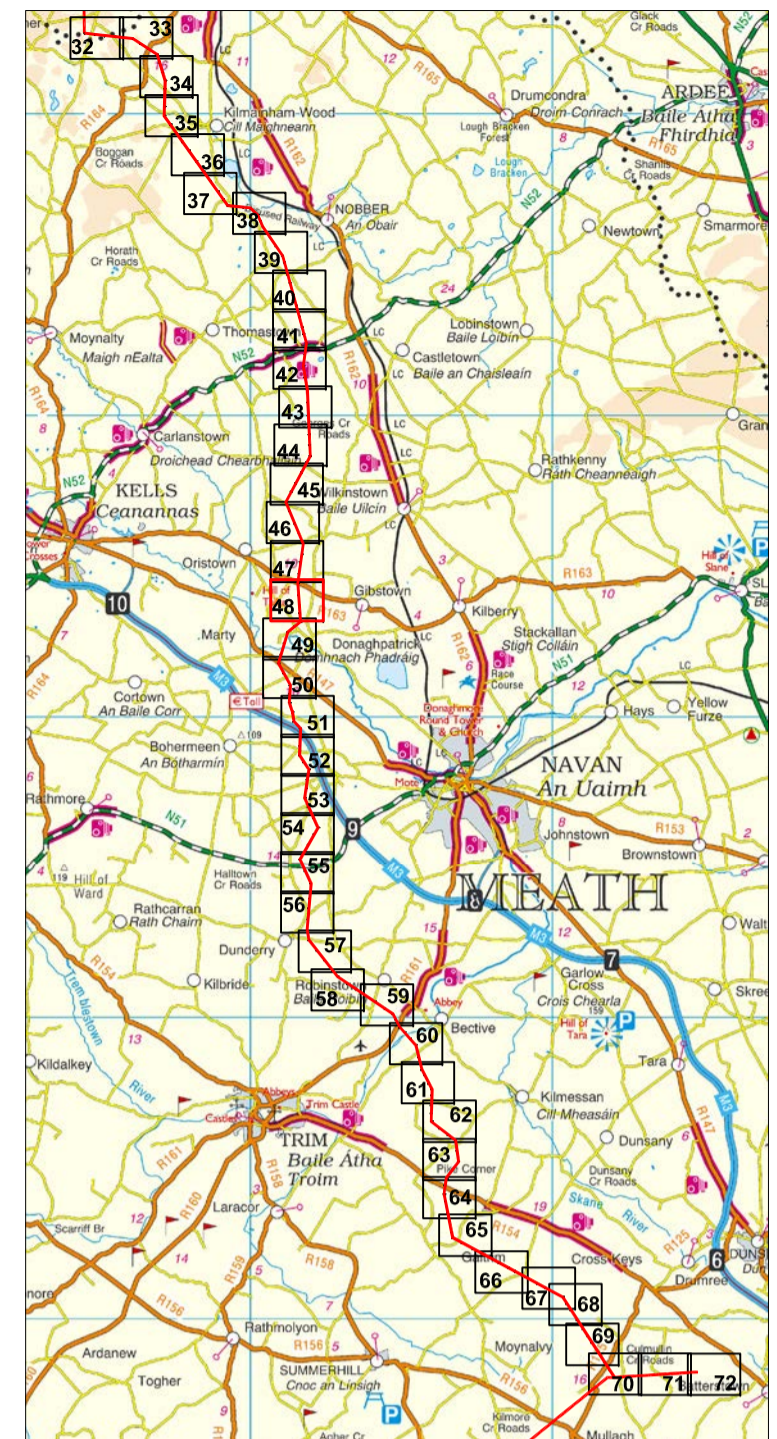

- NOTES:**
- Transmission lines and towers not to be scaled.
 - For details of proposed structures see structure description schedule.
 - Figured dimensions only to be taken from this drawing.
 - Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2312, 2375, 2375-A

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title:

**MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 48 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: M. Nolan Checked: D. Grehan Date: December 2014

Project Director: D. Grehan

Planning Dwg Ref: MT-004-048

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

Drawing No.: **6244-2027**

Revision: **B**