


LEGEND	
	Road
	Land Parcel
	Building
	Stream / River
	Townland Boundary
	Existing Electricity Lines
	Marsh
	Forestry
	Geo - Directory Point
	Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)
	Guarding Location - Temporary Works
	Proposed 400 kV Angle Tower Location
	Proposed 400 kV Intermediate Tower Location
	Existing 400kV Tower Location
	Outer Conductor Line
	Centreline of Proposed Line Route
	Proposed Outer Conductor Line
	Centreline of Existing & Proposed Line Route
	Existing Oldstreet - Woodland 400 kV Line
	Lake
	Existing Oldstreet - Woodland 400 kV Line

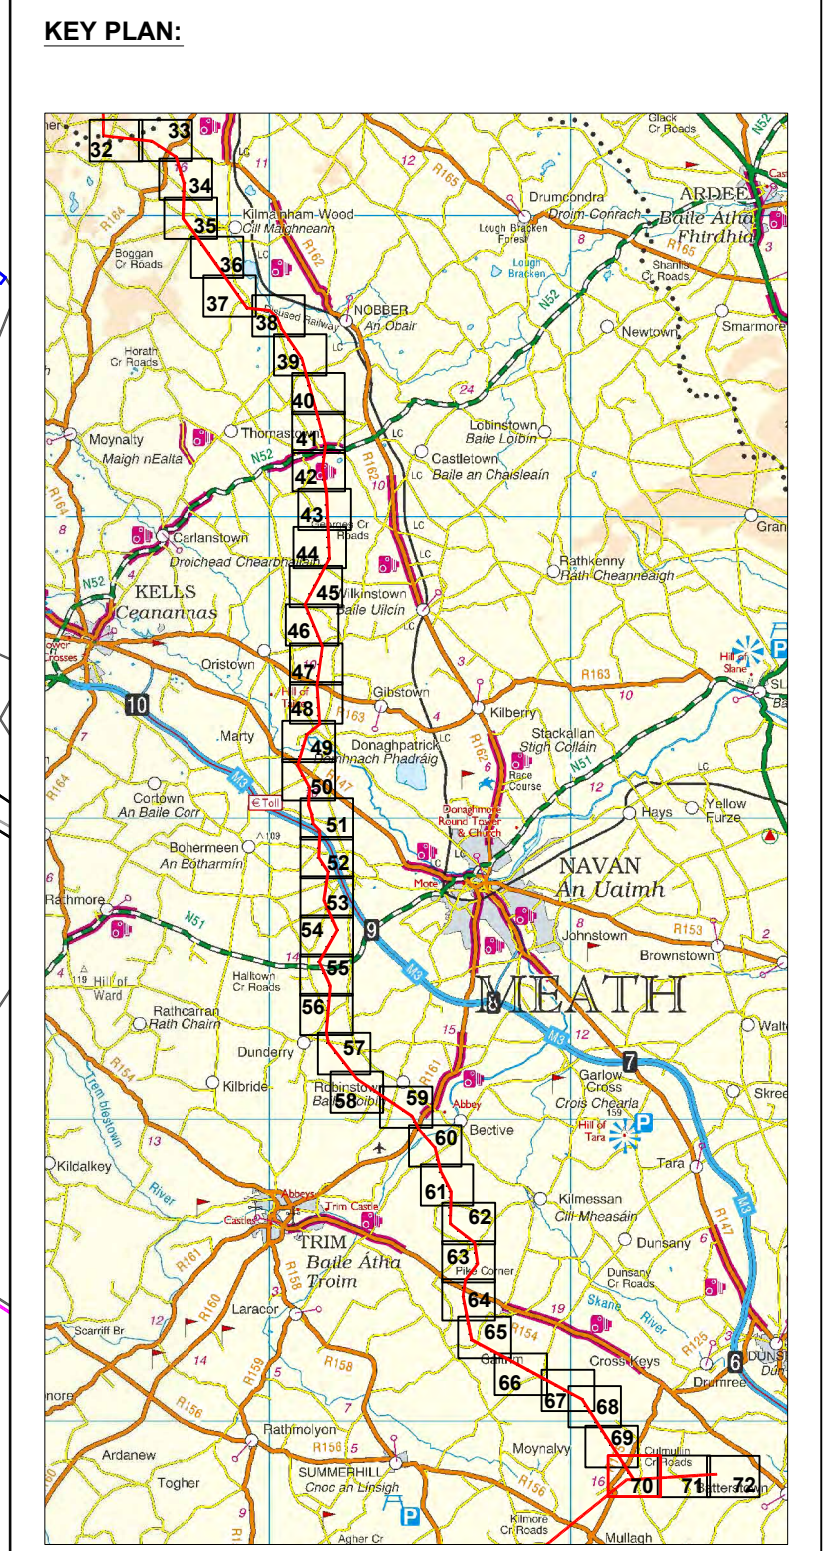

- NOTES:**
1. Transmission lines and towers not to be scaled.
 2. For details of proposed structures see structure description schedule.
 3. Figured dimensions only to be taken from this drawing.
 4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2918, 2919

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project: **NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT**

Title: **MEATH STUDY AREA (MSA) 1:2,500 LINE ROUTE MAP - Sheet 70 of 72 -**

Scale @ A1: **1:2,500**
 Prepared by: M. Nolan Checked: D. Grehan Date: December 2014
 Project Director: D. Grehan
 Planning Dwg Ref: MT-004-070

TOBIN Consulting Engineers,
 Block 10-4, Blanchardstown Corporate Park,
 Dublin 15, Ireland.
 tel: +353-(0)11-8030406
 fax: +353-(0)11-8030409
 e-mail: dublin@tobin.ie
 www.tobin.ie

Drawing No.: **6244-2049** Revision: **B**