


0 50m 100m 150m 200m

LEGEND

	Road		Proposed 400 kV Angle Tower Location
	Land Parcel		Proposed 400 kV Intermediate Tower Location
	Building		Outer Conductor
	Stream / River		Centreline of Proposed Line Route
	Townland Boundary		Outer Conductor
	Existing Electricity Lines		Forestry
	Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
	Guarding Location - Temporary Works		Geo - Directory Point
			Marsh

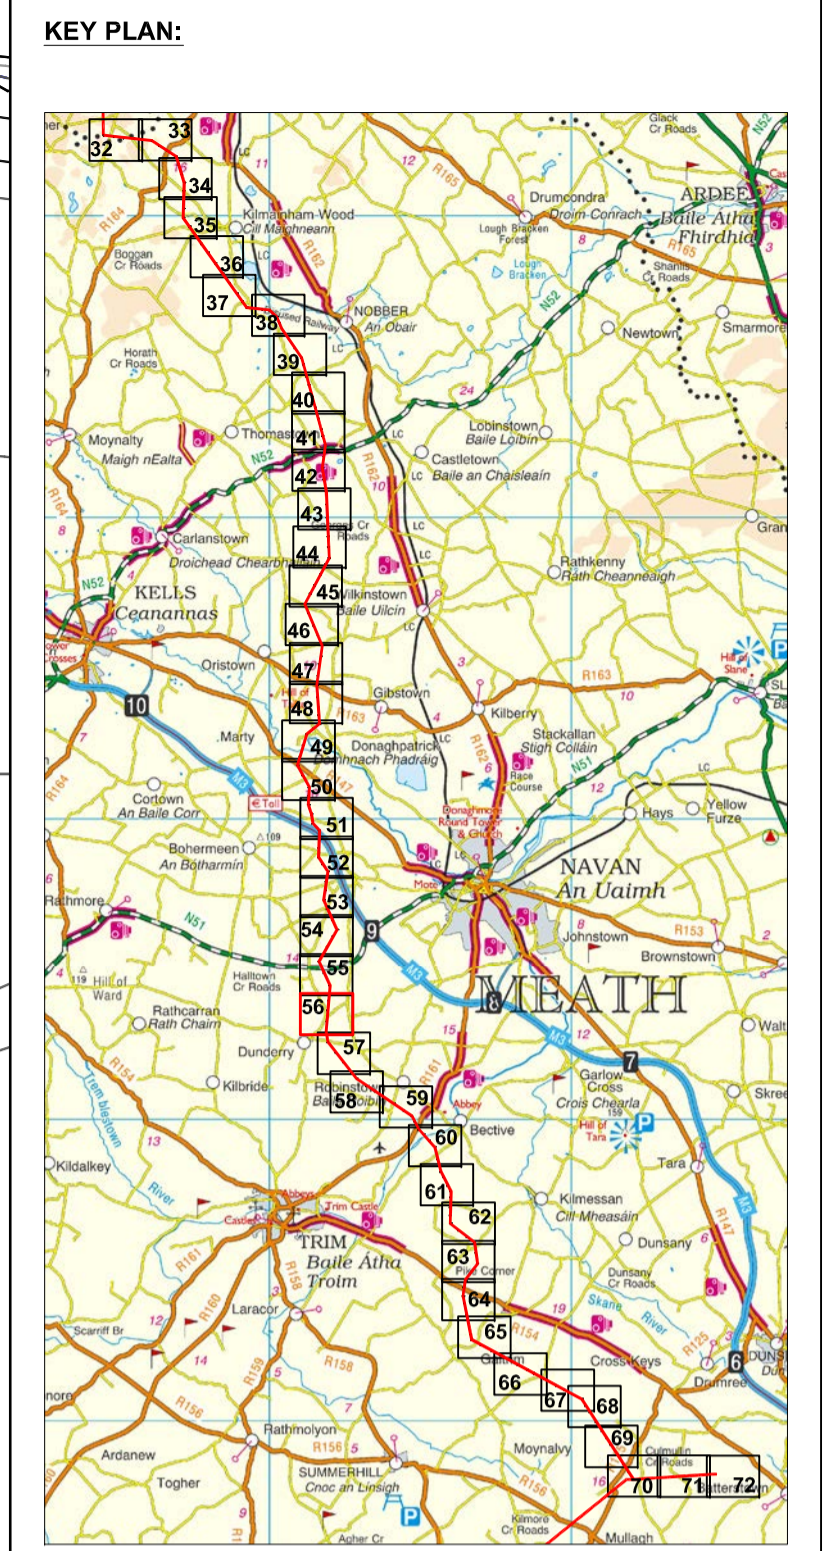

NOTES:

1. Transmission lines and towers not to be scaled.
2. For details of proposed structures see structure description schedule.
3. Figured dimensions only to be taken from this drawing.
4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.

OSI Sheet(s): 2574, 2574-B, 2574-C, 2574-D

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title:

**MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 56 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: M. Nolan Checked: D. Grehan Date: December 2014

Project Director: D. Grehan

Planning Dwg Ref: MT-004-056

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and intended. Each user of this document shall be deemed to have agreed to indemnify and hold TOBIN Consulting Engineers, its copyright holder, its client and its licensors harmless from any and all claims, damages, costs and expenses, including reasonable attorneys' fees, that may be incurred by any third party for any purpose.

Drawing No.: **6244-2035** Revision: **B**