


0 50m 100m 150m 200m

LEGEND

Road		Proposed 400 kV Angle Tower Location
Land Parcel		Proposed 400 kV Intermediate Tower Location
Building		Outer Conductor
Stream / River		Centreline of Proposed Line Route
Townland Boundary		Outer Conductor
Existing Electricity Lines		Forestry
Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
Guarding Location - Temporary Works		Geo - Directory Point
		Marsh

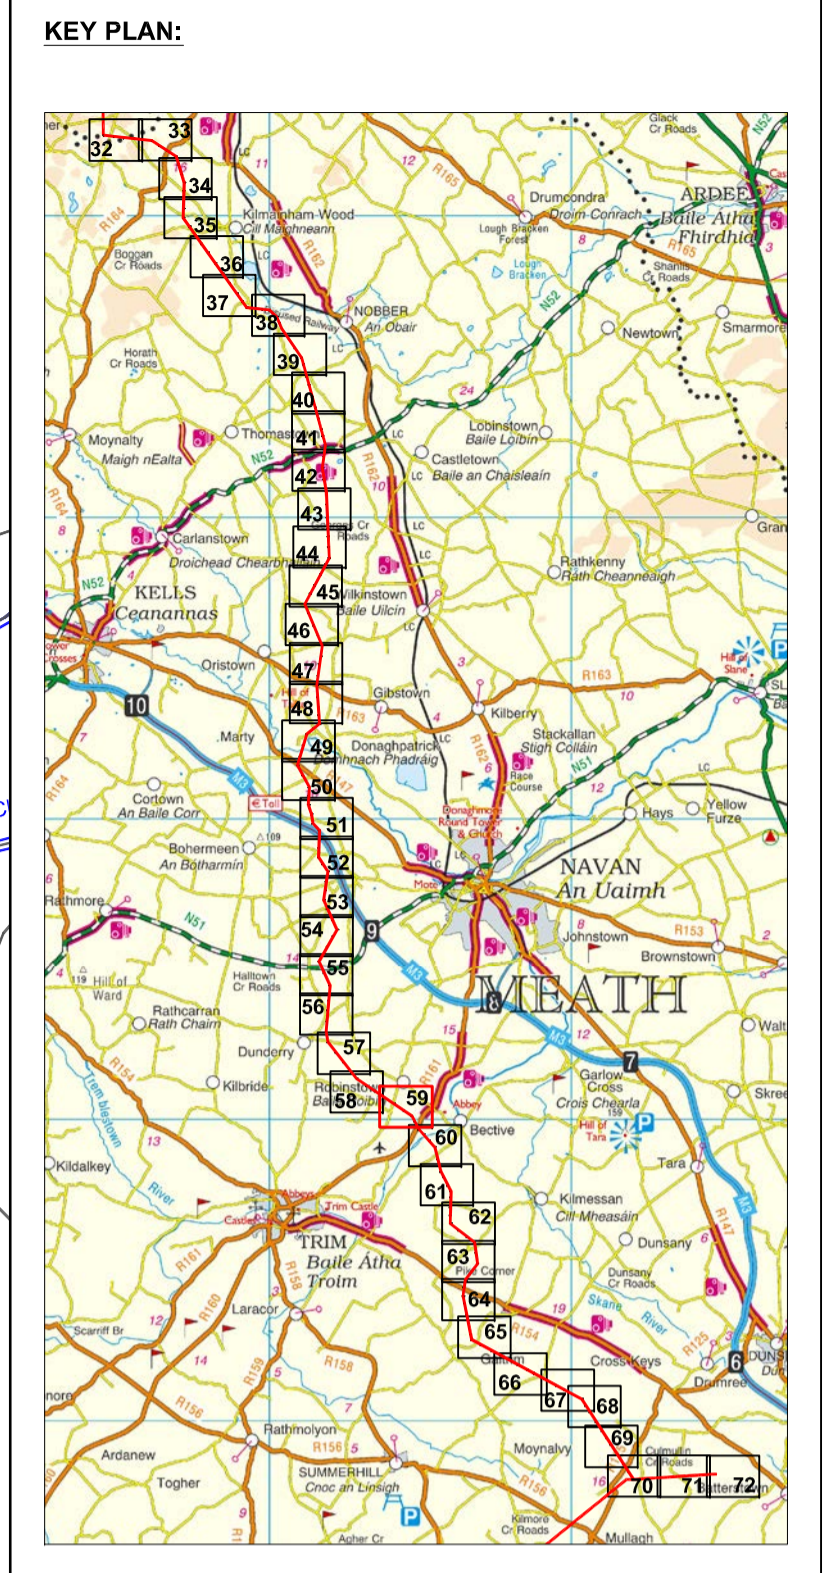

NOTES:

- Transmission lines and towers not to be scaled.
- For details of proposed structures see structure description schedule.
- Figured dimensions only to be taken from this drawing.
- Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.

OSI Sheet(s): 2641-B, 2641-D, 2642-A, 2642-C

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title:

**MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 59 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: **M. Nolan** Checked: **D. Grehan** Date: **December 2014**

Project Director: **D. Grehan**

Planning Dwg Ref: **MT-004-059**

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

Drawing No.: **6244-2038** Revision: **B**