


0 50m 100m 150m 200m

**LEGEND**

	Road		Proposed 400 kV Angle Tower Location
	Land Parcel		Proposed 400 kV Intermediate Tower Location
	Building		Outer Conductor
	Stream / River		Centreline of Proposed Line Route
	Townland Boundary		Outer Conductor
	Existing Electricity Lines		Forestry
	Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
	Guarding Location - Temporary Works		Geo - Directory Point
			Marsh

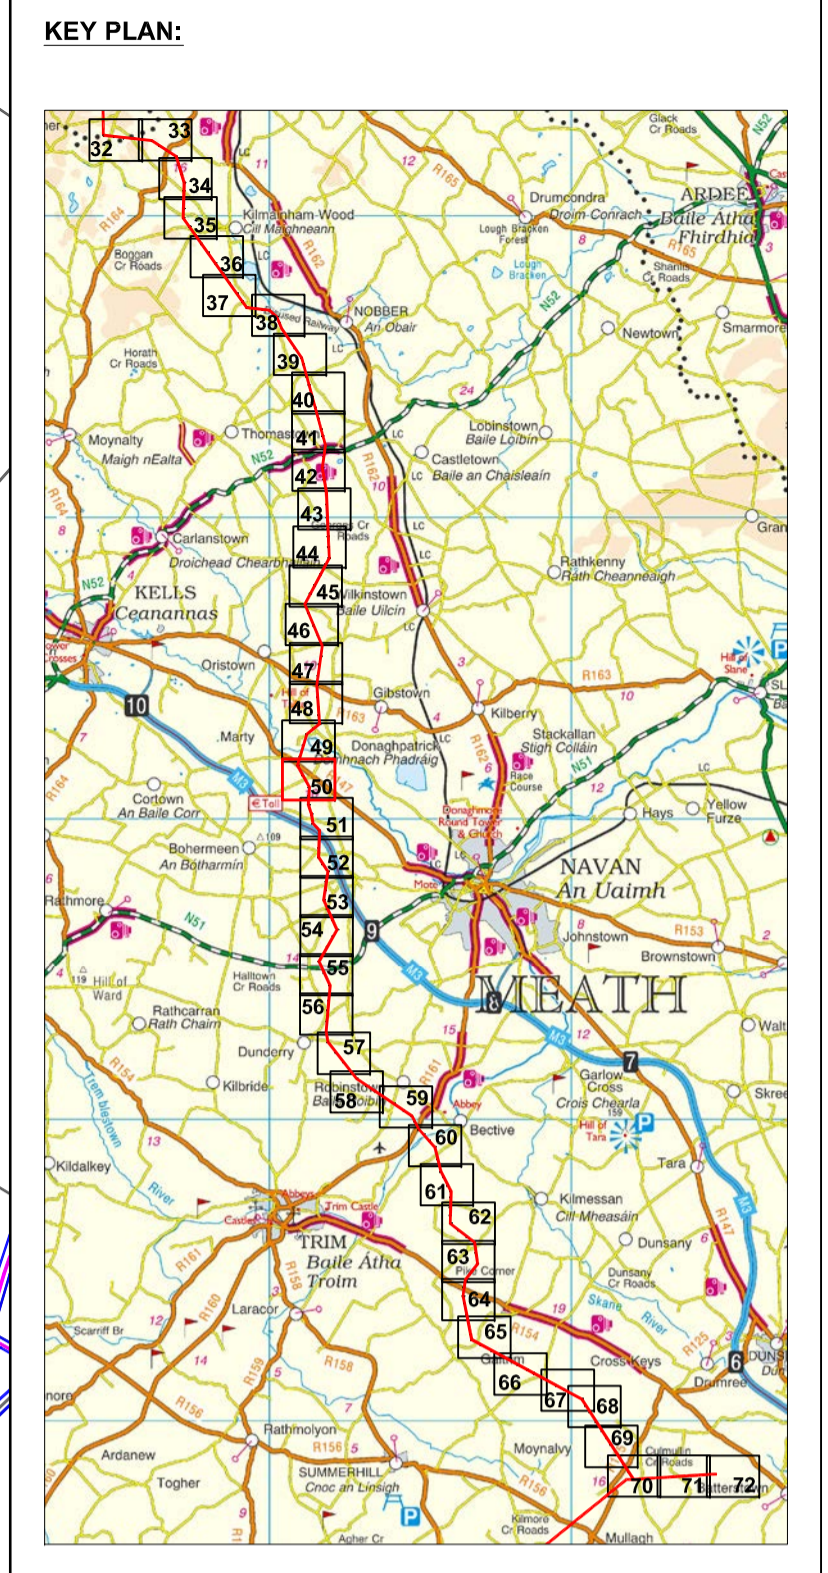

- NOTES:**
1. Transmission lines and towers not to be scaled.
  2. For details of proposed structures see structure description schedule.
  3. Figured dimensions only to be taken from this drawing.
  4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2375, 2375-C, 2437, 2437-B

**DRAFT**

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

**NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT**

Title:

**MEATH STUDY AREA (MSA)  
1:2,500 LINE ROUTE MAP  
- Sheet 50 of 72 -**

Scale @ A1: **1:2,500**

Prepared by:	Checked:	Date:
M. Nolan	D. Grehan	December 2014
Project Director: D. Grehan		
Planning Dwg Ref: MT-004-050		

**TOBIN**  
Patrick J. Tobin & Co. Ltd.

TOBIN Consulting Engineers,  
Block 10-4, Blanchardstown Corporate Park,  
Dublin 15, Ireland.  
tel: +353-(0)1-8030406  
fax: +353-(0)1-8030409  
e-mail: dublin@tobin.ie  
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and provided. Engineers, as copyright holder, do not warrant that this document may be reproduced or transmitted in any form and the document shall not be relied upon by any party for any purpose.

Drawing No.: **6244-2029**

Revision: **B**