

N  
DUNGANNY

RATHNALLY

TRUBLEY


BALLINA or BECTIVE

TRUBLEY

0 50m 100m 150m 200m

**LEGEND**

	Road		Proposed 400 kV Angle Tower Location
	Land Parcel		Proposed 400 kV Intermediate Tower Location
	Building		Outer Conductor
	Stream / River		Centreline of Proposed Line Route
	Townland Boundary		Outer Conductor
	Existing Electricity Lines		Forestry
	Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
	Guarding Location - Temporary Works		Geo - Directory Point
			Marsh

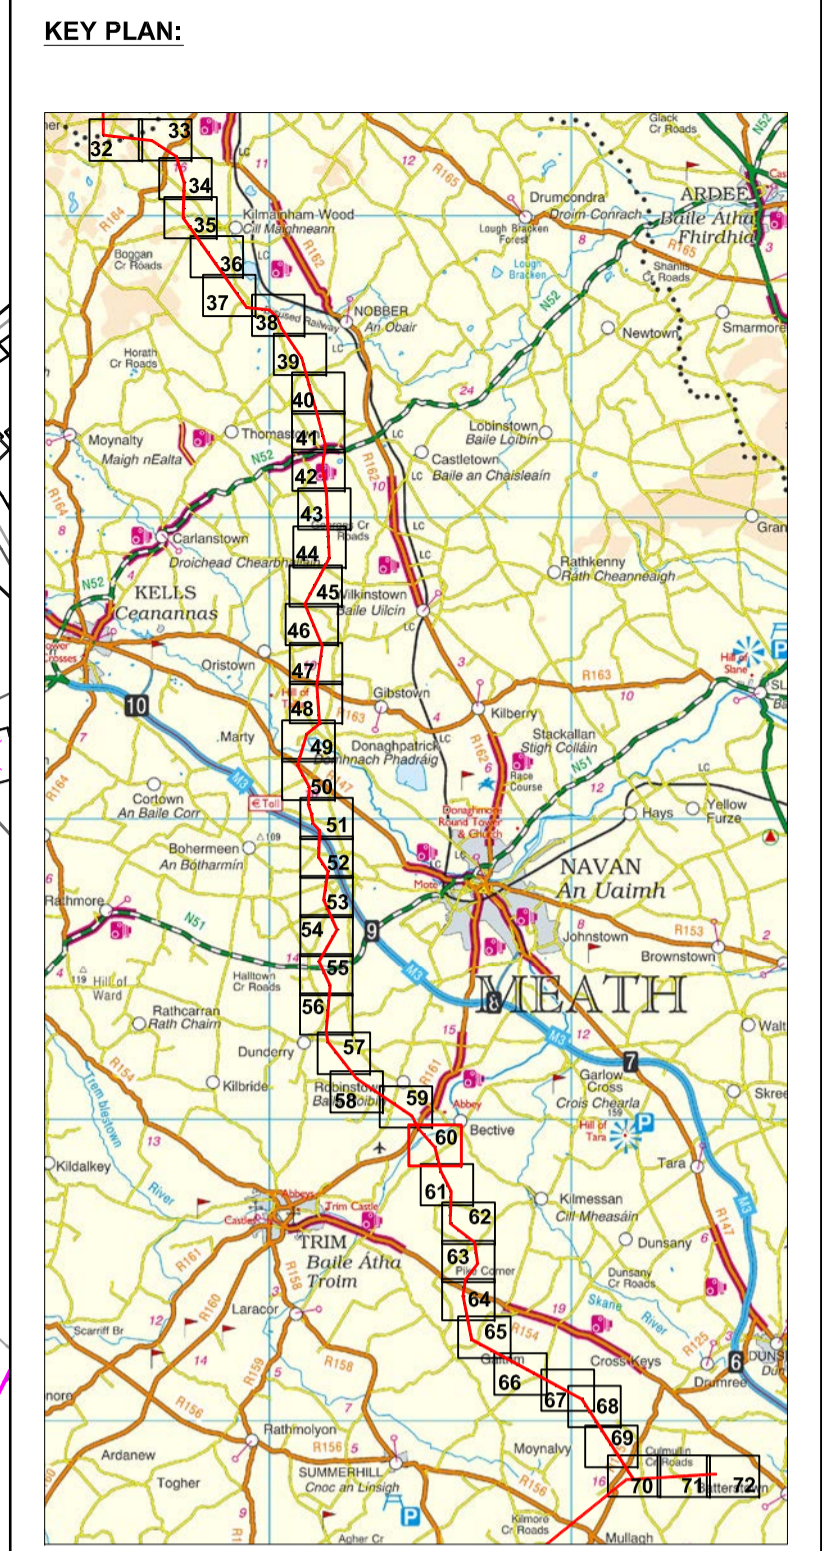

**NOTES:**

- Transmission lines and towers not to be scaled.
- For details of proposed structures see structure description schedule.
- Figured dimensions only to be taken from this drawing.
- Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.

OSI Sheet(s): 2642-C, 2642-D, 2712-A, 2712

**DRAFT**

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

**NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT**

Title:

**MEATH STUDY AREA (MSA)  
1:2,500 LINE ROUTE MAP  
- Sheet 60 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: M. Nolan      Checked: D. Grehan      Date: December 2014

Project Director: D. Grehan

Planning Dwg Ref: MT-004-060

**TOBIN**  
Patrick J. Tobin & Co. Ltd.

TOBIN Consulting Engineers,  
Block 10-4, Blanchardstown Corporate Park,  
Dublin 15, Ireland.  
tel: +353-(0)1-8030406  
fax: +353-(0)1-8030409  
e-mail: dublin@tobin.ie  
www.tobin.ie

Drawing No.: **6244-2039**

Revision: **B**